

LICENSEE EVENT REPORT

CONTROL BLK

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE NAME: ILDRS2 LICENSE NUMBER: 00-000000-00 LICENSE TYPE: 41111 EVENT TYPE: 03

CATEGORY: CON'T REPORT TYPE: L REPORT SOURCE: L DOCKET NUMBER: 050-0237 EVENT DATE: 040976 REPORT DATE: 050776

EVENT DESCRIPTION

02 DURING A REFUELING SURVEILLANCE LEAK TEST (TECH. SPEC. 4.5.K.1.A) ON
03 THE CCSW PUMP VAULT PENETRATIONS, SEVEN OF THE NINE PENETRATIONS FAILED
04 BY EXHIBITING LEAKAGE, WORK REQUESTS WERE INITIATED FOR RESEALING THE
05 PENETRATIONS. UPON COMPLETION OF REPAIRS, THE PENETRATIONS WERE RETESTED AND
06 EXHIBITED ZERO LEAKAGE. THIS IS NOT A REPETITIVE OCCURRENCE. (50-237/1976-23)

SYSTEM CODE: SF CAUSE CODE: E COMPONENT CODE: PENETR PRIME COMPONENT SUPPLIER: A COMPONENT MANUFACTURER: Z999 VIOLATION: Y

CAUSE DESCRIPTION

08 OPERATIONAL VIBRATION APPARENTLY CAUSED THE CAULKING TO CRACK. THE
09 PENETRATIONS WERE RESEALED WITH A PLIABLE SEALER (RTV) WHICH SHOULD
10 PREVENT FUTURE SCAL DEGRADATION.

FACILITY STATUS: H % POWER: 000 OTHER STATUS: NA METHOD OF DISCOVERY: B DISCOVERY DESCRIPTION: NA
 FORM OF ACTIVITY RELEASED: Z CONTENT OF RELEASE: Z AMOUNT OF ACTIVITY: NA LOCATION OF RELEASE: NA

PERSONNEL EXPOSURES

NUMBER: 000 TYPE: Z DESCRIPTION: NA

PERSONNEL INJURIES

NUMBER: 000 DESCRIPTION: NA

OFFSITE CONSEQUENCES

15 NA

LOSS OR DAMAGE TO FACILITY

TYPE: Z DESCRIPTION: NA

PUBLICITY

17 NA

ADDITIONAL FACTORS

18 NA

8303310084 760507
 PDR ADOCK 05000237
 S PDR

NAME: S. C. JERZ PHONE: EXT. 265



Commonwealth Edison

Dresden Nuclear Power Station

R.R. #


Morris, Illinois 60450

Telephone 815/942-2920


BBS Ltr. #352-76

May 7, 1976

Mr. James G. Keppler, Regional Director
Directorate of Regulatory Operations - Region III
U. S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

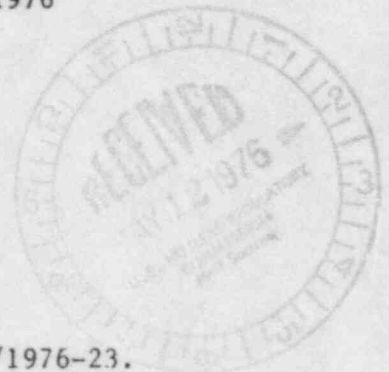

Enclosed please find Reportable Occurrence number 50-237/1976-23.
This report is being submitted to your office in accordance with the
Dresden Nuclear Power Station Technical Specifications, Section 6.6.B.


B. B. Stephenson
Station Superintendent
Dresden Nuclear Power Station

BBS:smp

Enclosure

cc: Director of Inspection & Enforcement
Director of Management Information & Program Control
File/NRC

4790
III
COPY SENT REGION