

# LICENSEE EVENT REPORT

CONTROL BLO

1

6

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE  
NAME

LICENSE NUMBER

LICENSE  
TYPE

EVENT  
TYPE

01 I L D R S 2 00-000000-00 411111 01

CATEGORY

REPORT  
TYPE

REPORT  
SOURCE

DOCKET NUMBER

EVENT DATE

REPORT DATE

01 CON'T 57 58 59 60 61 68 69 74 75 80

## EVENT DESCRIPTION

02 DURING THE QUARTERLY TIMING TEST, HPCI STEAM SUPPLY VALVE 2-2301-4  
03 WAS CLOSED, THEN FAILED TO REOPEN. ELECTRICIANS CONNECTED A VOLTMETER  
04 AT THE VALVE BREAKER, AT WHICH TIME THE VALVE OPENED. THE VALVE WAS  
05 CYCLED THREE TIMES, FUNCTIONING PROPERLY EACH TIME. ADS WAS AVAIL-  
06 ABLE AND OPERABLE. UNIT-2 WAS SHUT DOWN THE FOLLOWING DAY FOR  
(SEE ATTACHED SHEET)

SYSTEM  
CODE

CAUSE  
CODE

COMPONENT CODE

PRIME  
COMPONENT  
SUPPLIER

COMPONENT  
MANUFACTURER

VIOLATION

07 S F E C K T B R K N G O 8 O N

## CAUSE DESCRIPTION

08 THE FAILURE WAS ATTRIBUTED TO DIRTY CONTACTS IN THE BREAKER  
09 SUPPLYING VALVE 2301-4. SHOULD ANOTHER CAUSE OF FAILURE BE  
10 IDENTIFIED UPON INSPECTION OF THE SUPPLY BREAKER, AN  
(SEE ATTACHED SHEET)

FACILITY  
STATUS

% POWER

OTHER STATUS

METHOD OF  
DISCOVERY

DISCOVERY DESCRIPTION

11 E 089 NA B NA

FORM OF  
ACTIVITY  
RELEASED

CONTENT  
OF RELEASE

AMOUNT OF ACTIVITY

LOCATION OF RELEASE

12 Z Z NA NA

## PERSONNEL EXPOSURES

NUMBER

TYPE

DESCRIPTION

13 000 Z NA

## PERSONNEL INJURIES

NUMBER

DESCRIPTION

14 000 NA

## OFFSITE CONSEQUENCES

15 NA

## LOSS OR DAMAGE TO FACILITY

TYPE

DESCRIPTION

16 Z NA

## PUBLICITY

17 NA

## ADDITIONAL FACTORS

18 NA

8303310372 760324  
PDR ADOCK 05000237  
S PDR

19

NAME: K. D. LEITZELL PHONE: EXT. 265

EVENT DESCRIPTION (continued)

a refueling outage.

The breaker to valve 2301-4 will be inspected and its contacts cleaned during the Unit-2 outage currently underway. This is the first reported failure of this type on valve 2301-4. (050-237/1976-9)

CAUSE DESCRIPTION (continued)


update report will be submitted. The breaker is a General Electric 480V AC circuit breaker, model no. TEF136M1025.



Commonwealth Edison  
Dresden Nuclear Power Station  
R.R. #1  
Morris, Illinois 60450  
Telephone 815/942-2920

BBS Ltr. #253-76

March 24, 1976

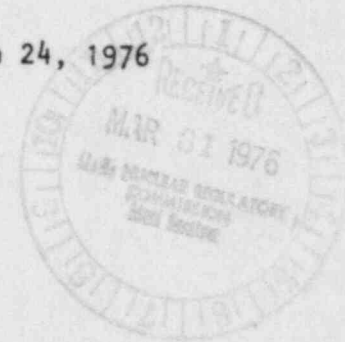

Mr. James G. Keppler, Regional Director  
Directorate of Regulatory Operations - Region III  
U. S. Nuclear Regulatory Commission  
799 Roosevelt Road  
Glen Ellyn, Illinois 60137

Enclosed please find Reportable Occurrence number 50-237/1976-9.  
This report is being submitted to your office in accordance with  
the Dresden Nuclear Power Station Technical Specifications, Section 6.6.B.

B. B. Stephenson  
Station Superintendent  
Dresden Nuclear Power Station

BBS:smp

Enclosure

cc: Director of Inspection & Enforcement  
Director of Management Information & Program Control  
File/NRC