

NSP

NORTHERN STATES POWER COMPANY

MINNEAPOLIS, MINNESOTA 55401

File

February 27, 1976

Mr. D. L. Ziemann, Chief
Operating Reactors Branch #2
Division of Reactor Licensing
U.S. Nuclear Regulatory Commission
Washington, DC 20555



Dear Mr. Ziemann:

MONTICELLO NUCLEAR GENERATING PLANT
Docket No. 50-263 License No. DPR-22

Response to 2/4/76 Questions on MSL Setpoints and MCPR

Your February 4, 1976 letter requested additional information on our December 1, 1975 request for changes to the Technical Specifications. Questions 1 and 2 deal with the proposed reduction of the main steamline low pressure setpoint which is a generic matter. Questions 3 and 4 deal with proposed changes to Monticello minimum critical power ratio (MCPR) limitations. The latter is a more urgent concern in that a delay in implementing these changes needlessly threatens full operating capacity of the plant. Should your review of the main steamline low pressure setpoint change require more time than that of the new MCPR limits, we request that the two issues be separated and the MCPR changes be issued as soon as possible. The questions and their respective answers are as follows:

NRC Request # 1

For the spectrum of steamline breaks downstream of the main steamline isolation valves (MSIV) provide the following:

- (a) An analysis of the change in the radiological consequences resulting from the reduction in the setpoint for MSIV closure on low steamline pressure from 850 psig to 825 psig. So that we may perform an independent check, also provide the difference in the amount of steam and liquid released as a result of the lower setpoint.
- (b) A discussion of the effects of the setpoint reduction on peak cladding temperature and MCPR.

Response # 1

The accident postulated does not rely on the main steamline low pressure setpoint to initiate an isolation and scram. The main steamline flow

NORTHERN STATES POWER COMPANY

D. L. Ziemann

-2-

February 27, 1976

sensors provide such protection. A September 17, 1975 letter from Mr. L. O. Mayer (NSP) to Mr. R. S. Boyd (USNRC) entitled, "Main Steam Line Flow Trip Setting" analyzes the spectrum of break sizes and shows the radiological consequences to be well within 10 CFR Part 100 limits. The proposed setpoint change in no way affects the reported radiological consequences of accidents involving steamline breaks.

The effects of the setpoint reduction on peak cladding temperature and MCPR are discussed in response to question 2 below.

NRC Request # 2

In the analysis of the failure of the turbine pressure regulator presented in your SAR, the main steamline isolation valves are assumed to start closing (initiating a reactor scram) when the low steamline pressure is reached.

- (a) Identify other transients that assume MSIV closure and reactor scram are initiated by the low steamline pressure signal.
- (b) Provide a reanalysis of the failure of the turbine pressure regulator transient, and other transients identified in (a), assuming MSIV closure and reactor scram at the proposed setpoint of 825 psig.

Response # 2

The main steamline low pressure sensors were installed to provide reactor isolation for the abnormal operational transient associated with failure of the initial turbine pressure regulator in the open direction. No credit is taken for the sensors in any of the other analyzed abnormal operational transients or postulated accidents.

The present isolation setpoint, 850 psi, was selected quite arbitrarily. The transient analysis presented in the FSAR shows the turbine pressure regulator failure to be a very insignificant event. Being familiar with the progression of minor reactor dynamic perturbations, one can conclude with confidence that there would be no significant changes if the isolation setpoint were at 825 psi. The initial intent of our submittal was to support the change qualitatively without the plant-specific analysis so as to avoid taxing industry expertise with trivial calculations. Since you have requested such an analysis, we would like to reference a bounding analysis done for the Hatch I unit, Docket Number 50-321, submitted October 9, 1975 by Mr. Chas Whitmer of Georgia Power Company. The Hatch analysis shows that a main steamline low pressure setpoint change from 880 to 825 psi involved no significant changes in the transient results. The increase in pressure

NORTHERN STATES POWER COMPANY

D. L. Ziemann

-3-

February 27, 1976

along with a flow decrease results in essentially no change in MCPR. Because of the similarities between Hatch and Monticello, and the fact that Monticello is requesting a smaller setpoint change (850 to 825 psi) than analyzed for Hatch, the Monticello transient results are expected to be even less significant. Being such a mild transient, the peak cladding temperature is of less concern than that of bounding transients such as a turbine trip without bypass which is routinely analyzed. Also, the parameters which affect cladding temperature might be studied from the Monticello FSAR, Figure 14-5-7. Failure of the initial pressure regulator in the open direction decreases pressure which causes greater moderator voiding, resulting in a rapid decrease in neutron flux which occurs essentially simultaneously with a scram. During this time core flow gradually decreases to approximately half of its initial condition. The removal of the heat source with continuous cooling results in a reduction of cladding temperature throughout the transient.

NRC Request # 3

Were MCPR values of 1.38 and 1.29 for 8x8 and 7x7 fuel used as the initial thermal conditions for establishing the worst case for rod withdrawal error? If so, what is the rod block setting and do the affected fuel bundles stay above a MCPR value of 1.06?

Response # 3

The rod withdrawal error was analyzed using the assumptions discussed in topical report NEDO-20360, "GE/BWR Generic Reload Licensing Application for 8x8 Fuel", Revision 1, Supplement 2, May, 1975. One of these assumptions is that the maximum worth rod is fully inserted and adjacent rods are withdrawn in a manner which will allow full design reactor power with operating limits attained near the inserted rod. In the case of the Monticello Reload-4 analysis, the fuel was assumed operating at the MCPR limits of 1.38 for 8x8 fuel and 1.29 for 7x7 fuel. The rod block monitor (RBM) setpoint was assumed to be 108%. It was found that even if the operator ignores all alarms during the course of this transient, the RBM will stop rod withdrawal while the critical power ratio (CPR) is still greater than the 1.06 MCPR safety limit.

NRC Request # 4

Provide the scram reactivity curve for EOC5.

NORTHERN STATES POWER COMPANY

D. L. Ziemann


-4-

February 27, 1976

Response # 4

The attached figure shows the scram reactivity used in the Cycle 5 analyses. This is conservatively derated to 80% of the expected value.


Yours very truly,



L. O. Mayer, PE
Manager, Nuclear Support Services

LOM/MHV/deb

cc: J. G. Keppler
G. Charnoff
MPCA
Attn: J. W. Ferman

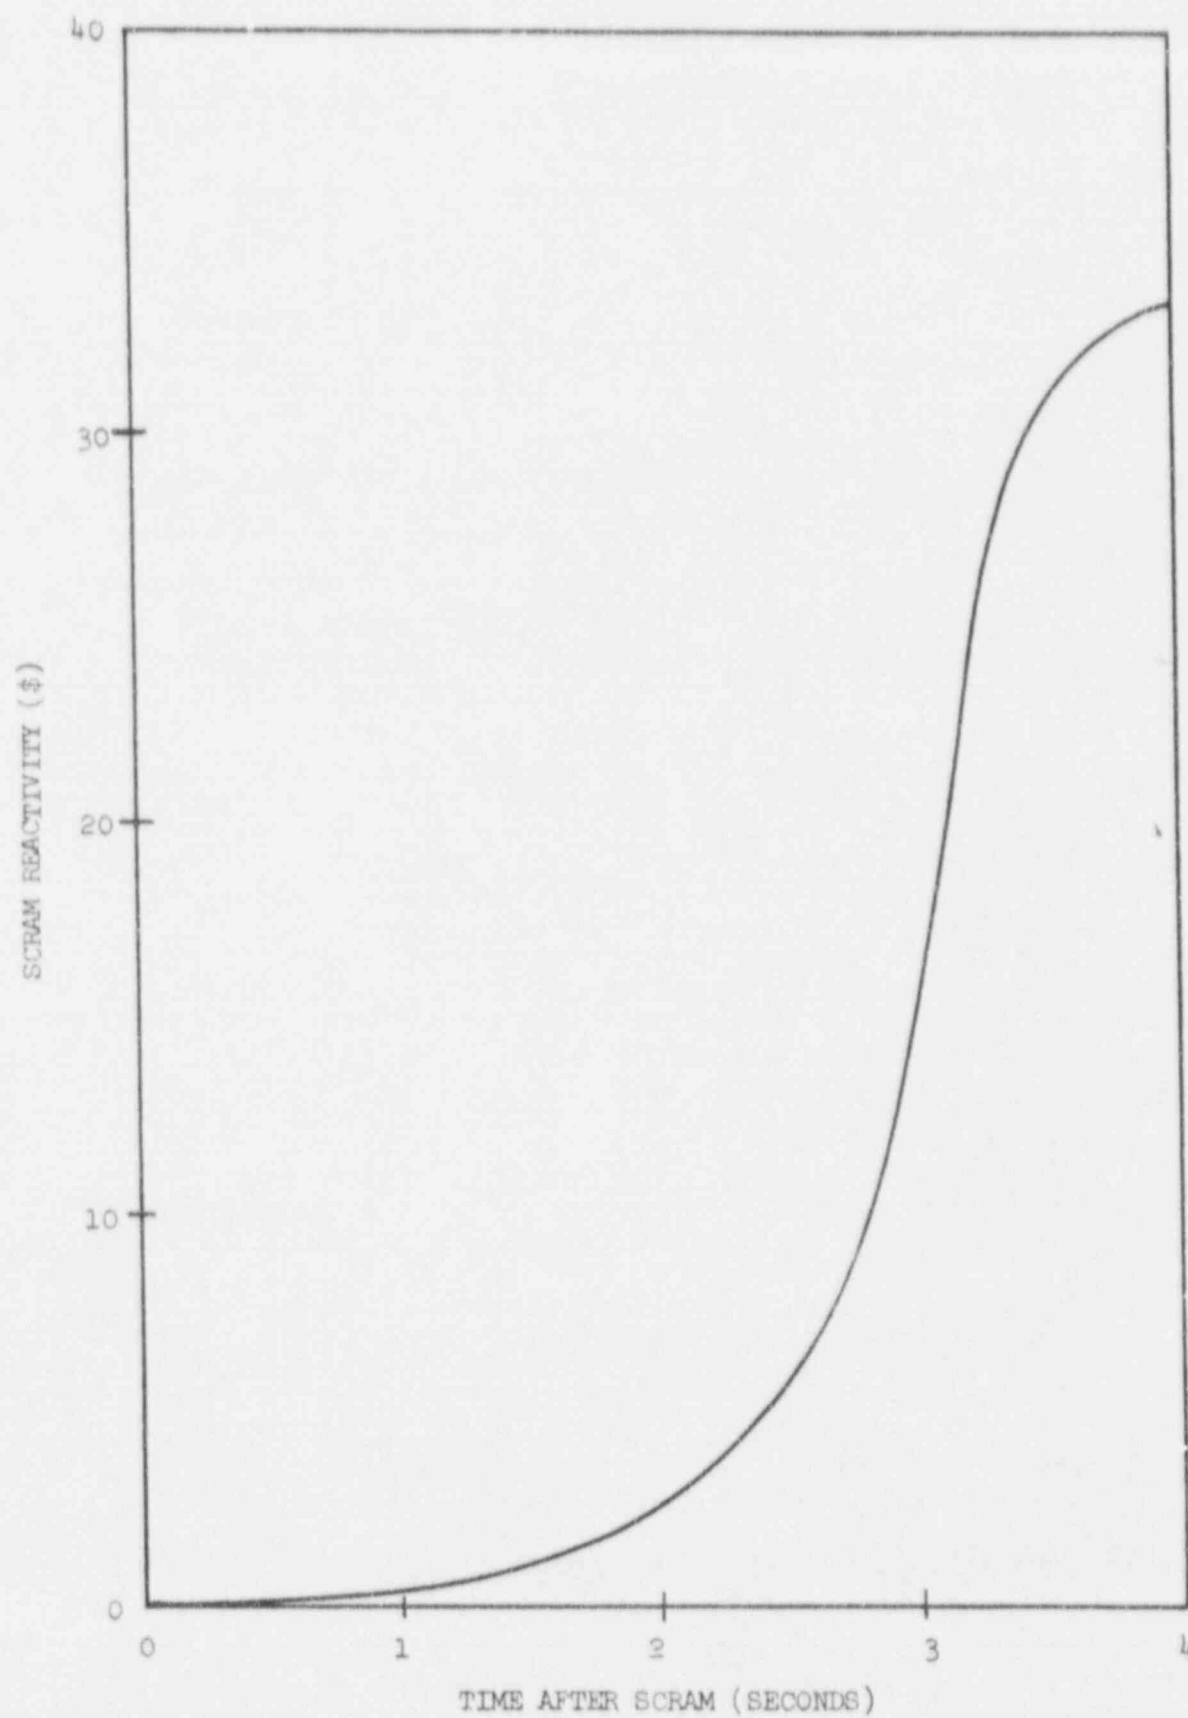

SCRAM REACTIVITY FOR MONTICELLO CYCLE 5

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER

TO: MR D L ZIEMANN

FROM: NORTHERN STATES POWER CO
MINNEAPOLIS, MINN
L O MAYERDATE OF DOCUMENT
-27-76 2-27-76DATE RECEIVED
3-1-76☐ LETTER☐ NOTORIZED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED

☒ COPY☒ UNCLASSIFIED

DESCRIPTION

ENCLOSURE

LTR, RE OUR 2-4-76 LTR. L FURN RESPONSES
TO QUESTIONS ON MSL SETPOINTS AND MCPR W/
ATCH DRAWING.

PLANT NAME: Monticello

SAFETY

FOR ACTION/INFORMATION

ENVIRO

3-4-76 rkb

ASSIGNED AD :

✓ BRANCH CHIEF : (6) Ziemann

PROJECT MANAGER:

✓ LIC. ASST. : Diggs

ASSIGNED AD :

BRANCH CHIEF :

PROJECT MANAGER :

LIC. ASST. :

INTERNAL DISTRIBUTION

✓ REG FILE	SYSTEMS SAFETY	PLANT SYSTEMS	ENVIRO TECH
✓ NRC PDR	HEINEMAN	TEDESCO	ERNST
✓ I & E (2)	SCHROEDER	BENAROYA	BALLARD
✓ OELD		LAINAS	SPANGLER
GOSSICK & STAFF	ENGINEERING	IPPOLITO	
MIPC	MACCARY		SITE TECH
CASE	KNIGHT	OPERATING REACTORS	GAMMILL
HANAUER	SIHWEIL	STELLO	STEPP
HARLESS	PAWLICKI		HULMAN
		OPERATING TECH	
PROJECT MANAGEMENT	REACTOR SAFETY	✓ EISENHUT (LTR)	SITE ANALYSIS
BOYD	ROSS	✓ SHAO	VOLLMER
P. COLLINS	NOVAK	✓ BAER	BUNCH
HOUSTON	ROSZTOCZY	✓ SCHWENCER	J. COLLINS
PETERSON	CHECK	✓ GRIMES	KREGER
MELTZ			
HELTEMES	AT & I	SITE SAFETY & ENVIRO	
SKOVHOLT	SALTZMAN	ANALYSIS	
	RUTBERG	DENTON & MULIER	

EXTERNAL DISTRIBUTION

CONTROL NUMBER

✓ LPDR:MINNEAPOLIS, MN	NATL LAB	BROOKHAVEN NATL LAB
✓ TIC	REG. V-IE	ULRIKSON(ORNL)
✓ NSIC	LA PDR	
ASLB	CONSULTANTS	
ACRS /6 HOLDING/SENT		

1923