




KANSAS GAS AND ELECTRIC COMPANY

GLENN L. KOESTER
VICE PRESIDENT - NUCLEAR

May 23, 1984

Mr. E.H. Johnson, Acting Chief
Reactor Project Branch 2
U.S. Nuclear Regulatory Commission
Region IV
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

KMLNRC 84-078
Re: Docket No. STN 50-482
Subj: Interim 10CFR50.55(e) Report - Barton
752 Transmitters

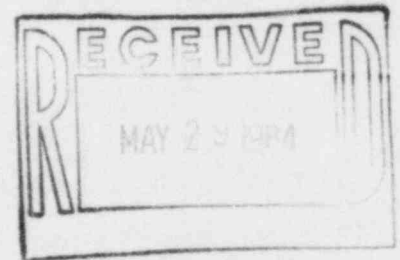

Dear Mr. Johnson:

This letter provides an interim report on a potential 10CFR50.55(e) concerning internal shorts of Barton 752 Transmitters. This matter was initially reported by Mr. H.K. Chernoff of Kansas Gas and Electric Company (KG&E) to Mr. William Johnson of the Nuclear Regulatory Commission, Region IV, on April 24, 1984.

Three ITT-Barton 752 Transmitters were found to be short circuiting internally. Initial investigation showed that lock washers used on the mounting screws for the sensor assembly were apparently making electrical contact with the Transmitter Circuit Board Assembly. This connection was short circuiting the transmitters and rendering them inoperable. KG&E and Westinghouse are pursuing a solution to this matter with ITT - Barton. Westinghouse Field Deficiency Reports (FDRs) and a KG&E Startup Field Report (SPR) have been written to document and resolve the existing condition.

The status of this potential 10CFR50.55(e) will be carried on the monthly status update as file 53564-K135. The Final Report or any significant new information will be submitted by separate correspondence. In the interim, please direct any questions to me or to Mr. Otto Maynard of my staff.

Yours very truly,

8406050263 840523
PDR ADOCK 05000482
S PDR

Glenn L. Koester

GLK:bb
xc: RCDeYoung
HBundy
PO'Connor

IE-27

1/0