

Arizona Public Service Company

June 6, 1984
ANPP-29681-TDS/TRB

U. S. Nuclear Regulatory Commission
Region V
Creekside Oaks Office Park
1450 Maria Lane - Suite 210
Walnut Creek, CA 94596-5368

Attention: Mr. T. W. Bishop, Director
Division of Resident
Reactor Projects and Engineering Programs

Subject: Interim Report - DER 84-31
A 50.55(e) Potentially Reportable Deficiency Relating to
Unsealed Piping Penetrations In The MSSS
File: 84-019-026; D.4.33.2


Reference: Telephone Conversation between P. Narbut and T. Bradish on
May 17, 1984

Dear Sir:

The NRC was notified of a potentially reportable deficiency in the referenced telephone conversation. At that time, it was estimated that a determination of reportability would be made within thirty (30) days.

Due to the extensive investigation and evaluation required, an Interim Report is attached. It is now expected that this information will be finalized by August 17, 1984, at which time a complete report will be submitted.

Very truly yours,

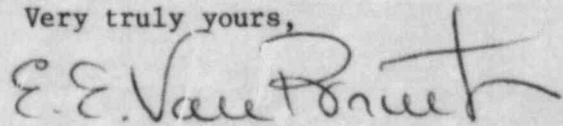

E. E. Van Brunt, Jr.
APS Vice President
Nuclear Production
ANPP Project Director

EEVB/TRB:ru
Attachment

cc: See Page Two

IE-27

Mr. T. W. Bishop
DER 84-31
Page Two

cc: Richard DeYoung, Director
Office of Inspection and Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

T. G. Woods, Jr.
D. B. Karner
W. E. Ide
D. B. Fasnacht
A. C. Rogers
L. A. Souza
B. S. Kaplan
D. E. Fowler
T. D. Shriver
C. N. Russo
J. Vorees
J. R. Bynum
J. M. Allen
J. A. Brand
R. C. Gehr
W. J. Stubblefield
W. G. Bingham
R. L. Patterson
R. W. Welcher
H. D. Foster
D. R. Hawkinson
L. E. Vorderbrueggen
G. A. Fiorelli
S. R. Frost
J. Self
D. Canady

Records Center
Institute of Nuclear Power Operations
1100 Circle 75 Parkway, Suite 1500
Atlanta, GA 30339

INTERIM REPORT - DER 84-31
POTENTIAL REPORTABLE DEFICIENCY
ARIZONA PUBLIC SERVICE COMPANY (APS)
PVNGS UNIT 1, 2, & 3

I. Potential Problem

The Main Steam Support Structure (System ZM) Detailed Design Criteria, paragraph 1.5.2, states: "The portion of the structure below elevation 100 feet - 0 inches shall be designed to be watertight both from external sources of water and internal sources above elevation 100 feet - 0 inches." Contrary to this criteria, floor penetrations for piping in the Main Steam Support Structure (MSSS) floor slab at elevation 100 feet are not sealed. The penetration seal schedule for the MSSS, drawing 13-A-ZYD-175, Rev. 1, specifically indicates "no seal required" for penetrations 1 through 13 which are detailed on the MSSS floor insert and penetration drawing 13-A-ZYD-485, Rev. C.

II. Approach To and Status of Proposed Resolution

Bechtel Engineering is currently studying this problem to determine reportability and technical justification for corrective action.

III. Projected Completion of Corrective Action and Submittal of the Final Report

Evaluation of this condition and submittal of the Final Report is forecast to be completed by August 17, 1984.