




KANSAS GAS AND ELECTRIC COMPANY

GLENN L. KOESTER
VICE PRESIDENT - NUCLEAR

September 21, 1984

Mr. D.R. Hunter, Chief
Reactor Project Branch 2
U.S. Nuclear Regulatory Commission
Region IV
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

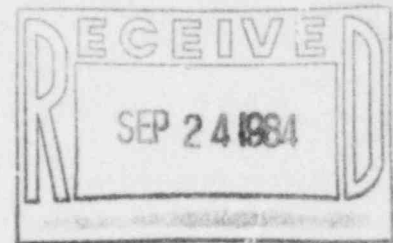

KMLNRC 84-160
Re: Docket No. STN 50-482
Ref: Interim Report KMLNRC 84-071 dated 4/26/84
from GLKoester, KG&E, to EHJohnson, NRC
Subj: Potential 10CFR50.55(e) Final Report -
Seismic Positioner Plates on DS-416 Breakers

Dear Mr. Hunter:

This letter provides the final report on a potential 10CFR50.55(e) concerning seismic positioner plates on Westinghouse DS-416 reactor trip breakers supplied to Wolf Creek Generating Station. This matter was initially reported to Mr. William Johnson of the Nuclear Regulatory Commission, Region IV, by Mr. O.L. Maynard of Kansas Gas and Electric Company (KG&E) on March 27, 1984.

During a field inspection of the four DS-416 reactor trip breakers, it was observed that the required seismic positioner plates had not been installed on these breakers. The omission of the seismic positioner plates could possibly have limited the ability of the reactor trip breaker assemblies to perform their function during a seismic event. In order to alleviate this concern, seismic positioner plates were provided by the breaker manufacturer and installed in the reactor trip breaker assemblies.

The aforementioned corrective action has been completed. If you have any questions concerning this matter, please contact me or Mr. Otto Maynard of my staff.

Yours very truly,

8410110231 840921
PDR ADOCK 05000482
S PDR

GLK:bb
xc: RCDeYoung
PO'Connor
HBundy

IE-27
1/0