



Commonwealth Edison

One First National Plaza, Chicago, Illinois
Address Reply to: Post Office Box 767
Chicago, Illinois 60690

DmB

September 26, 1984

Mr. James G. Keppler
Regional Administrator
U. S. Nuclear Regulatory Commission
Region III
799 Roosevelt Road
Glen Ellyn, IL 60137

Subject: Byron Station Units 1 and 2
Braidwood Station Units 1 and 2
10 CFR 50.55(e) Final Report
Pacific Air Products Linear Torque Converters
NRC Docket Nos. 50-454/455 and 50-456/457

References (a): T. R. Tramm letter to J. G. Keppler
dated March 28, 1984

(b): T. R. Tramm letter to J. G. Keppler
dated May 18, 1984

Dear Mr. Keppler:

On February 28, 1984, the Commonwealth Edison Company notified your office of a deficiency reportable pursuant to 10 CFR 50.55(e) regarding deficient Pacific Air Products Company (PAPCO) linear torque converters in HVAC damper actuators at our Byron and Braidwood Stations. References (a) and (b) provided information concerning this matter to fulfill the thirty day reporting requirement and provide interim status. For tracking purposes this deficiency was assigned Number 84-01 for Byron and 84-03 for Braidwood. The purpose of this letter is to provide a final report on the status of corrective actions at our Braidwood Station. This issue at Byron was closed during a recent inspection (50-454/84-21, 50-455/84-13). Since the issue is technically identical at Braidwood and the status of refurbishment similar to Byron's, it is suggested that the Byron review be the basis for closing the items at Braidwood.

PAPCO's Final Report [Investigative Report No. 7043-03 (Part III)] has been received and reviewed by CECO. The final report did not impact corrective actions previously recommended by PAPCO as discussed in Reference (a). The corrective actions being implemented by Commonwealth Edison Company called for return of the converters to PAPCO for refurbishment which included 1) lubrication of moving parts, 2) shaft polishing, and 3) replacing brass shaft guide bushings with an alternate material meeting IEEE Standards for cyclic wear.

8410150012 840926
PDR ADOCK 05000454
S PDR

SEP 27 1984

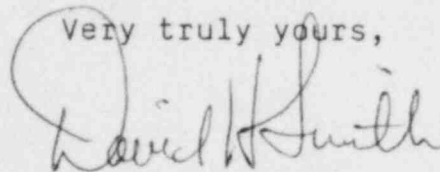
1/0

IEJ7

To date, all converters at Braidwood have been sent to PAPCO for refurbishment (157 total, 138 safety-related). Approximately 110 units have been returned. It is anticipated that all units will be returned by November 1, 1984. Braidwood Station has also written maintenance procedures consistent with PAPCO's recommendations to ensure that, during operations, the units are adequately inspected and maintained.

Please address any questions that you or your staff may have concerning this matter to this office.

Very truly yours,

A handwritten signature in dark ink, appearing to read "David H. Smith". The signature is fluid and cursive, with a large initial "D" and "S".

David H. Smith
Nuclear Licensing Administrator

cc: NRC Resident Inspector - Braidwood

Director of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555