


**TEXAS UTILITIES GENERATING COMPANY**  
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. 81 • DALLAS, TEXAS 75201

BILLY R. CLEMENTS  
VICE PRESIDENT, NUCLEAR OPERATIONS

September 27, 1984  
TXX-4317

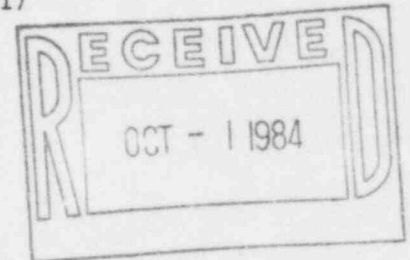

Mr. D.R. Hunter, Chief  
Reactor Project Branch 2  
U.S. Nuclear Regulatory Commission  
Office of Inspection & Enforcement  
611 Ryan Plaza Drive, Suite 1000  
Arlington, TX 76012

Docket Nos.: 50-445

COMANCHE PEAK STEAM ELECTRIC STATION  
NSSS AUXILIARY RELAY RACKS  
QA FILE: CP-84-26, SDAR-150  
FILE NO.: 10110

Dear Mr. Hunter,

On August 31, 1984 we verbally notified your Mr. Hunnicutt of an inconsistency identified by comparison of the "Q-List" in the FSAR Chapter 17 and the Environmentally Qualified Equipment List which revealed the NSSS Auxiliary Relay Racks are not qualified per IEEE-323-1974.

We have completed our investigation and concluded that the matter is not reportable under 10CFR50.55(e). Records supporting this determination are available for your inspector's review at the CPSES site.

Very truly yours,

BRC/tlg

cc: NRC Region IV - (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555

8410150177 840927  
PDR ADOCK 05000445  
S PDR

1/0 IE-27