


TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. #1 • DALLAS, TEXAS 75201

BILLY R. CLEMENTS
VICE PRESIDENT, NUCLEAR OPERATIONS

September 27, 1984
TXX-4318

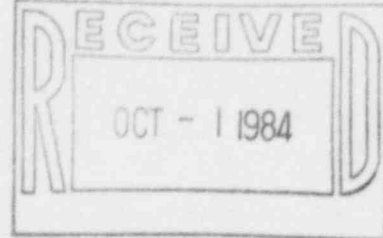

Mr. D.R. Hunter, Chief
Reactor Project Branch 2
U.S. Nuclear Regulatory Commission
Office of Inspection & Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76012

Docket Nos.: 50-445

COMANCHE PEAK STEAM ELECTRIC STATION
AIR-OPERATED DIAPHRAGM VALVES
QA FILE: CP-84-25, SDAR-149
FILE NO.: 10110

Dear Mr. Hunter,

On August 31, 1984 we verbally notified your Mr. Hunnicutt of a deficiency regarding air operated diaphragm valves which have a natural frequency less than that required.

We have completed our investigation and concluded that the matter is not reportable under 10CFR50.55(e). Records supporting this determination are available for your inspector's review at the CPSES site.

Very truly yours,

A handwritten signature in cursive script, reading "Billy R. Clements".

BRC/tlg

cc: NRC Region IV - (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)
U.S. Nuclear Regulatory Commission
Washington, DC 20555

8410150333 840927
PDR ADDCK 05000445
S PDR

IE-27
1/0