




LOUISIANA

POWER & LIGHT/Waterford 3 SES/P.O.Box B/Killona, LA 70066

July 19, 1984

W3K84-1658
Q-3-A35.07.108

Mr. John T. Collins
Regional Administrator, Region IV
U. S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76012

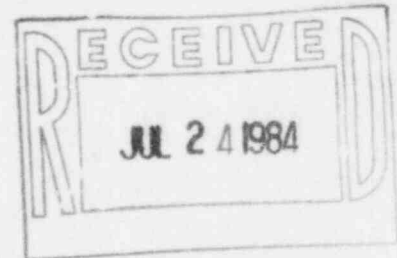

REFERENCE: LP&L Letter W3K84-1504 dated June 29, 1984

Dear Mr. Collins:

SUBJECT: Waterford SES Unit No. 3
Docket No. 50-382
Significant Construction Deficiency No. 108
"Potential Failure To Comply With FSAR Safe Shutdown Commitment"
Second Interim Report

The above referenced letter indicated submittal of the Final Report to the USNRC on July 20, 1984.

At the present time, Reactor Coolant System (RCS) pressure indication cabling has been rerouted from its containment penetration to LCP-43 independent of the cable vault, thereby ensuring its availability in the event of a cable vault fire.

The additional corrective action and testing stated in the First Interim Report is scheduled to be completed in late July 1984.

The Final Report will be provided to the USNRC on August 10, 1984.

Very truly yours,

T. F. Gerrets
T. F. Gerrets

Corporate Quality Assurance Manager

TFG:CNH:SSTG

cc: Director
Office of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

8408060032 840719
PDR ADOCK 05000382
S PDR

IL-27,10

Mr. John T. Collins

July 19, 1984

W3K84-1658

Page 2

cc: Director
Office of Management
Information and Program Control
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Mr. E. L. Blake
Shaw, Pittman, Potts & Trowbridge
1800 M Street, N.W.
Washington, D.C. 20036

Mr. W. M. Stevenson
Monroe & Lemann
1424 Whitney Building
New Orleans, Louisiana 70130

Mr. W. A. Cross
7910 Woodmont Avenue
Suite 1200
Bethesda, Maryland 20814