

ENCLOSURE 3

VOGTLE ELECTRIC GENERATING PLANT  
REQUEST FOR TECHNICAL SPECIFICATION CHANGES  
RESPONSE TO GENERIC LETTER 89-01  
RADIOLOGICAL EFFLUENT TECHNICAL SPECIFICATION CHANGES

PROPOSED TECHNICAL SPECIFICATION CHANGES

## INDEX

### DEFINITIONS

| <u>SECTION</u>                                   | <u>PAGE</u>       |
|--------------------------------------------------|-------------------|
| 1.32 SLAVE RELAY TEST.....                       | 1-5               |
| 1.33 SOLIDIFICATION(DELETED).....                | 1- <del>8</del> 6 |
| 1.34 SOURCE CHECK.....                           | 1-6               |
| 1.35 STAGGERED TEST BASIS.....                   | 1-6               |
| 1.36 THERMAL POWER.....                          | 1-6               |
| 1.37 TRIP ACTUATING DEVICE OPERATIONAL TEST..... | 1-6               |
| 1.38 UNIDENTIFIED LEAKAGE.....                   | 1-6               |
| 1.39 UNRESTRICTED AREA.....                      | 1-6               |
| 1.40 VENTILATION EXHAUST TREATMENT SYSTEM.....   | 1-6               |
| 1.41 VENTING.....                                | 1-7               |
| TABLE 1.1 FREQUENCY NOTATION.....                | 1-8               |
| TABLE 1.2 OPERATIONAL MODES.....                 | 1-9               |

# INDEX

## LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

| <u>SECTION</u>                                                                                                                            | <u>PAGE</u>         |
|-------------------------------------------------------------------------------------------------------------------------------------------|---------------------|
| TABLE 3.3-5 SEISMIC MONITORING INSTRUMENTATION.....                                                                                       | 3/4 3-51            |
| TABLE 4.3-4 SEISMIC MONITORING INSTRUMENTATION SURVEILLANCE<br>REQUIREMENTS.....                                                          | 3/4 3-52            |
| Meteorological Instrumentation (Common System).....                                                                                       | 3/4 3-53            |
| TABLE 3.3-6 METEOROLOGICAL MONITORING INSTRUMENTATION.....                                                                                | 3/4 3-54            |
| Remote Shutdown System.....                                                                                                               | 3/4 3-55            |
| TABLE 3.3-7 REMOTE SHUTDOWN SYSTEM MONITORING INSTRUMENTATION.....                                                                        | 3/4 3-56            |
| Accident Monitoring Instrumentation.....                                                                                                  | 3/4 3-58            |
| TABLE 3.3-8 ACCIDENT MONITORING INSTRUMENTATION.....                                                                                      | 3/4 3-59            |
| Chlorine Detection Systems (Deleted).....                                                                                                 | 3/4 3-63            |
| Loose Parts Detection System (Deleted) .....                                                                                              | 3/4 3-64            |
| Radioactive Liquid Effluent Monitoring Instrumentation(Deleted)                                                                           | 3/4 3-65            |
| <del>TABLE 3.3-9 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION</del>                                                             | <del>3/4 3-66</del> |
| <del>TABLE 4.3-5 RADIOACTIVE LIQUID EFFLUENT MONITORING<br/>INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....</del>                          | <del>3/4 3-68</del> |
| <del>Explosive Gas</del><br><del>X Radioactive Gaseous Effluent Monitoring Instrumentation..</del>                                        | <del>3/4 3-71</del> |
| TABLE 3.3-10 <del>RADIOACTIVE GASEOUS EFFLUENT</del> <sup>EXPLOSIVE GAS</sup> MONITORING<br>INSTRUMENTATION.....                          | 3/4 3-72            |
| TABLE 4.3-6 <del>RADIOACTIVE GASEOUS EFFLUENT</del> <sup>EXPLOSIVE GAS</sup> MONITORING<br>INSTRUMENTATION SURVEILLANCE REQUIREMENTS..... | 3/4 3-76            |
| High-Energy Line Break Isolation Sensors.....                                                                                             | 3/4 3-79            |
| TABLE 3.3-11 HIGH-ENERGY LINE BREAK INSTRUMENTATION.....                                                                                  | 3/4 3-80            |
| 3/4.3.4 TURBINE OVERSPEED PROTECTION.....                                                                                                 | 3/4 3-81            |

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

| <u>SECTION</u>                                                                                        | <u>PAGE</u>         |
|-------------------------------------------------------------------------------------------------------|---------------------|
| <u>3/4.10 SPECIAL TEST EXCEPTIONS</u>                                                                 |                     |
| 3/4.10.1 SHUTDOWN MARGIN.....                                                                         | 3/4 10-1            |
| 3/4.10.2 GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS...                                    | 3/4 10-2            |
| 3/4.10.3 PHYSICS TESTS.....                                                                           | 3/4 10-3            |
| 3/4.10.4 REACTOR COOLANT LOOPS.....                                                                   | 3/4 10-4            |
| 3/4.10.5 POSITION INDICATION SYSTEM - SHUTDOWN.....                                                   | 3/4 10-5            |
| <u>3/4.11 RADIOACTIVE EFFLUENTS</u>                                                                   |                     |
| 3/4.11.1 LIQUID EFFLUENTS                                                                             |                     |
| Concentration(Deleted).....                                                                           | 3/4 11-1            |
| <del>TABLE 4.11-1 RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS</del>                                |                     |
| <del>PROGRAM.....</del>                                                                               | <del>3/4 11-2</del> |
| Dose(Deleted).....                                                                                    | 3/4 11-5            |
| Liquid Radwaste Treatment System(Deleted).....                                                        | 3/4 11-6            |
| Liquid Holdup Tanks.....                                                                              | 3/4 11-7            |
| 3/4.11.2 GASEOUS EFFLUENTS                                                                            |                     |
| Dose Rate(Deleted).....                                                                               | 3/4 11-8            |
| <del>TABLE 4.11-2 RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS</del>                               |                     |
| <del>PROGRAM.....</del>                                                                               | <del>3/4 11-9</del> |
| Dose - Noble Gases(Deleted).....                                                                      | 3/4 11-12           |
| Dose - Iodine-131, Iodine-133, Tritium, and Radioactive<br>Material in Particulate Form(Deleted)..... | 3/4 11-13           |
| Gaseous Radwaste Treatment System(Deleted).....                                                       | 3/4 11-14           |
| Explosive Gas Mixture.....                                                                            | 3/4 11-15           |
| Gas Decay Tanks.....                                                                                  | 3/4 11-16           |
| 3/4.11.3 SOLID RADIOACTIVE WASTES(DELETED).....                                                       | 3/4 11-17           |
| 3/4.11.4 TOTAL DOSE(DELETED).....                                                                     | 3/4 11-18           |



## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

#### SECTION

#### PAGE

#### 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING (DELETED)

|                                                                                                                          |                      |
|--------------------------------------------------------------------------------------------------------------------------|----------------------|
| 3/4.12.1 MONITORING PROGRAM(DELETED).....                                                                                | 3/4 12-1             |
| <del>TABLE 3-12-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM.....</del>                                               | <del>3/4 12-3</del>  |
| <del>TABLE 3-12-2 REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS<br/>IN ENVIRONMENTAL SAMPLES. ....</del>             | <del>3/4 12-9</del>  |
| <del>TABLE 4-12-1 DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE<br/>ANALYSIS LOWER LIMIT OF DETECTION (LLD).....</del> | <del>3/4 12-10</del> |
| 3/4.12.2 LAND USE CENSUS(DELETED).....                                                                                   | 3/4 12-13            |
| 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM(DELETED).....                                                                | 3/4 12-14            |

## INDEX

### BASES

---

#### 3/4.11 RADIOACTIVE EFFLUENTS

|                                                 |            |
|-------------------------------------------------|------------|
| 3/4.11.1 LIQUID EFFLUENTS.....                  | B 3/4 11-1 |
| 3/4.11.2 GASEOUS EFFLUENTS.....                 | B 3/4 11-3 |
| 3/4.11.3 SOLID RADIOACTIVE WASTES(DELETED)..... | B 3/4 11-6 |
| 3/4.11.4 TOTAL DOSE(DELETED).....               | B 3/4 11-6 |

#### 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING (DELETED)

|                                                           |            |
|-----------------------------------------------------------|------------|
| 3/4.12.1 MONITORING PROGRAM(DELETED).....                 | B 3/4 12-1 |
| 3/4.12.2 LAND USE CENSUS(DELETED).....                    | B 3/4 12-1 |
| 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM(DELETED)..... | B 3/4 12-2 |

## INDEX

### ADMINISTRATIVE CONTROLS

---

#### SECTION

|                                                                                                             |             |
|-------------------------------------------------------------------------------------------------------------|-------------|
| <u>6.10 RADIATION PROTECTION PROGRAM.....</u>                                                               | <u>6-23</u> |
| <u>6.11 HIGH RADIATION AREA.....</u>                                                                        | <u>6-23</u> |
| <u>6.12 PROCESS CONTROL PROGRAM (PCP).....</u>                                                              | <u>5-24</u> |
| <u>6.13 OFFSITE DOSE CALCULATION MANUAL (ODCM).....</u>                                                     | <u>6-25</u> |
| <u>6.14 MAJOR CHANGES TO LIQUID, GASEOUS, AND SOLID</u><br><u>RADWASTE TREATMENT SYSTEMS (DELETED).....</u> | <u>6-25</u> |

## DEFINITIONS

### MEMBER(S) OF THE PUBLIC

1.18 MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the plant. This category does not include employees of the licensee, its contractors, or vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with the plant.

### OFFSITE DOSE CALCULATION MANUAL

1.19 The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses ~~due to~~ radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the Environmental Radiological Monitoring Program. ← resulting from

INSERT 1

### OPERABLE - OPERABILITY

1.20 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).

### OPERATIONAL MODE - MODE

1.21 An OPERATIONAL MODE (i.e., MODE) shall correspond to any one inclusive combination of core reactivity condition, power level, and average reactor coolant temperature specified in Table 1.2.

### PHYSICS TESTS

1.22 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation: (1) described in Chapter 14.0 of the FSAR, (2) authorized under the provisions of 10 CFR 50.59, or (3) otherwise approved by the Commission.

### PRESSURE BOUNDARY LEAKAGE

1.23 PRESSURE BOUNDARY LEAKAGE shall be leakage (except steam generator tube leakage) through a nonisolable fault in a Reactor Coolant System component body, pipe wall, or vessel wall.

### PROCESS CONTROL PROGRAM

1.24 The PROCESS CONTROL PROGRAM (PCP) shall contain the current formulas, sampling, analyses, tests, and determinations to be made to ensure that processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, and 71, ~~and Federal and State~~

INSERT 1

The ODCM shall also contain (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Section 6.7.4 and (2) descriptions of the information that should be included in the Annual Radiological Environmental Surveillance and Semiannual Radioactive Effluent Release Reports required by Specifications 6.8.1.3 and 6.8.1.4.

## DEFINITIONS

regulations, burial ground requirements, and other requirements governing the disposal of radioactive waste.

### PURGE - PURGING *solid*

1.25 PURGE or PURGING shall be any controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

### QUADRANT POWER TILT RATIO

1.26 QUADRANT POWER TILT RATIO shall be the ratio of the maximum upper excore detector calibrated output to the average of the upper excore detector calibrated outputs, or the ratio of the maximum lower excore detector calibrated output to the average of the lower excore detector calibrated outputs, whichever is greater. With one excore detector inoperable, the remaining three detectors shall be used for computing the average.

### RATED THERMAL POWER

1.27 RATED THERMAL POWER shall be a total reactor core heat transfer rate to the reactor coolant of 3411 MWt.

### REACTOR TRIP SYSTEM RESPONSE TIME

1.28 The REACTOR TRIP SYSTEM RESPONSE TIME shall be the time interval from when the monitored parameter exceeds its Trip Setpoint at the channel sensor until loss of stationary gripper coil voltage.

### REPORTABLE EVENT

1.29 A REPORTABLE EVENT shall be any of those conditions specified in Sections 50.72 and 50.73 of 10 CFR Part 50.

### SHUTDOWN MARGIN

1.30 SHUTDOWN MARGIN shall be the instantaneous amount of reactivity by which the reactor is subcritical or would be subcritical from its present condition assuming all rod cluster assemblies (shutdown and control) are fully inserted except for the single rod cluster assembly of highest reactivity worth which is assumed to be fully withdrawn.

### SITE BOUNDARY

1.31 The SITE BOUNDARY shall be the exclusion boundary line as shown in Figure 5.1-1.

### SLAVE RELAY TEST

1.32 A SLAVE RELAY TEST shall be the energization of each slave relay and verification of OPERABILITY of each relay. The SLAVE RELAY TEST shall include a continuity check, as a minimum, of associated testable actuation devices.



## DEFINITIONS

### SOLIDIFICATION

~~Deleted.~~

~~1.33 A SOLIDIFICATION shall be the conversion of wet wastes into a form that meets shipping and burial ground requirements.~~

### SOURCE CHECK

1.34 A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.

### STAGGERED TEST BASIS

1.35 A STAGGERED TEST BASIS shall consist of:

- a. A test schedule for n systems, subsystems, trains, or other designated components obtained by dividing the specified test interval into n equal subintervals, and
- b. The testing of one system, subsystem, train, or other designated component at the beginning of each subinterval.

### THERMAL POWER

1.36 THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

### TRIP ACTUATING DEVICE OPERATIONAL TEST

1.37 A TRIP ACTUATING DEVICE OPERATIONAL TEST shall consist of operating the Trip Actuating Device and verifying OPERABILITY of alarm, interlock and/or trip functions. The TRIP ACTUATING DEVICE OPERATIONAL TEST shall include adjustment, as necessary, of the Trip Actuating Device such that it actuates at the required Setpoint within the required accuracy.

### UNIDENTIFIED LEAKAGE

1.38 UNIDENTIFIED LEAKAGE shall be all leakage which is not IDENTIFIED LEAKAGE or CONTROLLED LEAKAGE.

### UNRESTRICTED AREA

1.39 An UNRESTRICTED AREA shall be any area at or beyond the SITE BOUNDARY access to which is not controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials, or any area within the SITE BOUNDARY used for residential quarters or for industrial, commercial, institutional, and/or recreational purposes.



TABLE 3.3-3 (Continued)

TABLE NOTATIONS

\*Time constants utilized in the lead-lag controller for Steam Line Pressure-Low are  $\tau_1 \geq 50$  seconds and  $\tau_2 \leq 5$  seconds. CHANNEL CALIBRATION shall ensure that these time constants are adjusted to these values.

\*\*The time constant utilized in the rate-lag controller for Steam Line Pressure-Negative Rate-High is greater than or equal to 50 seconds. CHANNEL CALIBRATION shall ensure that this time constant is adjusted to this value.

#Feedwater isolation only. Turbine trip occurs on reactor trip.

<sup>a</sup>During refueling operations.

<sup>b</sup>During power operation. This is an initial setpoint only. The trip setpoint will be set at 50 times background level. Background level should be determined at or near the end of the first fuel cycle.

<sup>c</sup>Setpoints will not exceed the limits of Specification ~~3.11.2.1.~~

6.7.4.f.

## INSTRUMENTATION

### RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

Specification 3/4.3.3.9 Deleted

#### LIMITING CONDITION FOR OPERATION

3.3.3.9 The radioactive liquid effluent monitoring instrumentation channels shown in Table 3.3-9 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of Specification 3.11.1.1 are not exceeded. The Alarm/Trip Setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL (ODCM).

APPLICABILITY: At all times.

DELETED

#### ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above specification, immediately suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 3.3-9. Restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, explain in the next Semiannual Radioactive Effluent Release Report pursuant to Specification 6.8.1.4 why this inoperability was not corrected in a timely manner.
- c. The provisions of Specifications 3.0.3 and 3.0.4, are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.3.3.9 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and ANALOG CHANNEL OPERATIONAL TEST at the frequencies shown in Table 4.3-5.

TABLE 3.3-9

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

| <u>INSTRUMENT</u>                                                                            |  | <u>MINIMUM CHANNELS OPERABLE</u> | <u>ACTION</u> |
|----------------------------------------------------------------------------------------------|--|----------------------------------|---------------|
| 1. Radioactivity Monitors Providing Alarm and Automatic Termination of Release               |  |                                  |               |
| a. Liquid Radwaste Effluent Line (RE-0018)                                                   |  | 1                                | 37            |
| b. Steam Generator Blowdown Effluent Line (RE-0021)                                          |  | 1                                | 38            |
| c. Turbine Building (Floor Drains) Sumps Effluent Line (RE-0848)                             |  | 1                                | 38            |
| 2. Radioactivity Monitors Providing Alarm But Not Providing Automatic Termination of Release |  |                                  |               |
| a. Nuclear Service Cooling Water System Effluent Line (RE-0020 A & B)                        |  | 1                                | 39            |
| 3. Flow Rate Measurement Devices                                                             |  |                                  |               |
| a. Liquid Radwaste Effluent Line (FT-0018)                                                   |  | 1                                | 40            |
| b. Steam Generator Blowdown Effluent Line (FT-0021)                                          |  | 1                                | 40            |
| c. Flow to Blowdown Sump (AFQI-7620, FR-7620, pen 1) (Common)                                |  | 1                                | 40            |

DELETED

TABLE 3.3-9 (Continued)

ACTION STATEMENTS

DELETED

ACTION 37 -

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that prior to initiating a release:

- a. At least two independent samples are analyzed in accordance with Specification 4.11.1.1.1, and
- b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge line valving.

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION 38 -

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are analyzed for radioactivity at a lower limit of detection of no more than  $10^{-7}$  microcurie/ml:

- a. At least once per 12 hours when the specific activity of the secondary coolant is greater than 0.01 microcurie/gram DOSE EQUIVALENT I-131, or
- b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 microcurie/gram DOSE EQUIVALENT I-131.

ACTION 39 -

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that, at least once per 12 hours, grab samples are collected and analyzed for radioactivity at a lower limit of detection of no more than  $10^{-7}$  microcurie/ml.

ACTION 40 -

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during actual releases. Pump performance curves generated in place may be used to estimate flow.

TABLE 4-3-5

# RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

ANALOG  
CHANNEL  
OPERATIONAL  
TEST

## INSTRUMENT

CHANNEL  
CHECK

SOURCE  
CHECK

CHANNEL  
CALIBRATION

1. Radioactivity Monitors Providing Alarm and Automatic Termination of Release
  - a. Liquid Radwaste Effluent Line (RE-0018)
  - b. Steam Generator Blowdown Effluent Line (RE-0021)
  - c. Turbine Building (Floor Drains) Sumps Effluent Line (RE-0848)
2. Radioactivity Monitors Providing Alarm But Not Providing Automatic Termination of Release
 

Nuclear Service Cooling Water System Effluent Line (RE-0020 A & B)

D

P

R(3)

Q(1)

D

M

R(3)

Q(1)

D

M

R(3)

Q(1)

D

M

R(3)

Q(2)

DELETED

TABLE 4.3-5 (Continued)

## RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

| INSTRUMENT                                                   | CHANNEL<br>CHECK | SOURCE<br>CHECK | CHANNEL<br>CALIBRATION | ANALOG<br>CHANNEL<br>OPERATIONAL<br>TEST |
|--------------------------------------------------------------|------------------|-----------------|------------------------|------------------------------------------|
| 3. Flow Rate Measurement Devices                             |                  |                 |                        |                                          |
| a. Liquid Radwaste Effluent Line (FI-0018)                   | D(4)             | N.A.            | R                      | N.A.                                     |
| b. Steam Generator Blowdown Effluent Line (FI-0021)          | D(4)             | N.A.            | R                      | N.A.                                     |
| c. Flow to Blowdown Sump (AFQI-7620, FR-7620 pen 1) (Common) | D(4)             | N.A.            | R                      | Q                                        |

DELETED



TABLE 4.3-5 (Continued)

TABLE NOTATIONS

- (1) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway (for item a. below only) and control room alarm annunciation occur if any of the following conditions exists:
- a. Instrument indicates measured levels above the Alarm/Trip Setpoint, or
  - b. Circuit failure, or
  - c. Instrument indicates a downscale failure, or
  - d. Instrument controls not set in operate mode. (annunciation via computer print-out)
- (2) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
- a. Instrument indicates measured levels above the Alarm Setpoint, or
  - b. Circuit failure, or **DELETED**
  - c. Instrument indicates a downscale failure, or
  - d. Instrument controls not set in operate mode. (annunciation via computer print-out)
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Bureau of Standards (NBS) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NBS. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (4) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days during which continuous, periodic, or batch releases are made.



## INSTRUMENTATION

### EXPLOSIVE GAS

#### RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

##### LIMITING CONDITION FOR OPERATION

3.3.3.10 The ~~radioactive gaseous effluent~~ <sup>explosive gas</sup> monitoring instrumentation channels shown in Table 3.3-10 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of Specifications ~~3.11.2.1a and 3.11.2.5~~ are not exceeded. ~~The Alarm/Trip Setpoints of these channels meeting Specification 3.11.2.1a shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.~~

APPLICABILITY: As shown in Table 3.3-10

##### ACTION:

With a ~~radioactive gaseous effluent~~ <sup>an explosive gas</sup> monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above specification, ~~immediately suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable and take the ACTION shown in Table 3.3-10.~~

- b. With less than the minimum number of ~~radioactive gaseous effluent~~ <sup>explosive gas</sup> monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 3.3-10. Restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, ~~explain in the next~~ prepare and submit a Special ~~Semiannual Radioactive Effluent Release Report~~ pursuant to Specification ~~6.8.1.4~~ why this inoperability was not <sup>6.8.2 to explain</sup> corrected in a timely manner. <sup>to the Commission</sup>
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

##### SURVEILLANCE REQUIREMENTS

4.3.3.10 Each ~~radioactive gaseous effluent~~ <sup>explosive gas</sup> monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, ~~SOURCE CHECK~~, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST at the frequencies shown in Table 4.3-6.

## EXPLOSIVE GAS

TABLE 3.3-10

~~1 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION~~

| INSTRUMENT<br>(NOT USED)                                                                                                      | MINIMUM CHANNELS<br>OPERABLE | APPLICABILITY | ACTION |
|-------------------------------------------------------------------------------------------------------------------------------|------------------------------|---------------|--------|
| 1. <del>1 GASEOUS WASTE PROCESSING SYSTEM</del>                                                                               |                              |               |        |
| a. <del>Noble Gas Activity Monitor<br/>Providing Alarm and Automatic<br/>Termination of Release<br/>(ARE-0014) (Common)</del> | 1                            | ***           | 45     |
| b. <del>Effluent System Flow Rate<br/>Measuring Device<br/>(AFT-0014) (Common)</del>                                          | 1                            | ***           | 46     |
| 2. GASEOUS WASTE PROCESSING SYSTEM<br>Explosive Gas Monitoring System                                                         |                              |               |        |
| a. Hydrogen Monitor                                                                                                           | 1/recombiner                 | **            | 50     |
| b. Oxygen Monitor                                                                                                             | 2/recombiner                 | **            | 49     |
| 3. Condenser Air Ejector and Steam Packing<br>Exhaustor System                                                                |                              |               |        |
| a. Noble Gas Activity Monitor<br>(RE-12839C)                                                                                  | 1                            | ***           | 47     |
| b. Iodine Sampler<br>(RE-12839B)                                                                                              | 1                            | ***           | 51     |
| c. Particulate Sampler<br>(RE-12839A)                                                                                         | 1                            | ***           | 51     |
| d. Flow Rate Monitor<br>(FT-12839)<br>(FIS-12862) #                                                                           | 1                            | ***           | 46     |
| e. Sampler Flow Rate Monitor<br>(FI-12211)                                                                                    | 1                            | ***           | 46     |

DELETED

VOGTLE UNITS - 1 &amp; 2

3/4 3-73

TABLE 3.3-10 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

| <u>INSTRUMENT</u> |                                                         | <u>MINIMUM CHANNELS<br/>OPERABLE</u> | <u>APPLICABILITY</u> | <u>ACTION</u> |
|-------------------|---------------------------------------------------------|--------------------------------------|----------------------|---------------|
| 4.                | Plant Vent                                              |                                      |                      |               |
| a.                | Noble Gas Activity Monitor<br>(RE-12442C or RE-12444C)  | 1                                    | *                    | 47, 48        |
| b.                | Iodine Sampler/Monitor<br>(RE-12442B or RE-12444B)      | 1                                    | *                    | 51            |
| c.                | Particulate Sampler/Monitor<br>(RE-12442A or RE-12444A) | 1                                    | *                    | 51            |
| d.                | Flow Rate Monitor<br>(FI-12442)                         | 1                                    | *                    | 46            |
| e.                | Sampler Flow Rate Monitor<br>(FI-12442 or FI-12444)     | 1                                    | *                    | 46            |

DELETED

TABLE 3.3-10 (Continued)

TABLE NOTATIONS

- \* ~~At all times. (Not Used)~~
- \*\* During GASEOUS WASTE PROCESSING SYSTEM operation.
- \*\*\* ~~During radioactive releases via this pathway. (Not Used)~~
- # ~~During Emergency Filtration. (Not Used)~~

ACTION STATEMENTS

48  
ACTION 41-44 (Not Used)

~~ACTION 45 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:~~

- ~~a. At least two independent samples of the tank's contents are analyzed, and~~
- ~~b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge valve lineup.~~

~~Otherwise, suspend release of radioactive effluents via this pathway.~~

~~ACTION 46 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours.~~

~~ACTION 47 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are taken at least once per 12 hours and these samples are analyzed for radioactivity within 24 hours.~~

~~ACTION 48 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend containment PURGING of radioactive effluents via this pathway.~~

- ACTION 49 -
- a. With the outlet oxygen monitor channel inoperable, operation of the system may continue provided grab samples are taken and analyzed at least once per 24 hours and the oxygen concentration remains less than 1 percent.
  - b. With the inlet oxygen monitor inoperable, operation may continue if the inlet hydrogen monitor is OPERABLE.
  - c. With both oxygen channels or both of the inlet oxygen and inlet hydrogen monitors inoperable, suspend oxygen supply to the recombiner. Addition of waste gas to the system may continue provided grab samples are taken and analyzed at least once per 4 hours during degassing operations or at least once per 24 hours during other operations and the oxygen concentration remains less than 1 percent.

TABLE 3.3-10 (Continued)

TABLE NOTATIONS (Continued)

ACTION 50 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, suspend oxygen supply to the recombiner. Addition of waste gas to the system may continue provided grab samples are taken and analyzed at least once per 4 hours during degassing operations or at least once per 24 hours during other operations and the oxygen concentration remains less than 1 percent.

~~ACTION 51 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the affected pathway may continue provided samples are continuously collected with auxiliary sampling equipment as required in Table 4.11.2.~~

TABLE 4.3-6

## EXPLOSIVE GAS

~~A RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS~~

| INSTRUMENT<br>(NOT USED)                                                                                           | CHANNEL<br>CHECK | <del>SOURCE<br/>CHECK</del> | CHANNEL<br>CALIBRATION | ANALOG<br>CHANNEL<br>OPERATIONAL<br>TEST | MODES FOR WHICH<br>SURVEILLANCE<br>IS REQUIRED |
|--------------------------------------------------------------------------------------------------------------------|------------------|-----------------------------|------------------------|------------------------------------------|------------------------------------------------|
| 1. <del>A GASEOUS WASTE PROCESSING SYSTEM</del>                                                                    |                  |                             |                        |                                          |                                                |
| <del>a. Noble Gas Activity Monitor -<br/>Providing Alarm and Automatic<br/>Termination of Release (ARE-0014)</del> | <del>P</del>     | <del>P</del>                | <del>R(3)</del>        | <del>Q(1)</del>                          | <del>c</del>                                   |
| <del>b. Effluent System Flow Rate<br/>Measuring Device (AFT-0014)</del>                                            | <del>P</del>     | <del>N.A.</del>             | <del>R</del>           | <del>N.A.</del>                          | <del>c</del>                                   |
| 2. GASEOUS WASTE PROCESSING SYSTEM<br>Explosive Gas Monitoring System                                              |                  |                             |                        |                                          |                                                |
| a. Hydrogen Monitors                                                                                               | D                | <del>N.A.</del>             | Q(4)                   | M                                        | b                                              |
| b. Oxygen Monitors                                                                                                 | D                | <del>N.A.</del>             | Q(5)                   | M                                        | b                                              |
| 3. Condenser Air Ejector and Steam<br>Packing Exhauster System                                                     |                  |                             |                        |                                          |                                                |
| a. Noble Gas Activity Monitor<br>(RE-12839C)                                                                       | D                | M                           | R(3)                   | Q(2)                                     | c                                              |
| b. Iodine Sampler<br>(RE-12839B)                                                                                   | W(6)             | N.A.                        | N.A.                   | N.A.                                     | c                                              |
| c. Particulate Sampler<br>(RE-12839A)                                                                              | W(6)             | N.A.                        | N.A.                   | N.A.                                     | c                                              |
| d. Flow Rate Monitor<br>(FT-12839)                                                                                 | D                | N.A.                        | R                      | N.A.                                     | c                                              |
| e. Sampler Flow Rate Monitor<br>(FX-13211)                                                                         | D                | N.A.                        | R                      | Q                                        | c                                              |



TABLE 4.3-6 (Continued)

## RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

| INSTRUMENT                                                | CHANNEL<br>CHECK | SOURCE<br>CHECK | CHANNEL<br>CALIBRATION | ANALOG<br>CHANNEL<br>OPERATIONAL<br>TEST | MODES FOR WHICH<br>SURVEILLANCE<br>IS REQUIRED |
|-----------------------------------------------------------|------------------|-----------------|------------------------|------------------------------------------|------------------------------------------------|
| 4. Plant Vent                                             |                  |                 |                        |                                          |                                                |
| a. Noble Gas Activity Monitor<br>(RE-12442C or RE-12444C) | D                | M               | R(3)                   | Q(2)                                     | a                                              |
| b. Iodine Sampler<br>(RE-12444B)                          | W(6)             | N.A.            | N.A.                   | N.A.                                     | a                                              |
| c. Particulate Sampler<br>(RE-12444A)                     | W(6)             | N.A.            | N.A.                   | N.A.                                     | a                                              |
| d. Flow Rate Monitor<br>(FT-12442)                        | D                | N.A.            | R                      | N.A.                                     | a                                              |
| e. Sampler Flow Rate Monitor<br>(FI-12442 or FI-12444)    | D                | N.A.            | R                      | Q                                        | a                                              |
| f. Particulate Monitor<br>(RE-12442A)                     | D                | N.A.            | R                      | Q                                        | a                                              |
| g. Iodine Activity Monitor<br>(RE-12442B)                 | D                | N.A.            | R                      | Q                                        | a                                              |

DELETED



TABLE 4.3-6 (Continued)

TABLE NOTATIONS

- a ~~At all times. Not used.~~
- b During GASEOUS WASTE PROCESSING SYSTEM operation.
- c ~~During Radioactive Releases via this pathway. Not used.~~

Not used

- (1) ~~^ The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway (for item a. below only) and control room alarm annunciation occurs if any of the following conditions exists:~~

- ~~a. Instrument indicates measured levels above the Alarm/Trip Setpoint, or~~
- ~~b. Circuit failure, or~~
- ~~c. Instrument indicates a downscale failure, or~~
- ~~d. Instrument controls not set in operate mode. (annunciation via computer print-out)~~

Not used

- (2) ~~^ The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:~~

- ~~a. Instrument indicates measured levels above the Alarm Setpoint, or~~
- ~~b. Circuit failure, or~~
- ~~c. Instrument indicates a downscale failure, or~~
- ~~d. Instrument controls not set in operate mode. (annunciation via computer print-out)~~

Not used

- (3) ~~^ The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Bureau of Standards (NBS) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NBS. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.~~

- (4) The CHANNEL CALIBRATION shall include the use of standard gas samples in accordance with the manufacturer's recommendations. In addition, a standard gas sample of nominal four volume percent hydrogen, balance nitrogen, shall be used in the calibration to check linearity of the hydrogen analyzer.

- (5) The CHANNEL CALIBRATION shall include the use of standard gas samples in accordance with the manufacturer's recommendations. In addition, a standard gas sample of nominal four volume percent oxygen, balance nitrogen, shall be used in the calibration to check linearity of the oxygen analyzer.

- (6) ~~The CHANNEL CHECK shall consist of visually verifying that the collection device (i.e., particulate filter or charcoal cartridge, etc.) is in place for sampling.~~

### 3/4.11 RADIOACTIVE EFFLUENTS

#### 3/4.11.1 LIQUID EFFLUENTS

##### CONCENTRATION

*Specification 3/4.11.1.1 Deleted*

##### LIMITING CONDITION FOR OPERATION

3.11.1.1 The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Figures 5.1-1 and 5.1-2) shall be limited to the concentrations specified in 10 CFR Part 20, Appendix B, Table II, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to  $2 \times 10^{-4}$  microcurie/ml total activity.

APPLICABILITY: At all times.

DELETED

##### ACTION:

- a. With the concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS exceeding the above limits, immediately restore the concentration to within the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

##### SURVEILLANCE REQUIREMENTS

4.11.1.1.1 Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 4.11-1.

4.11.1.1.2 The results of the radioactivity analyses shall be used in accordance with the methodology and parameters in the ODCM to assure that the concentrations at the point of release are maintained within the limits of Specification 3.11.1.1.

| TABLE 4.11-1<br>RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM |                           |                               |                                                |                                                        |
|------------------------------------------------------------------------|---------------------------|-------------------------------|------------------------------------------------|--------------------------------------------------------|
| LIQUID RELEASE TYPE                                                    | SAMPLING FREQUENCY        | MINIMUM ANALYSIS FREQUENCY    | TYPE OF ACTIVITY ANALYSIS                      | LOWER LIMIT OF DETECTION (LLD) <sup>(1)</sup> (μCi/ml) |
| 1. Batch Waste Release Tanks <sup>(2)</sup>                            | P<br>Each Batch           | P<br>Each Batch               | Principal Gamma Emitters <sup>(3)</sup>        | 5x10 <sup>-7</sup>                                     |
| a. Waste-Monitor Tank 1901-T6-009                                      | P                         | P                             | I-131                                          | 1x10 <sup>-6</sup>                                     |
|                                                                        | One Batch/M               | M                             | Dissolved and Entrained Gases (Gamma Emitters) | 1x10 <sup>-5</sup>                                     |
| b. Waste-Monitor Tank 1901-T6-010                                      | P                         | M                             | H-3                                            | 1x10 <sup>-5</sup>                                     |
|                                                                        | Each Batch                | Composite <sup>(4)</sup>      | Gross Alpha                                    | 1x10 <sup>-7</sup>                                     |
| c. Drainage of Systems                                                 | P                         | Q                             | Sr-89, Sr-90                                   | 5x10 <sup>-8</sup>                                     |
|                                                                        | Each Batch                | Composite <sup>(4)</sup>      | Fe-55                                          | 1x10 <sup>-6</sup>                                     |
| 2. Continuous Releases <sup>(5)</sup>                                  | Continuous <sup>(6)</sup> | W<br>Composite <sup>(6)</sup> | Principal Gamma Emitters <sup>(3)</sup>        | 5x10 <sup>-7</sup>                                     |
| a. Waste Water Retention Basin                                         | M                         | M                             | I-131                                          | 1x10 <sup>-6</sup>                                     |
|                                                                        | Grab Sample               | M                             | Dissolved and Entrained Gases (Gamma Emitters) | 1x10 <sup>-5</sup>                                     |
|                                                                        | Continuous <sup>(6)</sup> | M<br>Composite <sup>(6)</sup> | H-3                                            | 1x10 <sup>-5</sup>                                     |
|                                                                        |                           |                               | Gross Alpha                                    | 1x10 <sup>-7</sup>                                     |
|                                                                        | Continuous <sup>(6)</sup> | Q<br>Composite <sup>(6)</sup> | Sr-89, Sr-90                                   | 1x10 <sup>-8</sup>                                     |
|                                                                        |                           |                               | Fe-55                                          | 1x10 <sup>-6</sup>                                     |

TABLE 4.11-1 (Continued)

TABLE NOTATIONS

- (1) The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

DELETED

LLD = the "a priori" lower limit of detection (microCurie per unit mass or volume),

$s_b$  = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),

E = the counting efficiency (counts per disintegration),

V = the sample size (units of mass or volume),

$2.22 \times 10^6$  = the number of disintegrations per minute per microCurie,

Y = the fractional radiochemical yield, when applicable,

$\lambda$  = the radioactive decay constant for the particular radionuclide ( $\text{sec}^{-1}$ ), and

$\Delta t$  = the elapsed time between the midpoint of sample collection and the time of counting (sec).

Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

- (2) A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed by a method described in the ODCM to assure representative sampling.

TABLE 4.11-1 (Continued)

TABLE NOTATION (Continued)

- (3) The principal gamma emitters for which the LLD specification applies include the following radionuclides: Mn-54, Fe-55, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, and Ce-141. Ce-144 shall also be measured, but with an LLD of  $5 \times 10^{-6}$ . This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Semiannual Radioactive Effluent Release Report pursuant to Specification 6.8.1.4 in the format outlined in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.
- (4) A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen that is representative of the liquids released.
- (5) A continuous release is the discharge of liquid wastes of a nondiscrete volume, e.g., from a volume of a system that has an input flow during the continuous release. This will not be considered a continuous release point until there is a confirmed primary to secondary release, it will be a continuous release until the leak is repaired. This surveillance will continue until three consecutive weekly composite samples show no activity above LLD.
- (6) To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be collected continuously in proportion to the rate of flow of the effluent stream. Prior to analyses, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.

DELETED



## RADIOACTIVE EFFLUENTS

### DOSE

Specification 3/4.11.1.2 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.1.2 The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each unit, to UNRESTRICTED AREAS (see Figures 5.1-1 and 5.1-2) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the whole body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the whole body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times.

#### ACTION:

DELETED

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.8.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.1.2 Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

## RADIOACTIVE EFFLUENTS

### LIQUID RADWASTE TREATMENT SYSTEM

Specification 3/4.11.1.3 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.1.3 The Liquid Radwaste Treatment System shall be OPERABLE and appropriate portions of the system shall be used to reduce releases of radioactivity when the projected doses due to the liquid effluent, from each unit, to UNRESTRICTED AREAS (see Figures 5.1-1 and 5.1-2) would exceed 0.06 mrem to the whole body or 0.2 mrem to any organ in a 31-day period.

APPLICABILITY: At all times.

#### ACTION:

DELETED

- a. With radioactive liquid waste being discharged without treatment and in excess of the above limits and any portion of the Liquid Radwaste Treatment System not in operation, prepare and submit to the Commission within 30 days, pursuant to Specification 6.8.2, a Special Report that includes the following information:
  1. Explanation of why liquid radwaste was being discharged without treatment, identification of any inoperable equipment or subsystems, and the reason for the inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.1.3.1 Doses due to liquid releases from each unit to UNRESTRICTED AREAS shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM when Liquid Radwaste Treatment Systems are not being fully utilized.

4.11.1.3.2 The installed Liquid Radwaste Treatment System shall be considered OPERABLE by meeting Specifications 3.11.1.1 and 3.11.1.2.



## RADIOACTIVE EFFLUENTS

### 3/4.11.2 GASEOUS EFFLUENTS

#### DOSE RATE

Specification 3/4.11.2.1 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.2.1 The dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-2) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the whole body and less than or equal to 3000 mrem/yr to the skin, and
- b. For Iodine-131, for Iodine-133, for tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

DELETED

#### ACTION:

- a. With the dose rate(s) exceeding the above limits, immediately restore the release rate to within the above limit(s).
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.1.1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM.

4.11.2.1.2 The dose rate due to Iodine-131, Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 4.11-2.

TABLE 4.11-2

## RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

| GASEOUS RELEASE TYPE                                    | SAMPLING FREQUENCY                 | MINIMUM ANALYSIS FREQUENCY             | TYPE OF ACTIVITY ANALYSIS    | LOWER LIMIT OF DETECTION (LLD) (1)<br>( $\mu\text{Ci/ml}$ ) |
|---------------------------------------------------------|------------------------------------|----------------------------------------|------------------------------|-------------------------------------------------------------|
| 1. Waste Gas Decay Tank                                 | P<br>Each Tank<br>Grab Sample      | P<br>Each Tank                         | Principal Gamma Emitters (2) | $1 \times 10^{-4}$                                          |
| 2. Containment Purge<br>24" or 14"                      | P<br>Each PURGE (3)<br>Grab Sample | P<br>Each PURGE (3)                    | Principal Gamma Emitters (2) | $1 \times 10^{-4}$                                          |
|                                                         |                                    | M                                      | H-3 (oxide)                  | $1 \times 10^{-6}$                                          |
| 3. a. Plant Vent                                        | M (3), (4), (5)<br>Grab Sample     | M (3)                                  | Principal Gamma Emitters (2) | $1 \times 10^{-4}$                                          |
|                                                         |                                    |                                        | H-3 (oxide)                  | $1 \times 10^{-6}$                                          |
| b. Condenser Air<br>Ejector &<br>Steam Packing Exhaust* | M (8)<br>Grab Sample               | M                                      | Principal Gamma Emitters (2) | $1 \times 10^{-4}$                                          |
|                                                         |                                    |                                        | H-3 (oxide)                  | $1 \times 10^{-6}$                                          |
| 4. All Release Types<br>as listed in 3 above*           | Continuous (6)                     | W (7)<br>Charcoal<br>Sample            | I-131                        | $1 \times 10^{-12}$                                         |
|                                                         | Continuous (6)                     | W (7)<br>Particulate<br>Sample         | Principal Gamma Emitters (2) | $1 \times 10^{-11}$                                         |
|                                                         | Continuous (6)                     | M<br>Composite Par-<br>ticulate Sample | Gross Alpha                  | $1 \times 10^{-11}$                                         |
|                                                         | Continuous (6)                     | Q<br>Composite Par-<br>ticulate Sample | Sr-89, Sr-90                 | $1 \times 10^{-11}$                                         |

DELETED

TABLE 4.11-2 (Continued)

## TABLE NOTATIONS

\* 3b may be omitted provided the absence of a primary to secondary leak has been demonstrated; that is, the gamma activity in the secondary water does not exceed background by more than 20%.

- (1) The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

DELETED

Where:

LLD = the "a priori" lower limit of detection (microCurie per unit mass or volume),

$s_b$  = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),

$E$  = the counting efficiency (counts per disintegration),

$V$  = the sample size (units of mass or volume),

$2.22 \times 10^6$  = the number of disintegrations per minute per microCurie,

$Y$  = the fractional radiochemical yield, when applicable,

$\lambda$  = the radioactive decay constant for the particular radionuclide ( $\text{sec}^{-1}$ ), and

$\Delta t$  = the elapsed time between the midpoint of sample collection and time of counting (sec).

Typical values of  $E$ ,  $V$ ,  $Y$ , and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

TABLE A.11-2 (Continued)

TABLE NOTATIONS (Continued)

- (2) The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, Xe-136 in noble gas releases and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, I-131, Cs-134, Cs-137, Ce-141 and Ce-144 in iodine and particulate releases. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Semiannual Radioactive Effluent Release Report pursuant to Specification 6.8.1.4 in the format outlined in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.
- (3) Sampling and analysis shall also be performed following shutdown, startup, or a THERMAL POWER change exceeding 15% of RATED THERMAL POWER within a 1-hour period. This requirement does not apply if (1) analysis shows that the Dose Equivalent I-131 concentration in the primary coolant has not increased more than a factor of 3; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3.
- (4) Tritium grab samples shall be taken at least once per 24 hours when the refueling canal is flooded. **DELETED**
- (5) Tritium grab samples shall be taken at least once per 7 days from the plant vent whenever spent fuel is in the spent fuel pool.
- (6) The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Specifications 3.11.2.1, 3.11.2.2, and 3.11.2.3.
- (7) Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing, or after removal from sampler. Sampling shall also be performed at least once per 24 hours for at least 7 days following each shutdown, startup, or THERMAL POWER change exceeding 15% of RATED THERMAL POWER within a 1-hour period and analyses shall be completed within 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. This requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3.
- (8) Sampling not required if the gamma activity in the secondary water does not exceed background by more than 20%.

## RADIOACTIVE EFFLUENTS

### DOSE - NOBLE GASES

Specification 3/4.11.2.2 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.2.2 The air dose due to noble gases released in gaseous effluents, from each unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-2) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation, and
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times.

#### ACTION

DELETED

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.8.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.2 Cumulative dose contributions for the current calendar quarter and current calendar year for noble gases shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.



## RADIOACTIVE EFFLUENTS

### DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIOACTIVE MATERIAL IN PARTICULATE FORM

Specification 3/4.11.2.3 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.2.3 The dose to a MEMBER OF THE PUBLIC from Iodine-131, Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-2) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

APPLICABILITY: At all times.

DELETED

#### ACTION:

- a. With the calculated dose from the release of Iodine-131, Iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.8.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.3 Cumulative dose contributions for the current calendar quarter and current calendar year for Iodine-131, Iodine-133, tritium and radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.



## RADIOACTIVE EFFLUENTS

### GASEOUS RADWASTE TREATMENT SYSTEM

Specification 3/4.11.2.4 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.2.4 The VENTILATION EXHAUST TREATMENT SYSTEM and the GASEOUS WASTE PROCESSING SYSTEM shall be OPERABLE and appropriate portions of these systems shall be used to reduce releases of radioactivity when the projected doses in 31 days due to gaseous effluent releases, from each unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-2) would exceed:

- a. 0.2 mrad to air from gamma radiation, or
- b. 0.4 mrad to air from beta radiation, or
- c. 0.3 mrem to any organ of a MEMBER OF THE PUBLIC.

APPLICABILITY: At all times.

DELETED

#### ACTION:

- a. With radioactive gaseous waste being discharged without treatment and in excess of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.8.2, a Special Report that includes the following information:
  1. Identification of any inoperable equipment or subsystems, and the reason for the inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.4 Doses due to gaseous releases from each unit to areas at and beyond the SITE BOUNDARY shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM when Gaseous Radwaste Treatment Systems are not being fully utilized.

## RADIOACTIVE EFFLUENTS

### 3/4.11.3 SOLID RADIOACTIVE WASTES

~~Specification 3/4.11.3 deleted~~

#### LIMITING CONDITION FOR OPERATION

3.11.3 Radioactive wastes shall be solidified or dewatered in accordance with the PROCESS CONTROL PROGRAM to meet shipping and transportation requirements during transit, and disposal site requirements when received at the disposal site.

APPLICABILITY: At all times.

#### ACTION:

DELETED

- a. With SOLIDIFICATION or dewatering not meeting disposal site and shipping and transportation requirements, suspend shipment of the inadequately processed wastes and correct the PROCESS CONTROL PROGRAM, the procedures, and/or the Solid Waste System as necessary to prevent recurrence.
- b. With SOLIDIFICATION or dewatering not performed in accordance with the PROCESS CONTROL PROGRAM, test the improperly processed waste in each container to ensure that it meets burial ground and shipping requirements and take appropriate administrative action to prevent recurrence.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.3 SOLIDIFICATION of at least one representative test specimen from at least every tenth batch of each type of wet radioactive wastes (e.g., filter sludges, spent resins, evaporator bottoms, boric acid solutions, and sodium sulfate solutions) shall be verified in accordance with the PROCESS CONTROL PROGRAM:

- a. If any test specimen fails to verify SOLIDIFICATION, the SOLIDIFICATION of the batch under test shall be suspended until such time as additional test specimens can be obtained, alternative SOLIDIFICATION parameters can be determined in accordance with the PROCESS CONTROL PROGRAM, and a subsequent test verifies SOLIDIFICATION. SOLIDIFICATION of the batch may then be resumed using the alternative SOLIDIFICATION parameters determined by the PROCESS CONTROL PROGRAM;
- b. If the initial test specimen from a batch of waste fails to verify SOLIDIFICATION, the PROCESS CONTROL PROGRAM shall provide for the collection and testing of representative test specimens from each consecutive batch of the same type of wet waste until at least three consecutive initial test specimens demonstrate SOLIDIFICATION. The PROCESS CONTROL PROGRAM shall be modified as required, as provided in Specification 6.12, to assure SOLIDIFICATION of subsequent batches of waste; and
- c. With the installed equipment incapable of meeting Specification 3.11.3 or declared inoperable, restore the equipment to OPERABLE status or provide for contract capability to process wastes as necessary to satisfy all applicable transportation and disposal requirements.

## RADIOACTIVE EFFLUENTS

### 3/4.11.4 TOTAL DOSE

Specification 3/4.11.4 Deleted

#### LIMITING CONDITION FOR OPERATION

3.11.4 The annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the whole body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrem.

APPLICABILITY: At all times.

ACTION:

DELETED

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Specification 3.11.1.2a., 3.11.1.2b., 3.11.2.2a., 3.11.2.2b., 3.11.2.3a., or 3.11.2.3b., calculations shall be made including direct radiation contributions from the unit (including outside storage tanks etc.) to determine whether the above limits of Specification 3.11.4 have been exceeded. If such is the case, prepare and submit to the Commission within 30 days, pursuant to Specification 6.6.2, a Special Report that defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.405(c), shall include an analysis that estimates the radiation exposure (dose) to a MEMBER OF THE PUBLIC from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentrations of radioactive material involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR Part 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR Part 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.

- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

- 4.11.4.1 Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with Specifications 4.11.1.2, 4.11.2.2, and 4.11.2.3, and in accordance with the methodology and parameters in the ODCM.
- 4.11.4.2 Cumulative dose contributions from direct radiation from each unit (including outside storage tanks etc.) shall be determined in accordance with the methodology and parameters in the ODCM. This requirement is applicable only under conditions set forth in ACTION a. of Specification 3.11.4.

### 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

#### 3/4.12.1 MONITORING PROGRAM

Specification 3/4.12.1 Deleted

#### LIMITING CONDITION FOR OPERATION

3.12.1 The Radiological Environmental Monitoring Program shall be conducted as specified in Table 3.12-1.

APPLICABILITY: At all times.

ACTION:

DELETED

- a. With the Radiological Environmental Monitoring Program not being conducted as specified in Table 3.12-1, prepare and submit to the Commission, in the Annual Radiological Environmental Surveillance Report required by Specification 6.8.1.3, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. With the confirmed\*\* level of radioactivity as the result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 3.12-2 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days, pursuant to Specification 6.8.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose\* to a MEMBER OF THE PUBLIC is less than the calendar year limits of Specifications 3.11.1.2, 3.11.2.2, or 3.11.2.3. When more than one of the radionuclides in Table 3.12-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting level (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table 3.12-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose\* to a MEMBER OF THE PUBLIC from all radionuclides is equal to or greater than the calendar year limits of Specification 3.11.1.2, 3.11.2.2, or 3.11.2.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Surveillance Report required by Specification 6.8.1.3.

\*The methodology and parameters used to estimate the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

\*\*A confirmatory reanalysis of the original, a duplicate, or a new sample may be desirable or appropriate. The results of the confirmatory analysis shall be completed at the earliest time consistent with the analysis but in any case within 30 days.

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### LIMITING CONDITION FOR OPERATION

#### ACTION (Continued)

DELETED

- c. With milk or vegetation samples unavailable from one or more of the sample locations required by Table 3.12-1, identify specific locations for obtaining replacement samples and add them within 30 days to the Radiological Environmental Monitoring Program given in the ODCM. The specific locations from which samples were unavailable may then be deleted from the monitoring program. Pursuant to Specification 6.13, submit in the next Semiannual Radioactive Effluent Release Report documentation for a change in the ODCM including a revised figure(s) and table for the ODCM reflecting the new location(s) with supporting information identifying the cause of the unavailability of samples and justifying the selection of the new location(s) for obtaining samples.
- d. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.12.1 The radiological environmental monitoring samples shall be collected pursuant to Table 3.12-1 from the specific locations given in the table and figure(s) in the ODCM, and shall be analyzed pursuant to the requirements of Table 3.12-1 and the detection capabilities required by Table 4.12-1.

TABLE 3.12-1

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAMEXPOSURE PATHWAY  
AND/OR SAMPLENUMBER OF  
REPRESENTATIVE  
SAMPLES AND  
SAMPLE LOCATIONS (1)SAMPLING AND  
COLLECTION FREQUENCYTYPE AND FREQUENCY  
OF ANALYSIS

## 1. Direct Radiation (2)

Thirty-six routine monitoring stations either with two or more dosimeters or with one instrument for measuring and recording dose rate continuously, placed as follows:

An inner ring of stations, one in each meteorological sector in the general area of the SITE BOUNDARY;

An outer ring of stations, one in each meteorological sector in the 6 mile range from the site; and

The balance of the stations to be placed in special interest areas such as population centers, nearby residences, schools, and in one or two areas to serve as control stations.

Quarterly.

Gamma dose quarterly.

DELETED



TABLE 3.12-1 (Continued)

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

VOGTE UNITS - 1 & 2

3/4 12-4

| EXPOSURE PATHWAY<br>AND/OR SAMPLE                  | NUMBER OF<br>REPRESENTATIVE<br>SAMPLES AND<br>SAMPLE LOCATIONS <sup>(1)</sup>                                                                                                                                                                                                                                                                                                                       | SAMPLING AND<br>COLLECTION FREQUENCY                                                                               | TYPE AND FREQUENCY<br>OF ANALYSIS                                                                                                                                                                                                                |
|----------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 2. Airborne<br><br>Radioiodine and<br>Particulates | <p>Samples from five locations</p> <p>Three samples from close to the three SITE BOUNDARY locations, in different sectors;</p> <p>One sample from the vicinity of a community having the highest calculated annual average groundlevel D/Q; and</p> <p>One sample from a control location, as for example a population center 10 to 20 miles distant and in the least prevalent wind direction.</p> | <p>Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading.</p> | <p>Radioiodine Canister:<br/>I-131 analysis weekly.</p> <p>Particulate Sampler:<br/>Gross beta radioactivity analysis following filter change;<sup>(3)</sup> and gamma isotopic analysis<sup>(4)</sup> of composite (by location) quarterly.</p> |
| 3. Waterborne<br><br>a. Surface <sup>(5)</sup>     | <p>One sample upstream</p> <p>One sample downstream</p>                                                                                                                                                                                                                                                                                                                                             | <p>Composite sample over 1-month period.<sup>(6)</sup></p>                                                         | <p>Gamma isotopic analysis<sup>(4)</sup> monthly. Composite for Cesium analysis quarterly.</p>                                                                                                                                                   |

DELETED

TABLE 3.12-1 (Continued)

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

| EXPOSURE PATHWAY<br>AND/OR SAMPLE | NUMBER OF<br>REPRESENTATIVE<br>SAMPLES AND<br>SAMPLE LOCATIONS <sup>(1)</sup>                                                                                                                                                                                                                                       | SAMPLING AND<br>COLLECTION FREQUENCY                                                                                                                                                                                                                                                 | TYPE AND FREQUENCY<br>OF ANALYSIS                                                                                                                                                                                                                               |
|-----------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 3. Waterborne (Continued)         |                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                                                                                                                                                      |                                                                                                                                                                                                                                                                 |
| b. Drinking                       | Two samples at each of one to three of the nearest water treatment plants that could be affected by its discharge.<br><br>Two samples at a control location.                                                                                                                                                        | Composite sample of river water near intake at each water treatment plant over 2-week period <sup>(6)</sup> when I-131 analysis is performed, monthly composite otherwise; and grab sample of finished water at each water treatment plant every 2 weeks or monthly, as appropriate. | I-131 analysis on each sample when the dose calculated for the consumption of the water is greater than 1 mrem per year <sup>(7)</sup> . Composite for gross beta and gamma isotopic analyses <sup>(4)</sup> monthly. Composite for tritium analysis quarterly. |
| c. Sediment from Shoreline        | One sample from downstream area with existing or potential recreational value.                                                                                                                                                                                                                                      | Semiannually.                                                                                                                                                                                                                                                                        | Gamma isotopic analysis <sup>(4)</sup> semiannually.                                                                                                                                                                                                            |
| 4. Ingestion                      |                                                                                                                                                                                                                                                                                                                     |                                                                                                                                                                                                                                                                                      |                                                                                                                                                                                                                                                                 |
| a. Milk                           | Samples from milking animals in three locations within 3 miles distance having the highest dose potential. If there are none, then one sample from milking animals <sup>(8)</sup> in each of three areas between 3 and 5 miles distance where doses are calculated to be greater than 1 mrem per yr. <sup>(7)</sup> | Semimonthly.                                                                                                                                                                                                                                                                         | Gamma isotopic <sup>(4,9)</sup> analysis semimonthly                                                                                                                                                                                                            |

DELETED

TABLE 3.12-1 (Continued)

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

| EXPOSURE PATHWAY<br>AND/OR SAMPLE | NUMBER OF<br>REPRESENTATIVE<br>SAMPLES AND<br>SAMPLE LOCATIONS <sup>(1)</sup>                                                                                                                                                                                                                | SAMPLING AND<br>COLLECTION FREQUENCY                                                                       | TYPE AND FREQUENCY<br>OF ANALYSIS                                                                                                       |
|-----------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------|
| 4. Ingestion (Continued)          |                                                                                                                                                                                                                                                                                              |                                                                                                            |                                                                                                                                         |
| a. Milk                           | One sample from milking animals <sup>(8)</sup> at a control location about 10 miles distant or beyond and preferably in a wind direction of lower prevalence.                                                                                                                                |                                                                                                            |                                                                                                                                         |
| b. Fish                           | At least one sample of any commercially and recreationally important species in vicinity of plant discharge area.<br><br>At least one sample of any species in areas not influenced by plant discharge.<br><br>At least one sample of any anadromous species in vicinity of plant discharge. | Semiannually.                                                                                              | Gamma isotopic analysis <sup>(4)</sup> on edible portions.                                                                              |
| c. Grass or Leafy Vegetation      | One sample from two onsite locations near the SITE BOUNDARY in different sectors.<br><br>One sample from a control location at about 15 miles distance.                                                                                                                                      | During spring spawning season.<br><br>Monthly during growing season.<br><br>Monthly during growing season. | Gamma isotopic analyses <sup>(4)</sup> on edible portion.<br><br>Gamma isotopic <sup>(4,9)</sup><br><br>Gamma isotopic <sup>(4,9)</sup> |

DELETED

TABLE 3.12-1 (Continued)

TABLE NOTATIONS

DELETED

- (1) Specific parameters of distance and direction sector from a point midway between the center of the two reactors, and additional description where pertinent, shall be provided for each and every sample location in Table 3.12-1 in a table and figure(s) in the ODCM. Each sample location will be designated by a number, name or some other label. Refer to NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants," October 1978, and to Radiological Assessment Branch Technical Position, Revision 1, November 1979. Deviations are permitted from the required sampling schedule if specimens are unobtainable due to circumstances such as hazardous conditions, seasonal unavailability, and malfunction of sampling equipment. If specimens are unobtainable due to sampling equipment malfunction, effort shall be made to complete corrective action prior to the end of the next sampling period. All deviations from the sampling schedule shall be documented in the Annual Radiological Environmental Surveillance Report pursuant to Specification 6.8.1.3. It is recognized that, at times, it may not be possible or practicable to continue to obtain samples of the media of choice at the most desired location or time. In these instances suitable alternative media and locations may be chosen for the particular pathway in question and appropriate substitutions, if available, will be made within 30 days in the Radiological Environmental Monitoring Program given in the ODCM. Pursuant to Specification 6.13, submit in the next Semiannual Radioactive Effluent Release Report documentation for a change in the ODCM including a revised figure(s) and table for the ODCM reflecting the new location(s), if any, with supporting information identifying the cause of the unavailability of samples for the pathway and justifying the selection of the new location(s) for obtaining samples, or the unavailability of suitable new locations.
- (2) One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purposes of this table, a thermoluminescent dosimeter (TLD) is considered to be one phosphor; two or more phosphors in a packet are considered as two or more dosimeters. Film badges shall not be used as dosimeters for measuring direct radiation.
- (3) Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than 10 times the yearly mean of control samples, gamma isotopic analysis shall be performed on the individual samples.

TABLE 3.12-1 (Continued)

TABLE NOTATIONS (Continued)

DELETED

- (4) Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.
- (5) The "upstream sample" shall be taken at a distance beyond significant influence of the discharge. The "downstream" sample shall be taken in an area beyond but near the mixing zone.
- (6) Composite sample aliquots shall be collected at time intervals that are very short (e.g., hourly) relative to the compositing period (e.g., monthly) in order to assure obtaining a representative sample.
- (7) The dose shall be calculated for the maximum organ and age group, using the methodology and parameters in the ODCM.
- (8) A milking animal is a cow or goat producing milk for human consumption.
- (9) If gamma isotopic analysis is not sensitive enough to meet the lower Limit of Detection for I-131, a separate analysis for I-131 will be performed.

TABLE 3.12-2

## REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES

## REPORTING LEVELS

| ANALYSIS | WATER<br>(pCi/l) | AIRBORNE PARTICULATE<br>OR GASES (pCi/m <sup>3</sup> ) | FISH<br>(pCi/kg, wet) | MILK<br>(pCi/l) | GRASS OR LEAFY<br>VEGETATION<br>(pCi/kg, wet) |
|----------|------------------|--------------------------------------------------------|-----------------------|-----------------|-----------------------------------------------|
| H-3      | 20,000*          |                                                        |                       |                 |                                               |
| Mn-54    | 1,000            |                                                        | 30,000                |                 |                                               |
| Fe-59    | 400              |                                                        | 10,000                |                 |                                               |
| Co-58    | 1,000            |                                                        | 30,000                |                 |                                               |
| Co-60    | 300              |                                                        | 10,000                |                 |                                               |
| Zn-65    | 300              |                                                        | 20,000                |                 |                                               |
| Zr-95    | 400              |                                                        |                       |                 |                                               |
| Nb-95    | 400              |                                                        |                       |                 |                                               |
| I-131    | 2                | 0.9                                                    |                       | 3               | 100                                           |
| Cs-134   | 30               | 10                                                     | 1,000                 | 60              | 1,000                                         |
| Cs-137   | 50               | 20                                                     | 2,000                 | 70              | 2,000                                         |
| Ba-140   | 200              |                                                        |                       | 200             |                                               |
| La-140   | 100              |                                                        |                       | 300             |                                               |

DELETED

\*For drinking water samples. This is 40 CFR Part 141 value. If no drinking water pathway exists, a value of 30,000 pCi/l may be used.



TABLE 4.12-1

DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS<sup>(1) (2)</sup>LOWER LIMIT OF DETECTION (LLD)<sup>(3)</sup>

| ANALYSIS   | WATER<br>(pCi/l) | AIRBORNE PARTICULATE<br>OR GASES (pCi/m <sup>3</sup> ) | FISH<br>(pCi/kg, wet) | MILK<br>(pCi/l) | GRASS OR LEAFY<br>VEGETATION<br>(pCi/kg, wet) | SEDIMENT<br>(pCi/kg, dry) |
|------------|------------------|--------------------------------------------------------|-----------------------|-----------------|-----------------------------------------------|---------------------------|
| Gross Beta | 4                | 0.01                                                   |                       |                 |                                               |                           |
| H-3        | 2000*            |                                                        |                       |                 |                                               |                           |
| Mn-54      | 15               |                                                        | 130                   |                 |                                               |                           |
| Fe-59      | 30               |                                                        | 260                   |                 |                                               |                           |
| Co-58      | 15               |                                                        | 130                   |                 |                                               |                           |
| Co-60      | 15               |                                                        | 130                   |                 |                                               |                           |
| Zn-65      | 30               |                                                        | 260                   |                 |                                               |                           |
| Zr-95      | 30               |                                                        |                       |                 |                                               |                           |
| Nb-95      | 15               |                                                        |                       |                 |                                               |                           |
| I-131      | 1**              | 0.07                                                   |                       | 1               | 60                                            |                           |
| Cs-134     | 15               | 0.05                                                   | 130                   | 15              | 60                                            | 150                       |
| Cs-137     | 18               | 0.06                                                   | 150                   | 18              | 80                                            | 180                       |
| Ba-140     | 60               |                                                        |                       | 60              |                                               |                           |
| La-140     | 15               |                                                        |                       | 15              |                                               |                           |

DELETED

\*If no drinking water pathway exists, a value of 3000 pCi/l may be used.

\*\*If no drinking water pathway exists, a value of 15 pCi/l may be used.

TABLE 4.12-1 (Continued)

## TABLE NOTATIONS

DELETED

- (1) This list does not mean that only these nuclides are to be considered. Other peaks that are identifiable as plant effluents, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Surveillance Report pursuant to Specification 6.8.1.3.
- (2) Required detection capabilities for thermoluminescent dosimeters used for environmental measurements shall be in accordance with the recommendations of Regulatory Guide 4.13.
- (3) The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

- LLD = the "a priori" lower limit of detection (picoCuries per unit mass or volume),
- $s_b$  = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),
- E = the counting efficiency (counts per disintegration),
- V = the sample size (units of mass or volume),
- 2.22 = the number of disintegrations per minute per picoCurie,
- Y = the fractional radiochemical yield, when applicable,
- $\lambda$  = the radioactive decay constant for the particular radionuclide ( $\text{sec}^{-1}$ ), and
- $\Delta t$  = the elapsed time between sample collection, or end of the sample collection period, and time of counting (sec).

Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

TABLE 4.12-1 (Continued)

TABLE NOTATIONS (Continued)

DELETED

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Surveillance Report pursuant to Specification 6.8.1.3.

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.2 LAND USE CENSUS

~~Specification 3/4.12.2 Deleted~~

#### LIMITING CONDITION FOR OPERATION

3.12.2 A Land Use Census shall be conducted and shall identify within a distance of 5 miles the location in each of the 16 meteorological sectors of the nearest milk animal, the nearest residence, and the nearest garden of greater than 500 ft<sup>2</sup> producing broad leaf vegetation. Land within the Savannah River Plant may be excluded from this survey.

APPLICABILITY: At all times.

DELETED

#### ACTION:

- a. With a Land Use Census identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated in Specification 4.11.2.3, pursuant to Specification 6.8.1.4, identify the new location(s) in the next Semiannual Radioactive Effluent Release Report.
- b. With a Land Use Census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained in accordance with Specification 3.12.1, add the new location(s) within 30 days to the Radiological Environmental Monitoring Program given in the ODCM, if samples are available. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may then be deleted from this monitoring program. Pursuant to Specification 6.13, submit in the next Semiannual Radioactive Effluent Release Report documentation for a change in the ODCM including a revised figure(s) and table(s) for the ODCM reflecting the new location(s) with information supporting the change in sampling locations.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.12.2 The Land Use Census shall be conducted during the growing season at least once per 12 months using that information that will provide good results, such as by a door-to-door survey, by visual survey from automobile or aircraft, by consulting local agriculture authorities, or by some combination of these methods as feasible. The results of the Land Use Census shall be included in the Annual Radiological Environmental Surveillance Report pursuant to Specification 6.8.1.3.

RADIOLOGICAL ENVIRONMENTAL MONITORING

3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

Specification 3/4.12.3 Deleted

LIMITING CONDITION FOR OPERATION

3.12.3 Analyses shall be performed on all radioactive materials, supplied as part of an Interlaboratory Comparison Program that has been approved by the Commission, that correspond to samples and analysis required by Table 3.12-1.

APPLICABILITY: At all times.

DELETED

ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Surveillance Report pursuant to Specification 6.8.1.3.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.12.3 The Interlaboratory Comparison Program shall be described in the ODCM. A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Surveillance Report pursuant to Specification 6.8.1.3.

## INSTRUMENTATION

### BASES

#### REMOTE SHUTDOWN SYSTEM (Continued)

outside of the control room. This capability is required in the event control room habitability is lost and is consistent with General Design Criterion 19 of 10 CFR Part 50.

The OPERABILITY of the Remote Shutdown System ensures that a fire will not preclude achieving safe shutdown. The Remote Shutdown System instrumentation, control, and transfer switches necessary to eliminate effects of the fire and allow operation of instrumentation, and control circuits required to achieve and maintain a safe shutdown condition are independent of areas where a fire could damage systems normally used to shut down the reactor. This capability is consistent with General Design Criterion 3 and CH&B 9.5.1.

#### 3/4.3.3.6 ACCIDENT MONITORING INSTRUMENTATION

The OPERABILITY of the accident monitoring instrumentation ensures that sufficient information is available on selected plant parameters to monitor and assess these variables following an accident. This capability is consistent with the recommendations of Regulatory Guide 1.97, "Instrumentation for Light-Water-Cooled Nuclear Power Plants to Assess Plant Conditions During and Following an Accident," Revision 2, December 1980 and NUREG-0737, "Clarification of TMI Action Plan Requirements," November 1980. The instrumentation listed in Table 3.3-8 corresponds to the Category 1 instrumentation for which selection, design, qualification and display criteria are described in Regulatory Guide 1.97, Rev. 2.

#### 3/4.3.3.7 CHLORINE DETECTION SYSTEMS

The OPERABILITY of the Chlorine Detection Systems ensures that sufficient capability is available to promptly detect and initiate protective action in the event of an accidental chlorine release. This capability is required to protect control room personnel and is consistent with the recommendations of Regulatory Guide 1.95, Revision 1, "Protection of Nuclear Power Plant Control Room Operators Against an Accidental Chlorine Release," January 1977.

This capability will not be required if the quantity of chlorine gas stored on site is small (< 20 lbs.) and utilized for laboratory and calibration purposes. This applicability is consistent with the exclusions and recommendations of Regulatory Guide 1.95, Revision 1, "Protection of Nuclear Power Plant Control Room Operators Against an Accidental Chlorine Release," January 1977.

#### 3/4.3.3.8 LOOSE PARTS DETECTION SYSTEM

Not used.

#### 3/4.3.3.9 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

~~Not used.~~

~~A radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid~~



## INSTRUMENTATION

### BASES

#### 3/4.3.3.9 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION (Continued)

~~DELETED~~  
effluents during actual or potential releases of liquid effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

#### EXPLOSIVE GAS RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

~~Radioactive gaseous effluent instrumentation is provided to monitor and, if available, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. This instrumentation includes provisions for monitoring (and controlling) the concentrations of potential explosive gas mixtures in the GASEOUS WASTE PROCESSING SYSTEM. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50. The sensitivity of any noble gas activity monitors used to show compliance with the gaseous effluent release requirements of Specification 3.11.2.2 shall be such that concentrations as low as  $1 \times 10^{-6}$   $\mu\text{Ci}/\text{m}^3$  are measurable.~~

#### 3/4.3.3.11 HIGH ENERGY LINE BREAK ISOLATION SENSORS

The operability of the high energy line break isolation sensors ensures that the capability is available to promptly detect and initiate protective action in the event of a line break. This capability is required to prevent damage to safety-related systems and structures in the auxiliary building.

#### 3/4.3.4 TURBINE OVERSPEED PROTECTION

This specification is provided to ensure that the turbine overspeed protection instrumentation and the turbine speed control valves are OPERABLE and will protect the turbine from excessive overspeed. Protection from turbine excessive overspeed is required since excessive overspeed of the turbine could generate potentially damaging missiles which could impact and damage safety-related components, equipment or structures.

### 3/4.11 RADIOACTIVE EFFLUENTS

#### BASES

#### 3/4.11.1 LIQUID EFFLUENTS

##### 3/4.11.1.1 CONCENTRATION

Not used.

^ This specification is provided to ensure that the concentration of radioactive materials released in liquid waste effluents to UNRESTRICTED AREAS will be less than the concentration levels specified in 10 CFR Part 20, Appendix B, Table II, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water in UNRESTRICTED AREAS will result in exposures within: (1) the Section II.A design objectives of Appendix I, 10 CFR Part 50, to a MEMBER OF THE PUBLIC, and (2) the limits of 10 CFR Part 20.106(e) to the population. The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

This specification applies to the release of radioactive materials in liquid effluents from all units at the site.

DELETED

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

##### 3/4.11.1.2 DOSE

Not used.

^ This specification is provided to implement the requirements of Sections II.A, III.A, and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies that can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR Part 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of

DELETED

## RADIOACTIVE EFFLUENTS

### BASES

#### DOSE (Continued)

Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977. **DELETED**

This specification applies to the release of radioactive materials in liquid effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to LCOs, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

#### 3/4.11.1.3 LIQUID RADWASTE TREATMENT SYSTEM

Not used. The OPERABILITY of the Liquid Radwaste Treatment System ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the Liquid Radwaste Treatment System were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50 for liquid effluents. **DELETED**

This specification applies to the release of radioactive materials in liquid effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to LCOs, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

#### 3/4.11.1.4 LIQUID HOLDUP TANKS

The tanks listed in this specification include all those outdoor radwaste tanks that are not surrounded by liners, dikes, or walls capable of holding the tank contents and that do not have tank overflows and surrounding area drains connected to the Liquid Radwaste Treatment System.

Restricting the quantity of radioactive material contained in the specified tanks provides assurance that in the event of an uncontrolled release of the tank's contents, the resulting concentrations would be less than the limits of 10 CFR Part 20, Appendix B, Table II, Column 2, at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA.



## RADIOACTIVE EFFLUENTS

### BASES

#### 3/4.11.2 GASEOUS EFFLUENTS

##### 3/4.11.2.1 DOSE RATE

Not used.

~~This specification is provided to ensure that the dose at any time at and beyond the SITE BOUNDARY from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 to UNRESTRICTED AREAS. The annual dose limits are the doses associated with the concentrations of 10 CFR Part 20, Appendix B, Table II, Column I. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC in an UNRESTRICTED AREA, either within or outside the SITE BOUNDARY, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20.106(b)). For MEMBERS OF THE PUBLIC who may at times be within the SITE BOUNDARY, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrem/year to the whole body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.~~

~~DELETED~~

~~This specification applies to the release of radioactive materials in gaseous effluents from all units at the site.~~

~~The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination: Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).~~

##### 3/4.11.2.2 DOSE - NOBLE GASES

Not used.

~~This specification is provided to implement the requirements of Sections II.D, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section I.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a~~

## RADIOACTIVE EFFLUENTS

### BASES

#### DOSE - NOBLE GASES (Continued)

MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. The ODCM equations provided for determining the air doses at and beyond the SITE BOUNDARY are based upon the historical average atmospheric conditions.

DELETED

#### 3/4.11.2.3 DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIOACTIVE MATERIAL IN PARTICULATE FORM

Not used.

^ This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for Iodine-131, Iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days are dependent upon the existing radionuclide pathways to man in the areas at and beyond the SITE BOUNDARY. The pathways that were examined in the development of the calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and (4) deposition on the ground with subsequent exposure of man.

DELETED

## RADIOACTIVE EFFLUENTS

### BASES

#### 3/4.11.2.4 GASEOUS RADWASTE TREATMENT SYSTEM

~~Not used.~~

~~A The OPERABILITY of the GASEOUS WASTE PROCESSING SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.~~

*DELETED*

#### 3/4.11.2.5 EXPLOSIVE GAS MIXTURE

This specification is provided to ensure that the concentration of potentially explosive gas mixtures contained in the GASEOUS WASTE PROCESSING SYSTEM is maintained below the flammability limits of hydrogen and oxygen. Automatic control features are included in the system to prevent the hydrogen and oxygen concentrations from reaching these flammability limits. These automatic control features include isolation of the source of hydrogen and/or oxygen. Maintaining the concentration of hydrogen and oxygen below their flammability limits provides assurance that the releases of radioactive materials will be controlled in conformance with the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50.

#### 3/4 11.2.6 GAS DECAY TANKS

The tanks included in this specification are those tanks for which the quantity of radioactivity contained is not limited directly or indirectly by another Technical Specification. Restricting the quantity of radioactivity contained in each gas decay tank provides assurance that in the event of an uncontrolled release of the tank's contents, the resulting whole body exposure to a MEMBER OF THE PUBLIC at the nearest SITE BOUNDARY will not exceed 0.5 rem. This is consistent with Standard Review Plan 11.3, Branch Technical Position ETSB 11-5, "Postulated Radioactive Releases Due to a Waste Gas System Leak or Failure," in NUREG-0800, July 1981.



## RADIOACTIVE EFFLUENTS

### BASES

#### 3/4.11.3 SOLID RADIOACTIVE WASTES

Not used.

~~^ This specification implements the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50. The process parameters included in establishing the PROCESS CONTROL PROGRAM may include, but are not limited to, waste type, waste pH, waste/liquid/SOLIDIFICATION agent/catalyst ratios, waste oil content, waste principal chemical constituents, and mixing and curing times.~~

#### 3/4.11.4 TOTAL DOSE

Not used.

~~^ This specification is provided to meet the dose limitations of 40 CFR Part 190 that have been incorporated into 10 CFR Part 20 by 46 FR 18525. The specification requires the preparation and submittal of a Special Report whenever the calculated doses due to releases of radioactivity and to radiation from uranium fuel cycle sources that directly support the production of electrical power for public use exceed 25 mrem to the whole body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrem. For sites containing up to four reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR Part 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the units including outside storage tanks, etc.) are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR Part 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR Part 190 have not already been corrected), in accordance with the provisions of 40 CFR 190.11 and 10 CFR 20.405c, is considered to be a timely request and fulfills the requirements of 40 CFR Part 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR Part 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR Part 20, as addressed in Specifications 3.11.1.1 and 3.11.2.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle.~~

DELETED

### 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

#### BASES

##### 3/4.12.1 MONITORING PROGRAM

Not used.

^ The Radiological Environmental Monitoring Program required by this specification provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposure of MEMBERS OF THE PUBLIC resulting from the plant operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the Radiological Effluent Monitoring Program by measuring concentrations of radioactive materials and levels of radiation that may be compared with those expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring, Revision 1, November 1979. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. Following this period, program changes may be initiated based on operational experience.

DELETED

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 4.12-1 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Detailed discussion of the LLD, and other detection limits, can be found in Currie, L.A., "Limits for Qualitative Detection and Quantitative Determination-Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

##### 3/4.12.2 LAND USE CENSUS

Not used.

^ This specification is provided to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the Radiological Environmental Monitoring Program are made if required by the results of this census. The best information from the door-to-door survey, from aerial survey or from consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 500 ft<sup>2</sup> provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and (2) a vegetation yield of 2 kg/m<sup>2</sup>.

DELETED

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### BASES

---

#### 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

~~Not used.~~

~~A The requirement for participation in an approved Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive materials in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix 1 to 10 CFR Part 50.~~



Figure 5.1-2 Effluent Release Points

## ADMINISTRATIVE CONTROLS

### PROCEDURES AND PROGRAMS (Continued)

- 1) Identification of a sampling schedule for the critical variables and control points for these variables,
- 2) Identification of the procedures used to measure the values of the critical variables,
- 3) Identification of process sampling points,
- 4) Procedures for the recording and management of data,
- 5) Procedures defining corrective actions for all off-control point chemistry conditions, and
- 6) A procedure identifying: (a) the authority responsible for the interpretation of the data, and (b) the sequence and timing of administrative events required to initiate corrective action.

#### d. Post-Accident Sampling

A program which will ensure the capability to obtain and analyze reactor coolant, radioactive iodines and particulates in plant gaseous effluents, and containment atmosphere samples under accident conditions. The program shall include the following:

- 1) Training of personnel,
- 2) Procedures for sampling and analysis, and
- 3) Provisions for maintenance of sampling and analysis equipment.

#### e. A program which will ensure the capability to monitor plant variables and systems operating status during and following an accident. This program shall include those instruments provided to indicate system operating status and furnish information regarding the release of radioactive materials (Category 2 and 3 instrumentation as defined in Regulatory Guide 1.97 Revision 2) and provide the following:

- 1) preventive maintenance and periodic surveillance of instrumentation,
- 2) pre-planned operating procedures and back-up instrumentation to be used if one or more monitoring instruments become inoperable,
- 3) administrative procedures for returning inoperable instruments to OPERABLE status as soon as practicable.

f. & g. Insert 2



## INSERT 2

### f. Radioactive Effluent Controls Program

A program shall be provided conforming with 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to MEMBERS OF THE PUBLIC from radioactive effluents as low as reasonably achievable. The program (1) shall be contained in the ODCM, (2) shall be implemented by operating procedures, and (3) shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- 1) Limitations on the operability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM,
- 2) Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS conforming to 10 CFR Part 20, Appendix B, Table II, Column 2,
- 3) Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.106 and with the methodology and parameters in the ODCM,
- 4) Limitations on the annual and quarterly doses or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS conforming to Appendix I to 10 CFR Part 50,
- 5) Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days,
- 6) Limitations on the operability and use of the liquid and gaseous effluent treatment systems to ensure that the appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a 31-day period would exceed 2 percent of the guidelines for the annual dose or dose commitment conforming to Appendix I to 10 CFR Part 50,
- 7) Limitations on the dose rate resulting from radioactive material released in gaseous effluents to areas beyond the SITE BOUNDARY conforming to the doses associated with 10 CFR Part 20, Appendix B, Table II, Column 1,



## INSERT 2 (CONTINUED)

- 8) Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the SITE BOUNDARY conforming to Appendix I to 10 CFR Part 50,
- 9) Limitations on the annual and quarterly doses to a MEMBER OF THE PUBLIC from Iodine-131, Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released from each unit to areas beyond the SITE BOUNDARY conforming to Appendix I to 10 CFR Part 50, and
- 10) Limitations on the annual dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources conforming to 40 CFR Part 190.

### g. Radiological Environmental Monitoring Program

A program shall be provided to monitor the radiation and radionuclides in the environs of the plant. The program shall provide (1) representative measurements of radioactivity in the highest potential exposure pathways, and (2) verification of the accuracy of the effluent monitoring program and modeling of environmental exposure pathways. The program shall (1) be contained in the ODCM, (2) conform to the guidance of Appendix I to 10 CFR Part 50, and (3) include the following:

- 1) Monitoring, sampling, analysis, and reporting of radiation and radionuclides in the environment in accordance with the methodology and parameters in the ODCM,
- 2) A Land Use Census to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the monitoring program are made if required by the results of this census, and
- 3) Participation in a Interlaboratory Comparison Program to ensure that independent checks on the precision and accuracy of the measurements of radioactive materials in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring.

## ADMINISTRATIVE CONTROLS

### ANNUAL REPORTS (Continued)

- surveillance, inservice inspection, routine maintenance, special maintenance [describe maintenance], waste processing, and refueling). The dose assignments to various duty functions may be estimated based on pocket dosimeter, thermoluminescent dosimeter (TLD), or film badge measurements. Small exposures totalling less than 20% of the individual total dose need not be accounted for. In the aggregate, at least 80% of the total whole-body dose received from external sources should be assigned to specific major work functions;
- b. The results of specific activity analyses in which the primary coolant exceeded the limits of Specification 3.4.8. The following information shall be included: (1) Reactor power history starting 48 hours prior to the first sample in which the limit was exceeded (in graphic and tabular format); (2) Results of the last isotopic analysis for radioiodine performed prior to exceeding the limit, results of analysis while limit was exceeded and results of one analysis after the radioiodine activity was reduced to less than limit. Each result should include date and time of sampling and the radioiodine concentrations; (3) Clean-up flow history starting 48 hours prior to the first sample in which the limit was exceeded; (4) Graph of the I-131 concentration ( $\mu\text{Ci/gm}$ ) and one other radioiodine isotope concentration ( $\mu\text{Ci/gm}$ ) as a function of time for the duration of the specific activity above the steady-state level; and (5) The time duration when the specific activity of the primary coolant exceeded the radioiodine limit.
- c. A report shall be prepared and submitted to the commission on an annual basis if sealed source or fission detector leakage tests reveal the presence of greater than or equal to 0.005 microcuries of removable contamination.

### ANNUAL RADIOLOGICAL ENVIRONMENTAL SURVEILLANCE REPORT\*\*\*

Insert 3

6.8.1.3 ~~Routine Annual Radiological Environmental Surveillance Reports covering activities of the Radiological Environmental Monitoring Program during the previous calendar year shall be submitted prior to May 1 of each year. The initial report shall be submitted prior to May 1 of the year following initial criticality and shall include copies of reports of the preoperational Radiological Environmental Monitoring Program of the plant for at least two years prior to initial criticality.~~

DELETED

The Annual Radiological Environmental Surveillance Report shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including, as appropriate, a comparison with preoperational studies, with operational controls, and with previous environmental surveillance reports, and an assessment of any observed impacts of plant operations on the environment. The report shall also include the results of the Land Use Census required by Specification 3.12.2.

\*\*\*A single submittal may be made for Units 1 and 2.

INSERT 3

The Annual Radiological Environmental Surveillance Report covering the operation of the unit during the previous calendar year shall be submitted before May 1 of each year. The report shall include summaries, interpretations, and analysis of trends of the results of the Radiological Environmental Monitoring Program for the reporting period. The material provided shall be consistent with the objectives outlined in (1) the ODCM and (2) Sections IV.B.2, IV.B.3, and IV.C of Appendix I to 10 CFR Part 50.

## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOLOGICAL ENVIRONMENTAL SURVEILLANCE REPORT (Continued)

The Annual Radiological Environmental Surveillance Report shall include the results of analysis of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the table and figures in the Offsite Dose Calculation Manual, as well as summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. The radiological level of radionuclides which are naturally occurring not included in the plant effluents need not be reported. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as practicable in a supplementary report. **DELETED**

The report shall also include the following: a summary description of the Radiological Environmental Monitoring Program; at least two legible maps covering all sampling locations keyed to a table giving distances and directions from a point midway between the two reactors; the results of licensee participation in the Interlaboratory Comparison Program and the corrective action taken if the specified program is not being performed as required by Specification 3.12.2; reasons for not conducting the Radiological Environmental Monitoring Program as required by specification 3.12.1, and discussion of all deviations from the sampling schedule of Table 3.12-1; discussion of environmental sample measurements that exceed the reporting levels of Table 3.12-2 but are not the result of plant effluents, pursuant to ACTION b. of Specification 3.12.1; and discussion of all analyses in which the LLD required by Table 4.12-1 was not achieved.

### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT \*\*\*

#### Insert 4

6.8.1.4 ~~A Routine Semiannual Radioactive Effluent Release Report covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The period of the first report shall begin with the date of initial criticality.~~

The Semiannual Radioactive Effluent Release Reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof. For solid wastes, the format for Table 3 in Appendix B shall be supplemented with three additional categories: class of solid wastes (as defined by 10 CFR Part 61), type of container (e.g., LSA, Type A, Type B, Large Quantity) and SOLIDIFICATION agent or absorbent (e.g., cement, urea formaldehyde). **DELETED**

The Semiannual Radioactive Effluent Release Report to be submitted within 60 days after January 1 of each year shall include an annual summary of hourly

#### INSERT 4

The Semiannual Radioactive Effluent Release Report covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The material provided shall be (1) consistent with the objectives outlined in the ODCM and PCP and (2) in conformance with 10 CFR 50.36a and Section IV.B.1 of Appendix I to 10 CFR Part 50.

\*\*\*\* A single submittal may be made for Units 1 and 2. The submittal should combine those sections that are common to both units at the plant; however, the submittal shall specify the releases of gaseous and liquid radioactive material from each unit and of solid radioactive material from the site.



## ADMINISTRATIVE CONTROLS

### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)

meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability.\* This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from each unit during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figure 5.1-1) during the report period. All assumptions used in making these assessments, i.e., specific activity, exposure time, and location, shall be included in these reports. Historical annual average meteorological conditions or the meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents, as determined by sampling frequency and measurement, shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL (ODCM).

The Semiannual Radioactive Effluent Release Report to be submitted within 60 days after January 1 of each year shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other uranium fuel cycle sources within 8 km, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40 CFR Part 190, "Environmental Radiation Protection Standards for Nuclear Power Operation." Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1, October 1977.

DELETED

The Semiannual Radioactive Effluent Release Reports shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

The Semiannual Radioactive Effluent Release Reports shall include any changes made during the reporting period to the PROCESS CONTROL PROGRAM (PCP) and to the OFFSITE DOSE CALCULATION MANUAL (ODCM), pursuant to Specifications 6.12 and 6.13, respectively, as well as any major change to Liquid, Gaseous, or Solid Radwaste Treatment Systems pursuant to Specification 6.14. It shall also include a listing of new locations for dose calculations and/or environmental monitoring identified by the Land Use Census pursuant to Specification 3.12.2.

\*In lieu of submission with the Semiannual Radioactive Effluent Release Report, the licensee has the option of retaining this summary of required meteorological data on site in a file that shall be provided to the NRC upon request.



## ADMINISTRATIVE CONTROLS

### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)

The Semiannual Radioactive Effluent Release Reports shall also include the following: an explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in Specification 3.3.3.9 or 3.3.3.10, respectively; and description of the events leading to liquid holdup tanks or gas storage tanks exceeding the limits of Specification 3.11.1.4 or 3.11.2.6, respectively. **DELETED**

### MONTHLY OPERATING REPORTS

6.8.1.5 Routine reports of operating statistics and shutdown experience, including documentation of all challenges to the PORVs or safety valves, shall be submitted on a monthly basis to the Director, Office of Resource Management, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, with a copy to the Regional Administrator of the Regional Office of the NRC, no later than the 15th of each month following the calendar month covered by the report.

### CORE OPERATING LIMITS REPORT - UNIT 1

6.8.1.6 Core operating limits shall be established and documented in the CORE OPERATING LIMITS REPORT (COLR) before each reload cycle or any remaining part of a reload cycle for the following:

- a. SHUTDOWN MARGIN LIMIT FOR MODES 1 and 2 for Specification 3/4.1.1.1,
- b. SHUTDOWN MARGIN LIMITS FOR MODES 3, 4 and 5 for Specification 3/4.1.1.2,
- c. Moderator temperature coefficient BOL and EOL limits and 300 ppm surveillance limit for Specification 3/4.1.1.3,
- d. Shutdown Rod Insertion Limit for Specification 3/4.1.3.5,
- e. Control Rod Insertion Limits for Specification 3/4.1.3.6,
- f. Axial Flux Difference Limits for Specification 3/4.2.1,
- g. Heat Flux Hot Channel Factor  $K(Z)$  and  $W(Z)$ , for Specification 3/4.2.2,
- h. Nuclear Enthalpy Rise Hot Channel Factor Limit and the Power Factor Multiplier for Specification 3/4.2.3.

The analytical methods used to determine the core operating limits shall be those previously approved by the NRC in:

## ADMINISTRATIVE CONTROLS

### RECORD RETENTION (Continued)

- h. Records of inservice inspections performed pursuant to these Technical Specifications;
- i. Records of quality assurance activities required by the Final Safety Analysis Report;
- j. Records of reviews performed for changes made to procedures or equipment or reviews of tests and experiments pursuant to 10 CFR 50.59;
- k. Records of meetings of the PRB and the SRB;
- l. Records of the service lives of all hydraulic and mechanical snubbers required by Specification 3 7.8 including the date at which the service life commences and associated installation and maintenance records;
- m. Records of secondary water sampling and water quality; and
- .. Records of analyses required by the Radiological Environmental Monitoring Program that would permit evaluation of the accuracy of the analysis at a later date. This should include procedures effective at specified times and QA records showing that these procedures were followed.

#### o. Insert 5

### 6.10 RADIATION PROTECTION PROGRAM

6.10.1 Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained, and adhered to for all operations involving personnel radiation exposure.

### 6.11 HIGH RADIATION AREA

6.11.1 Pursuant to paragraph 20.203(c)(5) of 10 CFR Part 20, in lieu of the "control device" or "alarm signal" required by paragraph 20.203(c), each high radiation area, as defined in 10 CFR Part 20, in which the intensity of radiation is greater than 100 mrem/hr but less than 1000 mR/h at 45 cm (18 in.) from the radiation source or from any surface which the radiation penetrates shall be barricaded and conspicuously posted as a high radiation area and entrance thereto shall be controlled by requiring issuance of a Radiation Work Permit (RWP). Individuals qualified in radiation protection procedures (e.g., Health Physics Technician) or personnel continuously escorted by such individuals may be exempt from the RWP issuance requirement during the performance of their assigned duties in high radiation areas with exposure rates greater than 100 mrem/hr but less than 1000 mR/h, provided they are otherwise following plant radiation protection procedures for entry into such high radiation areas. Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

- a. A radiation monitoring device which continuously indicates the radiation dose rate in the area; or

INSERT 5

- o. Records of reviews performed for changes made to the OFFSITE DOSE CALCULATION MANUAL and the PROCESS CONTROL PROGRAM.

## ADMINISTRATIVE CONTROLS

### 6.11 HIGH RADIATION AREA (Continued)

- b. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate levels in the area have been established and personnel have been made knowledgeable of them; or
- c. An individual qualified in radiation protection procedures with a radiation dose rate monitoring device, who is responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified by the Health Physics Superintendent in the RWP.

6.11.2 In addition to the requirements of Specification 6.11.1, areas accessible to personnel with radiation levels greater than 1000 mR/h at 45 cm (18 in.) from the radiation source or from any surface which the radiation penetrates shall be provided with locked doors to prevent unauthorized entry, and the keys shall be maintained under the administrative control of the shift Foreman on duty and/or health physics supervision. Doors shall remain locked except during periods of access by personnel under an approved RWP which shall specify the dose rate levels in the immediate work areas and the maximum allowable stay time for individuals in that area. In lieu of the stay time specification of the RWP, direct or remote (such as closed circuit TV cameras) continuous surveillance may be made by personnel qualified in radiation protection procedures to provide positive exposure control over the activities being performed within the area.

For individual high radiation areas accessible to personnel with radiation levels of greater than 1000 mR/h that are located within large areas, such as PWR containment, where no enclosure exists for purposes of locking, and where no enclosure can be reasonably constructed around the individual area, that individual area shall be barricaded, conspicuously posted, and a flashing light shall be activated as a warning device.

### 6.12 PROCESS CONTROL PROGRAM (PCP)

6.12.1 The PCP shall be approved by the Commission prior to implementation.

6.12.2 Licensee-initiated changes to the PCP:

Insert 6

a. ~~1) Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made. This submittal shall contain:~~

~~1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information;~~

~~2) A determination that the change did not reduce the overall conformance of the solidified waste product to existing criteria for solid wastes; and~~

INSERT 6

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.9.3o. This documentation shall contain:
- 1) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
  - 2) A determination that the change will maintain the overall conformance of the solidified waste product to existing requirements of Federal, State, or other applicable regulations.



## ADMINISTRATIVE CONTROLS

### 6.12 PROCESS CONTROL PROGRAM (PCP) (Continued)

- 3) ~~Documentation of the fact that the change has been reviewed and found acceptable by the PRB.~~  
after review and acceptance by the PRB and the  
b. Shall become effective upon approval by the General Manager-Nuclear Plant.  
of

### 6.13 OFFSITE DOSE CALCULATION MANUAL (ODCM)

6.13.1 The ODCM shall be approved by the Commission prior to implementation.

6.13.2 Licensee-initiated changes to the ODCM:

Insert 7

- a. Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made effective. This submittal shall contain:
- 1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information. Information submitted should consist of a package of those pages of the ODCM to be changed with each page numbered, dated and containing the revision number, together with appropriate analyses or evaluations justifying the change(s);
  - 2) A determination that the change will not reduce the accuracy or reliability of dose calculations or Setpoint determinations; and
  - 3) Documentation of the fact that the change has been reviewed and found acceptable by the PRB.
- b. Shall become effective upon approval by the General Manager-Nuclear Plant.
- DELETED

### 6.14 MAJOR CHANGES TO LIQUID, GASEOUS, AND SOLID RADWASTE TREATMENT SYSTEMS

Not Used.

6.14.1 Licensee-initiated major changes to the Radwaste Treatment Systems (liquid, gaseous, and solid):

- a. Shall be reported to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the PRB. The discussion of each change shall contain:
- 1) A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.55;
  - 2) Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
- DELETED

\*Licensees may choose to submit the information called for in this Specification as part of the annual FSAR update.








INSERT 7

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.9.30. This documentation shall contain:
  - 1) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
  - 2) A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20.106, 40 CFR Part 190, 10 CFR 50.36a, and Appendix I to 10 CFR Part 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
- b. Shall become effective after review and acceptance by the PRB and the approval of the General Manager-Nuclear Plant.
- c. Shall be submitted to the Commission in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Semiannual Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (e.g., month/year) the change was implemented.

# 1

## IMAGE EVALUATION TEST TARGET (MT-3)

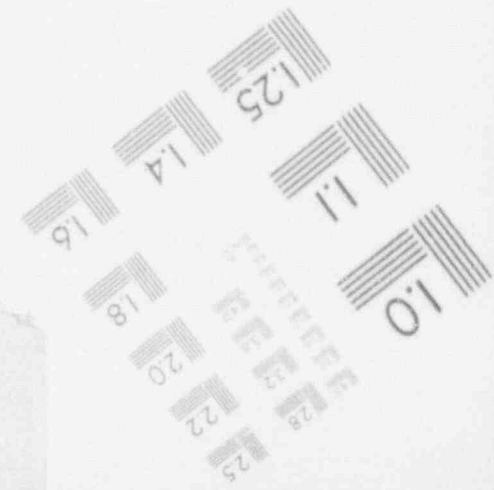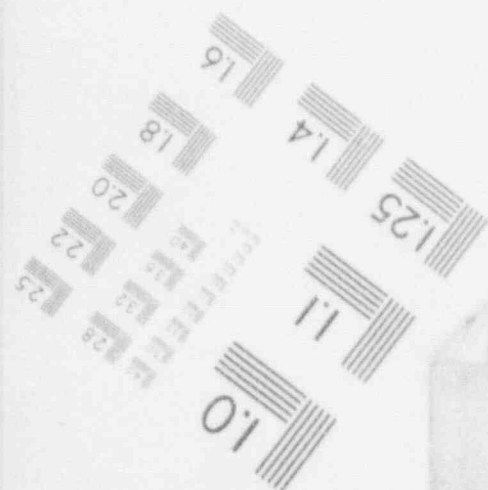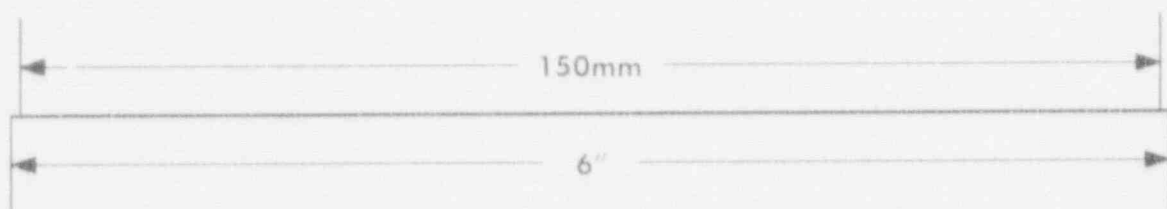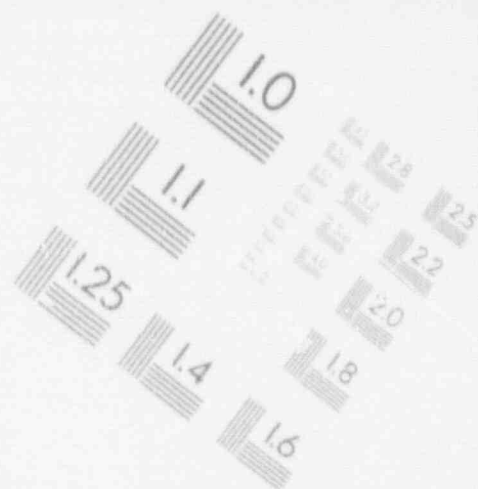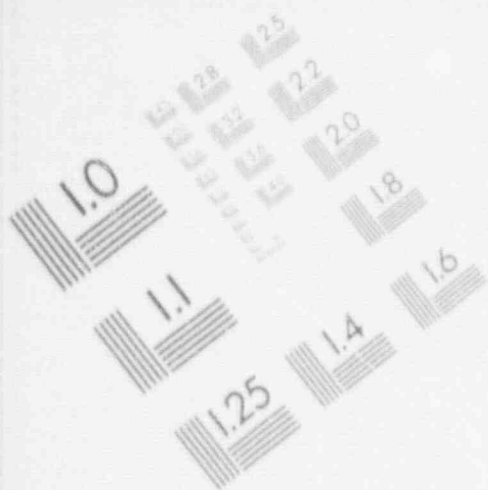

1

IMAGE EVALUATION  
TEST TARGET (MT-3)








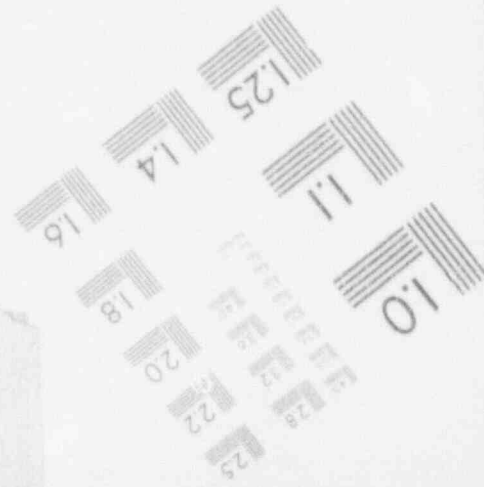


IMAGE EVALUATION  
TEST TARGET (MT-3)

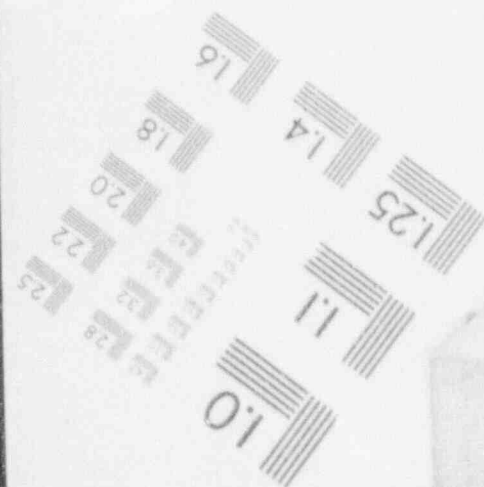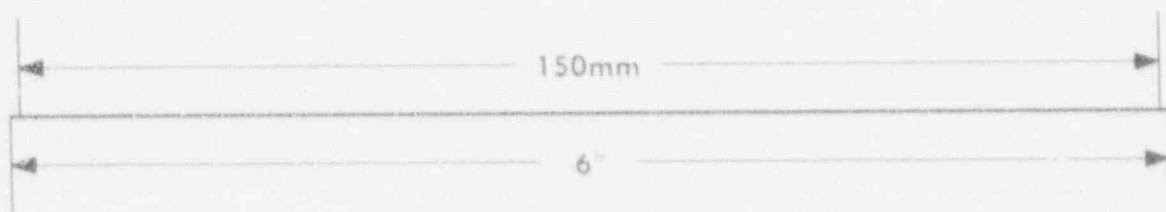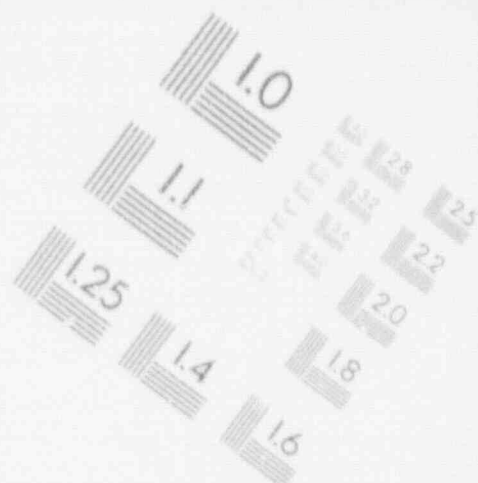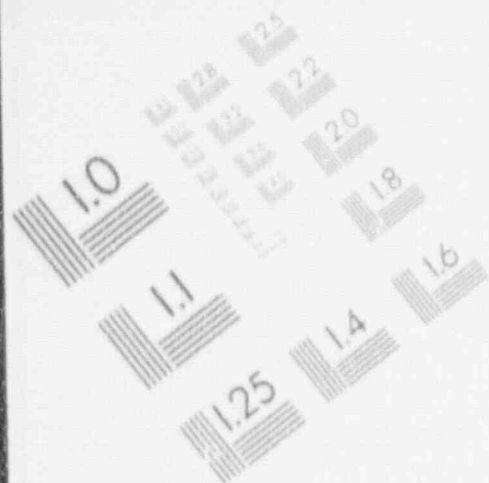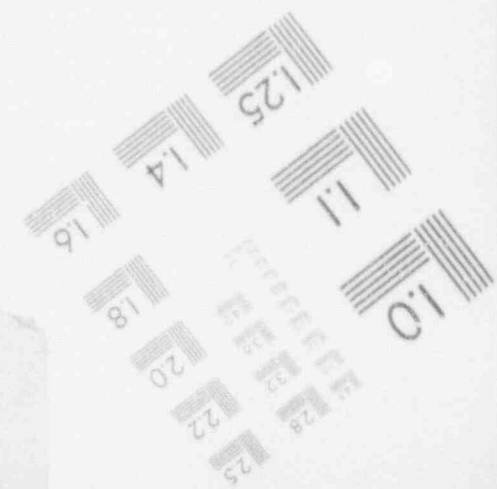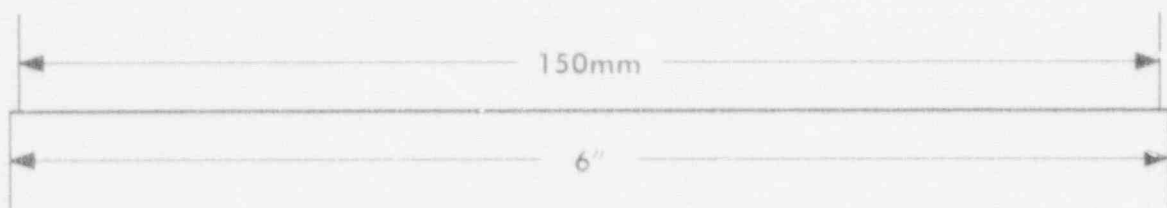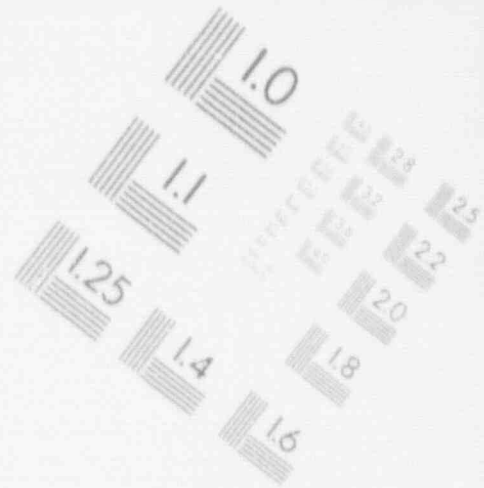

## ADMINISTRATIVE CONTROLS

### 6.14 MAJOR CHANGES TO LIQUID, GASEOUS, AND SOLID RADWASTE TREATMENT SYSTEMS (Continued)

- 3) A detailed description of the equipment, components, and processes involved and the interfaces with other plant systems;
  - 4) An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents and/or quantity of solid waste that differ from those previously predicted in the License application and amendments thereto;
  - 5) An evaluation of the change, which shows the expected maximum exposures to a MEMBER OF THE PUBLIC in the UNRESTRICTED AREA and to the general population that differ from those previously estimated in the License application and amendments thereto;
  - 6) A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents and in solid waste, to the actual releases for the period prior to when the change is to be made;
  - 7) An estimate of the exposure to plant operating personnel as a result of the change; and
  - 7) Documentation of the fact that the change was reviewed and found acceptable by the PRB.
- b. Shall become effective upon approval by the General Manager-Nuclear Plant.

DELETED