

Vermont Yankee Nuclear Power Station
Cycle 18
Core Operating Limits Report
Revision 3

Preparer Michelle A. Siroen 11/7/95
VY Nuclear Engineering Coordinator Date

Approved Mississippi 11/7/95
Nuclear Engineering Department Director Date

Approved M.P. Benoit 11/15/95
Reactor & Computer Engineering Manager Date

November 1995

Reviewed R. McCall 95-132 12/5/95
Plant Operations Review Committee Date

Approved Belmont 12/5/95
Plant Manager Date

Approved S. A. R. I. 12/11/95
Vice President Operations Date

Controlled Copy No. _____

REVISION RECORD

<u>Cycle</u>	<u>Revision</u>	<u>Date</u>	<u>Description</u>
14	0	10/89	Initial printing. Reviewed by PORC and approved by management.
15	0	9/90	Cycle 15 revisions. Reviewed by PORC and approved by management.
15	1	11/91	Incorporate new MCPR limits to allow operation within the exposure window. Reviewed by PORC and approved by management.
16	0	3/92	Cycle 16 revisions. Reviewed by PORC and approved by management.
17	0	7/93	Cycle 17 revisions. Reviewed by PORC and approved by management.
18	0	4/95	Cycle 18 revisions. Reviewed by PORC and approved by management.
18	1	8/95	Incorporate new MAPLHGR limits to account for Loss of Stator Cooling Event. Reviewed by PORC and approved by management.
18	2	8/95	Incorporate the thermal-hydraulic stability exclusion region. Reviewed by PORC and approved by management.
18	3	11/95	Revise the thermal-hydraulic stability exclusion region to more accurately represent the exclusion region boundary equation. Revise the MCPR limits to allow SRV and SV setpoint tolerance relaxation. Reviewed by PORC and approved by management.

ABSTRACT

This report presents the cycle-specific operating limits for the operation of Cycle 18 of the Vermont Yankee Nuclear Power Station. The limits are the maximum average planar linear heat generation rate, maximum linear heat generation rate, minimum critical power ratio, and thermal-hydraulic stability exclusion region.

TABLE OF CONTENTS

	<u>Page</u>
REVISION RECORD	ii
ABSTRACT	iii
LIST OF TABLES	v
LIST OF FIGURES	vi
1.0 INTRODUCTION	1
2.0 CORE OPERATING LIMITS	2
2.1 Maximum Average Planar Linear Heat Generation Rate Limits . .	2
2.2 Minimum Critical Power Ratio Limits	3
2.3 Maximum Linear Heat Generation Rate Limits	3
2.4 Thermal-Hydraulic Stability Exclusion Region	3
3.0 REFERENCES	13

LIST OF TABLES

<u>Number</u>	<u>Title</u>	<u>Page</u>
Table 2.1-1	MAPLHGR Versus Average Planar Exposure for BP8DWB311-10GZ Fuel	5
Table 2.1-2	MAPLHGR Versus Average Planar Exposure for BP8DWB311-11GZ Fuel	6
Table 2.1-3	MAPLHGR Versus Average Planar Exposure for BP8DWB335-10GZ Fuel	7
Table 2.1-4	MAPLHGR Versus Average Planar Exposure for BP8DWB335-11GZ Fuel	8
Table 2.2-1	Minimum Critical Power Ratio Operating Limits	9
Table 2.3-1	Maximum Allowable Linear Heat Generation Rate Limits	10

LIST OF FIGURES

<u>Number</u>	<u>Title</u>	<u>Page</u>
2.2-1	K_f Versus Percent of Rated Core Flow Rate	11
2.4-1	Stability Power and Flow Exclusion Region	12

1.0 INTRODUCTION

This report provides the cycle-specific limits for operation of the Vermont Yankee Nuclear Power Station in Cycle 18. It includes the limits for the maximum average planar linear heat generation rate, maximum linear heat generation rate, minimum critical power ratio, and thermal-hydraulic stability exclusion region. If any of these limits are exceeded, action will be taken as defined in the Technical Specifications.

This report has been prepared in accordance with the requirements of Technical Specification 6.7.A.4. The core operating limits have been developed using the NRC-approved methodologies listed in References 1 through 29, 34 through 36, and in Technical Specification 6.7.A.4. The bases for these limits are in References 20, 21, 30 through 35, and 37.

2.0 CORE OPERATING LIMITS

The Cycle 18 operating limits have been defined using NRC-approved methodologies. Cycle 18 must be operated within the bounds of these limits and all others specified in the Technical Specifications.

2.1 Maximum Average Planar Linear Heat Generation Rate Limits

During steady-state power operation, the Maximum Average Planar Linear Heat Generation Rate (MAPLHGR) for each fuel type, as a function of the average planar exposure, shall not exceed the limiting values shown in Tables 2.1-1 through 2.1-4. For single recirculation loop operation, the limiting values shall be the values from these Tables listed under the heading "Single Loop Operation." These values are obtained by multiplying the values for two loop operation by 0.83. The source of these values is identified on each table. These tables only list the limits for fuel types in Cycle 18.

The MAPLHGR values are usually the most limiting composite of the fuel mechanical design analysis MAPLHGRs and the Loss-of-Coolant Accident (LOCA) MAPLHGRs. The fuel mechanical design analysis, using the methods in Reference 21, demonstrates that all fuel rods in a lattice, operating at the bounding power history, meet the fuel design limits specified in Reference 21. The Vermont Yankee LOCA analysis, performed in accordance with 10CFR50, Appendix K, demonstrates that the LOCA analysis MAPLHGR values are bounded at all exposure points by the mechanical design analysis MAPLHGR values.

The MAPLHGR actually varies axially, depending upon the specific combination of enriched uranium and gadolinia that comprises a fuel bundle cross section at a particular axial node. Each particular combination of enriched uranium and gadolinia is called a lattice type. Each lattice type has a set of MAPLHGR values that vary with fuel burnup. The process computer

will verify that these lattice MAPLHGR limits are not violated. Tables 2.1-1 through 2.1-4 provide a limiting composite of MAPLHGR values for each fuel type, which envelope the lattice MAPLHGR values employed by the process computer. When hand calculations are required, these MAPLHGR values are used for all lattices in the bundle.

2.2 Minimum Critical Power Ratio Limits

During steady-state power operation, the Minimum Critical Power Ratio (MCPR) shall be equal to, or greater than, the limits shown in Table 2.2-1. The MCPR limits are also valid during coastdown beyond 10644 MWd/St.

For single recirculation loop operation, the MCPR limits at rated flow shall be the values from Table 2.2-1 listed under the heading, "Single Loop Operation." The single loop values are obtained by adding 0.01 to the two loop operation values. For core flows other than the rated condition, the MCPR limit shall be the appropriate value from Table 2.2-1 multiplied by K_f , where K_f is given in Figure 2.2-1 as a function of the flow control method in use. These limits are only valid for the fuel types in Cycle 18.

2.3 Maximum Linear Heat Generation Rate Limits

During steady-state power operation, the Linear Heat Generation Rate (LHGR) of any rod in any fuel bundle at any axial location shall not exceed the maximum allowable LHGR limits in Table 2.3-1. This table only lists the limits for fuel types in Cycle 18.

2.4 Thermal-Hydraulic Stability Exclusion Region

Normal plant operation is not allowed inside the bounds of the exclusion region defined in Figure 2.4-1. These power and flow limits are applicable

for Cycle 18. Operation inside of the exclusion region may result in a
| thermal-hydraulic oscillation. Operation within the buffer region is allowed
| when using the Stability Monitor. Otherwise, the buffer region is considered
| part of the exclusion region.

Table 2.1-1

MAPLHGR Versus Average Planar Exposure for BP8DWB311-10GZ Fuel

Plant: Vermont Yankee

Fuel Type: BP8DWB311-10GZ

<u>Average Planar Exposure (MWd/ST)</u>	<u>MAPLHGR (kW/ft)</u>	
	<u>Two Loop Operation</u>	<u>Single Loop Operation*</u>
0.0	10.93	9.07
200.00	11.00	9.13
1,000.00	11.13	9.24
2,000.00	11.32	9.40
3,000.00	11.52	9.56
4,000.00	11.64	9.66
5,000.00	11.77	9.77
6,000.00	11.92	9.89
7,000.00	12.11	10.05
8,000.00	12.34	10.24
9,000.00	12.59	10.45
10,000.00	12.83	10.65
12,500.00	13.00	10.79
15,000.00	12.81	10.63
20,000.00	12.24	10.16
25,000.00	11.55	9.59
35,000.00	10.24	8.50
45,000.00	8.76	7.27
50,735.00	5.91	4.91

Source: Vermont Yankee Cycle 18 Core Performance Analysis Report,
YAEC-1908, Reference 31; Vermont Yankee Nuclear Power Station
Single Loop Operation, NEDO-30060, Reference 30; Letter,
"Transmittal of Modified Thermal Mechanical MAPLHGR Limits for
Vermont Yankee Cycle 18 Loss of Stator Cooling Event,"
Reference 33.

Technical Specification References: 3.6.G.1a and 3.11.A.

* MAPLHGR for single loop operation is obtained by multiplying MAPLHGR for two loop operation by 0.83.

Table 2.1-2

MAPLHGR Versus Average Planar Exposure for BP8DWB311-11GZ Fuel

Plant: Vermont Yankee

Fuel Type: BP8DWB311-11GZ

<u>Average Planar Exposure (MWd/ST)</u>	<u>MAPLHGR (kW/ft)</u>	
	<u>Two Loop Operation</u>	<u>Single Loop Operation*</u>
0.00	10.93	9.07
200.00	11.00	9.13
1,000.00	11.13	9.24
2,000.00	11.32	9.40
3,000.00	11.52	9.56
4,000.00	11.64	9.66
5,000.00	11.77	9.77
6,000.00	11.92	9.89
7,000.00	12.11	10.05
8,000.00	12.34	10.24
9,000.00	12.59	10.45
10,000.00	12.83	10.65
12,500.00	13.00	10.79
15,000.00	12.81	10.63
20,000.00	12.24	10.16
25,000.00	11.55	9.59
35,000.00	10.24	8.50
45,000.00	8.76	7.27
50,735.00	5.91	4.91

Source: Vermont Yankee Cycle 18 Core Performance Analysis Report, YAE-1908, Reference 31; Vermont Yankee Nuclear Power Station Single Loop Operation, NEDO-30060, Reference 30; Letter, "Transmittal of Modified Thermal Mechanical MAPLHGR Limits for Vermont Yankee Cycle 18 Loss of Stator Cooling Event," Reference 33.

Technical Specification References: 3.6.G.1a and 3.11.A.

* MAPLHGR for single loop operation is obtained by multiplying MAPLHGR for two loop operation by 0.83.

Table 2.1-3

MAPLHGR Versus Average Planar Exposure for BP8DWB335-10GZ Fuel

Plant: Vermont Yankee

Fuel Type: BP8DWB335-10GZ

Average Planar Exposure (MWd/ST)	MAPLHGR (kW/ft)	
	<u>Two Loop Operation</u>	<u>Single Loop Operation*</u>
0.00	11.29	9.37
200.00	11.34	9.41
1,000.00	11.48	9.53
2,000.00	11.69	9.70
3,000.00	11.92	9.89
4,000.00	12.17	10.10
5,000.00	12.43	10.32
6,000.00	12.68	10.52
7,000.00	12.87	10.68
8,000.00	13.06	10.84
9,000.00	13.24	10.99
10,000.00	12.99	10.78
12,500.00	12.84	10.66
15,000.00	12.65	10.50
20,000.00	11.93	9.90
25,000.00	11.26	9.35
35,000.00	9.88	8.20
45,000.00	8.38	6.96
50,593.00	5.65	4.69

Source: Vermont Yankee Cycle 18 Core Performance Analysis Report, YAE-1908, Reference 31; Vermont Yankee Nuclear Power Station Single Loop Operation, NEDO-30000, Reference 30; Letter, "Transmittal of Modified Thermal Mechanical MAPLHGR Limits for Vermont Yankee Cycle 18 Loss of Stator Cooling Event," Reference 33.

Technical Specification References: 3.6.G.1a and 3.11.A.

* MAPLHGR for single loop operation is obtained by multiplying MAPLHGR for two loop operation by 0.83.

Table 2.1-4

MAPLHGR Versus Average Planar Exposure for BP8DWB335-11GZ FuelPlant: Vermont YankeeFuel Type: BP8DWB335-11GZ

Average Planar Exposure (MWd/ST)	MAPLHGR (kW/ft)	
	<u>Two Loop Operation</u>	<u>Single Loop Operation*</u>
0.00	11.28	9.36
200.00	11.33	9.40
1,000.00	11.43	9.49
2,000.00	11.60	9.63
3,000.00	11.80	9.79
4,000.00	12.04	9.99
5,000.00	12.30	10.21
6,000.00	12.53	10.40
7,000.00	12.73	10.57
8,000.00	12.94	10.74
9,000.00	13.13	10.90
10,000.00	12.99	10.78
12,500.00	12.84	10.66
15,000.00	12.65	10.50
20,000.00	11.93	9.90
25,000.00	11.26	9.35
35,000.00	9.88	8.20
45,000.00	8.38	6.96
50,593.00	5.65	4.69

Source: Vermont Yankee Cycle 18 Core Performance Analysis Report,
YAEC-1908, Reference 31; Vermont Yankee Nuclear Power Station
Single Loop Operation, NEDO-30060, Reference 30; Letter,
 "Transmittal of Modified Thermal Mechanical MAPLHGR Limits for
 Vermont Yankee Cycle 18 Loss of Stator Cooling Event,"
 Reference 33.

Technical Specification References: 3.6.G.1a and 3.11.A.

* MAPLHGR for single loop operation is obtained by multiplying MAPLHGR for two loop operation by 0.83.

Table 2.2-1

Minimum Critical Power Ratio Operating Limits

Value of "N" in RBM Equation (A) ¹	Average Control Rod Scram Time	Cycle Exposure Range	MCPR Operating Limits	
			Two Loop Operation	Single Loop Operation ²
42%	Equal to or better than L.C.O. 3.3.C.1.1	0.0 to 4000 MWd/St	1.39	1.40
		4000 to 5500 MWd/St	1.35	1.36
		5500 to 10644 MWd/St	1.33	1.34
	Equal to or better than L.C.O. 3.3.C.1.2	0.0 to 4000 MWd/St	1.39	1.40
		4000 to 5500 MWd/St	1.35	1.36
		5500 to 9035 MWd/St	1.33	1.34
41%	Equal to or better than L.C.O. 3.3.C.1.1	9035 to 10644 MWd/St	1.36	1.37
		0.0 to 4000 MWd/St	1.39	1.40
		4000 to 5500 MWd/St	1.35	1.36
	Equal to or better than L.C.O. 3.3.C.1.2	5500 to 6500 MWd/St	1.29	1.30
		6500 to 9035 MWd/St	1.27	1.28
		9035 to 10644 MWd/St	1.34	1.35
	Equal to or better than L.C.O. 3.3.C.1.2	0.0 to 4000 MWd/St	1.39	1.40
		4000 to 5500 MWd/St	1.35	1.36
		5500 to 6500 MWd/St	1.29	1.30
	Equal to or better than L.C.O. 3.3.C.1.2	6500 to 8035 MWd/St	1.27	1.28
		8035 to 9035 MWd/St	1.32	1.33
		9035 to 10644 MWd/St	1.36	1.37
≤40%	Equal to or better than L.C.O. 3.3.C.1.1	0.0 to 4000 MWd/St	1.39	1.40
		4000 to 5500 MWd/St	1.35	1.36
		5500 to 6500 MWd/St	1.29	1.30
	Equal to or better than L.C.O. 3.3.C.1.1	6500 to 8035 MWd/St	1.25	1.26
		8035 to 9035 MWd/St	1.29	1.30
		9035 to 10644 MWd/St	1.34	1.35
	Equal to or better than L.C.O. 3.3.C.1.2	0.0 to 4000 MWd/St	1.39	1.40
		4000 to 5500 MWd/St	1.35	1.36
		5500 to 6500 MWd/St	1.29	1.30
	Equal to or better than L.C.O. 3.3.C.1.2	6500 to 8035 MWd/St	1.25	1.26
		8035 to 9035 MWd/St	1.32	1.33
		9035 to 10644 MWd/St	1.36	1.37

Sources: Vermont Yankee Cycle 18 Core Performance Analysis Report, YAE-1908, Reference 31; End-of-Full-Power-Life Sensitivity Study for the Revised BWR Licensing Methodology, YAE-1822, Reference 32; Vermont Yankee Nuclear Power Station Single Loop Operation, NEDO-30060, Reference 30; and Safety Analysis of Safety/Relief Valve Setpoint Tolerance Relaxation for the Vermont Yankee Nuclear Power Station, YAE-1910, Reference 37.

Technical Specification References: 3.6.G.1a and 3.11.C.

1 The Rod Block Monitor (RBM) trip setpoints are determined by the equation shown in Table 3.2.5 of the Technical Specifications.

2 MCPR Operating Limits are increased by 0.01 for single loop operation.

Table 2.3-1

Maximum Allowable Linear Heat Generation Rate Limits

<u>Fuel Type</u>	<u>Maximum Allowable Linear Heat Generation Rate (kW/ft)</u>
SP8DWB311-10GZ	14.4
BP8DWB311-11GZ	14.4
BP8DWB335-10GZ	14.4
BP8DWB335-11GZ	14.4

Source: NEDE-24011-P-A, Reference 21.

Technical Specification References: 2.1.A.1a, 2.1.B.1, and 3.11.8.


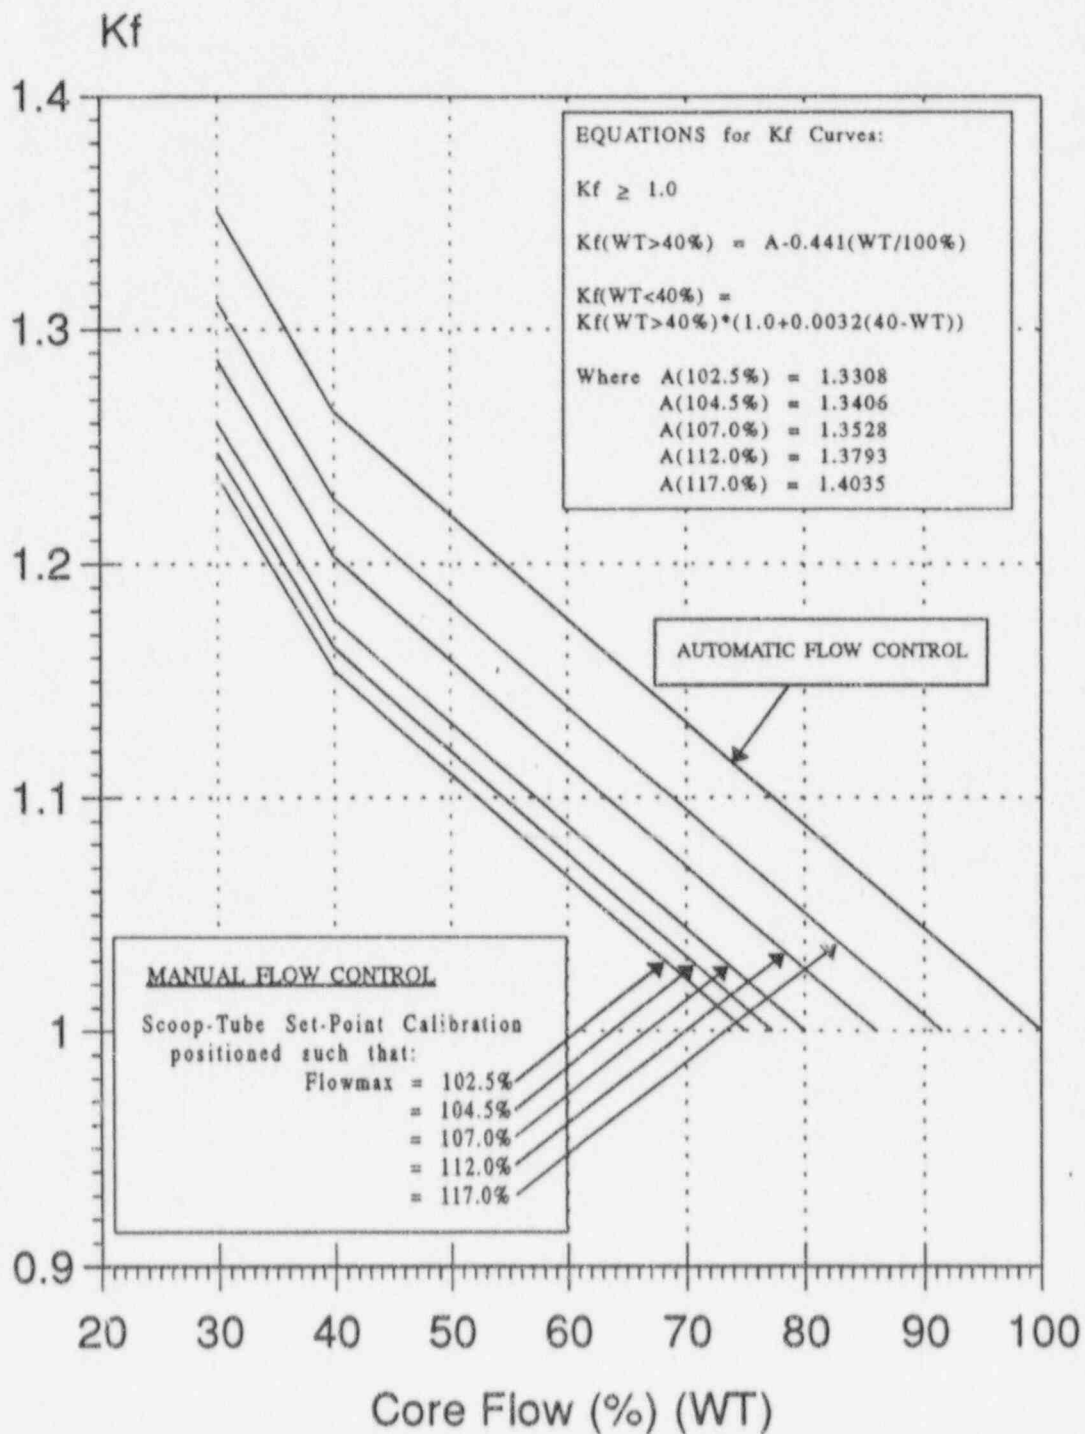


Figure 2.2-1

K_f Versus Percent of Rated Core Flow Rate
 (Technical Specification Reference 3.11.C)

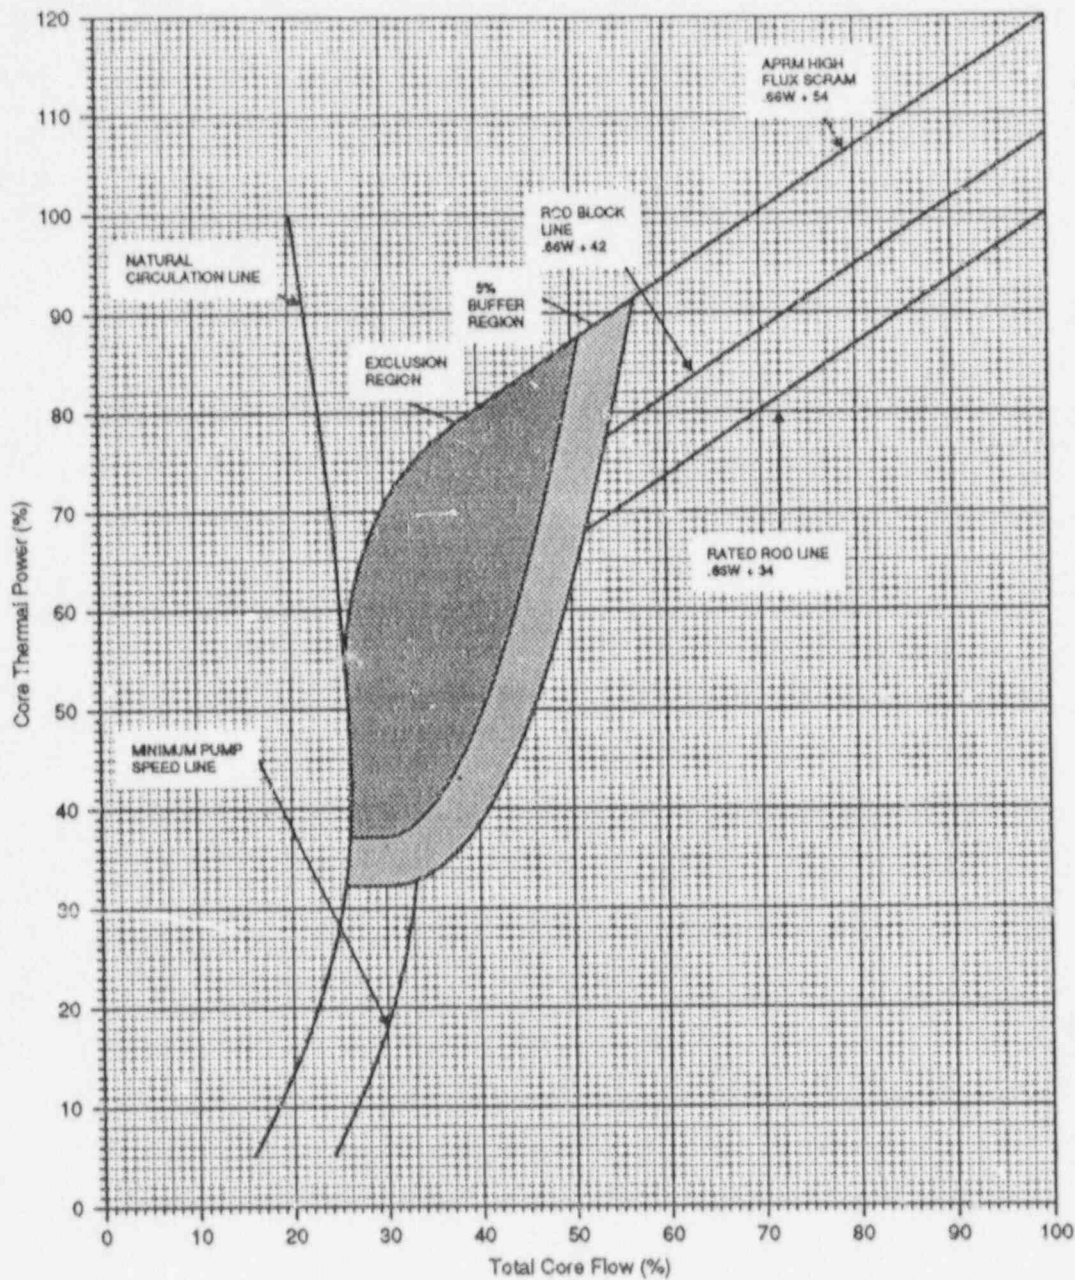

Exclusion Region Boundary Equation

For Flow $\geq 30\%$

$$\text{POWER} = 133.7831 - 6.61 (\text{FLOW} - 0.5) + 0.113 (\text{FLOW} - 0.5)^2$$

For Flow $\geq 26\%$ and $< 30\%$

$$\text{POWER} = 37.1$$

Figure 2.4-1

Stability Power and Flow Exclusion Region
(Technical Specification Reference 3.6.J)

3.0 REFERENCES

1. Report, A. A. F. Ansari, Methods for the Analysis of Boiling Water Reactors: Steady-State Core Flow Distribution Code (FIBWR), YAEC-1234, December 1980.
2. Report, A. A. F. Ansari and J. T. Cronin, Methods for the Analysis of Boiling Water Reactors: A System Transient Analysis Model (RETRAN), YAEC-1233, April 1981.
3. Report, A. A. F. Ansari, K. J. Burns and D. K. Beller, Methods for the Analysis of Boiling Water Reactors: Transient Critical Power Ratio Analysis (RETRAN-TCPYA01), YAEC-1299P, March 1982.
4. Report, A. S. DiGiovine, et al., CASMO-3G Validation, YAEC-1363-A, April 1988.
5. Report, A. S. DiGiovine, J. P. Gorski, and M. A. Tremblay, SIMULATE-3 Validation and Verification, YAEC-1659-A, September 1988.
6. Report, R. A. Woehlke, et al., MICBURN-3/CASMO-3/TABLES-3/SIMULATE-3 Benchmarking of Vermont Yankee Cycles 9 through 13, YAEC-1683-A, March 1989.
7. Report, J. T. Cronin, Method for Generation of One-Dimensional Kinetics Data for RETRAN-02, YAEC-1694-A, June 1989.
8. Report, V. Chandola, M. P. LeFrancois and J. D. Robichaud, Application of One-Dimensional Kinetics to Boiling Water Reactor Transient Analysis Methods, YAEC-1693-A, Revision 1, November 1989.
9. Report, RELAP5YA, A Computer Program for Light-Water Reactor System Thermal-Hydraulic Analysis, YAEC-1300P-A, Revision 0, October 1982; Revision 1, July 1993.
10. Report, Vermont Yankee BWR Loss-of-Coolant Accident Licensing Analysis Method, YAEC-1547P-A, July 1993.
11. Letter from R. W. Capstick (VYNPC) to USNRC, HUXY Computer Code Information for the Vermont Yankee BWR LOCA Licensing Analysis Method, FVY 87-63, dated June 4, 1987.
12. Letter from R. W. Capstick (VYNPC) to USNRC, Vermont Yankee LOCA Analysis Method FROSSTEY Fuel Performance Code (FROSSTEY-2), FVY 87-116, dated December 16, 1987.
13. Letter from R. W. Capstick (VYNPC) to USNRC, Response to NRC Request for Additional Information on the FROSSTEY-2 Fuel Performance Code, BVI 89-65, dated July 14, 1989.

14. Letter from R. W. Capstick (VYNPC) to USNRC, Supplemental Information on the FROSSTEY-2 Fuel Performance Code, BVY 89-74, dated August 4, 1989.
15. Letter from L. A. Tremblay, Jr. (VYNPC) to USNRC, Responses to Request for Additional Information on FROSSTEY-2 Fuel Performance Code, BVY 90-045, dated April 19, 1990.
16. Letter from L. A. Tremblay, Jr. (VYNPC) to USNRC, Supplemental Information to VYNPC April 19, 1990 Response Regarding FROSSTEY-2 Fuel Performance Code, BVY 90-054, dated May 10, 1990.
17. Letter from L. A. Tremblay, Jr. (VYNPC) to USNRC, Responses to Request for Additional Information on FROSSTEY-2 Fuel Performance Code, BVY 91-024, dated March 6, 1991.
18. Letter from L. A. Tremblay, Jr. (VYNPC) to USNRC, LOCA-Related Responses to Open Issues on FROSSTEY-2 Fuel Performance Code, BVY 92-39, dated March 27, 1992.
19. Letter from L. A. Tremblay, Jr. (VYNPC) to USNRC, FROSSTEY-2 Fuel Performance Code - Vermont Yankee Response to Remaining Concerns, BVY 92-54, dated May 15, 1992.
20. Report, L. Schor, et al., Vermont Yankee Loss-of-Coolant Accident Analysis, YAE-1772, June 1993.
21. Report, General Electric Standard Application for Reactor Fuel (GESTARII), NEDE-24011-P-A-10, GE Company Proprietary, February 1991, as amended.
22. Letter, USNRC to VYNPC, SER, November 27, 1981.
23. Letter, USNRC to VYNPC, SER, NVY 82-157, September 15, 1982.
24. Letter, USNRC to VYNPC, SER, NVY 85-205, September 27, 1985.
25. Letter, USNRC to VYNPC, SER, November 30, 1977.
26. Letter, USNRC to VYNPC, SER, NVY 87-136, August 25, 1987.
27. Letter, USNRC to VYNPC, SER, NVY 91-26, February 27, 1991.
28. Letter, USNRC to VYNPC, SER, NVY 92-192, October 21, 1992.
29. Letter, USNRC to VYNPC, SER, NVY 92-178, September 24, 1992.
30. Report, Vermont Yankee Nuclear Power Station Single Loop Operation, NEDO-30060, February 1983.

31. Report, M. A. Sironen, Vermont Yankee Cycle 18 Core Performance Analysis Report, YAEC-1908, Revision 1, November 1995.
32. Report, B. Y. Hubbard, et al., End-of-Full-Power-Life Sensitivity Study for the Revised BWR Licensing Methodology, YAEC-1822, October 1991.
33. Letter, P. J. Savoia to R. T. Yee, "Transmittal of Modified Thermal Mechanical MAPLHGR Limits for Vermont Yankee Cycle 18 Loss of Stator Cooling Event," PJS 95106, July 25, 1995.
34. Report, General Electric Nuclear Energy, BWR Owners' Group Long-Term Solutions Licensing Methodology, NEDO-31960, June 1991.
35. Report, General Electric Nuclear Energy, BWR Owners' Group Long-Term Solutions Licensing Methodology, NEDO-31960, Supplement 1, March 1992.
36. Letter, USNRC to VYNPC, SER, August 9, 1995.
37. Report, Safety Analysis of Safety/Relief Valve Setpoint Tolerance Relaxation for the Vermont Yankee Nuclear Power Station, YAEC-1910, March 1995.