



**GULF STATES UTILITIES COMPANY**

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704


AREA CODE 713 838-6631

August 15, 1984  
RBG-18675  
File Nos. G9.5, G9.25.1.1

Mr. John T. Collins, Regional Administrator  
U. S. Nuclear Regulatory Commission  
Region IV, Office of Inspection and Enforcement  
611 Ryan Plaza Drive, Suite 1000  
Arlington, Texas 76011

Dear Mr. Collins:

River Bend Station Unit 1  
Docket No. 59-458  
Final Report/DR-183

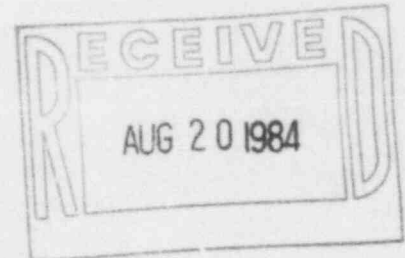

Gulf States Utilities Company has completed its evaluation of DR-183 concerning the contact configurations of 94AX relays supplied by Gould Brown Boveri. The condition concerns relays with field convertible contacts which were added as a field modification. As such, it is the responsibility of the Preliminary Test Organization to ascertain the contact configuration in the field and, if necessary, rework to agree with the latest ESK. The condition was identified prior to completion of functional testing of the contact circuits by the PTO. Because no hardware deficiency exists, GSU has determined this condition does not meet the reporting requirements of 10CFR50.55(e).

Sincerely,

*J. E. Booker*  
J. E. Booker  
Manager-Engineering,  
Nuclear Fuels & Licensing  
River Bend Nuclear Group

*JPD*  
JPD/lp

cc: Director of Inspection & Enforcement  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

NRC Resident Inspector-Site

8408280458 840815  
PDR ADDCK 05000458  
S PDR

*IR-27*  
*1/0*