

INFORMATION COPY

INSTRUMENTATION

3/4.3.2 SAFETY SYSTEM INSTRUMENTATION

SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.2.1 The Safety Features Actuation System (SFAS) functional units shown in Table 3.3-3 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column of Table 3.3-4 and with RESPONSE TIMES as shown in Table 3.3-5.

APPLICABILITY: As shown in Table 3.3-3.

ACTION:

- a. With a SFAS functional unit trip setpoint less conservative than the value shown in the Allowable Values column of Table 3.3-4, declare the functional unit inoperable and apply the applicable ACTION requirement of Table 3.3-3, until the functional unit is restored to OPERABLE status with the trip setpoint adjusted consistent with the Trip Setpoint value.
- b. With a SFAS functional unit inoperable, take the action shown in Table 3.3-3.

SURVEILLANCE REQUIREMENTS

4.3.2.1.1 Each SFAS functional unit shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST during the MODES and at the frequencies shown in Table 4.3-2.

4.3.2.1.2 The logic for the bypasses shall be demonstrated OPERABLE during the at power CHANNEL FUNCTIONAL TEST of functional units affected by bypass operation. The total bypass function shall be demonstrated OPERABLE at least once per 18 months during CHANNEL CALIBRATION testing of each functional unit affected by bypass operation.

4.3.2.1.3 The SAFETY FEATURES RESPONSE TIME of each SFAS function shall be demonstrated to be within the limit at least once per 18 months. Each test shall include at least one functional unit per function such that all functional units are tested at least once every N times 18 months where N is the total number of redundant functional units in a specific SFAS function as shown in the "Total No. of Units" Column of Table 3.3-3.

DAVIS-BESSE, UNIT 1

3/4 3-9

INFORMATION COPY

DocId Number 50-346
License Number NPP-3
Serial Number 2051
Attachment
Page 11

TABLE 3.3-3

SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

FUNCTIONAL UNIT	TOTAL NO. OF UNITS	UNITS TO TRIP	MINIMUM UNITS OPERABLE	APPLICABLE MODES	ACTION
1. INSTRUMENT STRINGS					
a. Containment Radiation - High	4	2	3	1, 2, 3, 4, 6****	101
b. Containment Pressure - High	4	2	3	1, 2, 3	101
c. Containment Pressure - High-High	4	2	3	1, 2, 3	101
d. RCS Pressure - Low	4	2	3	1, 2, 3*	101
e. RCS Pressure - Low-Low	4	2	3	1, 2, 3**	101
f. BVST Level - Low-Low	4	2	3	1, 2, 3	101
2. OUTPUT LOGIC					
a. Incident Level #1: Containment Isolation	2	1	2	1, 2, 3, 4, 6****	11
b. Incident Level #2: High Pressure Injection and Starting Diesel Generators	2	1	2	1, 2, 3, 4	11
c. Incident Level #3: Low Pressure Injection	2	1	2	1, 2, 3, 4	11
d. Incident Level #4: Containment Spray	2	1	2	1, 2, 3, 4	11
e. Incident Level #5: Containment Sump Recirculation Permissive	2	1	2	1, 2, 3, 4	11

INFORMATION COPY

Pocket Number 50-346
License Number NPP-3
Serial Number 2051
Attachment
Page 12

TABLE 3.3-3 (Continued)

SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

FUNCTIONAL UNIT	TOTAL NO OF UNITS	UNITS TO TRIP	MINIMUM UNITS OPERABLE	APPLICABLE NODES	ACTION
3. MANUAL ACTUATION					
a. SPAS (except Containment Spray and Emergency Sump Recirculation)	2	2	2	1,2,3,4,6****	12
b. Containment Spray	2	2	2	1,2,3,4	12
4. SEQUENCE LOGIC CHANNELS					
a. Sequencer	4	2***	3	1,2,3,4	10f
b. Essential Bus Feeder Breaker Trip (90%)	2	1	2*****	1,2,3,4	15f
c. Diesel Generator Start, Load Shed on Essential Bus (59%)	2	1	2	1,2,3,4	15f
5. INTERLOCK CHANNELS					
a. Decay Heat Isolation Valve	1	1	1	1,2,3	13f
b. Pressurizer Heaters	2	2	2	3*****	14

TABLE 3.3-3 (Continued)
TABLE NOTATION

- * Trip function may be bypassed in this MODE with RCS pressure below 1800 psig. Bypass shall be automatically removed when RCS pressure exceeds 1800 psig.
- ** Trip function may be bypassed in this MODE with RCS pressure below 600 psig. Bypass shall be automatically removed when RCS pressure exceeds 600 psig.
- *** One must be in SPAS Channels #1 or #3, the other must be in Channels #2 or #4.
- **** This instrumentation must be OPERABLE during CORE ALTERATIONS or movement of irradiated fuel within the containment to meet the requirements of Tech. Spec 3.9.4.
- ***** All functional units may be bypassed for up to one minute when starting each Reactor Coolant Pump or Circulating Water Pump. INSERT ATTACHED
- ***** When either Decay Heat Isolation Valve is open.
- † The provisions of Specification 3.0.4 are not applicable.

ACTION STATEMENTS

- ACTION 10 - With the number of OPERABLE functional units one less than the Total Number of Units, STARTUP and/or POWER OPERATION may proceed provided both of the following conditions are satisfied:
- a. The inoperable functional unit is placed in the tripped condition within one hour. For functional unit 4a the sequencer channel shall be placed in the tripped condition by physical removal of the sequencer module.
 - b. The Minimum Units OPERABLE requirement is met; however, one additional functional unit may be bypassed for up to 2 hours for surveillance testing per Specification 4.3.2.1.1.
- ACTION 11 - With any component in the Output Logic inoperable, trip the associated components within one hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- ACTION 12 - With the number of OPERABLE Units one less than the Total Number of Units, restore the inoperable functional unit to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- ACTION 13 - a. With less than the Minimum Units OPERABLE and reactor coolant pressure > 423 psig, both Decay Heat Isolation Valves (DE11 and DE12) shall be verified closed.

Docket Number 50-346
License Number NPP-3
Serial Number 2051
Attachment
Page 14

Insert for Table 3.3-3, Notation '*****'

This instrumentation, or the containment purge and exhaust system noble gas monitor (with the containment purge and exhaust system in operation), must be OPERABLE during CORE ALTERATIONS or movement of irradiated fuel within containment to meet the requirements of Technical Specification 3.9.4. When using the containment purge and exhaust system noble gas monitor, SFAS is not required to be OPERABLE in MODE 6.

INFORMATION COPY

Docket Number 50-346
License Number NPF-3
Serial Number 2051
Attachment
Page 15

TABLE 4.3-2

SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

FUNCTIONAL UNIT	CHANNEL CHECK	CHANNEL CALIBRATION	CHANNEL FUNCTIONAL TEST	MODES IN WHICH SURVEILLANCE REQUIRED
1. INSTRUMENT STRINGS				
a. Containment Radiation - High	S	R	M	1, 2, 3, 4, 6H
b. Containment Pressure - High	S	R	H(2)	1, 2, 3
c. Containment Pressure - High-High	S	R	H(2)	1, 2, 3
d. RCS Pressure - Low	S	R	H	1, 2, 3
e. RCS Pressure - Low-Low	S	R	H	1, 2, 3
f. BWST Level - Low-Low	S	P	H	1, 2, 3
2. OUTPUT LOGIC				
a. Incident Level #1: Containment Isolation	S	R	H	1, 2, 3, 4, 6H
b. Incident Level #2: High Pressure Injection and Starting Diesel Generators	S	R	H	1, 2, 3, 4
c. Incident Level #3: Low Pressure Injection	S	R	H	1, 2, 3, 4
d. Incident Level #4: Containment Spray	S	R	H	1, 2, 3, 4
e. Incident Level #5: Containment Sump Recirculation Permissive	S	R	H	1, 2, 3, 4
3. MANUAL ACTUATION				
a. SPAS (Except Containment Spray and Emergency Sump Recirculation)	NA	NA	H(1)	1, 2, 3, 4, 6H
b. Containment Spray	NA	NA	H(1)	1, 2, 3
4. SEQUENCE LOGIC CHANNELS	S	NA	H	1, 2, 3, 4

TABLE 4.1.2 (Continued)

SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE REQUIRED</u>
5. INTERLOCK CHANNELS				
a. Decay Heat Isolation Valve	S	R	**	1, 2, 3
b. Pressurizer Heater	S	R	**	3 **

**See Specification 4.5.2.d.1

TABLE NOTATION

- (1) Manual actuation switches shall be tested at least once per 18 months during shutdown. All other circuitry associated with manual safeguards actuation shall receive a CHANNEL FUNCTIONAL TEST at least once per 31 days.
- (2) The CHANNEL FUNCTIONAL TEST shall include exercising the transmitter by applying either vacuum or pressure to the appropriate side of the transmitter.

The surveillance requirements of Section 4.9.4 apply during core alterations or movement of irradiated fuel within the containment.

** When either Decay Heat Isolation Valve is open.

INSERT
ATTACHED

Docket Number 50-346
License Number NPF-3
Serial Number 2051
Attachment
Page 17

Insert for TS Table 4.3-2, Table Notation '#'

These surveillance requirements in conjunction with those of Section 4.9.4 apply during CORE ALTERATIONS or movement of irradiated fuel within the containment only if using the SFAS area radiation monitors listed in Table 3.3-3, Items 1a, 2a, and 3a, in lieu of the containment purge and exhaust system noble gas monitor.

REFUELING OPERATIONS

CONTAINMENT PENETRATIONS

LIMITING CONDITION FOR OPERATION

3.9.4 The containment penetrations shall be in the following status:

- a. The equipment door closed and held in place by a minimum of four bolts,
- b. A minimum of one door in each airlock closed, and
- c. Each penetration providing direct access from the containment atmosphere to the outside atmosphere shall be either:
 1. Closed by an isolation valve, blind flange, or manual valve, or
 2. Be capable of being closed by an OPERABLE automatic containment purge and exhaust isolation valve.

APPLICABILITY: During CORE ALTERATIONS or movement of irradiated fuel within the containment.

ACTION:

- a. With the requirements of the above specification not satisfied, immediately suspend all operations involving CORE ALTERATIONS or movement of irradiated fuel in the containment. The provisions of Specification 3.0.3 are not applicable.

INSERT NEW ACTIONS b. and c. ATTACHED

SURVEILLANCE REQUIREMENTS

4.9.4 Each of the above required containment penetrations shall be determined to be either in its closed/isolated condition or capable of being closed by an OPERABLE automatic containment purge and exhaust valve, within 100 hours prior to the start of and at least once per 7 days during CORE ALTERATIONS or movement of irradiated fuel in the containment, by:

- a. Verifying the penetrations are in their isolated condition, or
- b. Testing the containment purge and exhaust valves per the applicable portions of Specification 4.6.3.1.2.

← INSERT

Insert for TS 3.9.4 ACTION

- b. With the containment purge and exhaust isolation system inoperable, close each of the purge and exhaust penetrations providing direct access from the containment atmosphere to the outside atmosphere.
- c. The provisions of Specification 3.0.3 are not applicable.

Insert for TS 4.9.4.b

Verifying that with the containment purge and exhaust system in operation, and the containment purge and exhaust system noble gas monitor capable of providing a high radiation signal to the control room, that after initiation of the high radiation signal, the containment purge and exhaust isolation valves can be closed from the control room, or

If using the SFAS area radiation monitors, verifying that on a Containment Purge and Exhaust Isolation test signal, each purge and exhaust isolation valve automatically actuates to its isolation position.

INFORMATION COPY

CONTAINMENT SYSTEMS

3/4.6.3 CONTAINMENT ISOLATION VALVES

LIMITING CONDITION FOR OPERATION

3.6.3.1 All containment isolation valves shall be OPERABLE with isolation times less than or equal to required isolation times.*

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

With one or more of the isolation valve(s) inoperable, either:

- a. Restore the inoperable valve(s) to OPERABLE status within 4 hours, or
- **b. Isolate each affected penetration within 4 hours by use of at least one deactivated automatic valve secured in the isolation position, or
- **c. Isolate each affected penetration within 4 hours by use of at least one closed manual valve or blind flange; or
- d. Be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.3.1.1 The isolation valves shall be demonstrated OPERABLE prior to returning the valve to service after maintenance, repair or replacement work that could affect the valve's performance is performed on the valve or its associated actuator, control or power circuit by performance of a cycling test and verification of isolation time.

- * Surveillance testing of valves MS100, MS101, ICS11A and ICS11B is not required prior to entering MODE 4 but shall be performed prior to entering MODE 3.
- ** The provisions of Specification 3.0.4 are not applicable. Selected valves may be opened on an intermittent basis under administrative controls.

INFORMATION COPY

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

4.6.3.1.2 Each isolation valve shall be demonstrated OPERABLE during the COLD SHUTDOWN or REFUELING MODE at least once per 18 months by:

- a. Verifying that on a containment isolation test signal, each automatic isolation valve actuates to its isolation position.
- b. Verifying that on a Containment Purge and Exhaust isolation test signal, each Purge and Exhaust automatic valve actuates to its isolation position.

4.6.3.1.3 The isolation time of each power operated or automatic valve shall be determined to be within its limit when tested pursuant to Specification 4.0.5.

REFUELING OPERATIONS

CONTAINMENT PURGE AND EXHAUST ISOLATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.9.9 The containment purge and exhaust isolation system shall be OPERABLE.

APPLICABILITY: MODE 6.

ACTION:

With the containment purge and exhaust isolation system inoperable, close each of the purge and exhaust penetrations providing direct access from the containment atmosphere to the outside atmosphere. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.9.9 The containment purge and exhaust isolation system shall be demonstrated OPERABLE within 100 hours prior to the start of and at least once per 7 days during CORE ALTERATIONS by verifying that containment purge and exhaust isolation occurs on manual initiation and on a high radiation test signal from the Safety Features Actuation System.

↖ DELETED

3/4.9 REFUELING OPERATIONS

BASES

3/4.9.1 BORON CONCENTRATION

The limitations on reactivity conditions during REFUELING ensure that: 1) the reactor will remain subcritical during CORE ALTERATIONS, and 2) a uniform boron concentration is maintained for reactivity control in the water volumes having direct access to the reactor vessel. These limitations are consistent with the initial conditions assumed for the boron dilution incident in the accident analysis.

3/4.9.2 INSTRUMENTATION

The OPERABILITY of source range neutron flux monitors ensures that redundant monitoring capability is available to detect changes in the reactivity condition of the core.

3/4.9.3 DECAY TIME

The minimum requirement for reactor subcriticality prior to movement of irradiated fuel assemblies in the reactor pressure vessel ensures that sufficient time has elapsed to allow the radioactive decay of the short lived fission products. This decay time is consistent with the assumptions used in the safety analysis.

3/4.9.4 CONTAINMENT PENETRATIONS

The requirements on containment penetration closure and OPERABILITY ensure that a release of radioactive material within containment will be restricted from leakage to the environment. The OPERABILITY and closure requirements are sufficient to restrict radioactive material release from a fuel element rupture based upon the lack of containment pressurization potential while in the REFUELING MODE.

insert
→
attached

3/4.9.5 COMMUNICATIONS

The requirement for communications capability ensures that refueling station personnel can be promptly informed of significant changes in the facility status or core reactivity condition during CORE ALTERATIONS.

Docket Number 50-346
License Number NPF-3
Serial Number 2051
Attachment
Page 24

Insert for TS 3/4.9.4 Bases

With the containment purge and exhaust system in operation, a high radiation signal received from the containment purge and exhaust system noble gas monitor will effectively automatically contain the release by shutting down the containment purge system supply and exhaust fans and closing their inlet and outlet dampers. On a valid signal, the control room operator will then manually close the containment purge and exhaust isolation valves. Therefore, the uncontrolled release of radioactive material from the containment to the environment will be restricted.

Likewise, use of the SFAS area radiation monitors provide an automatic containment isolation signal on high radiation, restricting the uncontrolled release of radioactive material from the containment to the environment.

REFUELING OPERATIONS

BASES

3/4.9.6 FUEL HANDLING BRIDGE OPERABILITY

The OPERABILITY requirements of the hoist bridges used for movement of fuel assemblies ensures that: 1) fuel handling bridges will be used for movement of control rods and fuel assemblies, 2) each hoist has sufficient load capacity to lift a fuel element, and 3) the core internals and pressure vessel are protected from excessive lifting force in the event they are inadvertently engaged during lifting operations.

3/4.9.7 CRANE TRAVEL - FUEL HANDLING BUILDING

The restriction on movement of loads in excess of the nominal weight of a fuel assembly in a failed fuel container over other fuel assemblies in the storage pool ensures that in the event this load is dropped (1) the activity release will be limited to that contained in a single fuel assembly, and (2) any possible distortion of fuel in the storage racks will not result in a critical array. This assumption is consistent with the activity release assumed in the accident analyses.

3/4.9.8 COOLANT CIRCULATION

The requirement that at least one decay heat removal loop be in operation ensures that (1) sufficient cooling capacity is available to remove decay heat and maintain the water in the reactor pressure vessel below 140°F as required during the REFUELING MODE, and (2) sufficient coolant circulation is maintained through the reactor core to minimize the effect of a boron dilution incident and prevent boron stratification.

The requirement to have two DHR loops OPERABLE when there is less than 23 feet of water above the core ensures that a single failure of the operating DHR loop will not result in a complete loss of decay heat removal capability. With the reactor vessel head removed and 23 feet of water above the core, a large heat sink is available for core cooling. Thus, in the event of a failure of the operating DHR loop, adequate time is provided to initiate emergency procedures to cool the core.

3/4.9.9 CONTAINMENT PURGE AND EXHAUST ISOLATION SYSTEM

DELETED.

The OPERABILITY of this system ensures that the containment purge and exhaust penetrations will be automatically isolated upon detection of high radiation levels within the containment. The OPERABILITY of this system is required to restrict the release of radioactive material from the containment atmosphere to the environment.

3/4.9.10 and 3/4.9.11 WATER LEVEL - REACTOR VESSEL AND STORAGE POOL

The restrictions on minimum water level ensure that sufficient water depth is available to remove 99% of the assumed 10% iodine gas activity released from the rupture of an irradiated fuel assembly. The minimum water depth is consistent with the assumptions of the safety analysis.

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS


<u>SECTION</u>	<u>PAGE</u>
<u>3/4.9 REFUELING OPERATIONS</u>	
3/4.9.1 BORON CONCENTRATION.....	3/4 9-1
3/4.9.2 INSTRUMENTATION.....	3/4 9-2
3/4.9.3 DECAY TIME.....	3/4 9-3
3/4.9.4 CONTAINMENT PENETRATIONS.....	3/4 9-4
3/4.9.5 COMMUNICATIONS.....	3/4 9-5
3/4.9.6 FUEL HANDLING BRIDGE OPERABILITY.....	3/4 9-6
3/4.9.7 CRANE TRAVEL - FUEL HANDLING BUILDING.....	3/4 9-7
3/4.9.8 DECAY HEAT REMOVAL AND COOLANT CIRCULATION	
All Water Levels.....	3/4 9-8
Low Water Level.....	3/4 9-8a
3/4.9.9 <u>CONTAINMENT PURGE AND EXHAUST ISOLATION SYSTEM</u>	3/4 9-9
3/4.9.10 WATER LEVEL - REACTOR VESSEL.....	3/4 9-10
3/4.9.11 STORAGE POOL WATER LEVEL.....	3/4 9-11
3/4.9.12 STORAGE POOL VENTILATION.....	3/4 9-12
3/4.9.13 SPENT FUEL POOL FUEL ASSEMBLY STORAGE.....	3/4 9-13
<u>3/4.10 SPECIAL TEST EXCEPTIONS</u>	
3/4.10.1 GROUP HEIGHT, INSERTION AND POWER DISTRIBUTION LIMITS.....	3/4 10-1
3/4.10.2 PHYSICS TESTS.....	3/4 10-2
3/4.10.3 REACTOR COOLANT LOOPS.....	3/4 10-3
3/4.10.4 SHUTDOWN MARGIN.....	3/4 10-4

INDEX

BASES

<u>SECTION</u>	<u>PAGE</u>
3/4.9.6 FUEL HANDLING BRIDGE OPERABILITY.....	B 3/4 9-2
3/4.9.7 CRANE TRAVEL - FUEL HANDLING BUILDING.....	B 3/4 9-2
DELETED 3/4.9.8 COOLANT CIRCULATION.....	B 3/4 9-2
3/4.9.9 <u>CONTAINMENT PURGE AND EXHAUST ISOLATION SYSTEM.</u>	B 3/4 9-2
3/4.9.10 and 3/4.9.11 WATER LEVEL - REACTOR VESSEL AND STORAGE POOL.....	B 3/4 9-2 ①
3/4.9.12 STORAGE POOL VENTILATION.....	B 3/4 9-3
3/4.9.13 SPENT FUEL POOL FUEL ASSEMBLY STORAGE.....	B 3/4 9-3
<u>3/4.10 SPECIAL TEST EXCEPTIONS</u>	
3/4.10.1 GROUP HEIGHT, INSERTION AND POWER DISTRIBUTION LIMITS.....	B 3/4 10-1
3/4.10.2 PHYSICS TESTS.....	B 3/4 10-1
3/4.10.3 REACTOR COOLANT LOOPS.....	B 3/4 10-1
3/4.10.4 SHUTDOWN MARGIN.....	B 3/4 10-1
<u>3/4.11 RADIOACTIVE EFFLUENTS</u>	
3/4.11.1 LIQUID EFFLUENTS	B 3/4 11-1
3/4.11.2 GASEOUS EFFLUENTS.....	B 3/4 11-3
3/4.11.3 SOLID RADIOACTIVE WASTE.....	B 3/4 11-6
3/4.11.4 TOTAL DOSE.....	B 3/4 11-7
<u>3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING</u>	
3/4.12.1 MONITORING PROGRAM.....	B 3/4 12-1
3/4.12.2 LAND USE CENSUS.....	B 3/4 12-1
3/4.12.3 INTERLABORATORY COMPARISON PROGRAM.....	B 3/4 12-1

INFORMATION
COPY

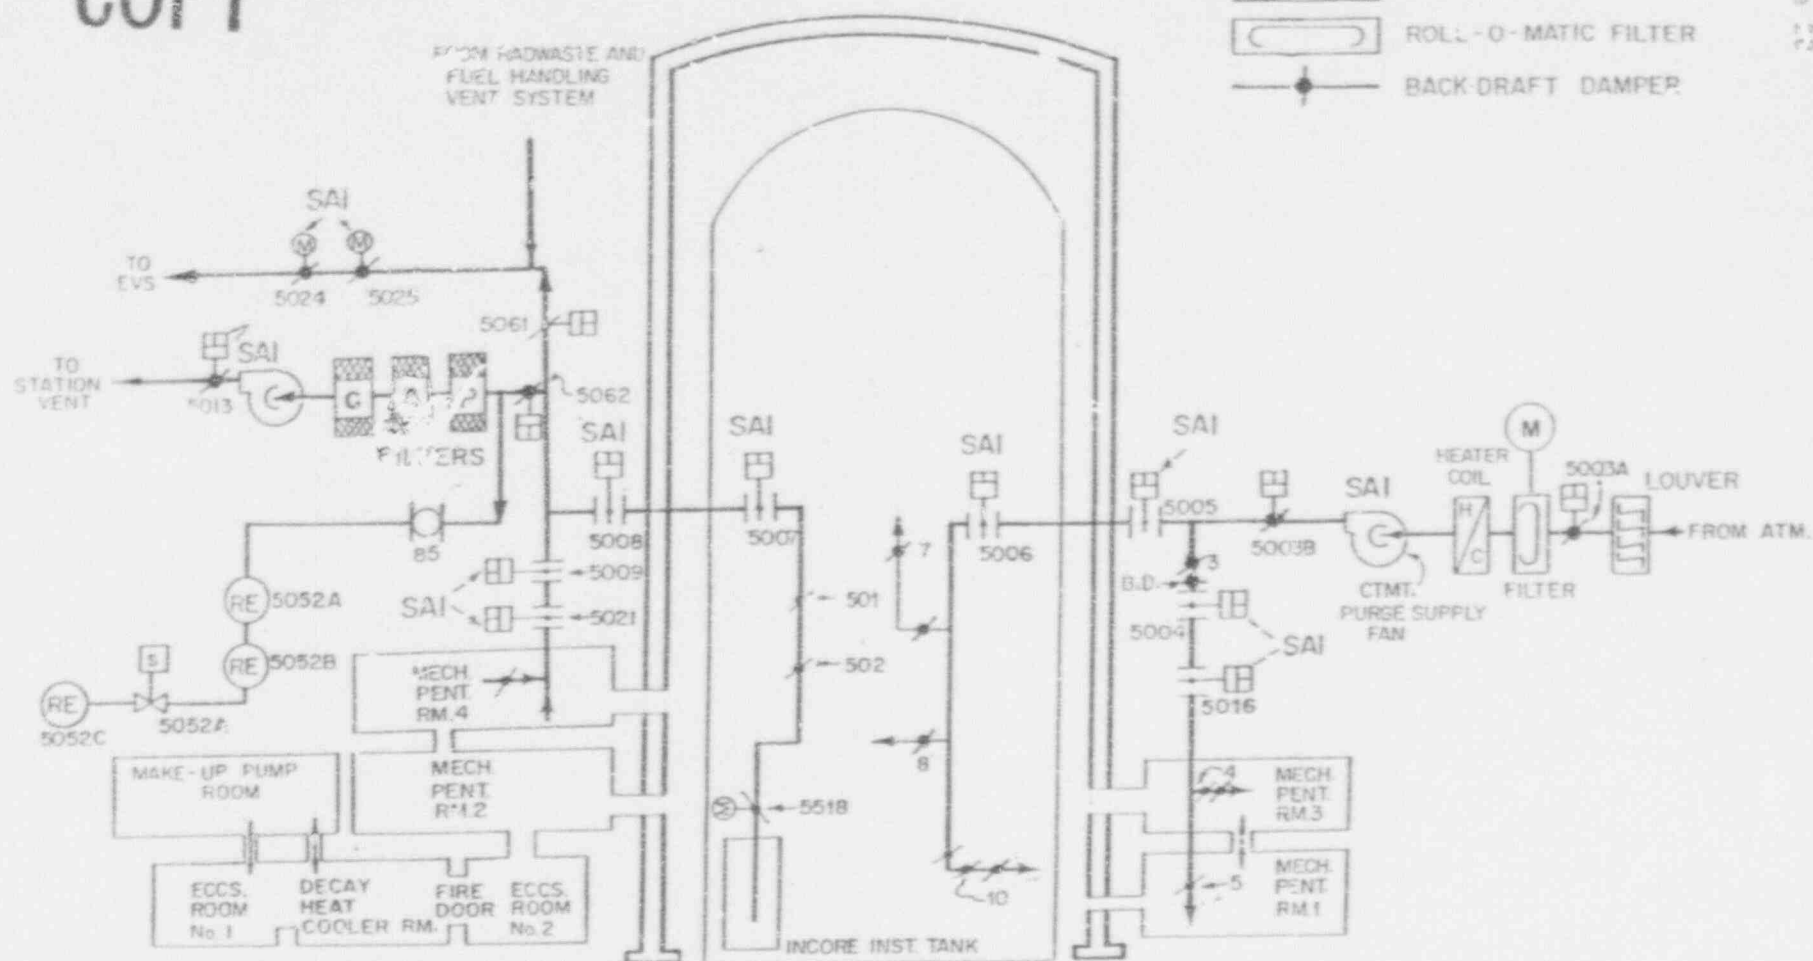

Docket Number 50-346
License Number NPF-3
Serial Number 2051
Attachment
Page 22