

## LICENSEE EVENT REPORT (LER)

FACILITY NAME (1)  
Joseph M. Farley - Unit 1

DOCKET NUMBER (2)

0 5 0 0 0 3 4 8 1 OF 0 2

PAGE (3)

TITLE (4)

Continuous Fire Watch Not Posted As Required

EVENT DATE (5)			LER NUMBER (6)			REPORT DATE (7)			OTHER FACILITIES INVOLVED (8)																				
MONTH	DAY	YEAR	YEAR	SEQUENTIAL NUMBER	REVISION NUMBER	MONTH	DAY	YEAR	FACILITY NAMES	DOCKET NUMBER(S)																			
1	0	2	2	8	4	8	4	-	0	2	2	-	0	0	1	1	2	1	8	4	J. M. Farley - Unit 2	0	5	0	0	0	3	6	4
											0		5	0	0	0													

OPERATING MODE (9)		THIS REPORT IS SUBMITTED PURSUANT TO THE REQUIREMENTS OF 10 CFR § (Check one or more of the following) (11)													
1		20.402(b)				20.406(a)				50.73(a)(2)(iv)				73.71(b)	
POWER LEVEL (10)	1	20.406(a)(1)(i)				50.36(a)(1)				50.73(a)(2)(v)				73.71(e)	
	0	20.406(a)(1)(ii)				50.36(a)(2)		X		50.73(a)(2)(vii)				OTHER (Specify in Abstract below and in Text, NRC Form 366A)	
		20.406(a)(1)(iii)				50.73(a)(2)(i)		X		50.73(a)(2)(viii)(A)					
		20.406(a)(1)(iv)				50.73(a)(2)(ii)				50.73(a)(2)(viii)(B)					
		20.406(a)(1)(v)				50.73(a)(2)(iii)				50.73(a)(2)(ix)					

LICENSEE CONTACT FOR THIS LER (12)  
NAME  
J. D. Woodard

TELEPHONE NUMBER

AREA CODE

2 0 5 8 9 9 - 5 1 5 6

COMPLETE ONE LINE FOR EACH COMPONENT FAILURE DESCRIBED IN THIS REPORT (13)									
CAUSE	SYSTEM	COMPONENT	MANUFACTURER	REPORTABLE TO NRC	CAUSE	SYSTEM	COMPONENT	MANUFACTURER	REPORTABLE TO NRC

SUPPLEMENTAL REPORT EXPECTED (14)  
YES (If yes, complete EXPECTED SUBMISSION DATE):  
NO

EXPECTED SUBMISSION DATE (15)

MONTH DAY YEAR

ABSTRACT (Limit to 1400 spaces, i.e., approximately fifteen single-space typewritten lines) (16)

At 0345 on 10-24-84, it was determined that the isolation valve for fire protection system ISW-111 was closed. The valve was opened and the fire protection system was returned to service at 0355 on 10-24-84. An investigation revealed that the isolation valve had been closed at approximately 1500 on 10-22-84. Technical Specification 3.7.11.2 action statements require a continuous fire watch to be posted within one hour of the time that ISW-111 is rendered inoperable. However, no fire watch had been posted. Health/safety of the public was not affected.

8412030305 841121  
PDR ADDCK 05000348  
S PDR

JE22

## LICENSEE EVENT REPORT (LER) TEXT CONTINUATION

APPROVED OMB NO. 3150-0104

EXPIRES 8/31/85

FACILITY NAME (1)  J. M. Farley - Unit 1	DOCKET NUMBER (2)  0 5 0 0 0 3 4 8 8 4 - 0 2 2 - 0 0 0 2 OF - 2	LER NUMBER (6)			PAGE (3)		
		YEAR	SEQUENTIAL NUMBER	REVISION NUMBER			

TEXT (If more space is required, use additional NRC Form 366A's) (17)


On 10-24-84, while making normal rounds of the Service Water Intake Structure, the Outside System Operator noticed that the isolation valve for fire protection sprinkler system 1SW-111 appeared to be closed. At 0355, after discussing this with the Shift Foreman, the Outside System Operator opened the isolation valve.

Technical Specification 3.7.11.2 action statements require a continuous fire watch to be posted within one hour of the time that fire protection system 1SW-111 is rendered inoperable. However, no fire watch had been posted. It was determined that 1SW-111 was isolated at approximately 1500 on 10-22-84 to allow Maintenance personnel to reset the clapper valve for this system. The Maintenance personnel were unable to reset the clapper valve and the fire protection system was left isolated.

This event was caused by personnel error in that the Shift Foreman failed to follow procedures for the control of fire watches. The individual involved has been counseled. Further, an Operations Memorandum, which was issued to all licensed personnel, stressed the need for strict procedural adherence and control in fire protection matters. This memorandum cited this event as an example.

Mailing Address  
Alabama Power Company  
600 North 18th Street  
Post Office Box 2641  
Birmingham, Alabama 35291  
Telephone 205 783-6090

R. P. McDonald  
Senior Vice President  
Flintridge Building



November 21, 1984

Docket No. 364


Document Control Desk  
U. S. Nuclear Regulatory Commission  
Washington, D.C. 20555

Dear Sir:

Joseph M. Farley Nuclear Plant, Unit 1, Licensee Event Report  
No. LER 84-022-00 is forwarded in accordance with 10CFR50.73 to provide 30  
day written notification of the occurrence.

If you have any questions, please advise.

Yours very truly,

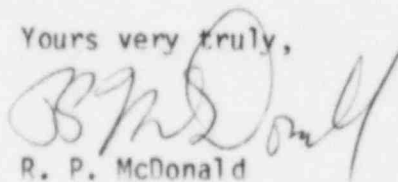

R. P. McDonald

RPM/DSM:sam

Enclosure

xc: IE, Region II

IE22  
11