

GULF STATES UTILITIES COMPANY


POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704

AREA CODE 409 838-6631



March 14, 1985
RBG- 20435
File Nos. G9.5, G9.25.1.1

Mr. Robert D. Martin, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

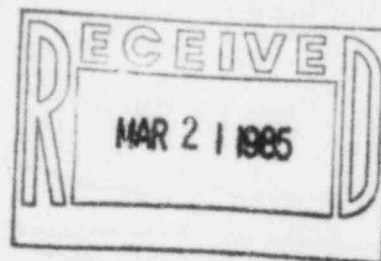

Dear Mr. Martin:

River Bend Station Unit 1
Docket No. 50-458
Final Report/DR-247

Gulf States Utilities Company (GSU) has completed its evaluation of DR-247 concerning six dimensional discrepancies of Category I site-fabricated pipe anchor clamps. The dimensional discrepancies were examined and it was determined that the structural integrity of the pipe anchor clamps is not affected by this condition. GSU has therefore determined this condition is not reportable under 10CFR50.55(e). However, the drawings were revised to reflect the as-built conditions of the support clamps and the weld attaching the clamp to its permanent support surface for two clamps (BZ74LW and BZ74MM) were increased in accordance with Nonconformance and Disposition Report Nos. 6885, 6959, and 7091.

Sincerely,

J. E. Booker

J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

WV/PJO
JEB/PJD/lp

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

NRC Resident Inspector-Site

8504030040 850314
PDR ADOCK 05000458
S PDR

EC-27
1/0

85-65