

PBAPS
LIST OF FIGURES

UNIT 3

<u>Figure</u>	<u>Title</u>	<u>Page</u>
1.1-1	APRM Flow Bias Scram Relationship To Normal Operating Conditions	16
4.1.1	Instrument Test Interval Determination Curves	55
4.2.2	Probability of System Unavailability vs. Test Interval	98
3.4.1	Required Volume and Concentration of Standby Liquid Control System Solution	122
3.4.2	Required Temperature vs. Concentration for Standby Liquid Control System Solution	123
3.5.K.1	MCPR Operating Limit vs. Tau, LTA	142
3.5.K.2	MCPR Operating Limit vs. Tau, BP/P8X8R Fuel	142a
3.5.1.A	DELETED	
3.5.1.B	DELETED	
3.5.1.C	DELETED	
3.5.1.D	DELETED	
3.5.1.E	Kf Factor vs. Core Flow	142d
3.5.1.F	MAPLHGR vs. Planar Average Exposure, Unit 3 8X8 PTA Fuel	142e
3.5.1.G	DELETED	
3.5.1.H	MAPLHGR vs. Planar Average Exposure, Unit 3 P8X8R Fuel (P8DRB284H)	142g
3.5.1.I	MAPLHGR vs. Planar Average Exposure, Unit 3 P8X8R and BP8X8R Fuel (P8DRB299 and BP8DRB299)	142h
3.5.1.J	MAPLHGR vs. Planar Average Exposure, Unit 3 BP8X8R Fuel (BP8DRB299H)	142i
3.5.1.K	MAPLHGR vs. Planar Average Exposure, Unit 3 P8X8Q LTA (P8DQB326)	142j
3.6.1	Minimum Temperature for Pressure Tests such as required by Section XI	164
3.6.2	Minimum Temperature for Mechanical Heatup or Cooldown following Nuclear Shutdown	164a
3.6.3	Minimum Temperature for Core Operation (Criticality)	164b
3.6.4	Transition Temperature Shift vs. Fluence	164c
3.6.5	Thermal Power Limits of Specifications 3.6.F.3, 3.6.F.4, 3.6.F.5, 3.6.F.6 and 3.6.F.7	164d
3.8.1	Site Boundary and Effluent Release Points	216e
6.2-1	Management Organization Chart	244
6.2-2	Organization for Conduct of Plant Operation	245

8504040184 850401
PDR ADOCK 05000278
P PDR

TABLE 3.5.K.2

OPERATING LIMIT MCPR VALUES
FOR VARIOUS CORE EXPOSURES*

<u>Fuel Type</u>	<u>MCPR Operating Limit For Incremental Cycle Core Average Exposure**</u>	
	BOC to 2000 MWD/t Before EOC	2000 MWD/t before EOC To EOC
BP/P8X8R	1.27	1.28
LTA	1.27	1.28

* If requirement 4.5.K.2.a is met.

** These values shall be increased by 0.01 for single loop operation.

TABLE 3.5.K.3

OPERATING LIMIT MCPR VALUES
FOR VARIOUS CORE EXPOSURES*


<u>Fuel Type</u>	<u>MCPR Operating Limit For Incremental Cycle Core Average Exposure**</u>	
	BOC to 2000 MWD/t Before EOC	2000 MWD/t before EOC To EOC
BP/P8X8R	1.33	1.40
LTA	1.33	1.40

* If surveillance requirement 4.5.K.2 is not performed.

** These values shall be increased by 0.01 for single loop operation.

FIGURE 3.5.K.1 MCPR OPERATING LIMIT vs \bar{T}

FUEL TYPE LTA

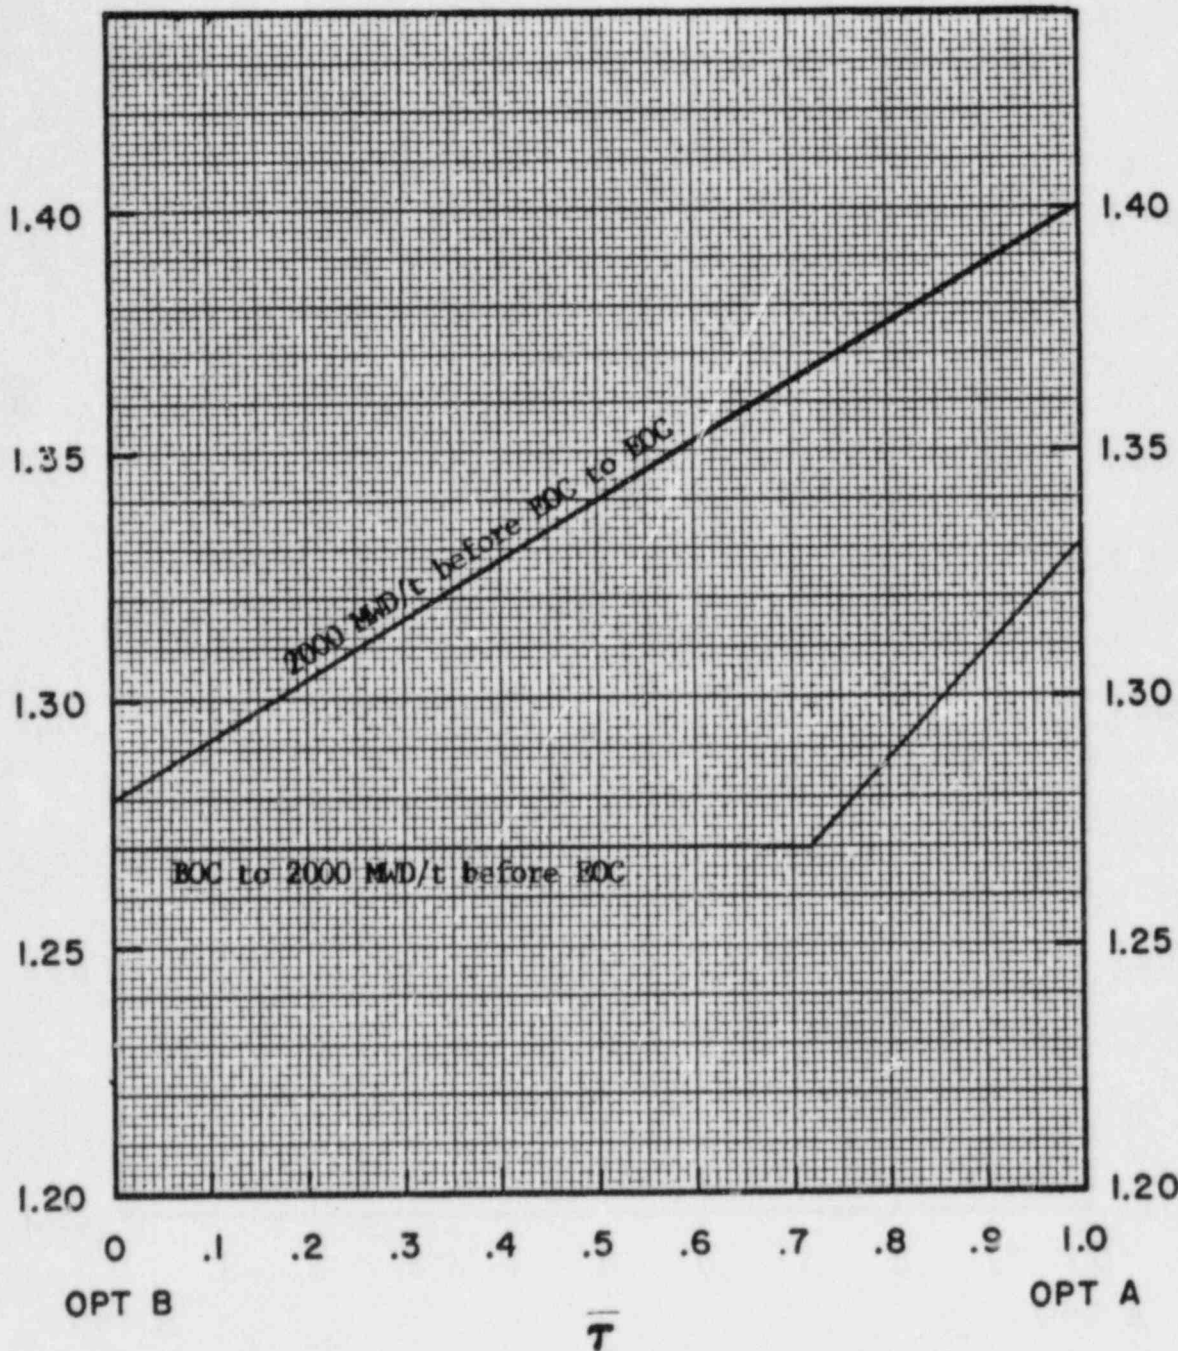

PEACH BOTTOM UNIT 3

FIGURE 3.5.K.2 MCPR OPERATING LIMIT vs \bar{T}

FUEL TYPE BP/P8X8R

