



GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704

AREA CODE 713 833-6631

November 27, 1984


RBG- 19522

File Nos. G9.5, G9.25.i.1

Mr. Robert D. Martin, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV, Office of Inspection and Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011


Dear Mr. Martin:


River Bend Station Unit 1
Docket No. 50-458
Final Report/DR 167

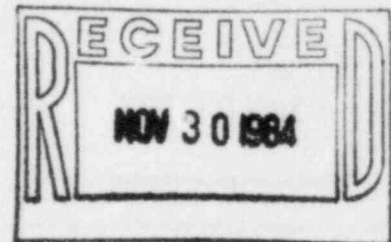

Gulf States Utilities Company (GSU) has completed its evaluation of DR-167 concerning wiring discrepancies in the HPCS Diesel Generator Control Panel supplied by General Electric Company. The wiring discrepancies would not have prevented the safety systems affected from performing their intended safety function; therefore, GSU has determined this condition is not reportable under 10CFR50.55(e). FDDR LD1-1246 has been issued to correct the identified discrepancies.

Sincerely,

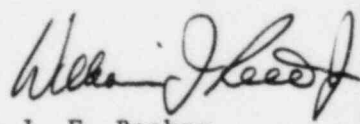
for J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group


JEB/PJD/lp

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

NRC Resident Inspector-Site

8412070048 841127
PDR ADDCK 05000458
S PDR

IE-2710