

X244

NRC C/O DOC CTRL DESK, C. PATEL
DIRECTOR OF NUC. REACTOR REGULATION
U. S. NUC. REGULATORY COMMISSION
MAIL STATION P1-137

WASHINGTON
20555

DC

April 21, 1992

The attached map has been corrected for the Offsite Dose Calculation Manual (DDCM) Byron Station Annex. BY-30 was duplicated previously in both the SSE and SE sectors on the map. The dairy (BY-30) is located in the SK sector, as per the February 21, 1992 Byron Station transmittal following the Onsite Review approval.

Please complete the following manual update:

Remove

- Byron Station Annex
Chapter 11, p. 11-19
Revision D.F.
December, 1991

Insert

- Byron Station Annex
Chapter 11, p. 11-19
Revision D.F.
December, 1991
Corrected Page

Please sign and date this control sheet. Return to:

COMMONWEALTH EDISON COMPANY
c/o Document Control - Emergency Preparedness
72 West Adams - Room 1237E
Chicago, IL 60690
(312) 294-8665

Your signature indicates you have verified that your control copy is correct.


Signature

Date

9205050074 920421
PDR ADOCK 05000456
PDR

ZENERPLN/224/19

Adock
4/11

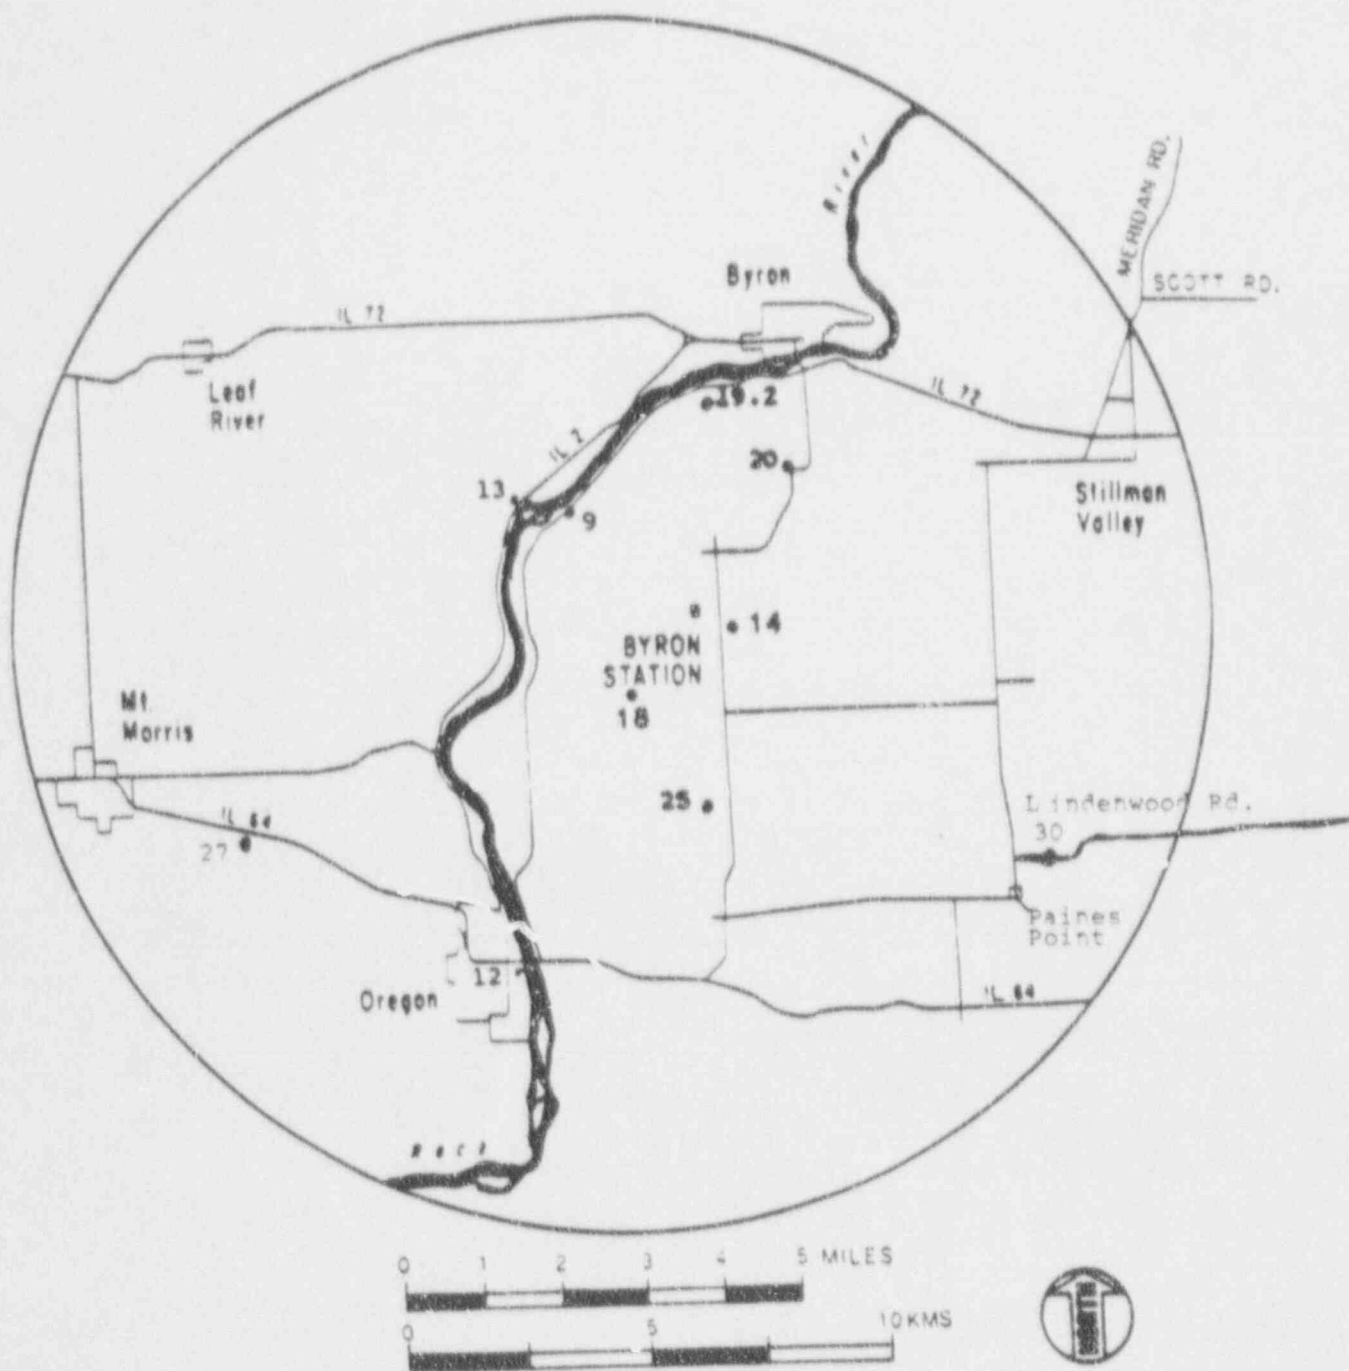

OFFSITE DOSE CALCULATION MANUAL
BYRON STATION

FIGURE 11-4

INGESTION AND WATERBORNE EXPOSURE
PATHWAY SAMPLE LOCATIONS