

**GEORGIA POWER COMPANY
EDWIN I. HATCH NUCLEAR PLANT**

**UNIT 1 CYCLE 17
CORE OPERATING LIMITS REPORT**

Revision 1

Southern Nuclear Operating Company
Post Office Box 1295
Birmingham, Alabama 35201

**EDWIN I. HATCH NUCLEAR PLANT
UNIT 1 FUEL CYCLE 16
CORE OPERATING LIMITS REPORT**

AFFECTED PAGE LIST

Unless noted otherwise, all pages are Revision 0.

<u>Page Number</u>	<u>Revision</u>
Cover	1
i	1
ii	1
iii	1
1	1
11	1
13	1
17	1
18	1
19	1
20	1

Edwin I. Hatch Nuclear Plant
Unit 1 Cycle 17
Core Operating Limits Report

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>	
1.0	Introduction	1	
2.0	Rod Block Monitor	1	
3.0	APLHGR Limit	2	
4.0	MCPR Limit	11	
5.0	APRM Flow Biased Simulated Thermal Power -High Time Constant	20	
6.0	References	20	

TABLE OF CONTENTS (Continued)

LIST OF FIGURES

<u>Figure No.</u>	<u>Title</u>	<u>Page</u>
3-1	MAPLHGR Multiplier ($MAPFAC_F$) Versus Core Flow	3
3-2	MAPLHGR Multiplier ($MAPFAC_P$) Versus Core Power	4
3-3	APLHGR Versus Average Planar Exposure (GE9B-P8DWB330-10GZ-80M-150-T)	5
3-4	APLHGR Versus Average Planar Exposure (GE9B-P8DWB314-8G4.0-80M-150-T)	6
3-5	APLHGR Versus Average Planar Exposure (GE9B-P8DWB331-10GZ-80M-150-T)	7
3-6	APLHGR Versus Average Planar Exposure (GE13-P9HTB327-12GZ-100M-J46-T-LUA-RECON)	8
3-7	APLHGR Versus Average Planar Exposure (GE9B-P8DWB346-10GZ-80U-150-T)	9
3-8	APLHGR Versus Average Planar Exposure (GE12-P10HSB331-6G5.0/4G4.0-100T-150-T)	10
4-1	MCPR Multiplier (K_P) Versus Core Power	14
4-2	MCPR Limits ($MCPR_F$) Versus Core Flow	15
4-3	MCPR Limit Versus Average Scram Time (with Turbine Bypass Valves Operable and EOC-RPT System Operable)	16
4-4	MCPR Limit Versus Average Scram Time (with Turbine Bypass Valves Operable and EOC-RPT System Inoperable)	17

TABLE OF CONTENTS (Continued)

LIST OF FIGURES (Continued)

<u>Figure No.</u>	<u>Title</u>	<u>Page</u>
4-5	MCPR Limit Versus Average Scram Time <i>(with Turbine Bypass Valves Inoperable and EOC-RPT System Operable)</i>	18
4-6	MCPR Limit Versus Average Scram Time <i>(with Turbine Bypass Valves Inoperable and EOC-RPT System Inoperable)</i>	19

LIST OF TABLES

<u>Table No.</u>	<u>Title</u>	<u>Page</u>
4-1	Operating Flexibility Options Applicability	13

1.0 INTRODUCTION

The Core Operating Limits Report (COLR) for Plant Hatch Unit 1 Cycle 17 is prepared in accordance with the requirements of Technical Specification 5.6.5. The production of this document is documented in a DRF under QA No. NFS-96-029. The core operating limits presented herein were developed using NRC-approved methods (References 1 and 2). Results from the fuel vendor's reload analyses for the fuel in Unit 1 Cycle 17 are documented in References 3, 4, and 5.

The following cycle-specific core operating limits are included in this report:

- a. Control Rod Block Instrumentation -- Technical Specification 3.3.2.1
- b. Average Planar Linear Heat Generation Rate (APLHGR) -- Technical Specification 2.1
- c. Minimum Critical Power Ratio (MCPR) -- Technical Specifications 3.2.2 and 3.3.2.1
- d. APRM Flow Biased Simulated Thermal Power - High -- Technical Specifications Surveillance Requirement 3.3.1.1.14

2.0 ROD BLOCK MONITOR (Technical Specification 3.3.2.1)

Both Rod Block Monitor (RBM) channels shall be operable as specified in Technical Specification 3.3.2.1 and when:

- a. Thermal Power is $\geq 29\%$ and $< 90\%$ of Rated Thermal Power, and MCPR is < 1.70 ;
or
- b. Thermal Power is $\geq 90\%$ of Rated Thermal Power, and MCPR is < 1.40 .

3.0 APLHGR LIMIT (Technical Specification 3.2.1)

The APLHGR limit for each fuel type is given by the applicable rated-power, rated-flow APLHGR limit taken from Figures 3-3 through 3-8, multiplied by the smaller of either:

- a. The flow-dependent multiplier, $MAPFAC_F$, from Figure 3-1,
- or
- b. The power-dependent multiplier, $MAPFAC_P$, from Figure 3-2.

For the fuel types whose APLHGR limits are shown in Figures 3-3 through 3-8, the APLHGR limit shall be applied to each axial location in the fuel assembly.

As required by GESTAR (Reference 1), the hand-calculated APLHGR values for a multi-lattice fuel (i.e., GE9-330, GE9-331, GE13-LUA, GE9-346, and GE12-331) must be less than or equal to the APLHGR limits shown in Figures 3-3, 3-5, 3-6, 3-7, and 3-8, respectively. When APLHGR values are determined by the process computer, the lattice-dependent APLHGR limits are used. Under these conditions, some axial locations may have APLHGR values exceeding the values shown in Figures 3-3, 3-5, 3-6, 3-7, and 3-8.

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

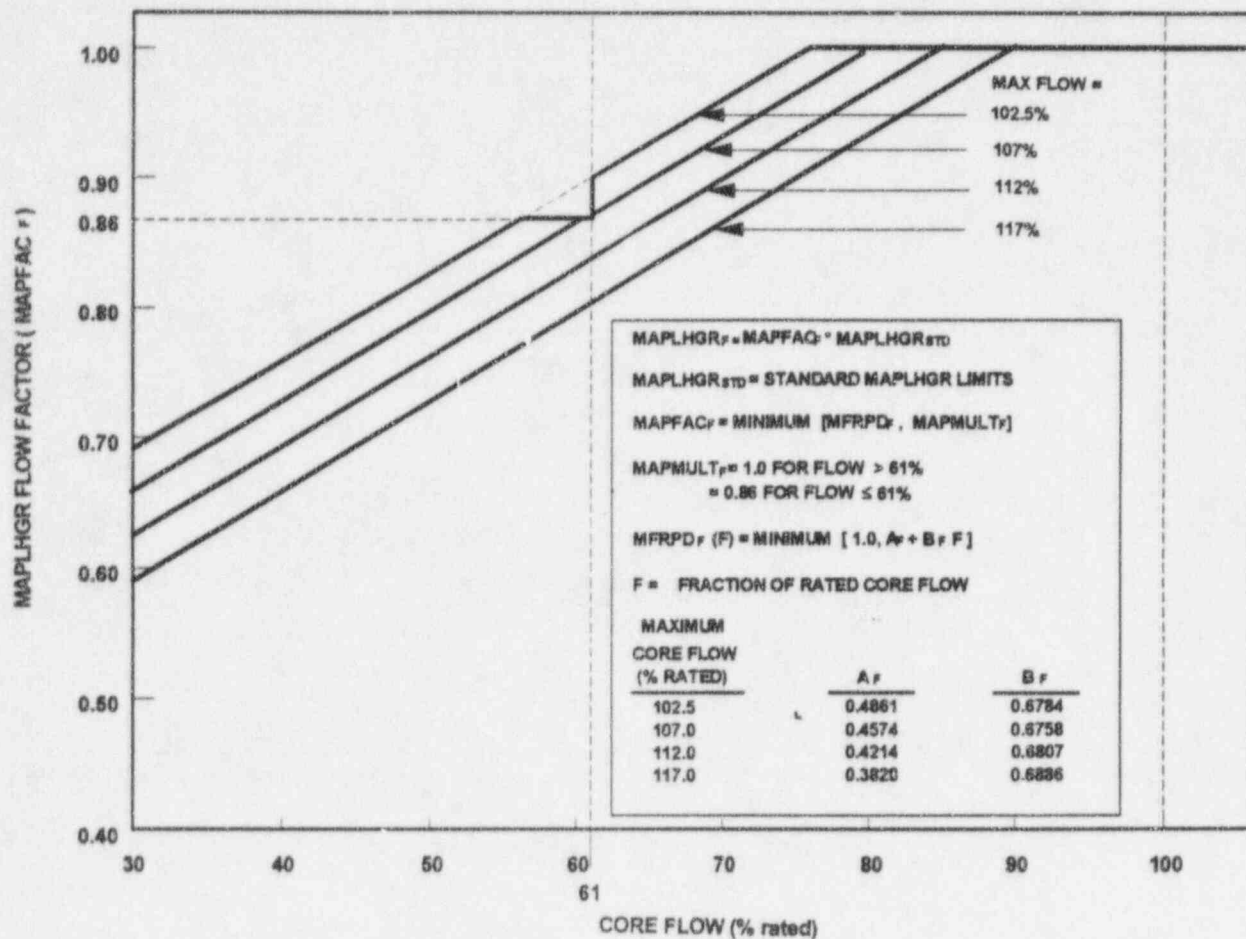


FIGURE 3-1

MAPLHGR MULTIPLIER (MAPFAC_F) VERSUS CORE FLOW

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

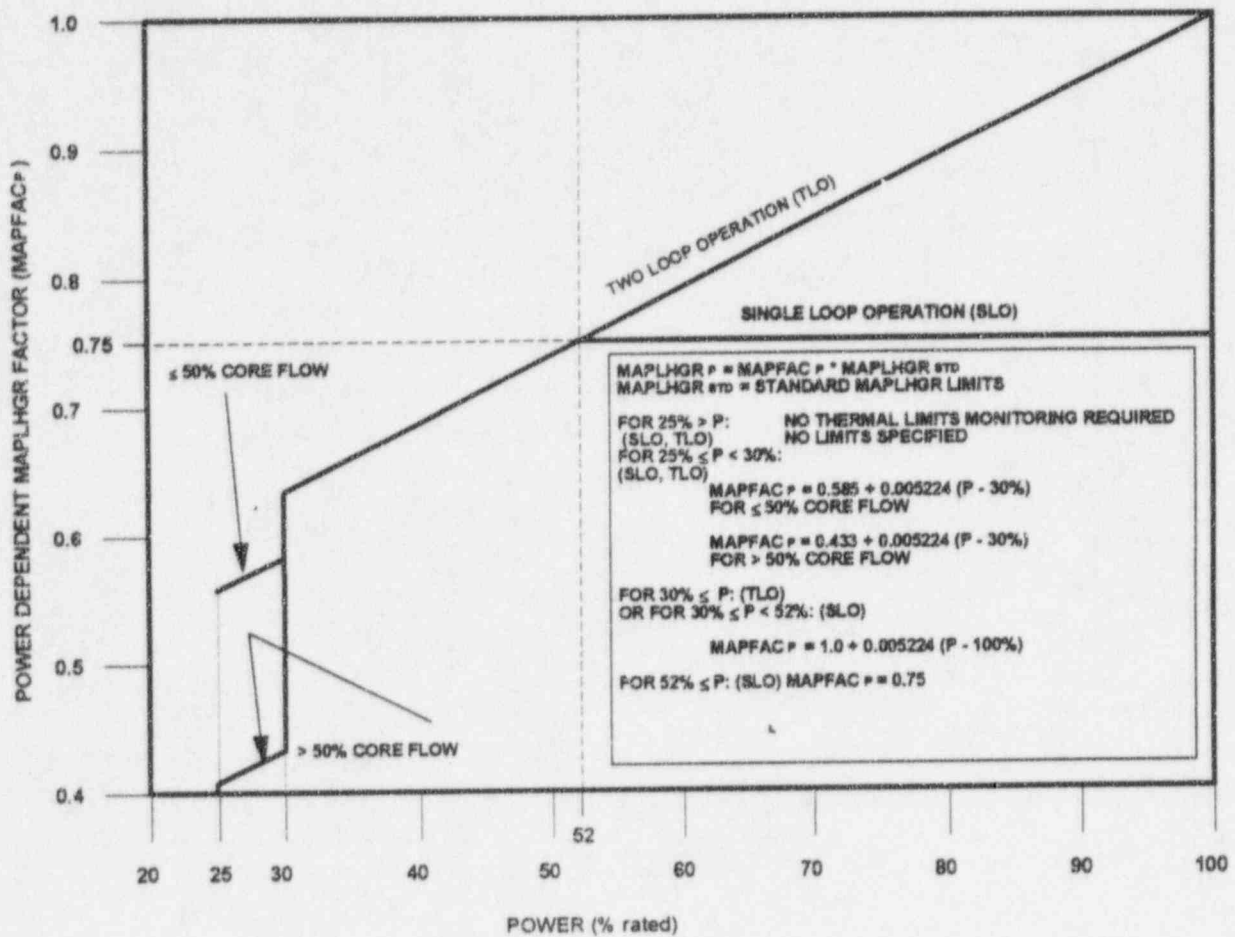


FIGURE 3-2

MAPLHGR MULTIPLIER (MAPFAC_p) VERSUS CORE POWER

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

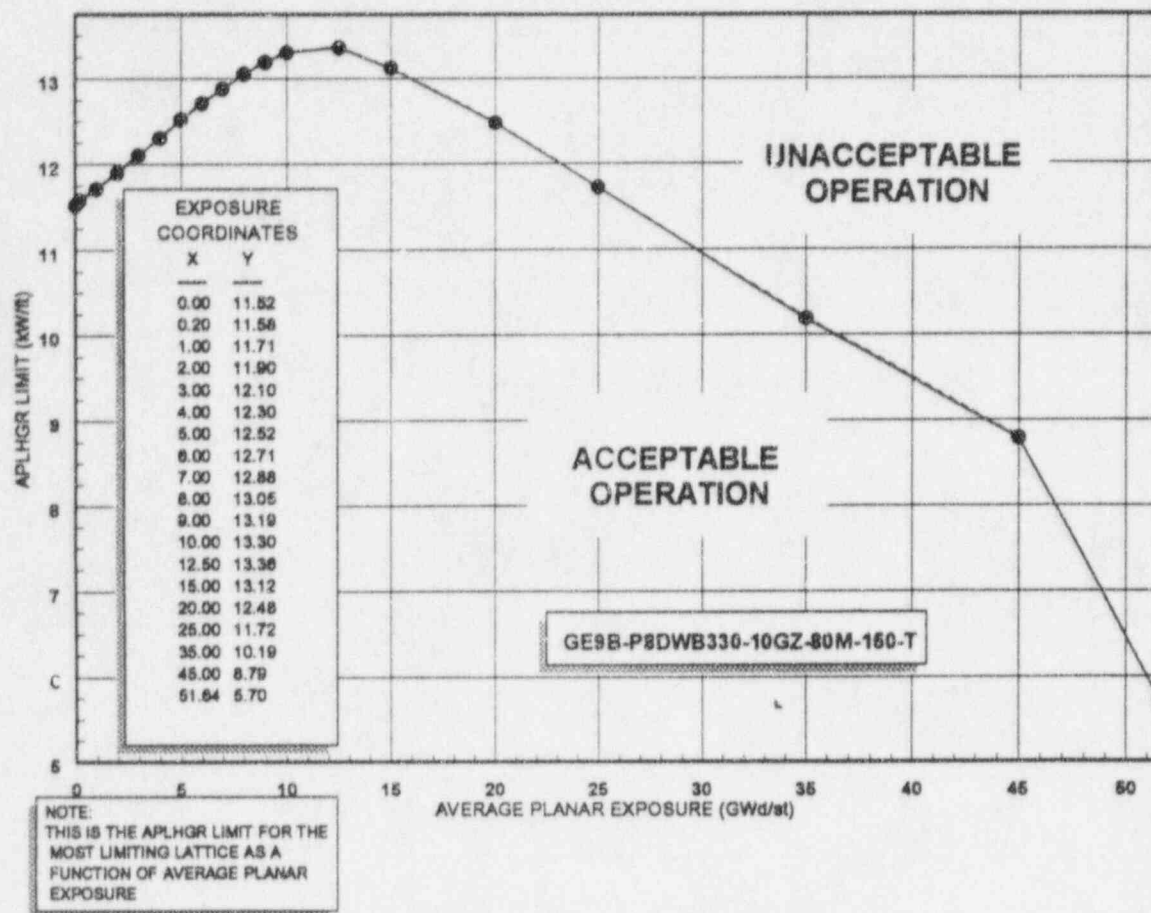


FIGURE 3-3
AVERAGE PLANAR LINEAR HEAT GENERATION RATE
VERSUS
AVERAGE PLANAR EXPOSURE
(Fuel Type: GE9B-P8DWB330-10GZ-80M-150-T)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

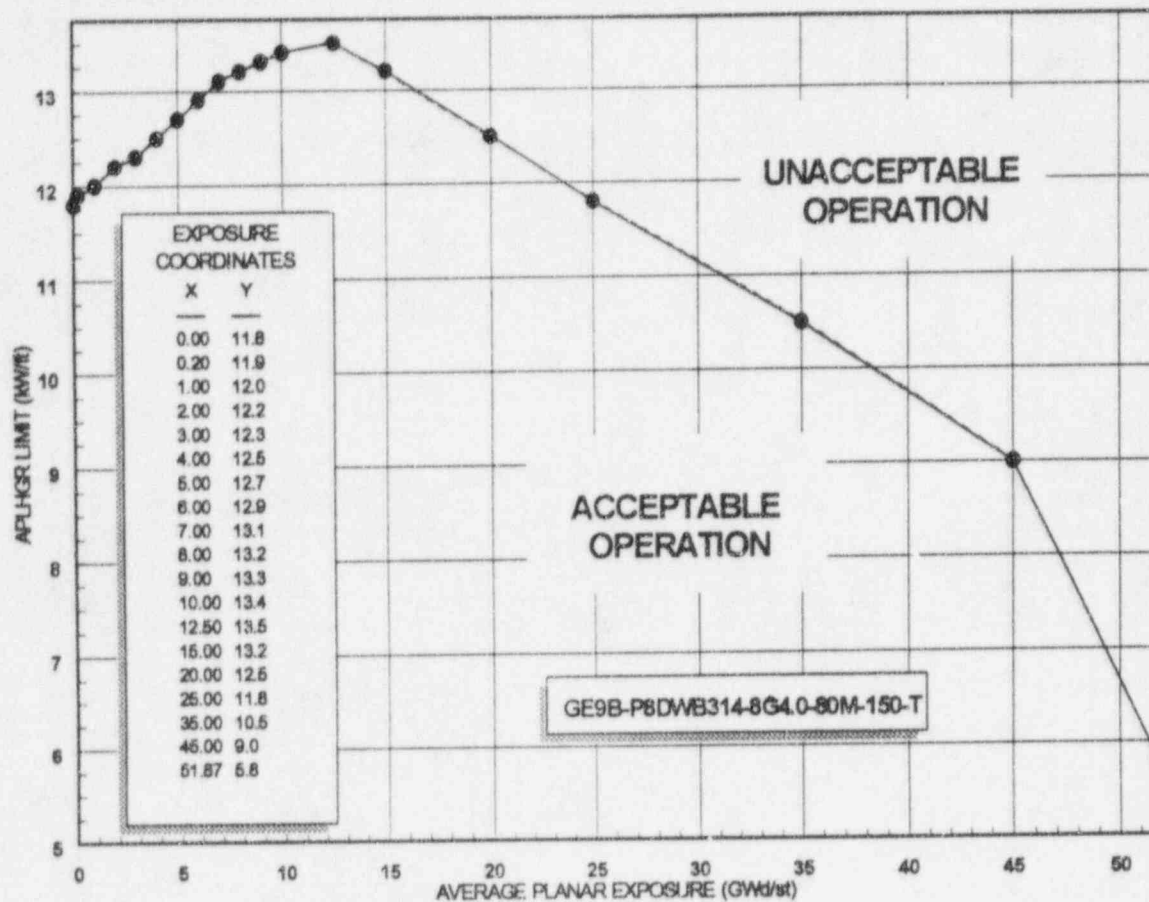


FIGURE 3-4
AVERAGE PLANAR LINEAR HEAT GENERATION RATE
VERSUS
AVERAGE PLANAR EXPOSURE
(Fuel Type: GE9B-P8DWB314-8G4.0-80M-150-T)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

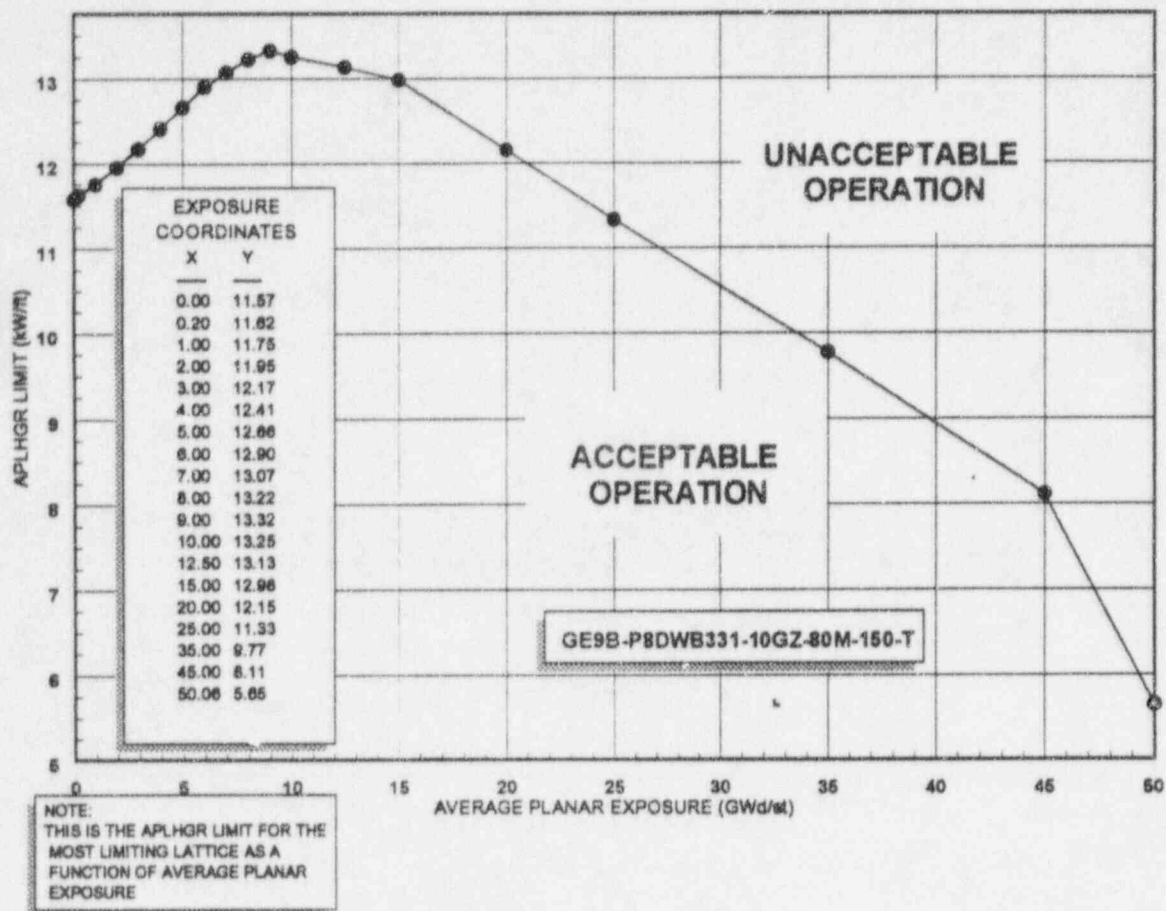


FIGURE 3-5
AVERAGE PLANAR LINEAR HEAT GENERATION RATE
VERSUS
AVERAGE PLANAR EXPOSURE
(Fuel Type: GE9B-P8DWB331-10GZ-80M-150-T)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

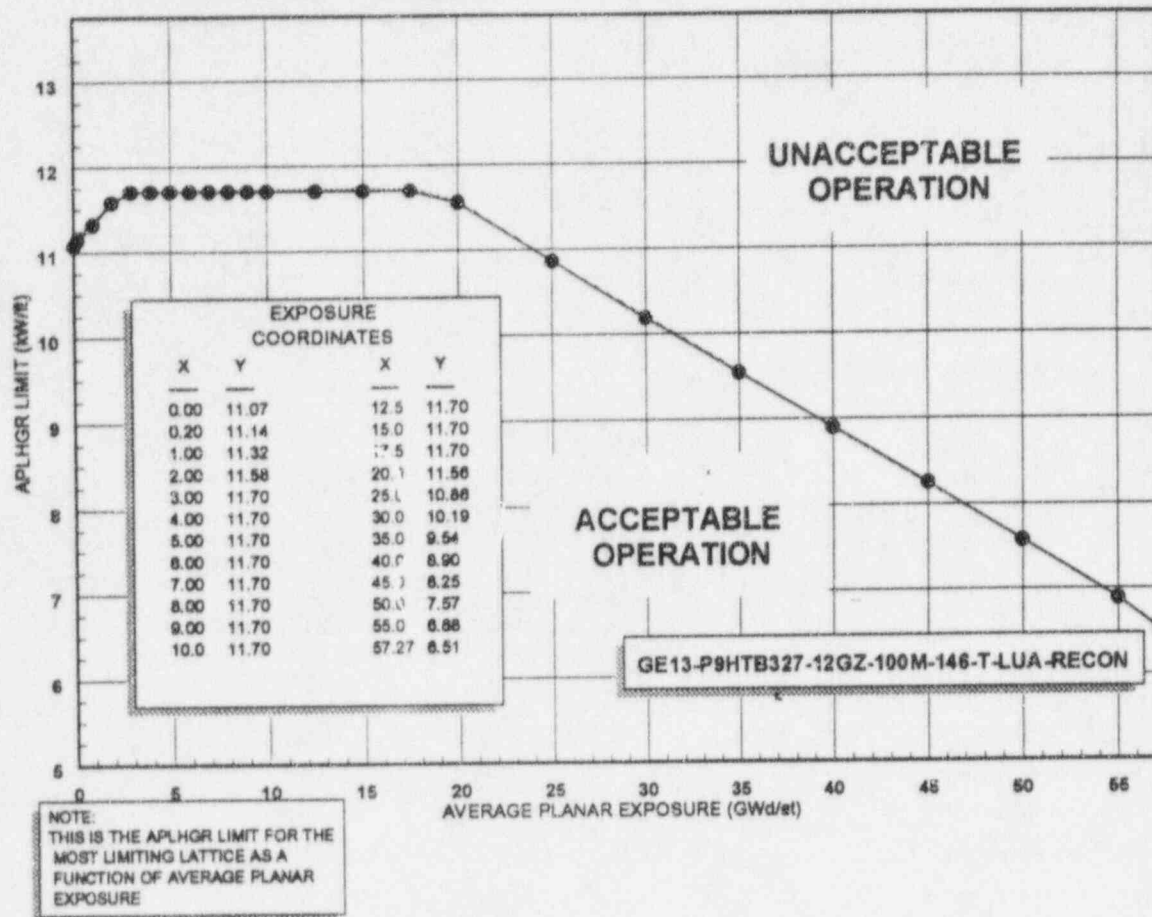


FIGURE 3-6
AVERAGE PLANAR LINEAR HEAT GENERATION RATE
VERSUS
AVERAGE PLANAR EXPOSURE
(Fuel Type: GE13-P9HTB327-12GZ-100M-146-T-LUA-RECON)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

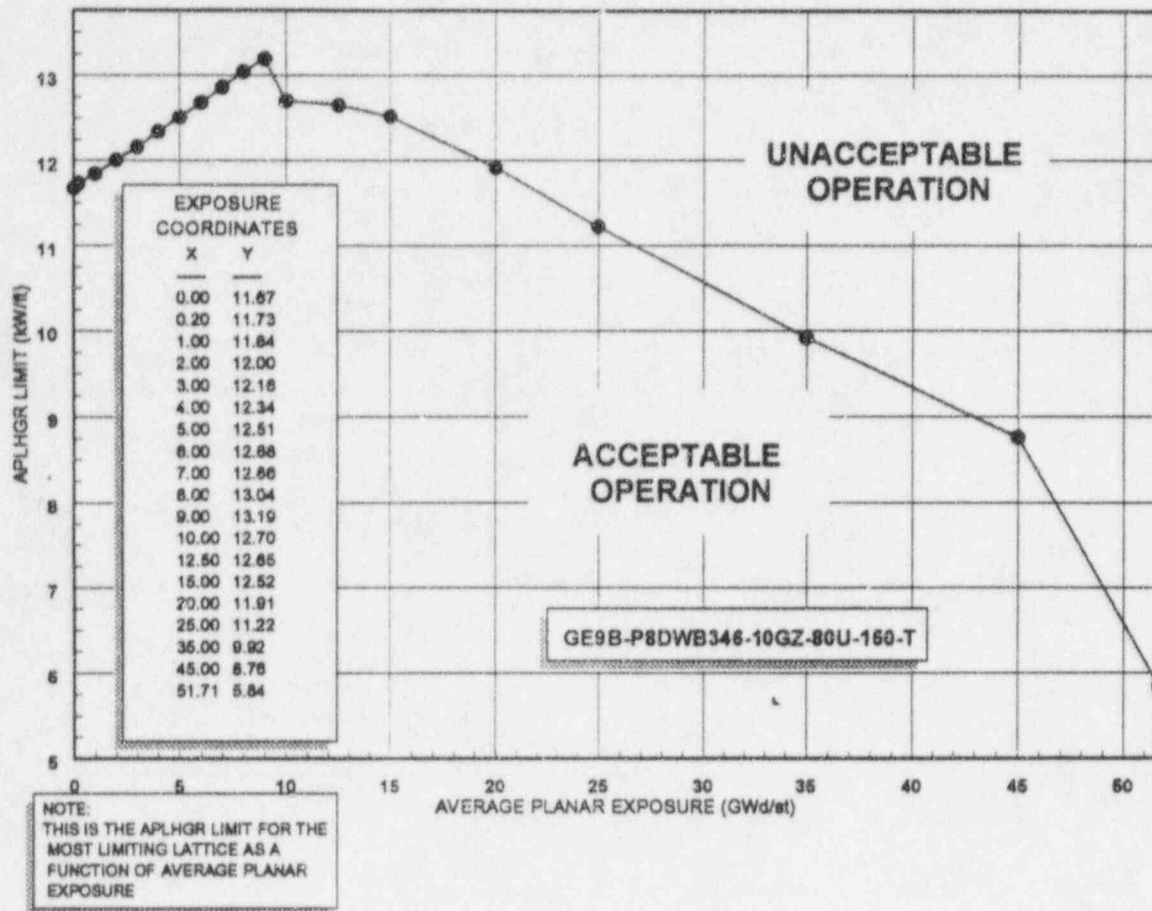


FIGURE 3-7
AVERAGE PLANAR LINEAR HEAT GENERATION RATE
VERSUS
AVERAGE PLANAR EXPOSURE
(Fuel Type: GE9B-P8DWB346-10GZ-80U-150-T)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

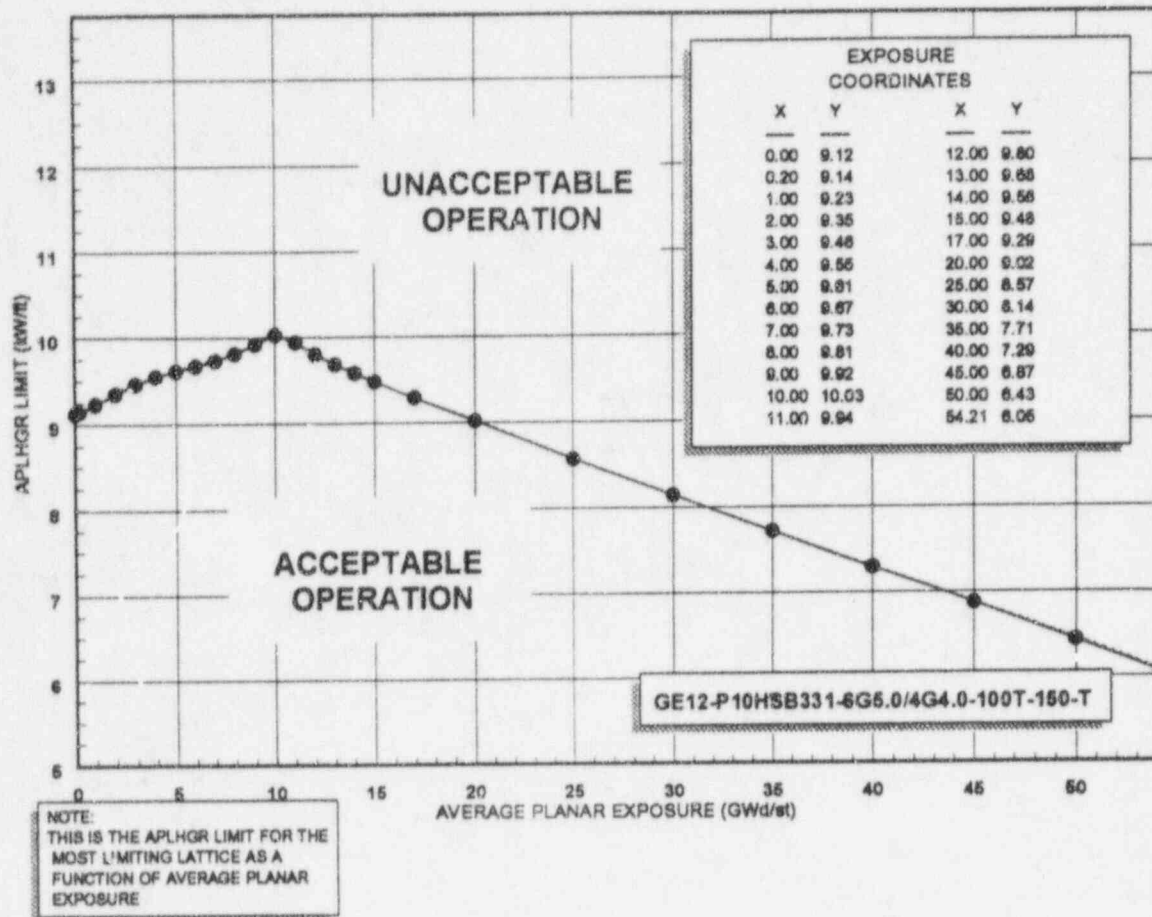


FIGURE 3-8
AVERAGE PLANAR LINEAR HEAT GENERATION RATE
VERSUS
AVERAGE PLANAR EXPOSURE
(Fuel Type: GE12-P10HSB331-6G5.0/4G4.0-100T-150-T)

4.0 MCPR LIMIT (Technical Specification 3.2.2)

The MCPR operating limit (OLMCPR) is a function of core power, core flow, average scram time, fuel type, number of operating recirculation loops, operability of the end-of-cycle recirculation pump trip (EOC-RPT) system, and operability of the turbine bypass valves.

With both recirculation pumps in operation (TLO), the OLMCPR for each fuel type with various combinations of equipment operability, scram times, core flow and core power is determined as follows:

- a. For $25\% \leq \text{power} < 30\%$, the OLMCPR is given in Figure 4-1.
- b. For $\text{power} \geq 30\%$, the OLMCPR is the greater of either:
 - 1) The flow-dependent MCPR limit determined from the applicable maximum core flow limit line of Figure 4-2,
 - or
 - 2) The product of the values from Figure 4-1 and the applicable Figures 4-3 through 4-6 as determined by Table 4-1.

As stated in the note on Figures 4-3 through 4-6, with one recirculation pump operating (SLO), the calculated OLMCPR determined above is increased by 0.01.

In Figures 4-3 through 4-6, Option A scram time MCPR limits correspond to $\tau = 1.0$, where τ is determined from scram time measurements performed in accordance with Technical Specifications Surveillance Requirements 3.1.4.1 and 3.1.4.2. Option B values correspond to $\tau = 0.0$. For scram times between Option A and Option B, the MCPR limit for each fuel type corresponds to τ . If τ has not been determined, Option A limits are to be used. Refer to Table 4-1 to determine the applicable set of fuel-type dependent curves.

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

The average scram time of the control rods, τ , is defined as:

$$\tau = 0, \text{ or } \frac{\tau_{ave} - \tau_B}{\tau_A - \tau_B}, \text{ whichever is greater.}$$

where: $\tau_A = 1.08$ sec (Technical Specification 3.1.4, Table 3.1.4-1, scram time limit to notch 36).

$$\tau_B = \mu + 1.65 * \sigma * \left[\frac{N_1}{\sum_{i=1}^n N_i} \right]^{1/2}$$

where: $\mu = 0.822$ sec (mean scram time used in the transient analysis).

$\sigma = 0.018$ sec (standard deviation of μ).

$$\tau_{ave} = \frac{\sum_{i=1}^n N_i \tau_i}{\sum_{i=1}^n N_i}$$

where: n = number of surveillance tests performed to date in the cycle.

N_i = number of active control rods measured in the i th surveillance test.

τ_i = average scram time to notch 36 of all rods in the i th surveillance test.

N_1 = total number of active rods measured in Technical Specifications Surveillance Requirement 3.1.4.1.

TABLE 4-1
OPERATING FLEXIBILITY OPTIONS APPLICABILITY

EOC-RPT	WITH: Turbine Bypass Valves	USE:
Operable	Operable	Figure 4-3
Inoperable	Operable	Figure 4-4
Operable	Inoperable	Figure 4-5
Inoperable	Inoperable	Figure 4-6

NOTE: Operation within the licensed power/flow region with a single recirculation loop and intermittent operation with reduced feedwater temperature are included in the MCPR limits presented in Figures 4-3 through 4-6.

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

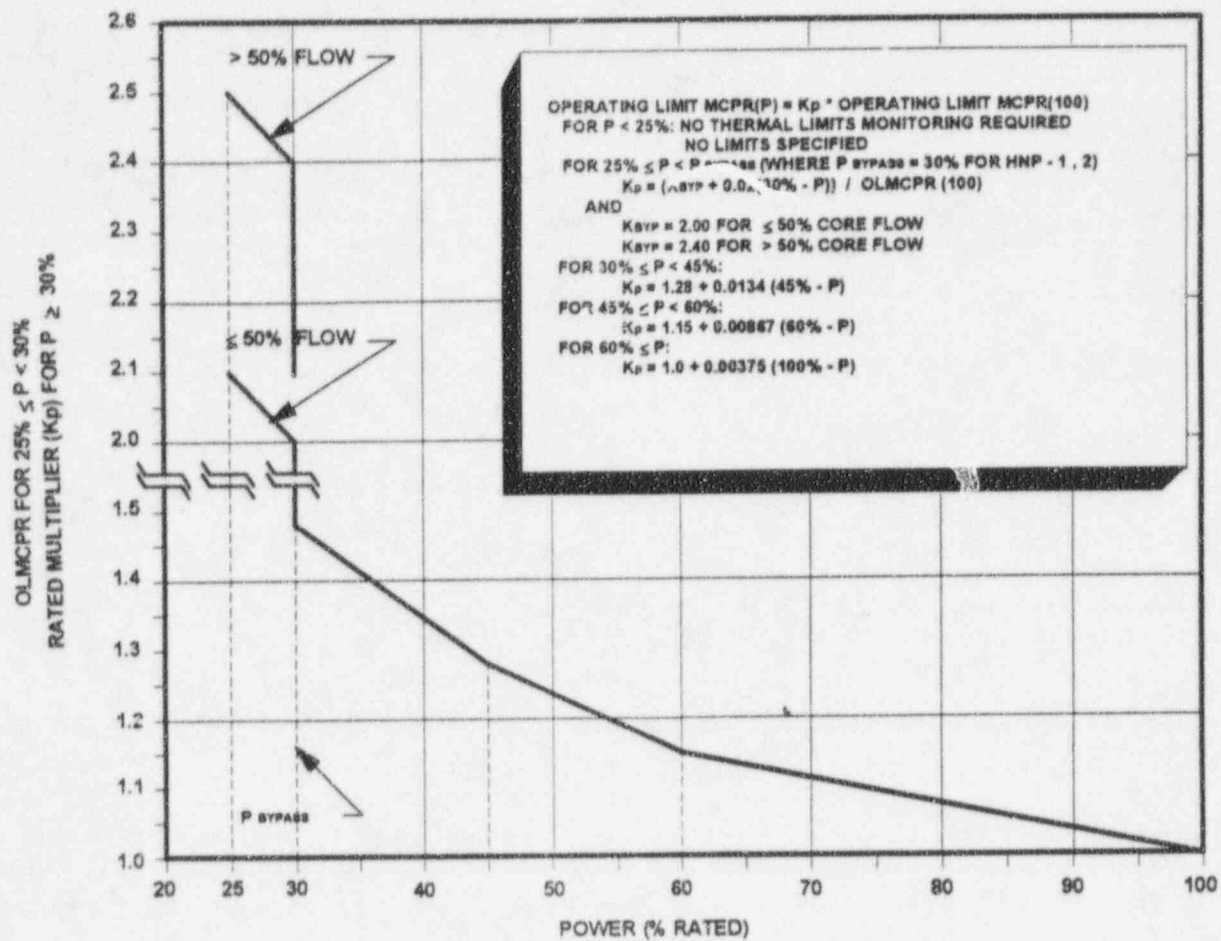


FIGURE 4-1

MCPR MULTIPLIER (K_p) VERSUS CORE POWER

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report


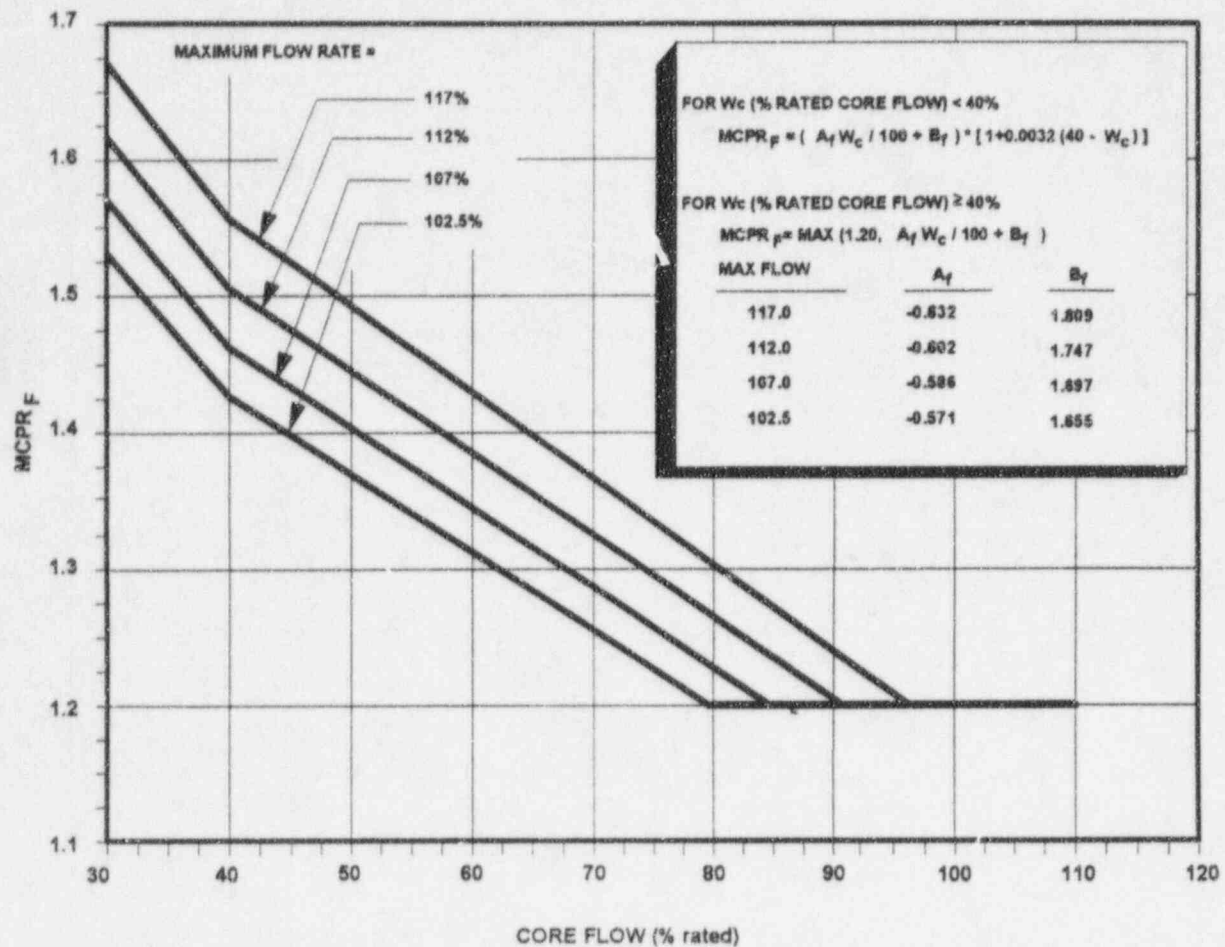


FIGURE 4-2

MCPR LIMITS (MCPR_F) VERSUS CORE FLOW

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

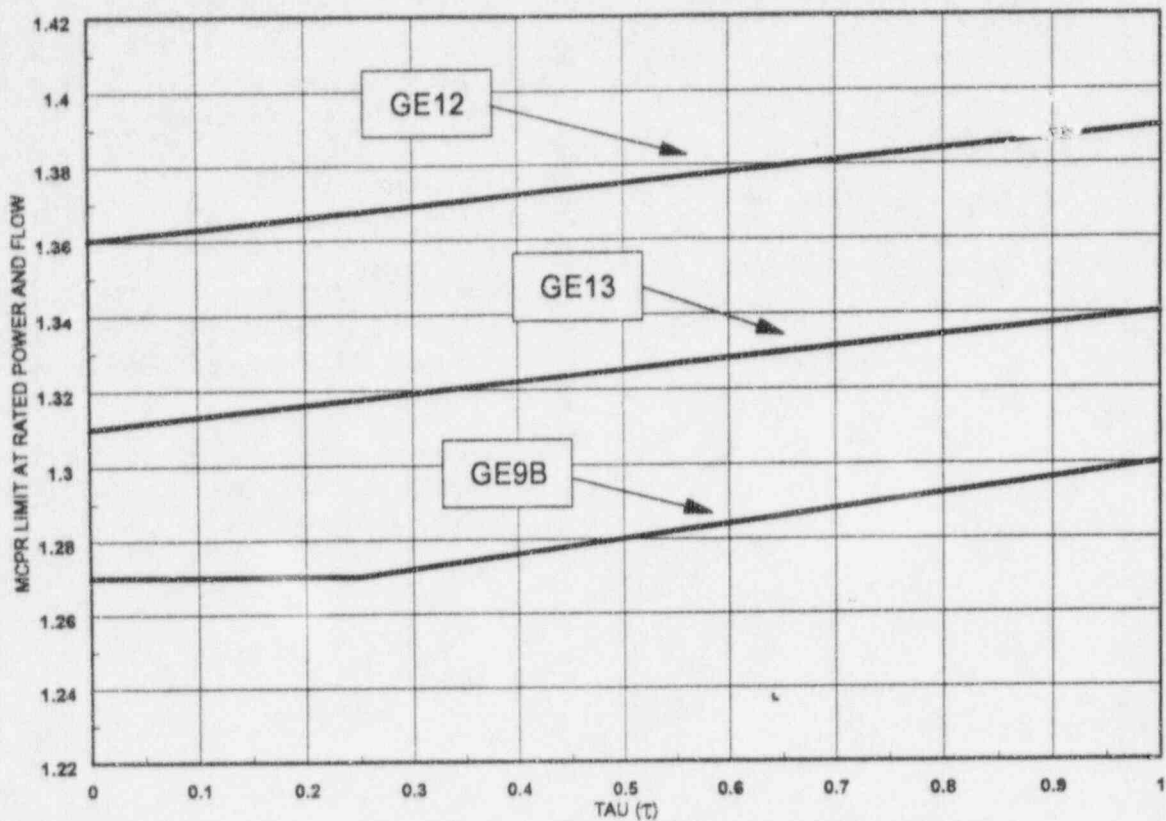


NOTE: For SLO, increase the MCPR Limit obtained from this figure by 0.01.

FIGURE 4-3

MCPR LIMIT VERSUS AVERAGE SCRAM TIME
(with Turbine Bypass Valves Operable and EOC-RPT System Operable)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

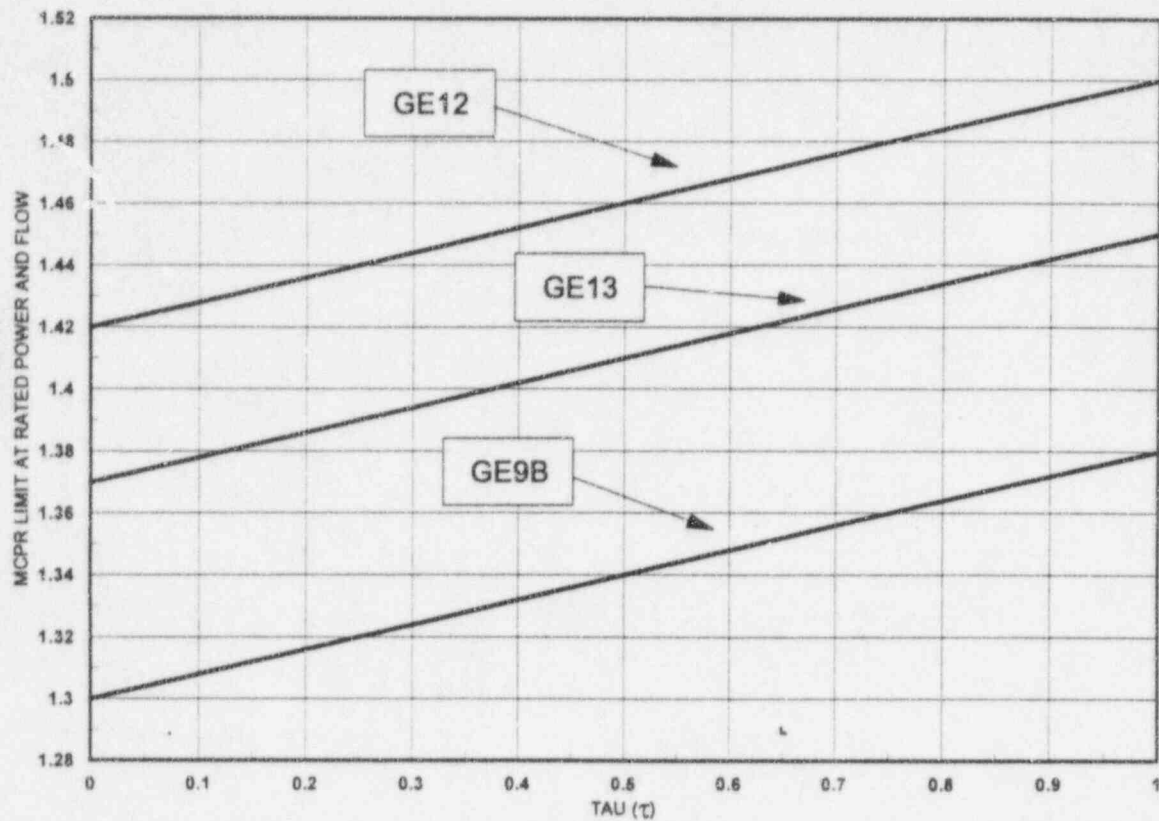


NOTE: For SLO, increase the MCPR Limit obtained from this figure by 0.01.

FIGURE 4-4

MCPR LIMIT VERSUS AVERAGE SCRAM TIME
(with Turbine Bypass Valves Operable and EOC-RPT System Inoperable)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

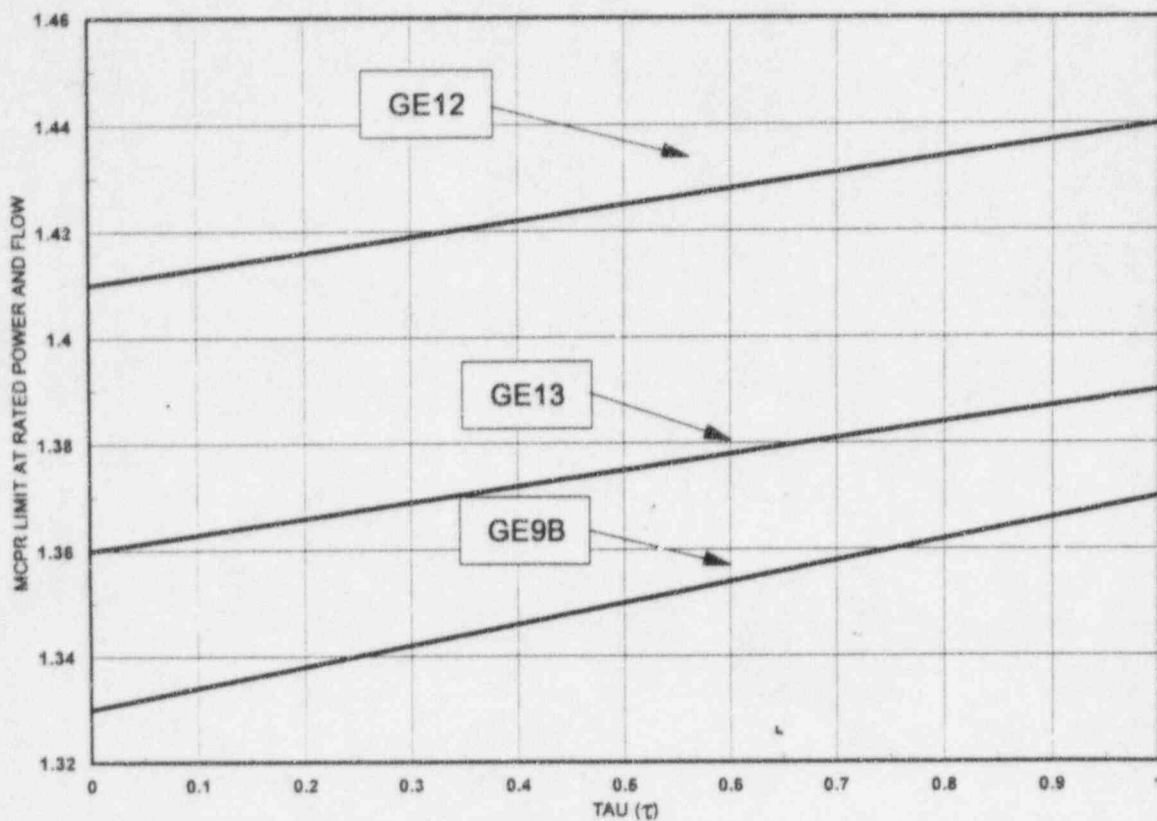


NOTE: For SLO, increase the MCPR Limit obtained from this figure by 0.01.

FIGURE 4-5

MCPR LIMIT VERSUS AVERAGE SCRAM TIME
(with Turbine Bypass Valves Inoperable and EOC-RPT System Operable)

Plant Hatch Unit 1 Cycle 17
Core Operating Limits Report

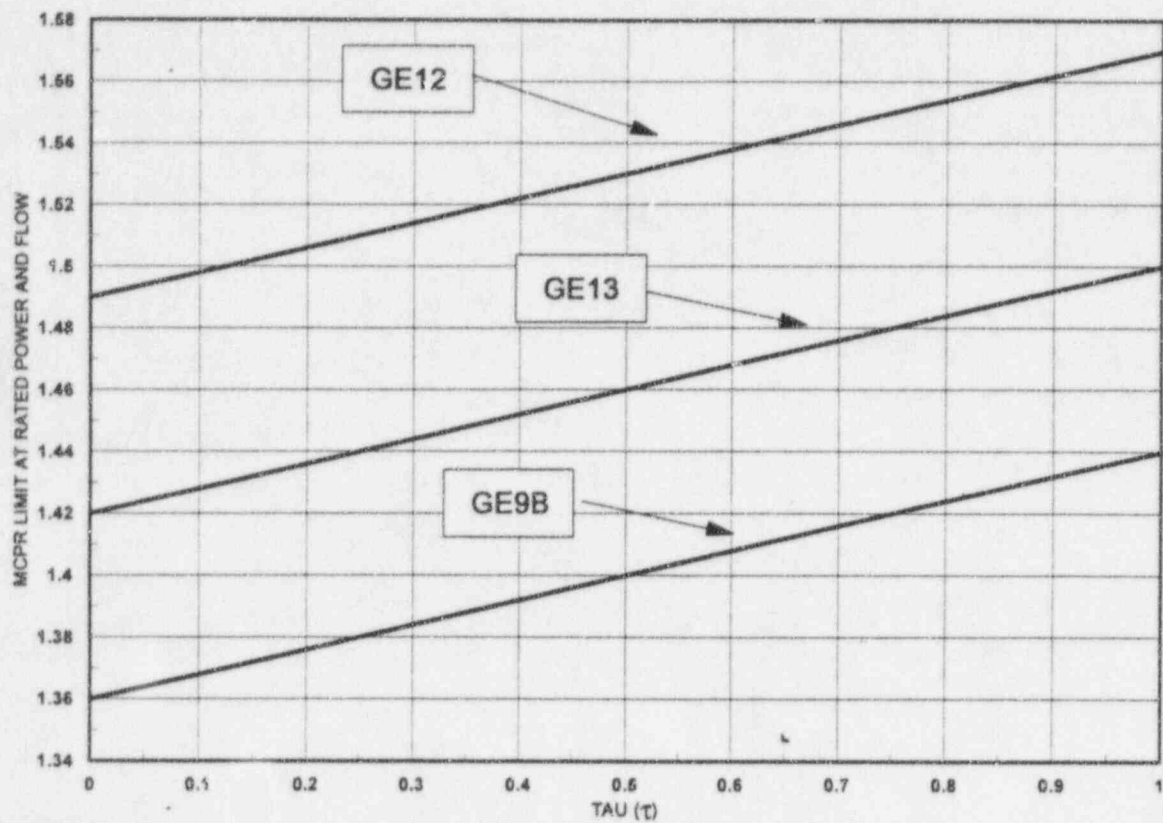

NOTE: For SLO, increase the MCPR Limit obtained from this figure by 0.01.

FIGURE 4-6

MCPR LIMIT VERSUS AVERAGE SCRAM TIME
(with Turbine Bypass Valves Inoperable and EOC-RPT System Inoperable)

**5.0 APRM FLOW BIASED SIMULATED THERMAL POWER - HIGH Time
Constant (Surveillance Requirement 3.3.1.1.14)**

The allowable value for the APRM Flow Biased Simulated Thermal Power - High time constant is ≤ 7.0 seconds.

6.0 REFERENCES

1. "General Electric Standard Application for Reactor Fuel," NEDE-24011-P-A-11-US, November 1995.
2. Letter, L. P. Crocker (NRC) to W. G. Hairston (GPC), "Issuance of Amendment No. 168 to Facility Operating License DPR-57 and Amendment No. 106 to Facility Operating License NPF-5 - Edwin I. Hatch Nuclear Plant Units 1 and 2 (TAC Nos. 73614 and 73615)," December 29, 1989.
3. "Supplemental Reload Licensing Report for Edwin I. Hatch Nuclear Plant Unit 1, Reload 16, Cycle 17," General Electric Document 24A5353, Revision 0, March 1996.
4. "Edwin I. Hatch Nuclear Plant Units 1 and 2 SAFER/GESTR - LOCA Loss-of-Coolant Accident Analysis," NEDC-31376-P, December 1986.
5. Letter No. 262-96-060, D. P. Stier (GE) to R.E. Kingston (GE), "Results of FWCF Transients without Bypass for Hatch-1 Cycle-17," April 25, 1996.