

NEW YORK POWER AUTHORITY  
JAMES A. FITZPATRICK NUCLEAR POWER PLANT

DOCUMENT TRANSMITTAL AND RECEIPT FORM

TO: NRC Region 1 Administrator

FROM: Janet Kerfien - Tech Services

UNCONTROLLED  
COPY NO. Information Only

DATE: August 2, 1996

PROCEDURE

REVISION

CORE OPERATING LIMITS REPORT

4

Please update your uncontrolled manual!  
Thanks, Janet ☺

APPLICABLE MANUAL: CORE OPERATING LIMITS REPORT

INSTRUCTIONS:

1. Insert the attached revised documents into your uncontrolled manual.
2. Sign below signifying that you have received the subject uncontrolled documents and have inserted them into the applicable uncontrolled manual.
3. **Return all superseded documents**, as applicable, with this signed form to the sender within 14 days.

NOTE

Failure to incorporate these documents into your uncontrolled manual and return of this form will result in cancellation of the subject uncontrolled documents.

\_\_\_\_\_  
SIGNATURE

\_\_\_\_\_  
DATE

9608080263 960731  
PDR ADOCK 05000333  
P PDR

UNCONTROLLED  
COPY

NEW YORK POWER AUTHORITY  
JAMES A. FITZPATRICK NUCLEAR POWER PLANT  
REPORT

CORE OPERATING LIMITS REPORT  
REVISION 4

REVIEWED BY: PLANT OPERATIONS REVIEW COMMITTEE

MEETING NO. 96-068

DATE 7-19-96

APPROVED BY:

Rodriguez  
REACTOR ANALYST SUPERVISOR

DATE 7-19-96

APPROVED BY:

Woolf  
PLANT MANAGER

DATE 7/31/96

0/1  
ADD1

## 1.0 PURPOSE

This report provides the cycle-specific operating limits for Cycle 12 of the James A. FitzPatrick Nuclear Power Plant. The following limits are addressed:

Operating Limit Minimum Critical Power Ratio (MCPR)

Flow Dependent MCPR Limits

Maximum Average Planar Linear Heat Generation Rate (MAPLHGR)

Linear Heat Generation Rate (LHGR)

Flow-Biased Average Power Range Monitor (APRM) and Rod Block Monitor (RBM) Settings

## 2.0 APPLICABILITY

The plant shall be operated within the limits specified in this report. If any of these limits are violated, the corrective actions specified in the Technical Specifications shall be taken.

## 3.0 REFERENCES

- 3.1 JAFNPP Administrative Procedure 12.05, Control of Core Operating Limits Report.
- 3.2 JAFNPP License Appendix A, Operating Technical Specifications.
- 3.3 FitzPatrick Cycle 12 Core Reload Safety Evaluation, JAF-SE-94-127.
- 3.4 JAFNPP SAFER/GESTR-LOCA Loss of Coolant Analysis, NEDE-31317P, including Errata and Addenda Sheets 1, 2 and 3.
- 3.5 Supplemental Reload Licensing Submittal for JAFNPP Reload 11 Cycle 12, GE Report 24A5167 Revision 0 June 1996. Includes a Supplement 1 containing MAPLHGR DATA.
- 3.6 Supplement 1 to GE Report 23A7114 June, 1992. Contains MAPLHGR Data for Reload 10 Fuel.
- 3.7 Cycle 12 Core Reload, M1-94-164.
- 3.8 RAP-7.3.17 Rev.6, Core Monitoring Software and Databases Changes.
- 3.9 PLANT OPERATION UP TO 100% POWER WITH ONE STEAM LINE ISOLATED, JAF-SE-96-035.

#### 4.0 DEFINITIONS

- 4.1 Minimum critical power ratio(MCPR) - Minimum value of the ratio of that power in a fuel assembly which is calculated to cause some point in that fuel assembly to experience boiling transition to the actual assembly operating power as calculated by application of the GEXL correlation (Reference NEDE-10958).
- 4.2 Fraction of Limiting Power Density - The ratio of the linear heat generation rate (LHGR) existing at a given location to the design LHGR. The design LHGR is given in Table 8.2.
- 4.3 Maximum Fraction of Limiting Power Density - The Maximum Fraction of Limiting Power Density (MFLPD) is the highest value existing in the core of the Fraction of Limiting Power Density (FLPD).
- 4.4 Rated Recirculation Flow - that drive flow which produces a core flow of  $77.0 \times 10^6$  lb/hr.

#### 5.0 RESPONSIBILITIES

- 5.1 See AP-12.05 (Reference 3.1).
- 5.2 It is the responsibility of the Shift Manager to assure that the reactor is operated within the limits described herein.
- 5.3 It is the responsibility of the Reactor Analyst Supervisor to assure that the limits described herein are properly installed in the 3D-Monicores databank used for thermal limit surveillance (Reference 3.8)

#### 6.0 SPECIAL INSTRUCTIONS/REQUIREMENTS

Not applicable.

7.0 PROCEDURE

## 7.1 Operating Limit MCPR

During power operation, The Operating Limit MCPR shall be equal to or greater than the limits given below.

7.1.1 Technical Specification Reference: 3.1.B

7.1.2 The Operating Limit MCPR shall be determined based on the following requirement:

7.1.2.1 The average scram time to notch position 38 shall be:

$$\tau_{AVE} \leq \tau_B$$

7.1.2.2 The average scram time to notch position 38 is determined as follows:

$$\tau_{AVE} = \frac{\sum_{i=1}^n N_i \tau_i}{\sum_{i=1}^n N_i}$$

where:

n = number of surveillance tests performed to date in the cycle,

$N_i$  = number of active rods measured in the  $i$ th surveillance, and

$\tau_i$  = average scram time to notch position 38 of all rods measured in the  $i$ th surveillance test.

7.1.2.3 The adjusted analysis mean scram time is calculated as follows:

$$\tau_B \text{ (sec)} = \mu + 1.65 \sigma \left[ \frac{N_1}{\sum_{i=1}^n N_i} \right]^{1/2}$$

where:

$\mu$  = mean of the distribution for the average scram insertion time to the pickup of notch position 38 = 0.706 sec.

$\sigma$  = standard deviation of the distribution for average scram insertion time to the pickup of notch position 38 = 0.016 sec.

$N_1$  = the total number of active rods measured in Technical Specification 4.3.C.1.

The number of rods to be scram tested and the test intervals are given in Technical Specification 4.3.C.

7.1.3 When requirement of 7.1.2 is met, the Operating Limit MCPR shall not be less than that specified in Table 8.1, or Table 8.1.A if operating above 75% of rated thermal power with three steam lines in service.

- 7.1.4 When the requirement 7.1.2 is not met (i.e.  $\tau_B < \tau_{AVE}$ ) then the Operating Limit MCPR values (as a function of  $\tau$ ) are given in Figure 8.1, or Figure 8.1.A if operating above 75% of rated thermal power with three steam lines in service.

$$\text{where } \tau = (\tau_{AVE} - \tau_B) / (\tau_A - \tau_B)$$

and

$\tau_{AVE}$  = the average scram time to notch position 38 as defined in 7.1.2.2.

$\tau_B$  = the adjusted analysis mean scram time as defined in 7.1.2.3

$\tau_A$  = the scram time to notch position 38 as defined in Technical Specification 3.3.C.1.

Note: Should the operating limit MCPR obtained from these figures be less than the operating limit MCPR found in 7.1.3 for the applicable RBM trip level setting then 7.1.3 shall apply.

- 7.1.5 During single-loop operation, the Operating Limit MCPR shall be increased by 0.01.

- 7.1.6 During reactor power operation with core flow less than 100 percent of rated, the Operating Limit MCPR shall be multiplied by the appropriate  $K_f$  specified in Figure 8.2.

## 7.2 Maximum Average Planar Linear Heat Generation Rate (MAPLHGR)

- 7.2.1 Technical Specification Reference: 3.5.H

- 7.2.2 During power operation, the APLHGR for each fuel type as a function of axial location and average planar exposure shall be within limits based on applicable APLHGR limit values which have been approved for the respective fuel and lattice types.

- 7.2.3 When hand calculations are required, the APLHGR for each type of fuel as a function of average planar exposure shall not exceed the limiting value for the most limiting lattice (excluding natural uranium) shown in Figures 8.3.a through h.

- 7.2.4 During single loop operation, the APLHGR for each fuel type shall not exceed the values given in 7.2.2 or 7.2.3 above multiplied by 0.84.



## 7.3 Linear Heat Generation Rate (LHGR)

7.3.1 Technical Specification Reference: 3.5.I.

7.3.2 The LHGR of any rod in any fuel assembly at any axial location shall not exceed the maximum allowable LHGR specified in Table 8.2.

## 7.4 APRM Trip Settings

7.4.1 APRM Flow Referenced Flux Scram Trip Setting (Run Mode)

7.4.1.1 Technical Specification References:  
2.1.A.1.c, Table 3.1-1, 3.1.A

7.4.1.2 When the Mode Switch is in the RUN position, the APRM flow referenced flux scram trip setting shall be

 $S \leq 0.66W + 54\%$  for two loop operation; $S \leq 0.66W + 54\% - 0.66 \Delta W$  for single loop operation;

where:

S = setting in percent of rated thermal power (2436 MWt);

W = recirculation flow in percent of rated;

 $\Delta W$  = difference between two loop and single-loop effective drive flow at the same core flow.



- 7.4.1.3 In the event of operation with a maximum fraction of limiting power density (MFLPD) greater than the fraction of rated power (FRP), the setting shall be modified as follows:

$S \leq (0.66W + 54\%) (FRP/MFLPD)$  for two loop operation;

$S \leq (0.66W + 54\% - 0.66 \Delta W) (FRP/MFLPD)$  for single-loop operation;

where:

FRP = fraction of rated thermal power (2436 Mwt);

MFLPD = Maximum fraction of limiting power density, where the limiting power density is as specified in Table 8.2.

The ratio of FRP to MFLPD shall be set equal to 1.0 unless the actual operating value is less than the design value of 1.0, in which case the actual operating value will be used.

#### 7.4.2 APRM Flow Biased Rod Block Setting

- 7.4.2.1 Technical Specification References:  
2.1.A.1.d, Table 3.2-3, 3.2.C

- 7.4.2.2 The APRM rod block trip setting shall be:

$S \leq 0.66W + 42\%$  for two loop operation;

$S \leq 0.66W + 42\% - 0.66 \Delta W$  for single loop operation;

where:

S = rod block setting in percent of rated thermal power (2436 Mwt);

W = recirculation flow in percent of rated;

$\Delta W$  = difference between two loop and single loop effective drive flow at the same core flow.

- 7.4.2.3 In the event of operation with a maximum fraction of limiting power density (MFLPD) greater than the fraction of rated power (FRP), the setting shall be modified as follows:

$S \leq (0.66W + 42\%) (FRP/MFLPD)$  for two loop operation;

$S \leq (0.66W + 42\% - 0.66\Delta W) (FRP/MFLPD)$  for single loop operation;

where:

FRP = fraction of rated thermal power (2436 Mwt);

MFLPD = maximum fraction of limiting power density as specified in Table 8.2.

#### 7.5 RBM Flow Biased Rod Block Setting

- 7.5.1 Technical Specification Reference: 3.2.C

- 7.5.2 The RBM flow biased rod block trip setting shall be:

$S \leq 0.66W + K$  for two loop operation;

$S \leq 0.66W + K - 0.66\Delta W$  for single loop operation;

where:

S = rod block setting in percent of initial;

W = loop flow in percent of rated

K = intercept values of 39%, 40%, 41%, 42%, 43%, and 44% can be used with the appropriate MCPR Operating Limit from Table 8.1 (note that for Cycle 12 the RBM intercept value does not effect the MCPR Operating Limit for K values  $\leq 44\%$ );

$\Delta W$  = difference between two loop and single loop effective drive flow.

8.0 FIGURES AND TABLES

Table 8.1	MCPR Operating Limit for Incremental Cycle Core Average Exposure
Table 8.1.A	MCPR Operating Limit for Incremental Cycle Core Average Exposure for Operation above 75% of Rated Thermal Power with Three Steam Lines in Service
Table 8.2	Maximum LHGR
Figure 8.1	MCPR Operating Limit Versus $\tau$
Figure 8.1.A	MCPR Operating Limit Versus $\tau$ for Operation above 75% of Rated Thermal Power with Three Steam Lines in Service
Figure 8.2	$K_f$ Factor
Figure 8.3.a	MAPLHGR Versus Planar Average Exposure: BD336A
Figure 8.3.b	MAPLHGR Versus Planar Average Exposure: BD339A
Figure 8.3.c	MAPLHGR Versus Planar Average Exposure: GE10-P8HXB322-11GZ-70M-150-T
Figure 8.3.d	MAPLHGR Versus Planar Average Exposure: GE10-P8HXB324-12GZ-70M-150T
Figure 8.3.e	MAPLHGR Versus Planar Average Exposure: 89LTA
Figure 8.3.f	MAPLHGR Versus Planar Average Exposure: GE11-P9HUB356-15GZ-100M-146T and ATRIUM-10A
Figure 8.3.g	MAPLHGR Versus Planar Average Exposure: GE11-P9HUB359-16GZ1-100M-146-T
Figure 8.3.h	MAPLHGR Versus Planar Average Exposure: GE11-P9HUB380-12GZ5-100M-146-T
Figure 8.4.a	CYCLE 12 LOADING PATTERN, UPPER LEFT QUADRANT, BUNDLE DESIGN
Figure 8.4.b	CYCLE 12 LOADING PATTERN, UPPER RIGHT QUADRANT, BUNDLE DESIGN
Figure 8.4.c	CYCLE 12 LOADING PATTERN, LOWER RIGHT QUADRANT, BUNDLE DESIGN

Figure 8.4.d CYCLE 12 LOADING PATTERN, LOWER LEFT  
QUADRANT, BUNDLE DESIGN

9.0 EXHIBITS

Not Applicable.

TABLE 8.1  
MCPR Operating Limit for Incremental Cycle  
Core Average Exposure

Cycle 12 Exposure Range	GE11-P9HUB380- 12GZ5-100M-146-T	All Other Fuel Bundle Types
BOC to 4 GWD/ST	1.36	1.31
>4 GWD/ST to 9 GWD/ST	1.31	1.31
>9 GWD/ST to 10.5 GWD/ST	1.32	1.32
>10.5 GWD/ST to EOC	1.35	1.35

Technical Specification Reference: 3.1.B

For single loop operation, these limits shall be increased by 0.01.

TABLE 8.1.A  
MCPR Operating Limit for Incremental Cycle Core Average Exposure  
for Operation above 75% of Rated Thermal Power with Three Steam  
Lines in Service

Cycle 12 Exposure Range	GE11-P9HUB380- 12GZ5-100M-146-T	All Other Fuel Bundle Types
BOC to 4 GWD/ST	1.36	1.31
>4 GWD/ST to 9 GWD/ST	1.31	1.31
>9 GWD/ST to 10.5 GWD/ST	1.34	1.34
>10.5 GWD/ST to EOC	1.37	1.37

Technical Specification Reference: 3.1.B

For single loop operation, these limits shall be increased by 0.01.


TABLE 8.2  
Maximum LHGR

Fuel Type	Fuel Bundle Design	Maximum LHGR (kw/ft)
BD336A	GE8x8EB	14.4
BD339A	GE8x8EB	14.4
GE10-P8HXB322 11GZ-70M-150-T	GE8x8NB-3	14.4
GE10-P8HXB324 12GZ-70M-150-T	GE8x8NB-3	14.4
89LTA	GE11LTA	14.4
GE11-P9HUB356 15GZ-100M-146-T	GE11	14.4
GE11-P9HUB359 16GZ1-100M-146-T	GE11	14.4
GE11-P9HUB380 12GZ5-100M-146-T	GE11	14.4

Technical Specification Reference: 3.5.1



FIGURE 8.1  
MCPR Operating Limit Versus  $\tau$  (TAU)

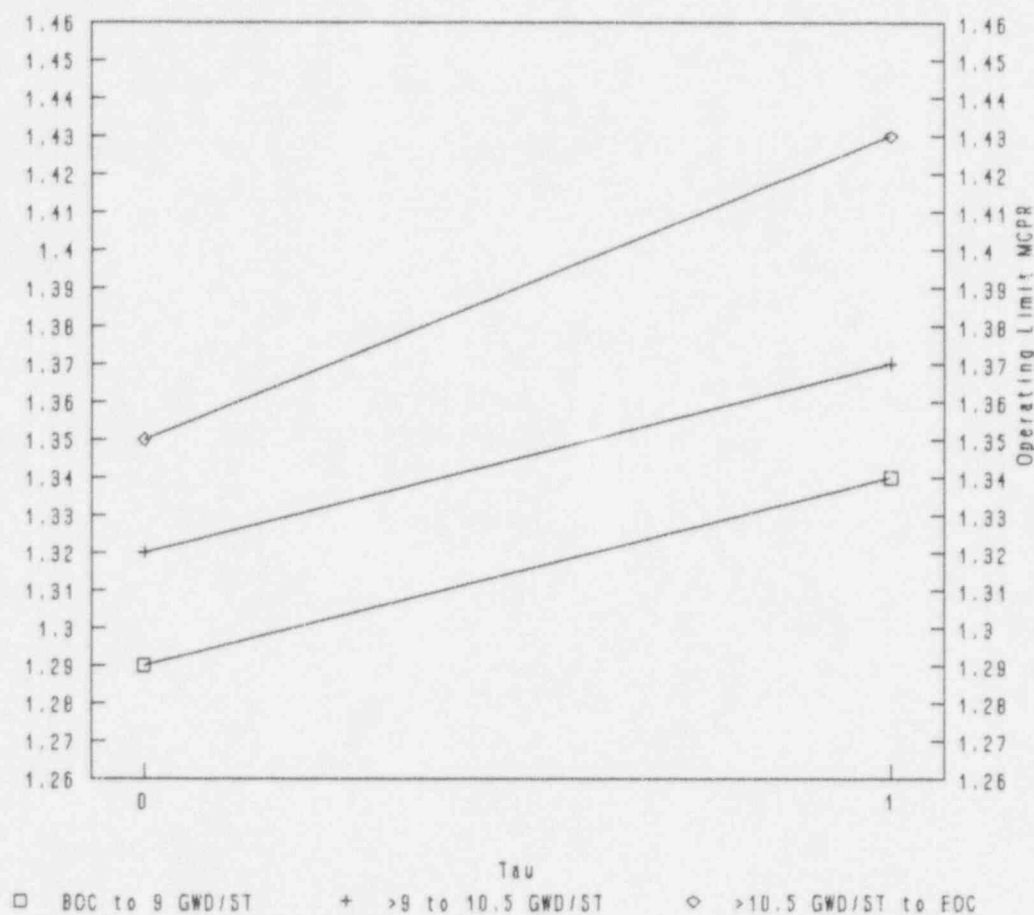


Technical Specification Reference: 3.1.B

For single loop operation, these limits shall be increased by 0.01.

Note: Should the operating limit MCPR obtained from this figure be less than the operating limit MCPR found in 7.1.3 for the applicable RBM trip level setting then 7.1.3 shall apply.


FIGURE 8.1.A  
MCPR Operating Limit Versus  $\tau$  (TAU)  
For Operation above 75% of Rated Thermal  
Power with Three Steam Lines in Service

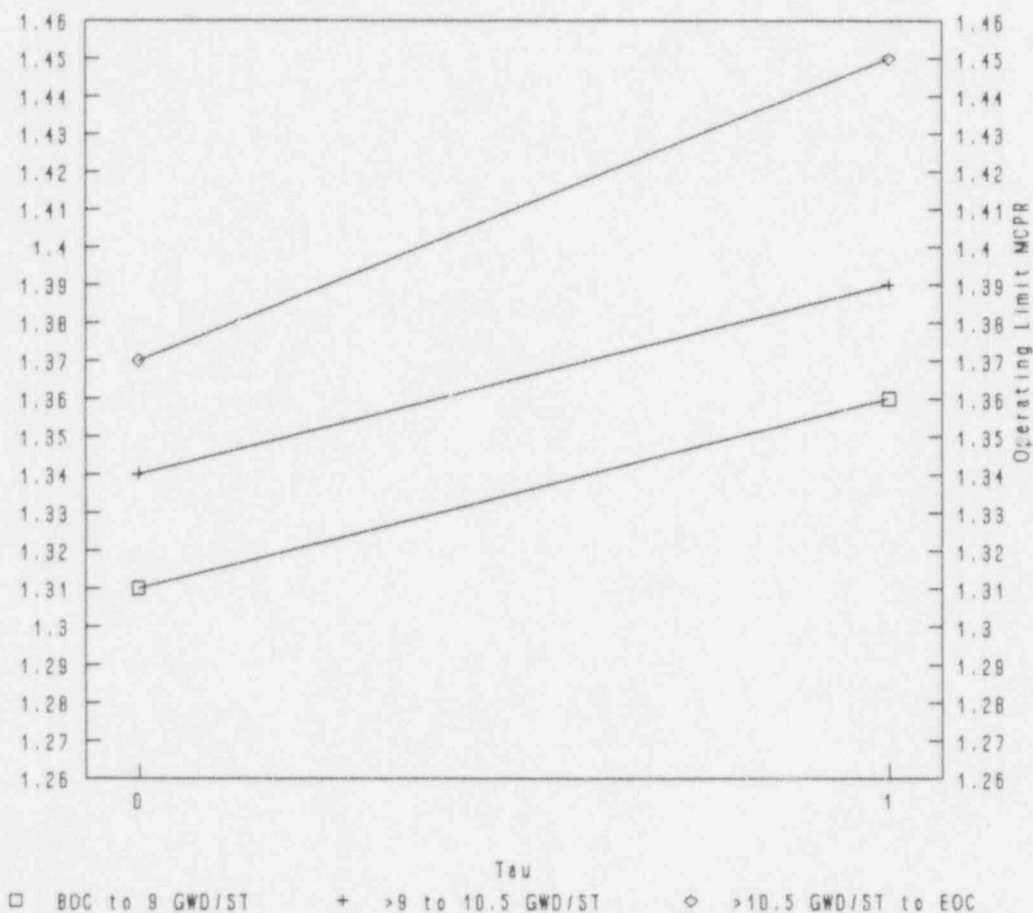

Technical Specification Reference: 3.1.B


For single loop operation, these limits shall be increased by 0.01.

Note: Should the operating limit MCPR obtained from this figure be less than the operating limit MCPR found in 7.1.3 for the applicable RBM trip level setting then 7.1.3 shall apply.

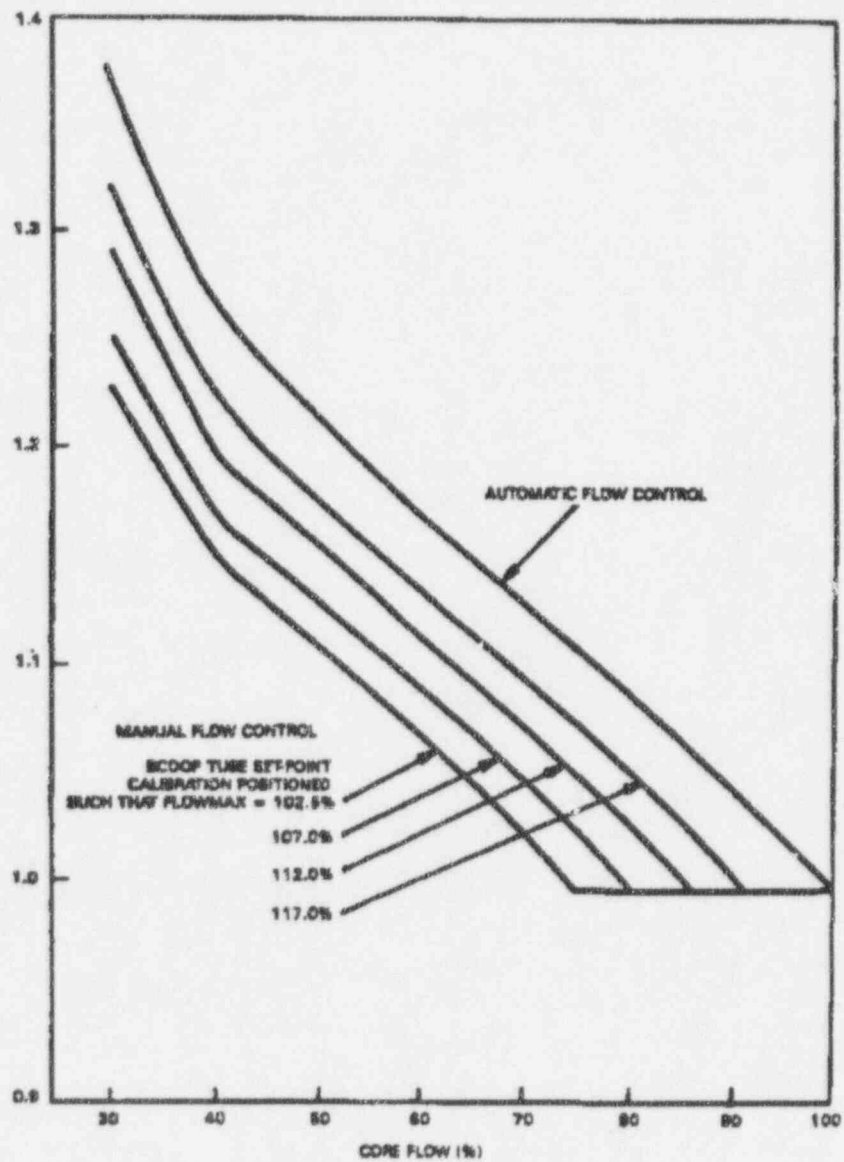FIGURE 8.2  
 $K_f$  Factor $K_f$ 

Technical Specification Reference: 3.1.B

FIGURE 8.3.a  
MAPLHGR Versus Planar Average Exposure: BD336A

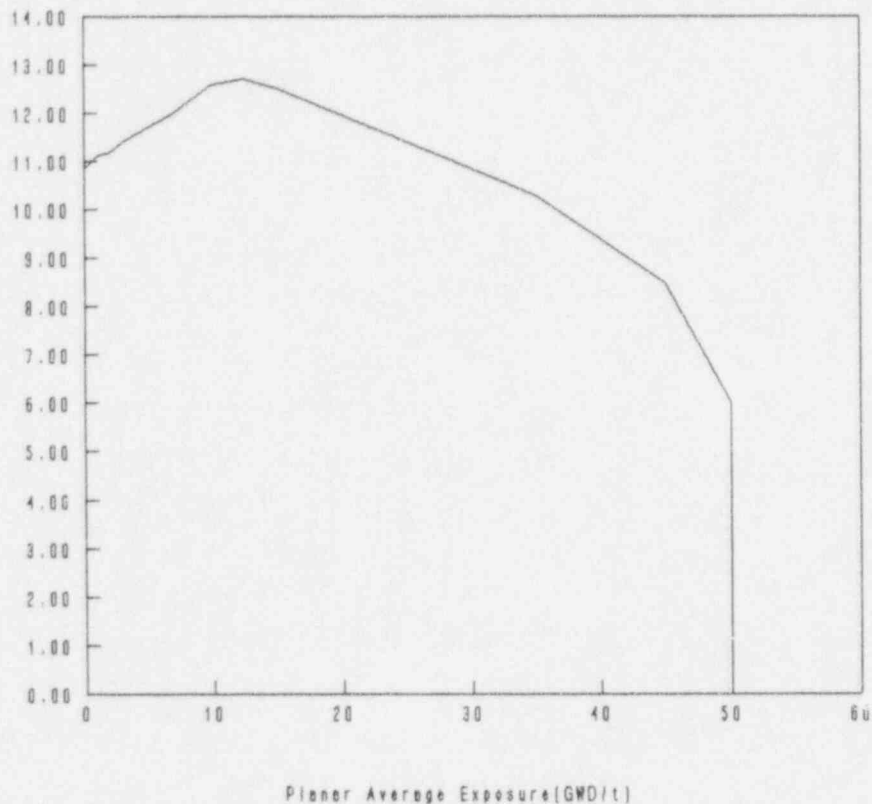


This curve represents the limiting exposure dependent MAPLHGR values.

Technical Specification Reference: 3.5.H

Reference: NEDC-31317P

For single loop operating these MAPLHGR values shall be multiplied by 0.84.

FIGURE 8.3.b  
MAPLHGR Versus Planar Average Exposure:  
BD339A

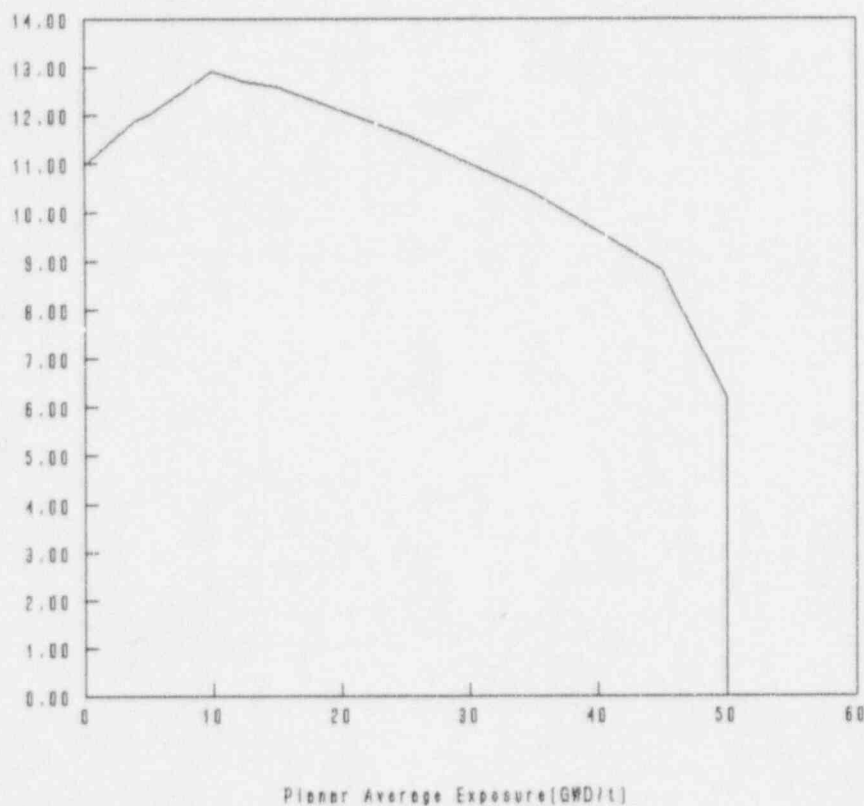


This curve represents the limiting exposure dependent MAPLHGR values.

Technical Specification Reference: 3.5.H

Reference: NEDC-31317P

For single loop operating these MAPLHGR values shall be multiplied by 0.84.

FIGURE 8.3.c  
MAPLHGR Versus Planar Average Exposure:  
GE10-P8HXB322-11GZ-70M-150-T

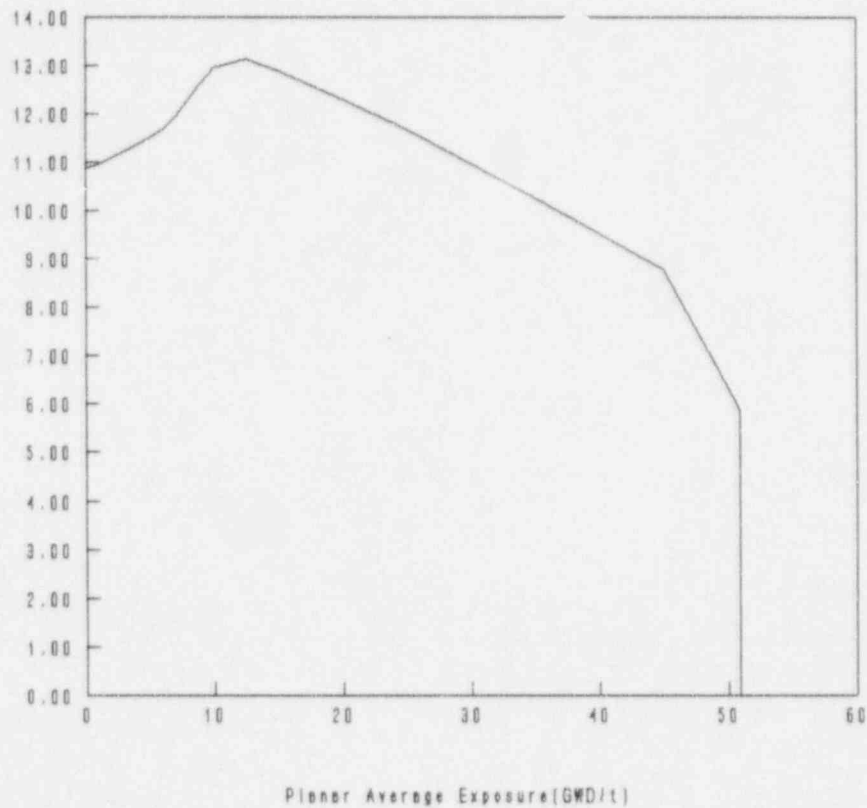


This curve represents the limiting exposure dependent MAPLHGR values.

Technical Specification Reference: 3.5.H

Reference: NEDC-31317P

For single loop operating these MAPLHGR values shall be multiplied by 0.84.

FIGURE 8.3.d  
MAPLHGR Versus Planar Average Exposure:  
GE10-P8HXB324-12GZ-70M-150T

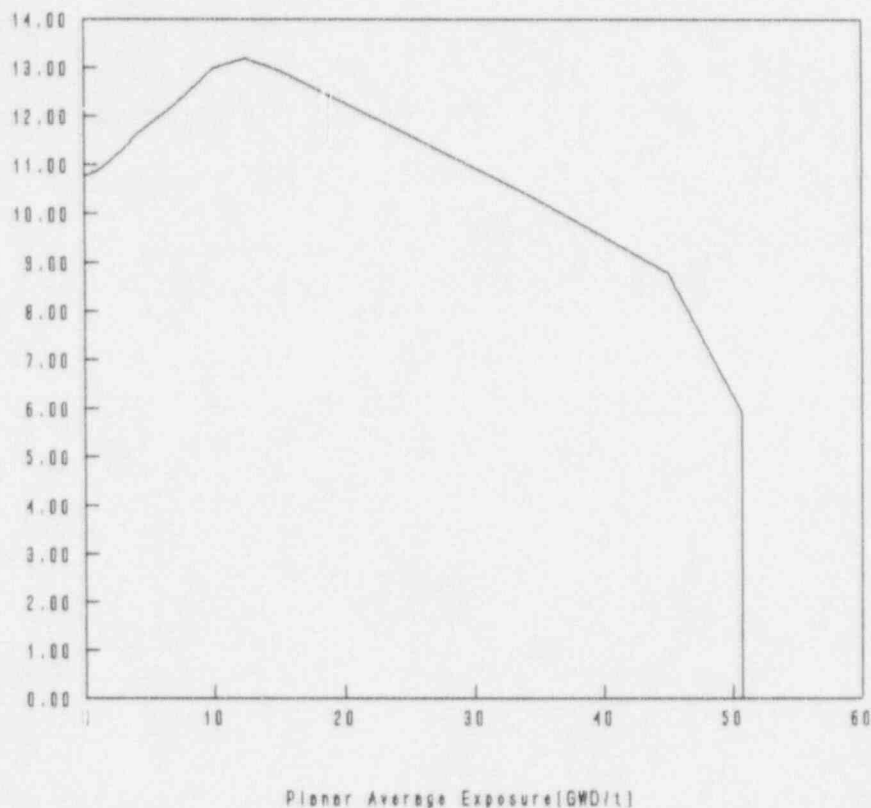

This curve represents the limiting exposure dependent MAPLHGR values.


Technical Specification Reference: 3.5.H

Reference: NEDC-31317P

For single loop operating these MAPLHGR values shall be multiplied by 0.84.



FIGURE 8.3.e  
MAPLHGR Versus Planar Average Exposure:  
89LTA

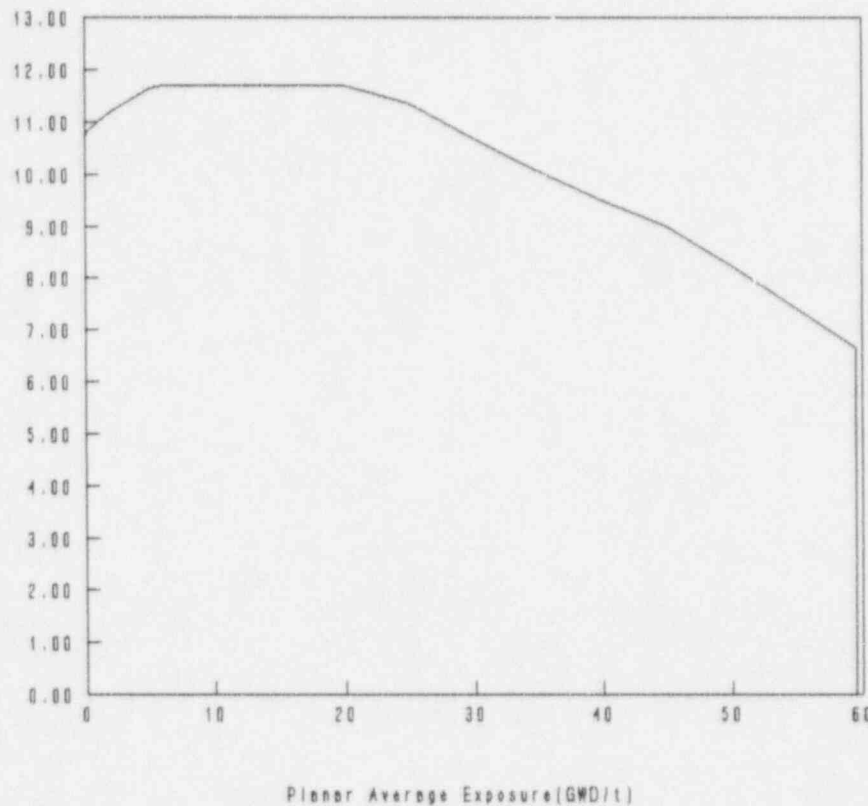

This curve represents the  
limiting exposure dependent  
MAPLHGR values.


Technical Specification Reference: 3.5.H

Reference: NEDC-31317P

For single loop operating these MAPLHGR values shall be  
multiplied by 0.84.

FIGURE 8.3.f

MAPLHGR Versus Planar Average Exposure:  
GE11-P9HUB356-15GZ-100M-146-T and ATRIUM-10A\*

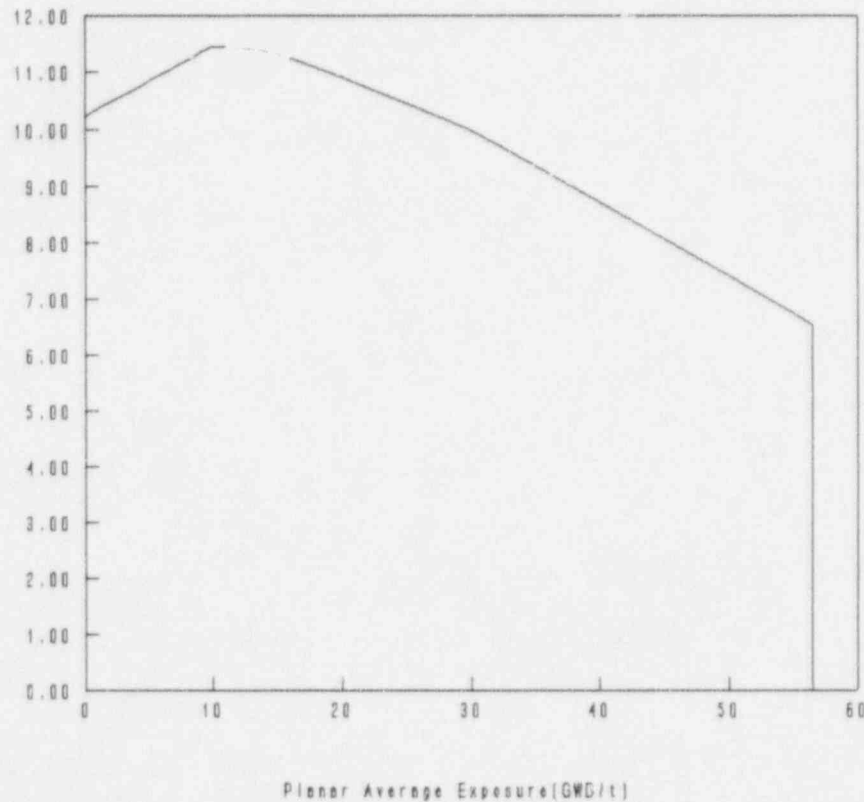

\*The A10-339 bundle will be monitored as a GE11-P9HUB356-15GZ-100M-146-T bundle. Operation to the limiting MAPLHGR for the GE11 bundle assures this bundle will remain within LHGR limits, see Reference 3.8.


This curve represents the limiting exposure dependent MAPLHGR values.

Technical Specification Reference: 3.5.H

Reference: A23A7114 Rev 1

For single loop operating these MAPLHGR values shall be multiplied by 0.84.

FIGURE 8.3.g  
MAPLHGR Versus Planar Average Exposure:  
GE11-P9HUB359-16GZ1-100M-146-T

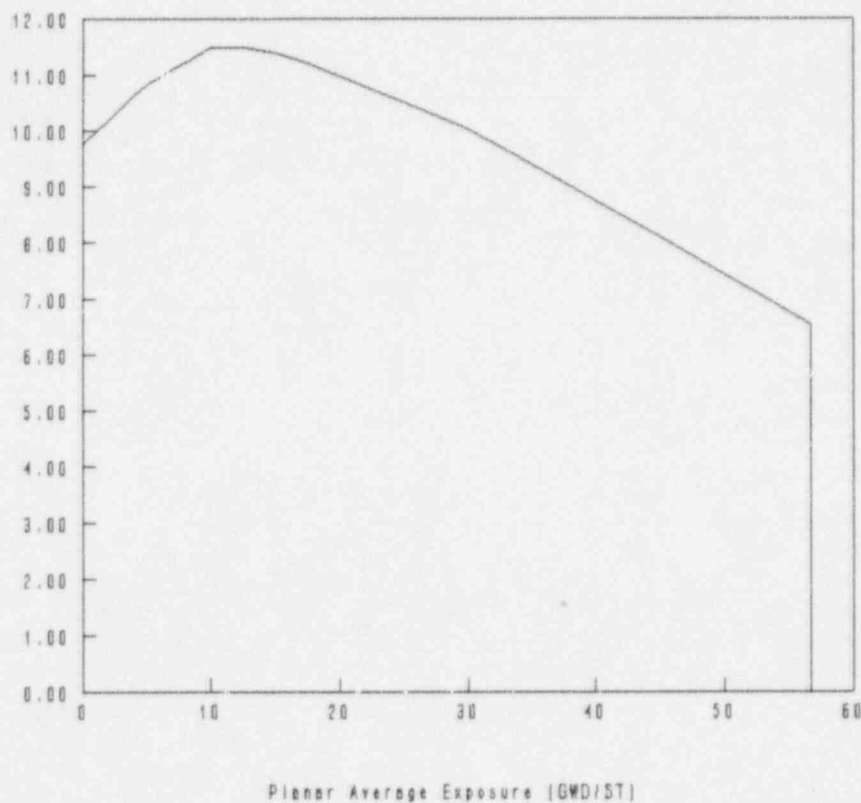


This curve represents the limiting exposure dependent MAPLHGR values.

Technical Specification Reference: 3.5.H

Reference: 23A7114 Rev 1

For single loop operating these MAPLHGR values shall be multiplied by 0.84.

FIGURE 8.3.h  
MAPLHGR Versus Planar Average Exposure:  
GE11-P9HUB380-12GZ5-100M-146-T

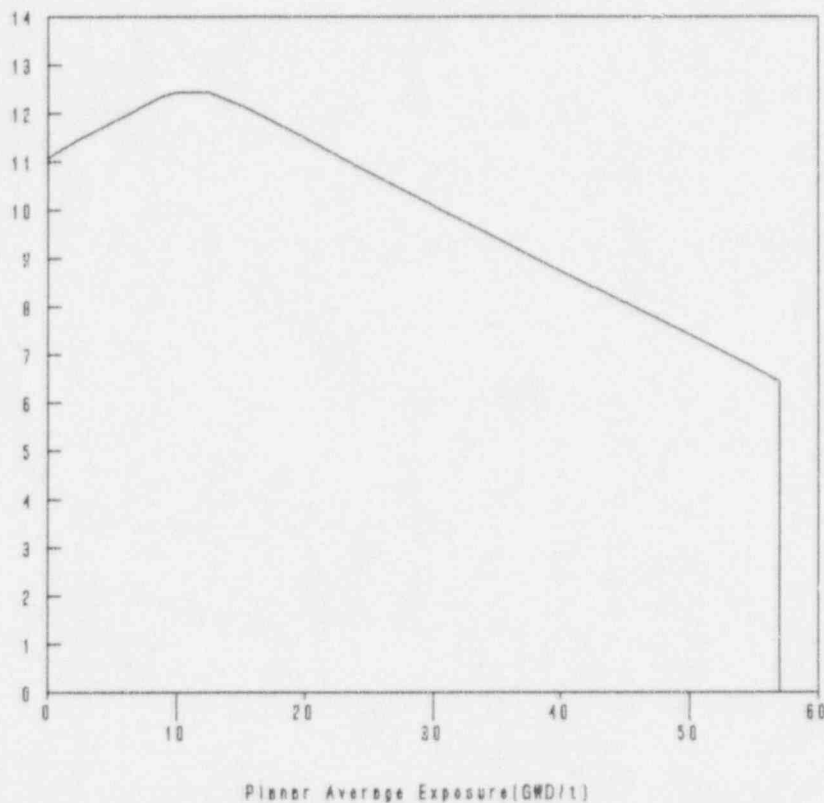

This curve represents the limiting exposure dependent MAPLHGR values.

Technical Specification Reference: 3.5.H

Reference: 24A5167 Rev 0

For single loop operating these MAPLHGR values shall be multiplied by 0.84.

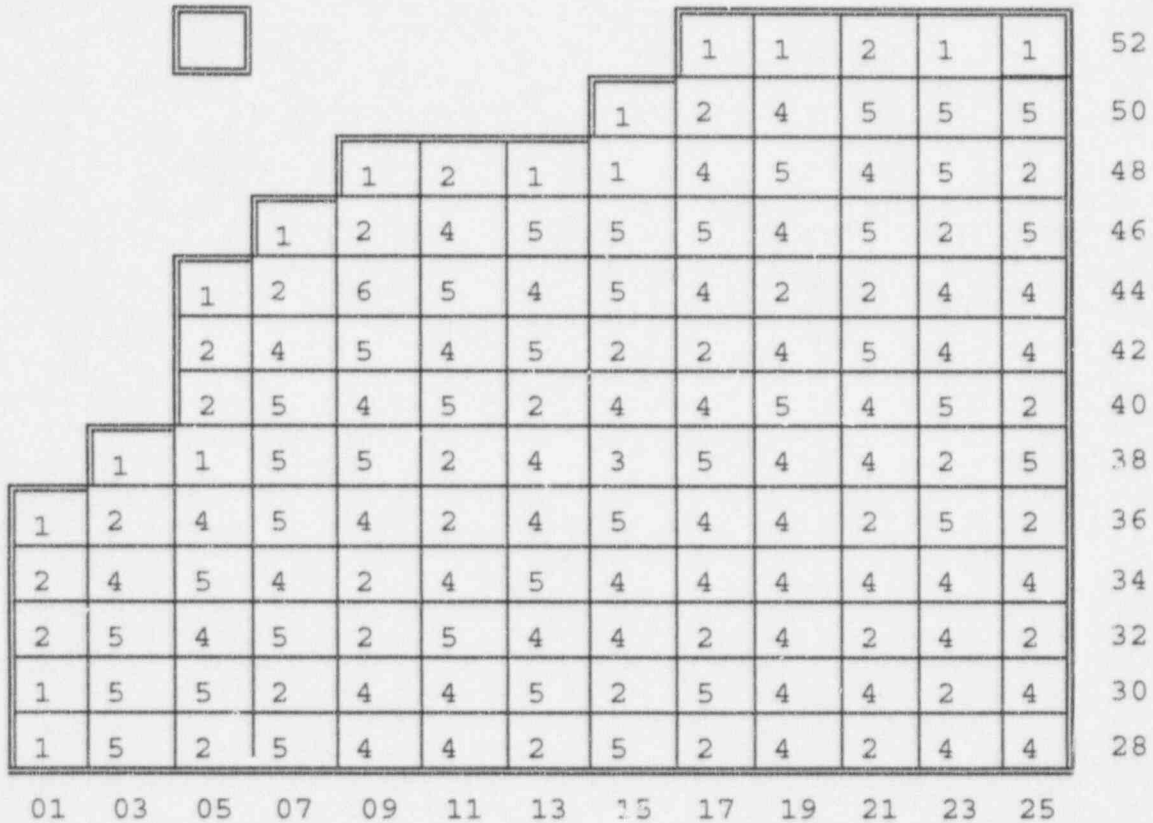


FIGURE 8.4.a  
CYCLE 12 LOADING PATTERN, UPPER LEFT QUADRANT, BUNDLE DESIGN

- 1 = GE8x8EB, Bundle Types BD319A, BD336A, BD339A
- 2 = GE8x8NB-3, Bundle Types P8HXB322, P8HXB324
- 3 = GE11LTA, Bundle Type 89LTA
- 4 = GE11, Bundle Type P9HUB356, P9HUB359
- 5 = GE11, Bundle Type P9HUB380
- 6 = ATRIUM-10A, Bundle Type A10-339

1 = GE8x8EB, Bundle Types BD319A, BD336A, BD339A  
2 = GE8x8NB-3, Bundle Types P8HXB322, P8HXB324  
3 = GE11LTA, Bundle Type 89LTA  
4 = GE11, Bundle Type P9HUB356, P9HUB359  
5 = GE11, Bundle Type P9HUB380  
6 = ATRIUM-10A, Bundle Type A10-339

	27	29	31	33	35	37	39	41	43	45	47	49	51
26	4	4	2	4	2	5	2	4	4	5	2	5	2
24	4	2	4	4	5	2	5	4	4	2	5	5	1
22	2	4	2	4	2	4	4	5	2	5	4	5	2
20	4	4	4	4	4	4	5	4	2	4	5	4	2
18	2	5	2	4	4	5	4	2	4	5	4	2	1
16	5	2	4	4	5	3	4	2	5	5	1	1	
14	2	5	4	5	4	4	2	5	4	5	1		
12	4	4	5	4	2	2	5	4	5	4	2		
10	4	4	2	2	4	5	4	5	6	2	1		
08	5	2	5	4	5	5	5	4	2	1			
06	2	5	4	5	4	2	2	2	1				
04	5	5	5	4	2	1							
02	1	1	2	2	1								

FIGURE 8.4.c  
CYCLE 12 LOADING PATTERN, LOWER RIGHT QUADRANT, BUNDLE DESIGN

- 1 = GE8x8EB, Bundle Types BD319A, BD336A, BD339A
- 2 = GE8x8NB-3, Bundle Types P8HXB322, P8HXB324
- 3 = GE11LTA, Bundle Type 89LTA
- 4 = GE11, Bundle Type P9HUB356, P9HUB359
- 5 = GE11, Bundle Type P9HUB380
- 6 = ATRIUM-10A, Bundle Type A10-339



01	03	05	07	09	11	13	15	17	19	21	23	25	
1	5	2	5	4	4	2	5	2	4	2	4	4	26
1	5	5	2	4	4	5	2	5	4	4	2	4	24
2	5	4	5	2	5	4	4	2	4	2	4	2	22
1	4	5	4	2	4	5	4	4	4	4	4	4	20
1	2	4	5	4	2	4	5	4	4	2	5	2	18
	1	1	5	5	2	4	3	5	4	4	2	5	16
		2	5	4	5	2	4	4	5	4	5	2	14
		2	4	5	4	5	2	2	4	5	4	4	12
		1	1	6	5	4	5	4	2	2	4	4	10
			1	1	4	5	5	5	4	5	2	5	08
				1	2	1	2	4	5	4	5	2	06
							1	2	4	5	5	5	04
								1	2	2	1	1	02

FIGURE 8.4.d  
CYCLE 12 LOADING PATTERN, LOWER LEFT QUADRANT, BUNDLE DESIGN

- 1 = GE8x8EB, Bundle Types BD319A, BD336A, BD339A
- 2 = GE8x8NB-3, Bundle Types P8HXB322, P8HXB324
- 3 = GE11LTA, Bundle Type 89LTA
- 4 = GE11, Bundle Type P9HUB356, P9HUB359
- 5 = GE11, Bundle Type P9HUB380
- 6 = ATRIUM-10A, Bundle Type A10-339