


NOT USED ON

# REFERENCE DRAWINGS

REV. NO.	DATE	DESCRIPTION
H-4 12171		LOGIC DIAGRAM, RAPS BLOWBY
H-4 12172		LOGIC DIAGRAM, RAPS COMPRESSOR
H-4 12173		LOGIC & BLOWBY DIAGRAM, RAPS ANNUNCIATOR & MONITOR
H-4 10023		INSTRUMENT LOGIC DIAGRAM
H-4 10024		INSTRUMENT LOGIC DIAGRAM

## NOTES

1. PRESSURE RELIEF VALVES ARE INSTALLED OUTSIDE THE COLD BOX. BECHTEL PROVIDES RELIEF VALVE EXHAUST LINE AND INTERFACES AT RELIEF VALVE EXHAUST PORT.
2. VALVE OPENS ON PNEUMATIC FAILURE AND CLOSSES ON ELECTRICAL FAILURE.

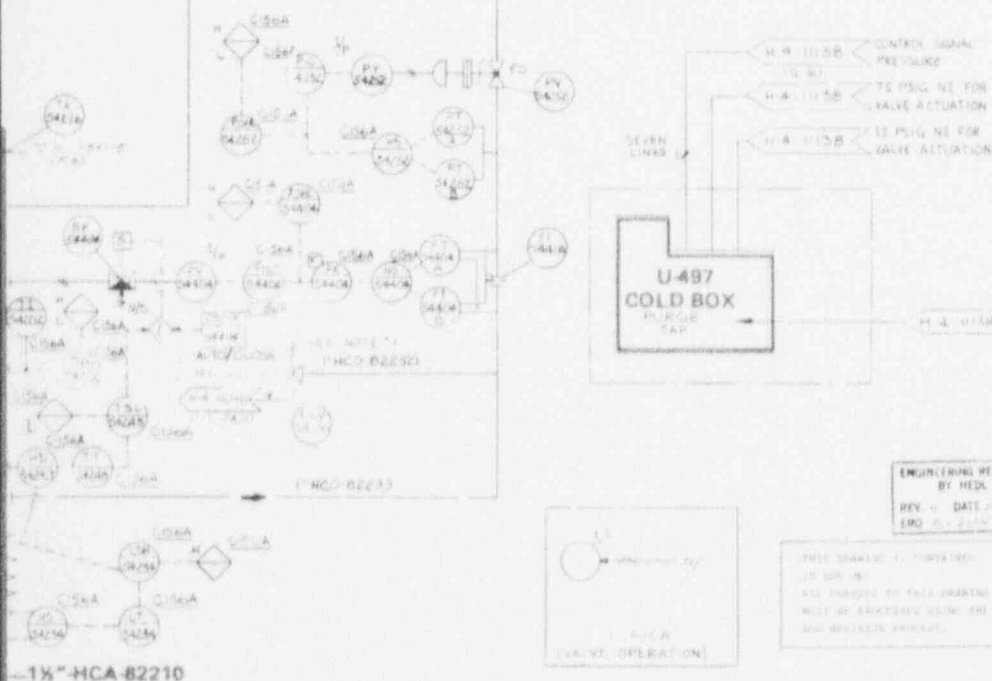

ENGINEERING RELEASE BY HEDL  
REV. 1 DATE 10-10-78  
ERO 5-2100 B

THIS DRAWING IS FORWARDED IN 20% SET  
ALL CHANGES TO THIS DRAWING MUST BE REQUESTED USING THE REVISED PRICE.

REV. NO.	DATE	DESCRIPTION	BY	CHKD
1	10-10-78	REVISED PER CONN H-1105	W-11	
2	10-10-78	REVISED PER CONN H-1105	W-11	
3	10-10-78	REVISED PER CONN H-1105	W-11	
4	10-10-78	REVISED PER CONN H-1105	W-11	
5	10-10-78	REVISED PER CONN H-1105	W-11	
6	10-10-78	REVISED PER CONN H-1105	W-11	
7	10-10-78	REVISED PER CONN H-1105	W-11	
8	10-10-78	REVISED PER CONN H-1105	W-11	
9	10-10-78	REVISED PER CONN H-1105	W-11	
10	10-10-78	REVISED PER CONN H-1105	W-11	
11	10-10-78	REVISED PER CONN H-1105	W-11	
12	10-10-78	REVISED PER CONN H-1105	W-11	

RAPS COLD BOX U-497  
234

SCALE: NONE	UNIT: INCHES	CONTRACT NO.	DATE: 6-19-73
DESIGNER: MOHLER	CHECKED: [Signature]	APPROVED: [Signature]	DATE: 6-19-73
<p>U.S. ATOMIC ENERGY COMMISSION ISLAND OPERATIONS OFFICE Hanford Engineering Development Laboratory Bechtel Corporation San Francisco, CA 94105</p>			
<p>FAST FLUX TEST FACILITY</p>			
<p>PROJECT NO. H-4-11056</p>			
<p>DRAWING NO. A888-5903</p>			