


17375

A-1

DOCKETED
USNRC

'96 AUG 20 P4:54

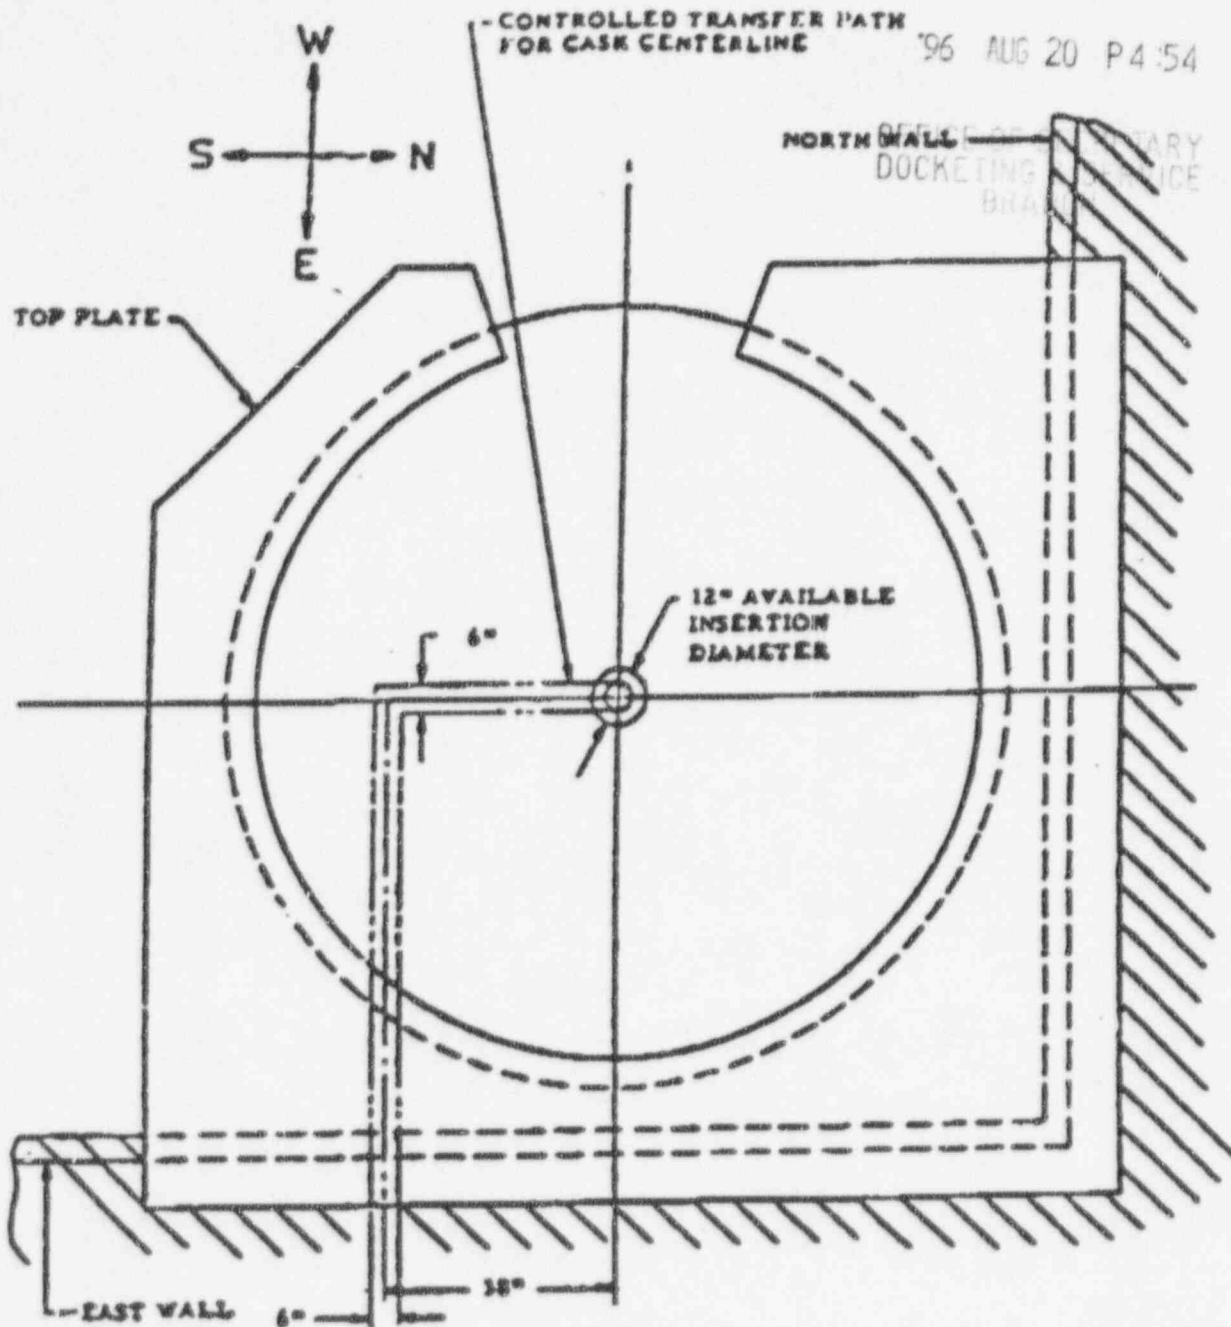

960920002B 960807
PDR ADOCK 05000219
G PDR

NUCLEAR REGULATORY COMMISSION

Docket No. 50-219-OLA EXHIBIT NO. L-1
In the matter of Gen. Public Utility Corp.
☐ Staff ☒ Applicant ☐ Intervenor ☐ Other
☒ Identified ☐ Received ☐ Rejected Reporter JM
Date 08-07-96 Witness _____

Oyster Creek

Update - 8

12/90

Transfer Path for Cask Centerline

Fig. 2.1-11

Figure 1 - Cask Drop Protection System Top Plate