


**GULF STATES UTILITIES COMPANY**



RIVER BEND STATION POST OFFICE BOX 220 ST. FRANCISVILLE, LOUISIANA 70775  
AREA CODE 504 635-6094 346-8651

May 15, 1985  
RBG- 21010  
File Nos. G9.5, G9.25.1.1

Mr. Robert D. Martin, Regional Administrator  
U. S. Nuclear Regulatory Commission  
Region IV  
611 Ryan Plaza Drive, Suite 1000  
Arlington, Texas 76011

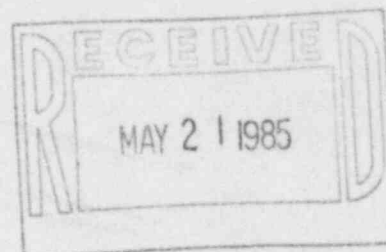

Dear Mr. Martin:

River Bend Station - Unit 1  
Docket No. 50-458  
Final Report/DR-242

Gulf States Utilities Company (GSU) has completed its evaluation of DR-242 concerning the failure of a motor pinion gear in a SB-2-60 motor operator supplied by Limitorque for a safety related valve (1E12\*MOVFO08) in the Residual Heat Removal System. Since the failure of the valve in either the fully open or fully closed position would not affect the safe operations of the plant, GSU has determined this condition is not reportable under 10CFR50.55(e). However, Rework Control Form No. M50269 has been issued to replace the pinion gear and clutch gear in valve 1E12\*MOVFO08.

Sincerely,

J. E. Booker  
Manager-Engineering,  
Nuclear Fuels & Licensing  
River Bend Nuclear Group

<sup>PJO</sup>  
JEB/PJD/amg

cc: Director of Inspection & Enforcement  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

NRC Resident Inspector-Site

850605016  
PDR ADOCH 050 58  
S PDR

15-27  
110

85-349