



GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704

AREA CODE 409 838-6631

July 15, 1985
RBG- 21544
File No. G9.5,
G9.8.6.2

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Denton:

River Bend Station-Unit 1
Docket No. 50-458

Enclosed for your review is Gulf States Utilities Company's response to the request for additional information identified by the Nuclear Regulatory Commission's Auxiliary Systems Branch regarding Final Safety Analysis Report (FSAR) Figures 6.3-1, 9.3-7L and 9.3-7p. These editorial corrections as identified in Attachment 1 will be included in a future FSAR amendment.

Sincerely,

J. E. Booker

J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

JEB/ERG/JEP/kt

Attachment

8507290227 850715
PDR ADOCK 05000458
A PDR

*Boo/
1/60*

ATTACHMENT 1

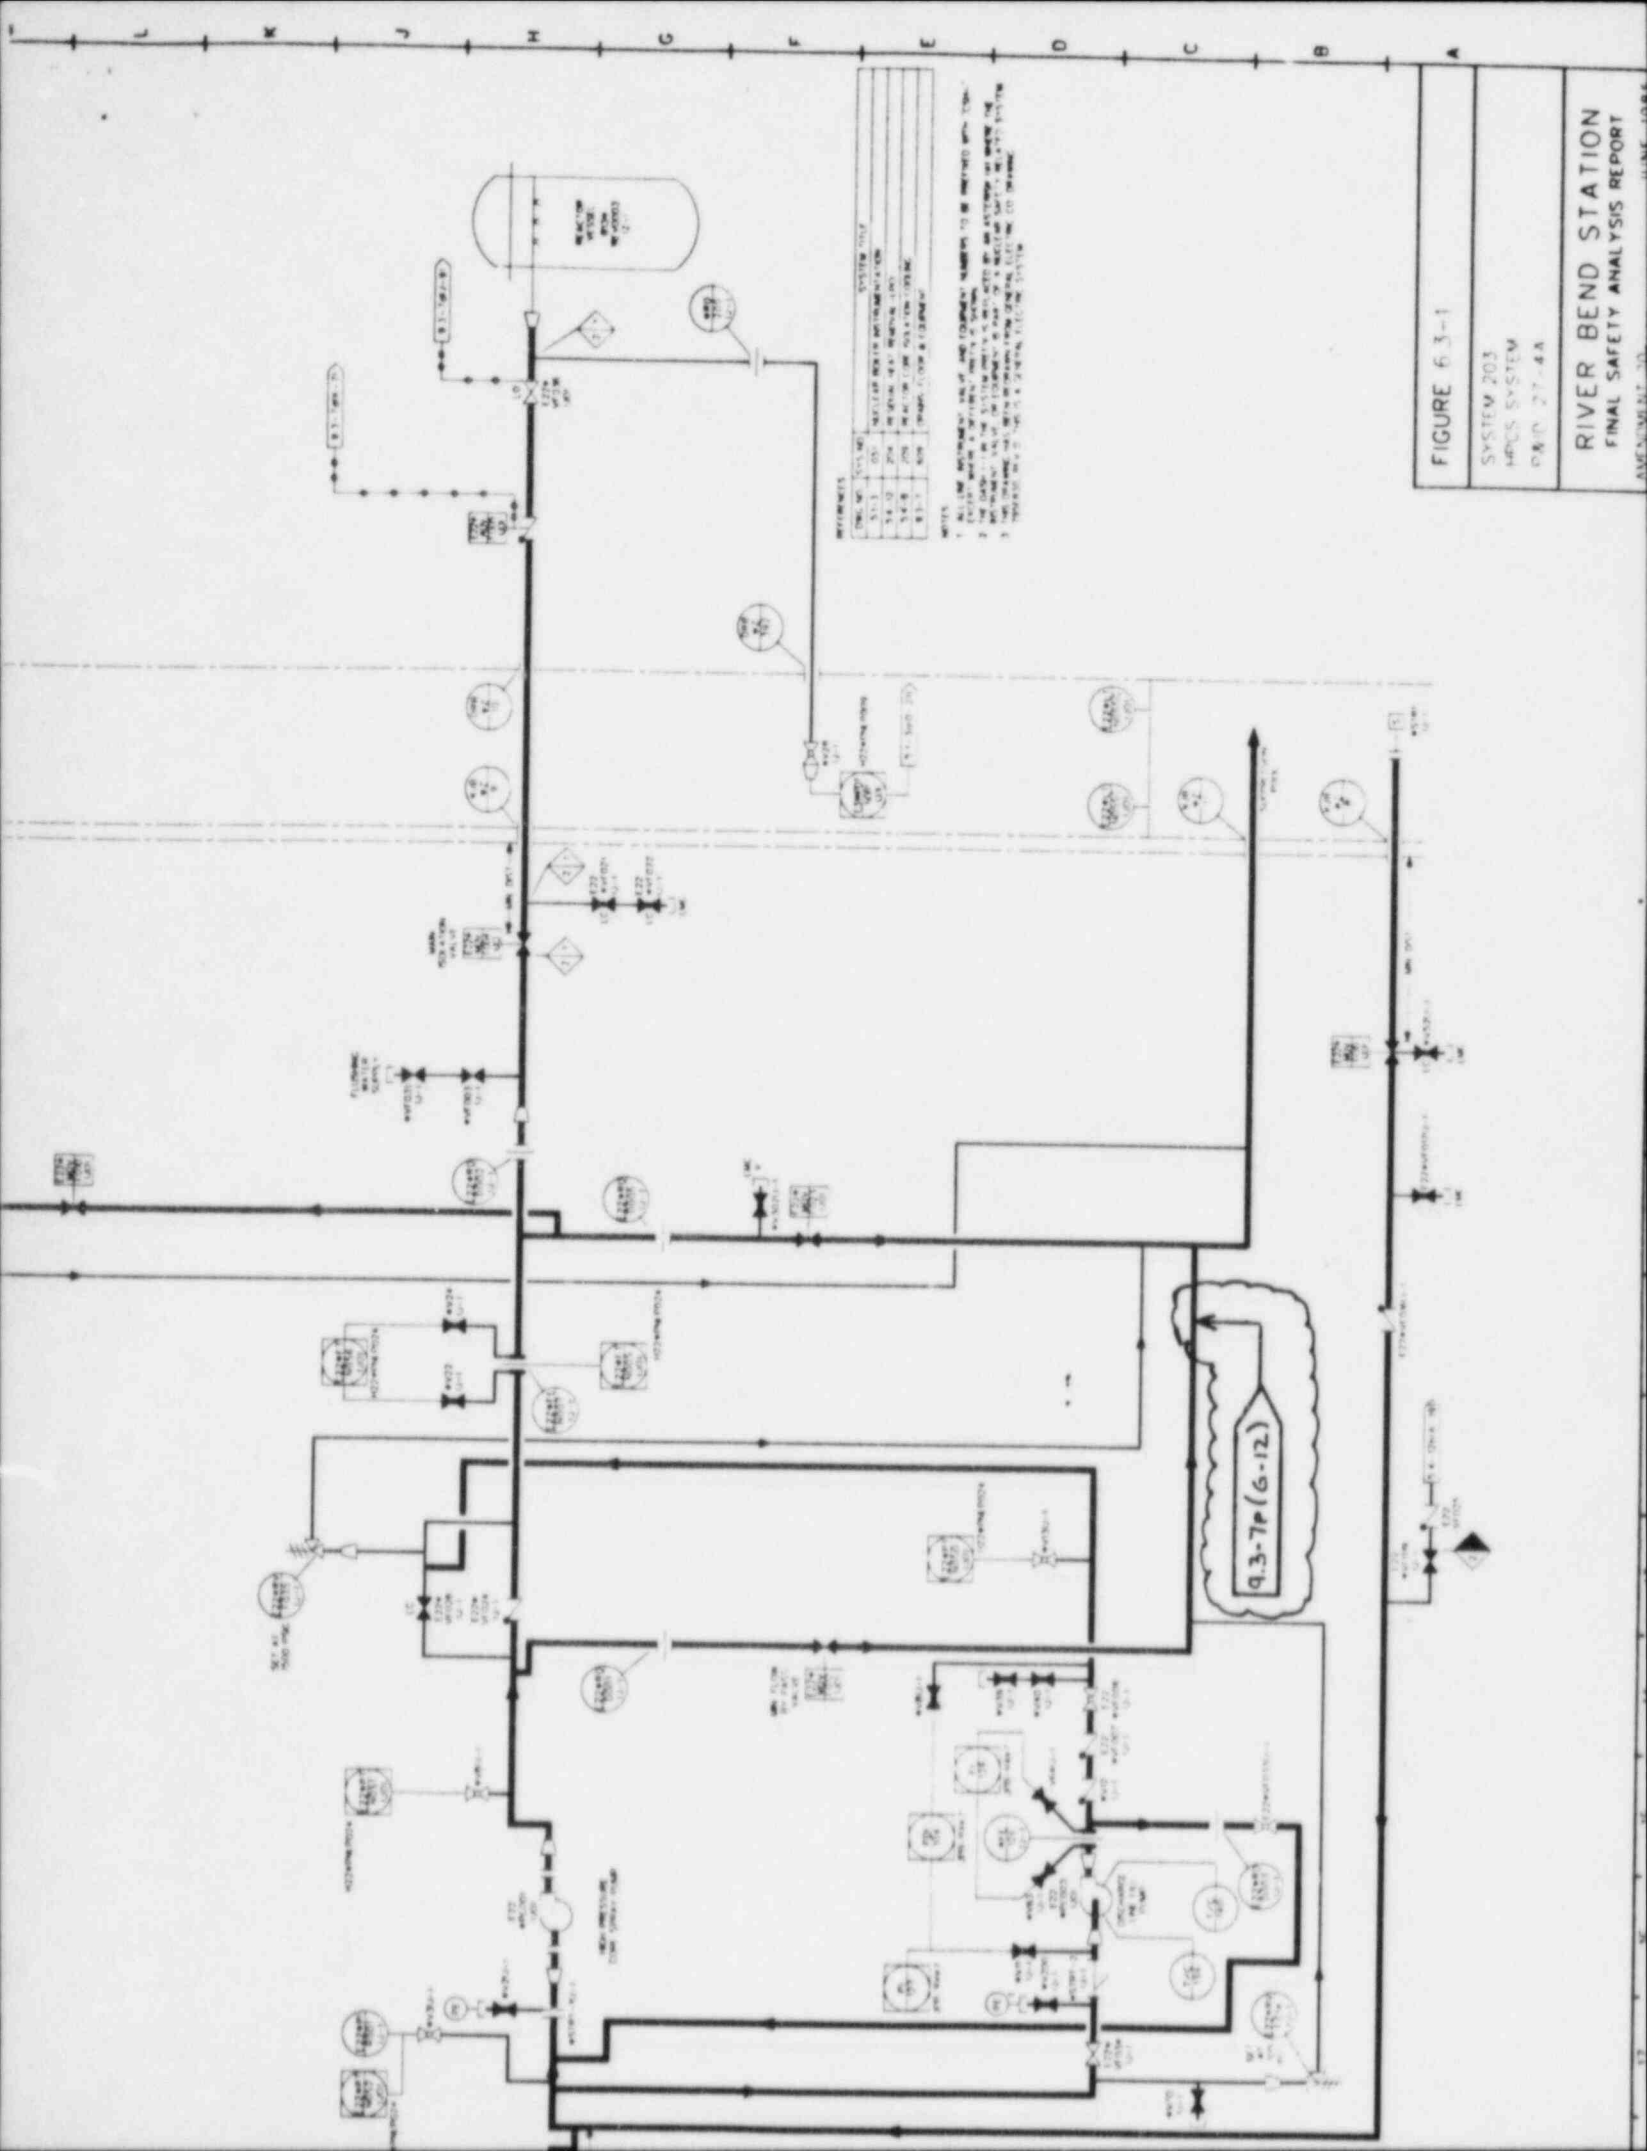
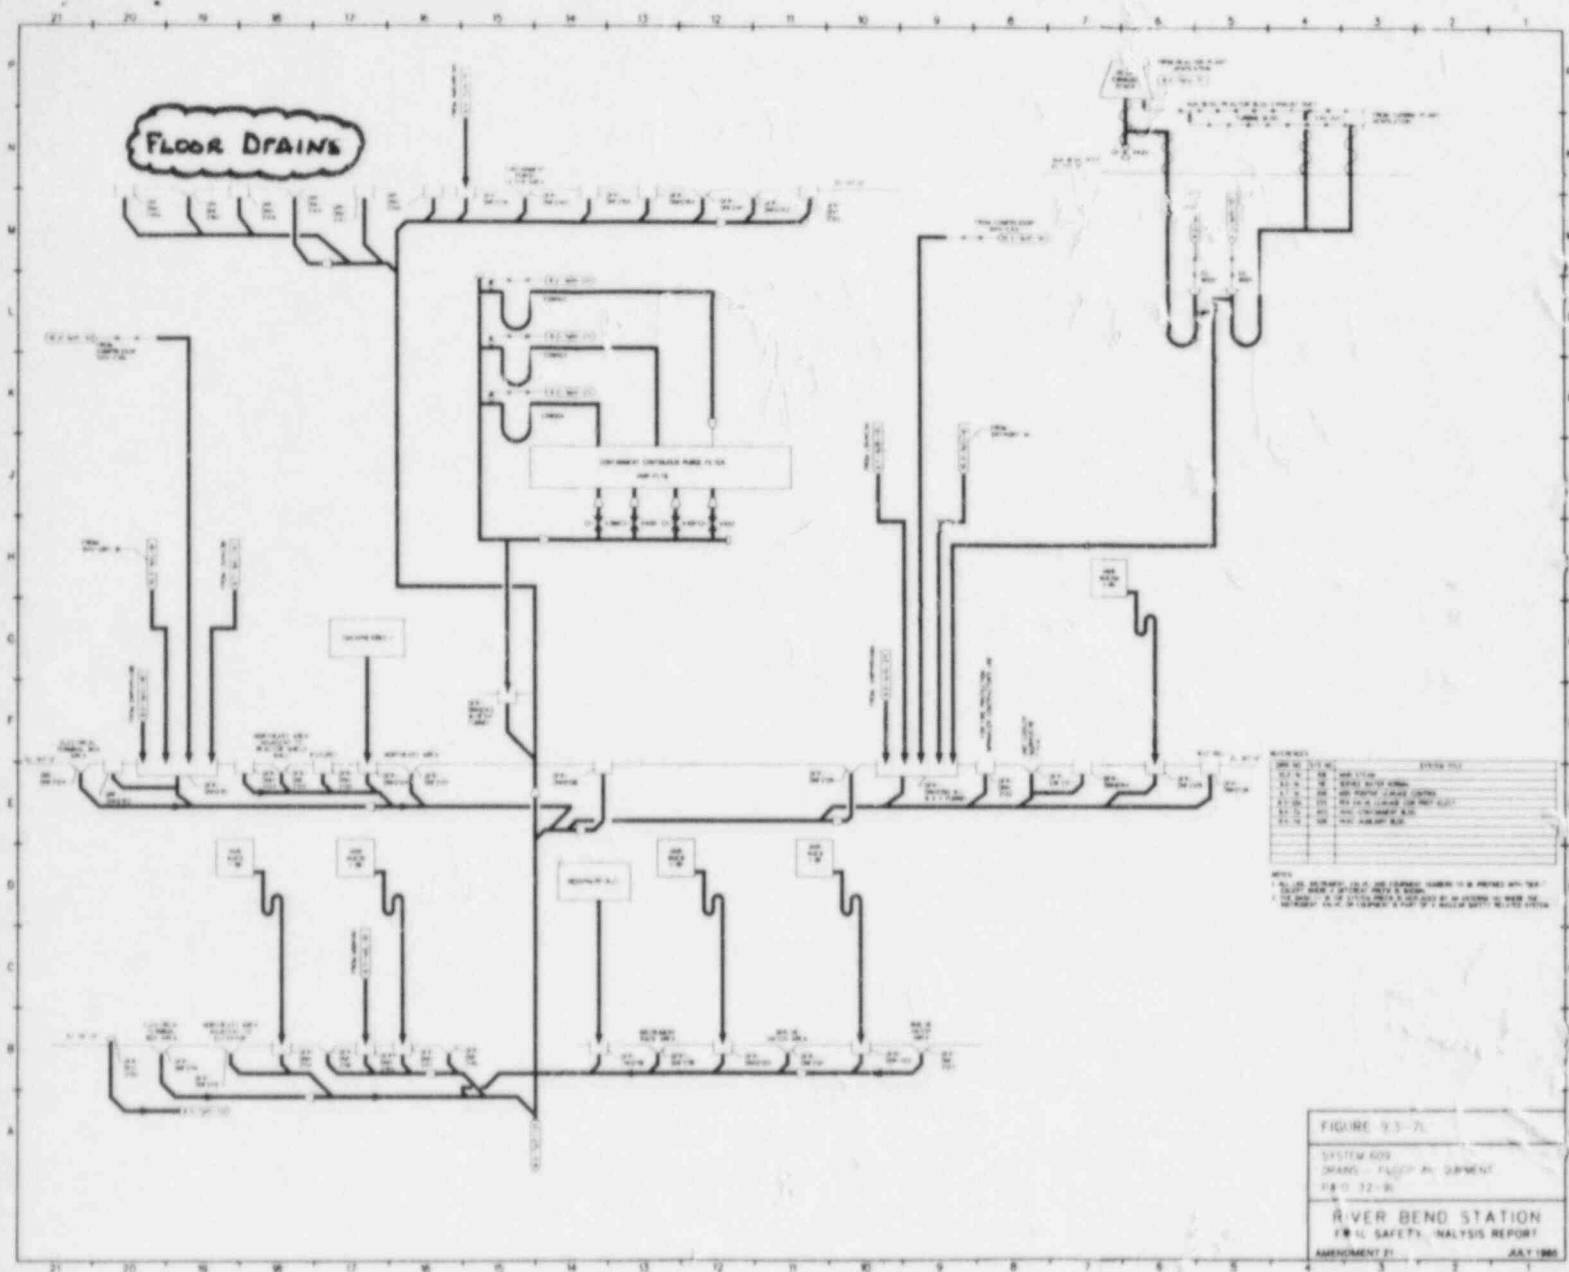


FIGURE 6.3-1

SYSTEM 203
HPLS SYSTEM
D.M. 27-4A



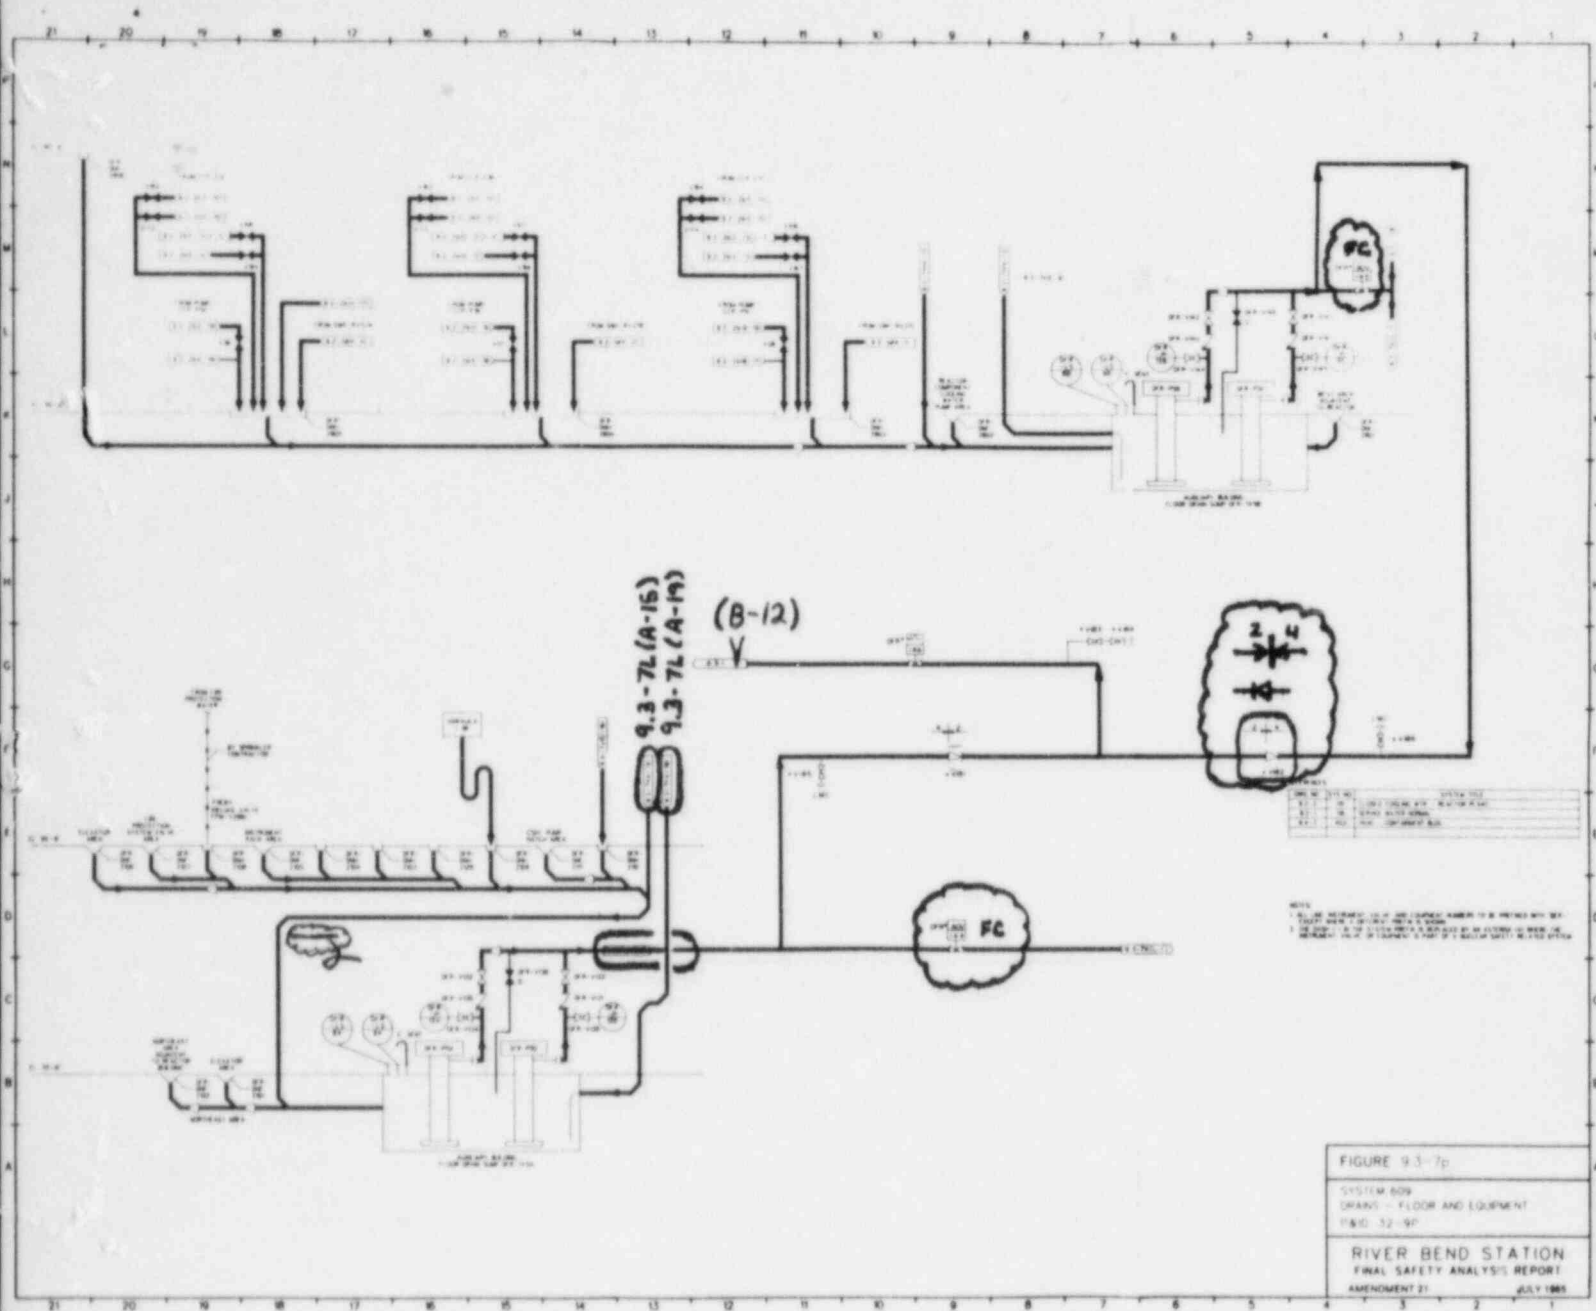


FIGURE 9.3-7p

SYSTEM 609
 DRAWING - FLOOR AND EQUIPMENT
 P&ID: 52-50

RIVER BEND STATION
 FINAL SAFETY ANALYSIS REPORT
 AMENDMENT 21 JULY 1985