

TENNESSEE VALLEY AUTHORITY

Browns Ferry Nuclear Plant
P. O. Box 2000
Decatur, Alabama 35602

July 11, 1985

U. S. Nuclear Regulatory Commission
Document Control Desk
Washington, D. C. 20555


Dear Sir:

TENNESSEE VALLEY AUTHORITY - BROWNS FERRY NUCLEAR PLANT (BFN) UNIT 3 -
DOCKET NO. 50-296 - FACILITY OPERATING LICENSE DPR-68 - REPORTABLE
OCCURRENCE REPORT BFRO-50-296/85006 R1

The enclosed figure was inadvertently omitted from the July 3, 1985
report providing additional details concerning the mismatch of reactor
water level indicators. Please enclose with the subject report.

Very truly yours,

TENNESSEE VALLEY AUTHORITY



G. T. Jones
Plant Manager
Browns Ferry Nuclear Plant

Enclosures

cc (Enclosures):

Regional Administrator
U. S. Nuclear Regulatory Commission
Office of Inspection and Enforcement
Region II
101 Marietta Street, Suite 2900
Atlanta, Georgia 30303


INPO Records Center
Suite 1500
1100 Circle 75 Parkway
Atlanta, Georgia 30339

NRC Resident Inspector, BFN

8507220514 850711
PDR ADOCK 05000296
S PDR

TE22
1/1

FIGURE 7 REACTOR VESSEL LEVEL INSTRUMENTATION

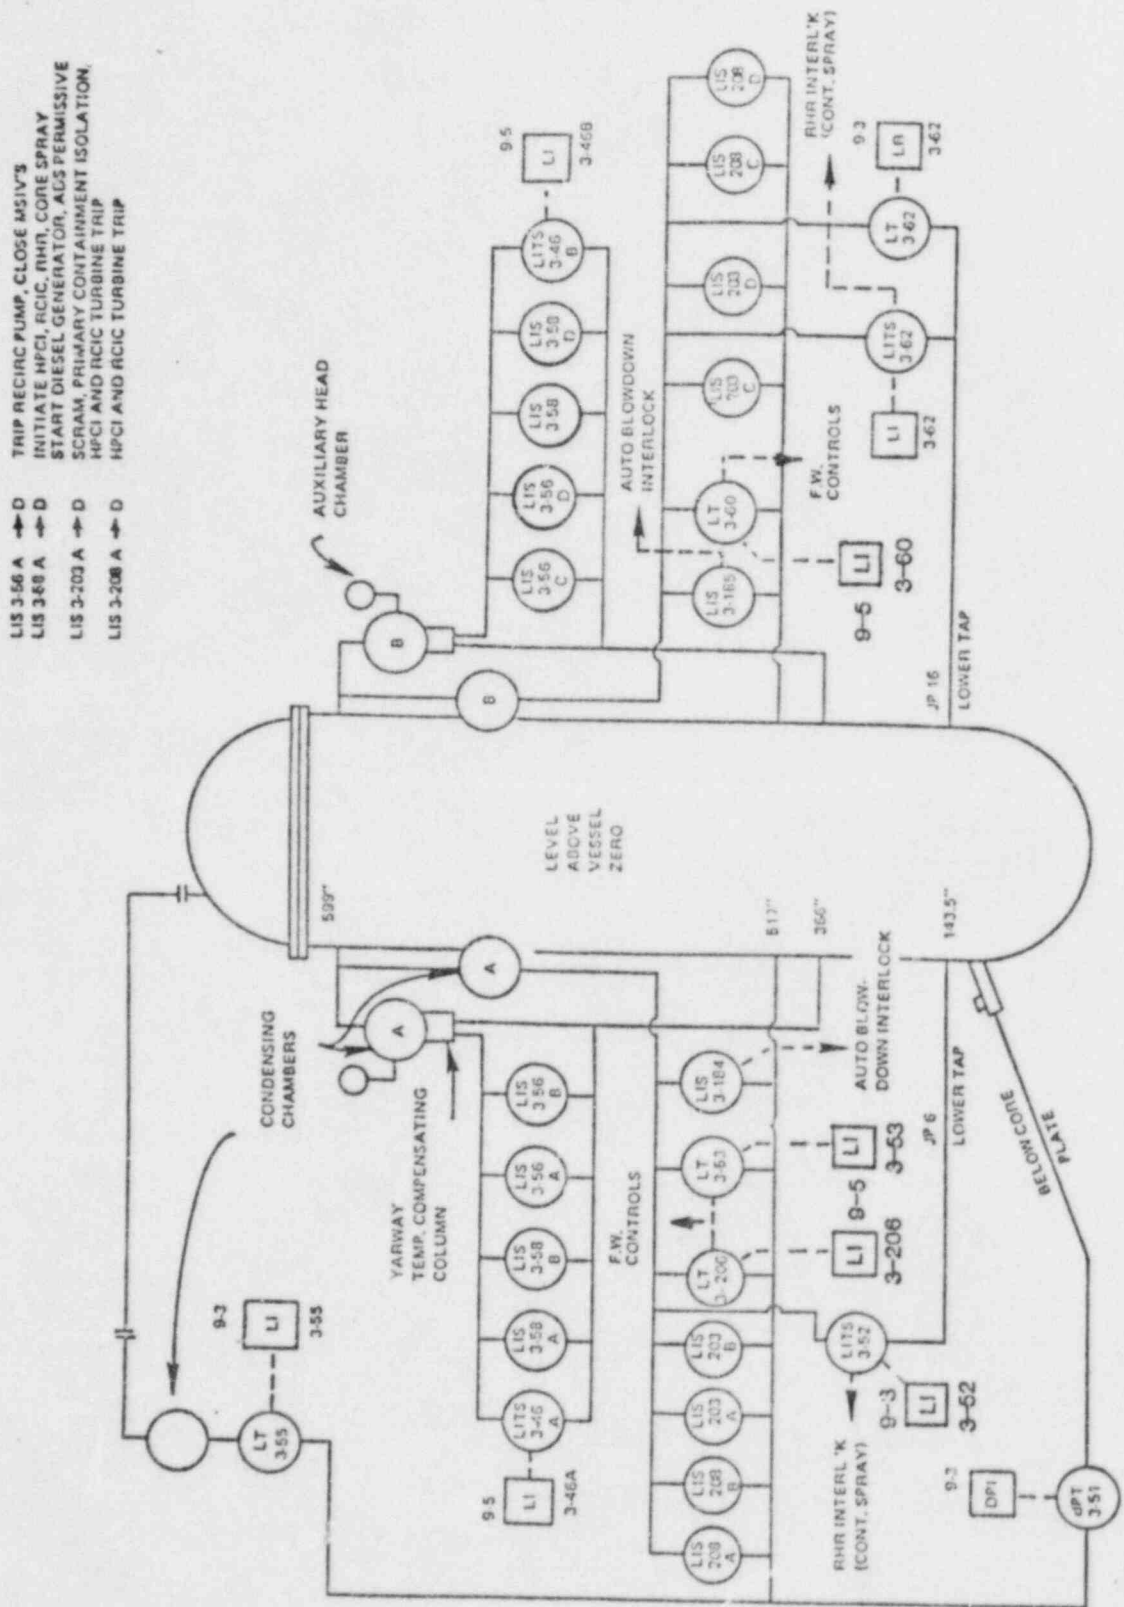

LIS 3-56 A → D
 LIS 3-58 A → D
 LIS 3-203 A → D
 LIS 3-208 A → D

TRIP RECIRC PUMP, CLOSE MSIV'S
 INITIATE HPCI, RCIC, RHR, CORE SPRAY
 START DIESEL GENERATOR, ADS PERMISSIVE
 SCRAM, PRIMARY CONTAINMENT ISOLATION,
 HPCI AND RCIC TURBINE TRIP
 HPCI AND RCIC TURBINE TRIP