

# The Light company

Houston Lighting & Power South Texas Project Electric Generating Station P. O. Box 289 Wadsworth, Texas 77483

January 21, 1997  
ST-HL-AE-5545  
File No.: G09.11  
10CFR50.54

U. S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, DC 20555-0001

South Texas Project  
Units 1 and 2

Docket Nos. STN 50-498, STN 50-499

Submittal of The Revised Graded Quality Assurance Operations Quality Assurance Plan

Reference: 1) Letter from W. T. Cottle to U. S. Nuclear Regulatory Commission dated March 28, 1996, "Submittal of Revised Quality Assurance Plan" (ST-HL-AE-5321)

The South Texas Project submits the attached version of the South Texas Project Operations Quality Assurance Plan (OQAP) in response to the comments received on Reference 1 and during in your staffs visit in August 1996. Your comments on this version are solicited. This version incorporates the revised methodology for the implementation of the South Texas Project's Graded Quality Assurance (GQA) Program. This version is currently under review internally.

In particular, the following enhancements from the previous submittal were incorporated:

- 1) The two sections proposed in our original GQA submittal have been combined into one section. This section is no longer subdivided based on the GQA categorization (i.e., Full vs. Basic).
- 2) A Regulatory Guide table has been added which identifies the South Texas Projects level of commitment with regards to the Regulatory Guides and associated ANSI Standards. This table describes the extent to which the guides and standards are to be applied relative to whether the application is the Full QA Program or the Basic QA Program. Where specific exception is taken, it will be documented in the table.

240092


9701270069 970121  
PDR ADDCK 05000498  
P PDR

Project Manager on Behalf of the Participants in the South Texas Project

Attachment 2 provides a summary of changes between the currently approved OQAP and the attached draft Graded Quality Assurance OQAP.

We believe that this submittal continues to support the process outlined in the Nuclear Regulatory Commission's Graded Quality Assurance Initiative. A final approved version of this OQAP will be submitted incorporating internal comments and resolution of any comments from the Nuclear Regulatory Commission.

If there are any questions regarding this submittal, please contact Mr. R. J. Rehkugler at (512) 972-7922 or me at (512) 972-8686.



L. E. Martin  
General Manager,  
Nuclear Assurance  
and Licensing

JMP/

- Attachment: 1) Graded Quality Assurance Program Operations Quality Assurance Plan  
2) Summary of Changes Between Currently Approved OQAP and this submittal

Leonard J. Callan  
Regional Administrator, Region IV  
U. S. Nuclear Regulatory Commission  
611 Ryan Plaza Drive, Suite 400  
Arlington, TX 76011-8064

Thomas W. Alexion  
Project Manager, Mail Code 13H3  
U. S. Nuclear Regulatory Commission  
Washington, DC 20555-0001

David P. Loveless  
Sr. Resident Inspector  
c/o U. S. Nuclear Regulatory Comm.  
P. O. Box 910  
Bay City, TX 77404-0910

J. R. Newman, Esquire  
Morgan, Lewis & Bockius  
1800 M Street, N.W.  
Washington, DC 20036-5869

M. T. Hardt/W. C. Gunst  
City Public Service  
P. O. Box 1771  
San Antonio, TX 78296

J. C. Lanier/M. B. Lee  
City of Austin  
Electric Utility Department  
721 Barton Springs Road  
Austin, TX 78704

Central Power and Light Company  
ATTN: G. E. Vaughn/C. A. Johnson  
P. O. Box 289, Mail Code: N5012  
Wadsworth, TX 77483

Rufus S. Scott  
Associate General Counsel  
Houston Lighting & Power Company  
P. O. Box 61067  
Houston, TX 77208

Institute of Nuclear Power  
Operations - Records Center  
700 Galleria Parkway  
Atlanta, GA 30339-5957

Dr. Bertram Wolfe  
15453 Via Vaquero  
Monte Sereno, CA 95030

Richard A. Ratliff  
Bureau of Radiation Control  
Texas Department of Health  
1100 West 49th Street  
Austin, TX 78756-3189

J. R. Egan, Esquire  
Egan & Associates, P.C.  
2300 N Street, N.W.  
Washington, D.C. 20037

U. S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, D.C. 20555-0001

J. W. Beck  
Little Harbor Consultants, Inc.  
44 Nichols Road  
Cohasset, MA 02025-1166

ATTACHMENT 1

GRADED QUALITY ASSURANCE PROGRAM  
OPERATIONS QUALITY ASSURANCE PLAN



**SOUTH TEXAS PROJECT ELECTRIC GENERATING  
STATION OPERATIONS QUALITY ASSURANCE PLAN**

**APPROVAL**

NUMBER

Approval

REV.

NO.

13

PAGE 1 OF 1

EFFECTIVE  
DATE

Approved By: \_\_\_\_\_ Date: \_\_\_\_\_

W. T. Cottle, Executive Vice President and  
General Manager, Nuclear

Approved By: \_\_\_\_\_ Date: \_\_\_\_\_

L. E. Martin, General Manager, Nuclear  
Assurance and Licensing

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>TABLE OF CONTENTS</b>	NUMBER	REV. NO.
	Table of Contents	13
	PAGE 1 OF 2	
	EFFECTIVE DATE	

Chapter Number	Title	Effective Chapter Revision	Effective Revision Date	Change Notice No.
	Definitions	7		
1.0	Organization	9		
2.0	Program Description	11		
3.0	Conduct of Plant Operations	7		
4.0	Qualification, Training, and Certification of Personnel	7		
5.0	Maintenance, Installation of Modifications, and Related Activities	5		
6.0	Design and Modification Control	7		
7.0	Procurement	7		
8.0	Control and Issuance of Documents	6		
9.0	Control of Material	6		
10.0	Inspection	7		
11.0	Test Control	6		
12.0	Instrument and Calibration Control	7		
13.0	Control Of Conditions Adverse to Quality	8		
14.0	Records Control	5		
15.0	Quality Oversight Activities	7		
16.0	Reserved for Future Use			

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>TABLE OF CONTENTS</b>	NUMBER	REV. NO.
	Table of Contents	13
	PAGE 2 OF 2	
	EFFECTIVE DATE	

17.0 ASME Code Section XI - Repairs and Replacements	6
18.0 ASME Code Section XI - Inservice Inspection and Testing	7

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 1 OF 9	7
	EFFECTIVE DATE	

This chapter is provided to define terminology used in chapters of the OQAP. They are derived from standard definitions where possible. Program procedures and documents which implement the OQAP may provide variations of these definitions providing the intent of the OQAP definition and requirements are satisfied.

### DEFINITIONS

Abnormal Condition - Any of the following:

- a. Exceeding a limiting condition for a power plant operation established in the applicable technical specifications.
- b. Observed inadequacies in the implementation of administrative or procedural controls such that the adequacy causes or threatens to cause the existence or development of an unsafe condition in connection with the operation of a nuclear power plant.
- c. Conditions arising from natural or off-site man-made events that affect or threaten to affect the safe operation of a power plant.

Administrative controls - Rules, orders, instructions, procedures, policies, and designations of authority and responsibility written by management to obtain assurance of safety and high-quality operation.

Approval - An act of endorsing or adding positive authorization or both.

Approved Vendors List - A listing of vendors who have been evaluated to specific criteria and have been found to be qualified to provide specific items and/or services.

As-Built Data - Documented data that describe the condition actually achieved in a product.

Assessment/Evaluation - Systematic examination of plant systems/components, various plant activities or incidents to evaluate the effectiveness of work practices and/or management controls (i.e., self-assessments, independent assessments, and combinations of the two).

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 2 OF 9	7
	EFFECTIVE DATE	

Audit - A documented activity performed in accordance with written procedures or checklists to verify, by examination and evaluation of objective evidence, that applicable elements of the quality assurance program have been developed, documented, and effectively implemented in accordance with specified requirements. An audit does not include surveillance or inspection for the purpose of process control or product acceptance (ANSI N45.2.12). An audit may include performance monitoring as an input to satisfy a specific portion or aspect of an audit, but should not totally replace an audit.

Authorized Nuclear Inspector (ANI) - Inspectors performing inspections required by Section III of the ASME Code who have been qualified by written examination under the rules of any state of the United States or province of Canada which has adopted the Code. The inspector shall be an employee of an authorized inspection agency and shall not be an employee of the Certificate of Authorization holder. The ANI shall meet the requirements of ANSI N626.

Authorized Nuclear Inservice Inspector (ANII) - Inspectors performing inspections required by Section XI of the ASME code. The ANII is a representative of an authorized inspection agency or a state or municipality of the United States, Canadian Province, or other enforcement authority having jurisdiction over the Nuclear Power components at the plant site.

Calibration - The process by which standards or working equipment are checked against standards of known higher accuracy and adjusted as necessary to ensure their compliance with designated specifications.

Certification - The action of determining, verifying, and attesting in writing to the qualifications of personnel or material.

Cleanness - A state of being clean in accordance with predetermined standards, and usually implies freedom from dirt, scale, heavy rust, oil, or other contaminating impurities.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 3 OF 9	7
	EFFECTIVE DATE	

Commercial Grade Item - A commercial grade item (as defined in 10CFR21) is one which:

A structure, system, or component, or part thereof that affects its safety function, that was not designed and manufactured as a basic component.

Commercial grade items do not include items where the design and manufacturing process require in-process inspections and verifications to ensure that defects or failures to comply are identified and corrected (i.e., one or more critical characteristics of the item cannot be verified).

Component - A piece of equipment such as a vessel, piping, pump, valve, or core support structure, which will be combined with other components to form an assembly.

Contaminants - Foreign materials such as mill scale, dirt, oil, chemicals, and any matter that renders a fluid, solid, or surface impure and unclean according to present standards of acceptable cleanness.

Contractor - Any organization under contract for furnishing equipment, material, or services. It includes the terms vendor, supplier, subcontractor, fabricator, and subtier levels of these, where appropriate. Prime contractor is used to indicate either the architect engineer, NSSS supplier, constructor, or nuclear fuel supplier.

Corrective Action - Any appropriate measure applied for the purpose of making less likely the recurrence of the initial deficiency. Examples are:

- a. Revision of procedures, practices, and/or design documents.
- b. Increased surveillance of procedures and practices.
- c. Work stoppage until problem situation is alleviated.
- d. Special training of personnel.
- e. Reassignment of personnel.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	<b>NUMBER</b> Definitions	<b>REV. NO.</b> 7
	<b>PAGE 4 OF 9</b>	
	<b>EFFECTIVE DATE</b>	

Corrective Maintenance - Repair and restoration of equipment or components that have failed or are malfunctioning and are not performing their intended function.

Critical Characteristics - Identifiable and measurable attributes/variables of a commercial grade item, which once selected to be verified, provide reasonable assurance that the item received is the item specified.

Dedication - The point in time after which a commercial grade item is accepted for a safety-related application and deficiency reporting becomes the responsibility of the party performing the acceptance.

Deficiency - The characteristic of an item or document that makes it nonconforming with the original criteria and is reported as audit findings, supplier deficiencies, event reports, significant defects, nonconformance reports, corrective action reports, or other procedurally controlled mechanisms.

Design - Technical and management processes which commence with identification of design input and which lead to and include the issuance of design output documents.

Design Control - Design control is the process used to verify that the design drawings, design calculations and specifications, including fabrication and inspection procedures for both shop and field, meet the project requirements.

Design Input - Those criteria, parameters, bases, or other design requirements upon which a detailed final design is based.

Design Output - Documents such as drawings, specifications, and other documents defining technical requirements of structures, systems, and components.

Document Review - The process of appraisal of documentation to determine the adequacy of the document with respect to quality/technical requirements.

Drawing - A document which depicts the geometric configuration of an item, or the function of an item.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 5 OF 9	7
	EFFECTIVE DATE	

Equivalency Evaluation - A technical evaluation performed to confirm that an alternative item, not identical to the original item, will satisfactorily perform its intended function once in service. This term is synonymous with "Equal-to-or-Better-Than Evaluation".

Examination - An element of inspection consisting of investigation of materials, components, supplies, or services, to determine conformance to those specified requirements which can be determined by such investigation. Examination is usually nondestructive and includes simple physical manipulation, gaging, and measurement.

Handling - An act of physically moving items by hand or mechanical means, but not including transport modes.

Hold Point - A preselected step in any procedure or work process that identifies a portion or portions of the procedure or work process which requires QA/QC inspection due to the complexity, safety considerations, and/or inaccessibility of the activity and beyond which work may not progress until the required inspection is performed.

In-Service Inspection - The inspection performed generally during a reactor refueling outage or plant shutdown which assures that the nuclear equipment, vessels, and materials are of sufficient integrity to provide protection of public health and safety.

Inspection - A phase of quality control by which means of examination, observation, or measurement determines the conformance of materials, supplies, components, parts, appurtenances, systems, processes, or structures to predetermined quality requirements.

Item - Any level of unit assembly, including structures, system, subsystem, subassembly, component, part, or material.

Material - A substance or combination of substances forming components, parts, pieces, and equipment items. (Intended to include such as machinery, castings, liquids, formed steel shapes, aggregates, and cement.)



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 6 OF 9	7
	EFFECTIVE DATE	

Nonconformance - A deficiency in characteristic, documentation, or procedure which renders the quality of an item unacceptable or indeterminate. Examples of nonconformance include: physical defects, test failures, incorrect or inadequate documentation, or deviation from prescribed processing, inspection, or test procedures.

Notification Point - A preselected step established by Quality Control in any procedure or work process which identifies a discretionary inspection point which may be waived based on the availability of Quality Control personnel and other activities of a more critical nature.

Nuclear Fuel - Uranium ore, converted uranium, enriched uranium, fabricated fuel, pins and assemblies.

Package - A wrapping or container including its contents of material or equipment.

Part - An item which has work performed on it and which is attached to and becomes part of a component before completion of the component.

Plant Modification - A planned physical change to a plant structure, system or component as described in design documents.

Preventive Maintenance - Preventive, periodic and planned maintenance actions taken to maintain a piece of equipment within design operating conditions and extend its life and is performed prior to equipment failure. This includes technical specification surveillances, inservice inspections and other regulatory forms of preventive maintenance.

Procedure - A document that specifies or describes how an activity is to be performed. It may include methods to be employed, equipment, or materials to be used and sequence of operations.

Procurement - Interdisciplinary function by which equipment, materials, or services are acquired.

Procurement Documents - Purchase requisitions, purchase orders, drawings, contracts, specifications or instructions used to define requirements for purchase. (ANSI N45.2.13)

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 7 OF 9	7
	EFFECTIVE DATE	

Proposal - A document which describes the equipment, material, or services which the vendor proposes to furnish. The proposal should include commercial information and a statement of any exceptions to the provisions of the inquiry.

Purchase Order (or Contract) - A document authorizing a vendor to provide equipment, material or services in accordance with the terms and conditions established in the purchase order or contract.

Qualification (Personnel) - The characteristics or abilities gained through training or experience or both that enable an individual to perform a required function.

Qualified Procedure - A procedure which incorporates all applicable codes and standards, manufacturer's parameters, and engineering specifications and has been proven adequate for its intended purpose.

Quality Assurance - All those planned or systematic actions necessary to provide adequate confidence that an item or facility will perform satisfactorily in service.

Quality Control - Those quality assurance actions which provide a means to control and measure the characteristics of an item, process, or facility to established requirements.

Quality-Related - Those activities or items required to be included in the Operations QA program by the UFSAR, Federal Codes, other regulatory licensing requirements or management directive. The term quality-related encompasses safety related activities or items.

Quality-Related Item - A structure, system, or component identified in UFSAR Section 3.2 as requiring applicable quality oversight during the operations phase of STPEGS.

Receiving - Taking delivery of an item at a designated location.

Records - Those records, physical or electronic media, which furnish documentary evidence of the quality of items and of activities affecting quality. A document is considered a quality assurance record when the document has been completed.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	<b>NUMBER</b> Definitions	<b>REV.</b> <b>NO.</b> 7
	<b>PAGE 8 OF 9</b>	
	<b>EFFECTIVE DATE</b>	

Reference Standard - Standards (that is, primary, secondary and working standards, where appropriate) used in a calibration program. These standards establish the basic accuracy limits for that program.

Repair - The process of restoring a nonconforming characteristic to a condition such that the capability of an item to function reliably and safety is unimpaired even though the item still may not conform to the original statement.

Replacements - Spare and renewal components, appurtenances and subassemblies or parts of a component or system. Replacements also include the addition of components but do not include the addition of complete systems.

Review - A deliberately critical examination, including observation of plant operation, evaluation of audit results, procedures, certain contemplated actions, and after-the-fact investigations of abnormal conditions.

Rework - The process by which a nonconforming item is made to conform to a prior specified requirement by completion, remachining, reassembling, or other corrective means.

Safety-Related - Those plant features necessary to assure the integrity of the reactor coolant pressure boundary, the capability to shut down the reactor and maintain it in a safely shutdown condition, or the capability to prevent or mitigate the consequences of accidents which could result in off-site exposures comparable to the guideline exposure of NRC Regulations 10CFR100.

Special Process - A process, the results of which are highly dependent on the control of the process or the skill of the operators, or both, and in which the specified quality cannot be readily determined by inspection or test of the product.

Specification - A concise statement of a set of requirements to be satisfied by a product, material, or process indicating, whenever appropriate, the procedure by means of which it may be determined whether the requirements given are satisfied. (Specifications may also be used to describe technical services to be provided.)

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DEFINITIONS</b>	NUMBER	REV.
	Definitions	NO.
	PAGE 9 OF 9	7
	EFFECTIVE DATE	

Standard - The result of a particular standardization effort approved by a recognized authority.

Stop Work - The suspension of an activity.

Storage - The act of holding items at the construction site or in an area other than its permanent location in the plant.

Surveillance/Quality Performance Monitoring - The act of observing real time activities and/or reviewing documentation to verify conformance with specified requirements and industry good practices, and to evaluate their adequacy and effectiveness.

Surveillance Testing - Periodic testing to verify that safety-related structures, systems, and components continue to function or are in a state of readiness to perform their function.

Survey - An activity performed in a vendor's facility to determine the adequacy and implementation of a vendor's quality assurance program. This activity is normally done prior to award of a purchase order.

System - A group of subsystems united by some interaction or interdependence, performing duties but functioning as a single unit.

Testing - The determination or verification of the capability of an item to meet specified requirements by subjecting the item to a set of physical, chemical, environmental, or operating conditions.

Use-as-is - A disposition which may be imposed for a nonconformance when it can be established that the discrepancy will result in no adverse conditions and that the item under consideration will continue to meet all engineering functional requirements including performance, maintainability, fit, and safety.

Verification - An act of confirming, substantiating, and assuring that an activity or condition has been implemented in conformance with the specified requirements.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ORGANIZATION</b>	NUMBER	REV. NO.
	Chapter 1.0	9
	PAGE 1 OF 6	
	EFFECTIVE DATE	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to describe the organizational structure as related to quality assurance and to establish the responsibilities of organizations for the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 Houston Lighting & Power Company (HL&P), as licensee and Project Manager for itself and the other owners, has the Quality Assurance (QA) responsibility for design, engineering, procurement, fabrication, modification, maintenance, repair, in-service inspection, refueling, testing, and operation of the STPEGS.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components designated as "Full", "Targeted", or "Basic".

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 None

## 5.0 RESPONSIBILITIES

- 5.1 The Nuclear Group is comprised of Nuclear Generation, Nuclear Engineering, Nuclear Assurance & Licensing (NA&L), Plant Services, Human Resources Nuclear, Nuclear Safety and Quality Concerns Program and the Site Business Unit. The heads of these groups report to the Executive Vice President and General Manager, Nuclear.
- 5.1.1 The Executive Vice President and General Manager, Nuclear, has overall responsibility for the implementation of the Operations Quality Assurance Program and approving the Operations Quality Assurance Plan (OQAP) and revisions thereto.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ORGANIZATION</b>	<b>NUMBER</b>  Chapter 1.0	<b>REV. NO.</b>  9
	<b>PAGE 2 OF 6</b>	
	<b>EFFECTIVE DATE</b>	

5.1.2 The Vice President, Nuclear Generation is responsible for implementing quality program requirements applicable to staffing STPEGS with qualified personnel and acquiring and coordinating the assistance of internal and external organizations for the testing, operation, modification, maintenance, and radiological monitoring functions of STPEGS.

5.1.2.1 The General Manager, Generation Support; Plant Manager, Unit 1; and Plant Manager, Unit 2 report to the Vice President, Nuclear Generation.

5.1.2.2 The Plant Managers have prime responsibility for the safe operations of their respective units. The plant staff, under the direction of the Plant Managers, develop detailed procedures and instructions for testing, operation, modification, and maintenance of the STPEGS.

5.1.3 The Vice President, Nuclear Engineering is responsible for implementing quality program requirements applicable to the design engineering and control, systems engineering, nuclear fuels design, acquisition and management, and engineering support functions.

5.1.3.1 The Manager, Design Engineering; Manager, Systems Engineering; and Director, Nuclear Fuel and Analysis report to the Vice President, Nuclear Engineering.

5.1.4 The General Manager, NA&L is responsible for the development, maintenance, and independent verification of implementation of the STPEGS QA Program; making periodic reports on its effectiveness; review of selected documents which control activities within its scope; and preparation, control, and approval of the QQAP and revisions thereto.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ORGANIZATION</b>	<b>NUMBER</b>  Chapter 1.0	<b>REV. NO.</b>  9
	<b>PAGE 3 OF 6</b>	
	<b>EFFECTIVE DATE</b>	

The General Manager, NA&L is also responsible for implementing quality program requirements applicable to STPEGS corrective action, licensing, and Independent Safety Engineering Group activities, and administration of the Nuclear Safety Review Board.

The General Manager, NA&L has the authority to identify, initiate, recommend, or provide solutions to quality-related problems and verify the implementation and effectiveness of the solutions. This position has the independence to conduct QA/Quality Control (QC) activities without undue pressure of cost or schedule.

The General Manager, NA&L, has the authority to stop work for cause. This authority in QA matters has been granted by the Executive Vice President and General Manager, Nuclear. The QA organization, including the inspection staff, is based upon the anticipated QA/QC involvement in operations, modification, and maintenance activities.

The position of General Manager, NA&L is on the same or higher organizational level as the highest line manager responsible for performing activities affecting quality as shown in Attachment I.

- 5.1.4.1 The Director, Quality; Manager, Operating Experience; Manager, Nuclear Licensing; and Manager, Industry Relations report to the General Manager, NA&L.
- 5.1.4.2 The NSRB administratively reports to the Manager, Industry Relations. The NSRB functionally reports directly to and advises the Executive Vice President and General Manager, Nuclear.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ORGANIZATION</b>	<b>NUMBER</b>  Chapter 1.0	<b>REV. NO.</b>  9
	<b>PAGE 4 OF 6</b>	
	<b>EFFECTIVE DATE</b>	

5.1.4.3 The Director, Quality is responsible for Independent Safety Review Group activities, audits, independent assessments, surveillances, performance monitoring, inspections and NDE examinations.

5.1.4.4 During the overview of activities performed by the NA&L organization, the Director, Quality; at his discretion; reports directly to the Executive Vice President and General Manager, Nuclear.

5.1.5 The General Manager, Plant Services is responsible for implementing quality program requirements applicable to nuclear training, information systems, emergency response, records management and administration, and procurement and material control for STPEGS.

5.1.5.1 The Manager, Nuclear Training; Manager, Nuclear Information Systems; Manager, Emergency Response; Director, Records Management and Administration; and Director, Nuclear Purchasing and Materials Management report to the General Manager, Plant Services.

5.1.6 The General Manager, Human Resources Nuclear is responsible for implementing quality program requirements applicable to employee relations (i.e., access authorization), employee development and organizational effectiveness, salary/compensation, and legal and personnel services.

5.1.6.1 The Manager, Employee Relations; Manager, Employee Development & Organizational Effectiveness; and Manager, Benefits report to the General Manager, Human Resources Nuclear.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ORGANIZATION</b>	NUMBER	REV. NO.
	Chapter 1.0	9
	PAGE 5 OF 6	
	EFFECTIVE DATE	

5.1.7 The Director, Nuclear Safety and Quality Concerns Program (NSQP), is responsible for implementing quality program requirements applicable to the NSQP.

5.1.8 The Assistant to the Executive Vice President and General Manager, Nuclear is responsible for implementing quality program requirements applicable to the Site Business Unit.

5.1.8.1 The Manager, Plant Projects and Programs; Manager, Planning and Controls; and Manager, Plant Protection report to the Assistant to the Executive Vice President and General Manager, Nuclear.

## 6.0 REQUIREMENTS

6.1 The fundamental responsibility for implementing quality program requirements is assigned to all personnel performing activities affecting the safe and reliable operation of the STPEGS. These personnel and their management are responsible for implementing through approved procedures and other work documents, the quality assurance program controls described in the QAP.

6.2 Attachment I depicts the organizational structure of the STPEGS as it relates to the implementation of the Operations Quality Assurance Plan. The structure reflects the reporting alignment for key positions. Line organizational details and responsibilities are further described in STPEGS UFSAR Chapter 13.1.

## 7.0 DOCUMENTATION


7.1 None

## 8.0 ATTACHMENTS

8.1 Attachment I - Nuclear Group Organization

SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION  OPERATIONS QUALITY ASSURANCE PLAN  ORGANIZATION	NUMBER Chapter 1.0	REV. NO. 9
	PAGE 6 OF 6	
	EFFECTIVE DATE	
	DATE	

ATTACHMENT I  
NUCLEAR GROUP ORGANIZATION

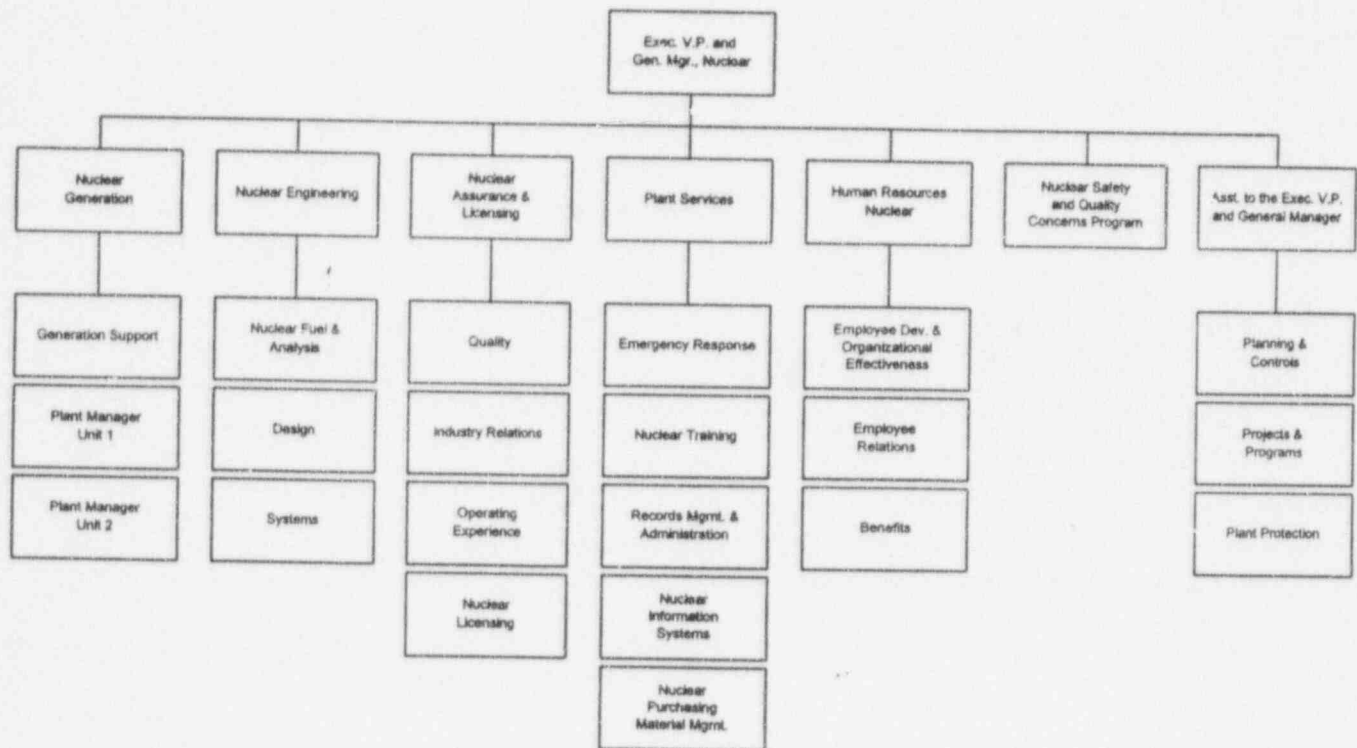

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV. NO.
	Chapter 2.0	11
	PAGE 1 OF 15	
	EFFECTIVE DATE	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to define criteria and establish administrative controls for implementation of the Quality Assurance (QA) Program for the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 The QA Program is implemented and controlled in accordance with the Operations Quality Assurance Plan (OQAP) and is applicable to structures, systems, and components to an extent consistent with their importance to safety, and complies with the requirements of 10CFR50, Appendix B and other program commitments as appropriate.

Graded Quality Assurance is one element of STPEGS's Comprehensive Risk Management (CRM) Program. Graded Quality Assurance provides the process by which risk-based methodology [i.e., Probabilistic Safety Assessment (PSA)], deterministic insight, and performance-based information analyses are combined to provide direction as to what levels of programmatic controls are needed for structures, systems, and components, and as to the levels of first line and independent oversight needed to provide necessary assurance that items will operate safely and activities are accomplished as prescribed. The CRM Program is implemented by Working Groups who provide risk-informed, performance-based recommendations to an Expert Panel. The Expert Panel is a multi-discipline group comprised of high-level management representing Design and Systems Engineering, Nuclear Licensing, Industry Relations, Risk and Reliability Analysis, Quality, and Plant Management. The Expert Panel is chartered with guiding the implementation of the CRM Program.

The QA program is implemented in three graded applications (i.e., "Full", "Targeted", and "Basic").

"Full" program controls are applied to structures, systems, and components determined to be "high" safety significant/risk important.

"Targeted" program controls are applied to non-safety related structures, systems, and components which are categorized "high" or "medium" safety significant/risk important and to structures, systems, and components

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b>  Chapter 2.0	<b>REV. NO.</b>  11
	<b>PAGE 2 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

which are categorized "low" or "not" safety significant/risk important and quality-related. "Full" program controls are applied in a selected manner and specifically "Targeted" at those characteristics or attributes of the structure, system, or component which render it significant or important.

"Basic" program controls are applied to safety-related structures, systems, and components which are categorized as "medium" or "low" safety significant/risk important.

**NOTE:** An analysis to determine which level of program controls is appropriate must be completed prior to designation as "Targeted" or "Basic". Until these analyses are complete for items currently covered by the OQAP, "Full" program controls will be applied across the board.

- 2.2 The QA Program will also extend, as applicable and/or determined by STP management, to programs including 10CFR71, Subpart H (except design and fabrication of NRC certified radioactive waste shipping casks), ASME Boiler and Pressure Vessel Code, Sections III and XI; and to quality-related areas as defined herein including the Fire Protection Program, Emergency Plan, Radiological Environmental Monitoring Program, Radwaste Management Program, Computer Program Verification and Control, Seismic and Environmental Equipment Qualification Programs, Radiation Protection Program, and Station Blackout (SBO) systems and equipment.

### 3.0 DEFINITIONS

- 3.1 Full program controls - The highest levels of program controls and oversight that are to be afforded to safety-related structures, systems, and components determined to be "high" safety significant/risk important. These are in full compliance with the requirements of 10CFR50, Appendix B, and additionally represent compliance with the applicable commitments relative to USNRC Regulatory Guides and ANSI Standards which they endorse. These controls provide the highest levels of program controls and line/independent oversight and are designed to provide a high degree of assurance that items perform safely and activities are accomplished as expected. They reflect controls as committed in Attachment I.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b> Chapter 2.0	<b>REV. NO.</b> 11
	<b>PAGE 3 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

3.2 Targeted program controls - A level of program controls and oversight applied to non-safety related structures, systems, and components which are categorized "high" or "medium" safety significant/risk important and to structures, systems, and components which are categorized "low" or "not" safety significant/risk important and quality-related. These controls are selected elements of the "Full" program applied in a selected manner and specifically "Targeted" at those characteristics or attributes of the structure, system, or component which render it significant or important. These controls provide a high degree of assurance that the structure, system, or component will perform their specific function and the important elements of the activities are accomplished as expected. They reflect selected controls as committed in Attachment I.

3.3 Basic program controls - "Basic" program controls are applied to safety-related structures, systems, and components which are categorized as "medium" or "low" safety significant/risk important and are subject to the controls of the QA program as committed in Attachment I. These controls are defined as good business practices which reflect the most economical and efficient means of conducting business and are designed to provide assurance that structures, systems, and components perform, and activities are accomplished, as expected.

#### 4.0 REFERENCES

- 4.1 10CFR50, Appendix B
- 4.2 10CFR71, Subpart H
- 4.3 ASME B&PV Code
- 4.4 OQAP Chapter 14.0, Records Control
- 4.5 10CFR50.63, Loss of All Alternating Current Power

#### 5.0 REQUIREMENTS

- 5.1 The OQAP is prepared to prescribe the STPEGS QA Program.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b>  Chapter 2.0	<b>REV. NO.</b>  11
	<b>PAGE 4 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

- 5.1.1 The OQAP shall provide quality program policies to be implemented for the STPEGS. The OQAP assigns responsibilities necessary for the attainment of quality assurance objectives and the verification of conformance to established requirements.
- 5.1.2 The QA Program shall be in effect throughout the operating life of the STPEGS.
- 5.1.3 The Executive Vice President and General Manager, Nuclear has overall responsibility for quality assurance.
- 5.1.4 The General Manager, Nuclear Assurance and Licensing (NA&L), is responsible for the development and maintenance of the OQAP.

## 5.2 Organizational Independence

- 5.2.1 The reporting arrangement utilized by the NA&L Organization ensures that those personnel performing independent oversight have the organizational freedom to:
  - 5.2.1.1 Identify quality problems.
  - 5.2.1.2 Initiate, recommend, or provide solutions.
  - 5.2.1.3 Verify implementation of solutions.
- 5.2.2 Personnel verifying compliance with quality requirements do not have direct responsibility for the performance of or directly supervise the activity being verified.

## 5.3 QA Program

- 5.3.1 The operations phase of the STPEGS includes design, engineering, procurement, fabrication, repair, testing, operation, maintenance, refueling, inservice inspection, and modification. The OQAP requires that HL&P, its contractors, subcontractors, and vendors comply with the criteria established by 10CFR50, Section 50.55a; 10CFR50, Appendix A, General Design Criterion (GDC) 1; 10CFR50, Appendix B, and 10CFR71, Sub-Part H (except design and fabrication of NRC certified radioactive waste



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b>  Chapter 2.0	<b>REV. NO.</b>  11
	<b>PAGE 5 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

shipping casks).

It is the intent of HL&P to comply, as applicable, with the Regulatory Guides (RG) and implementing American National Standards Institute (ANSI) N45.2 daughter standards as defined in Attachment I.

#### 5.4 Delegation of QA Functions

5.4.1 The OQAP may be executed in whole or part by subcontract personnel. However, STPEGS will retain responsibility for the total quality assurance program, and NA&L personnel will perform appropriate oversight activities of subcontracted activities.

#### 5.5 Identification of Safety Significant Structures, Systems, and Components

5.5.1 The program described herein is applied to activities affecting the safety functions of those structures, systems, and components which prevent, or mitigate the consequences of postulated accidents that could cause undue risk to the health and safety of the public. The structures, systems, and components controlled are listed in UFSAR Section 3.2, along with their associated fire protection systems. UFSAR Section 3.2 also identifies those structures, systems, and components which may not represent a safety significant/risk important concern but to which the STPEGS OQAP is applied.

5.5.2 The fire protection QA Program is part of the overall STPEGS Operations QA Program. Fire protection QA Program criteria are implemented as part of the HL&P Operations QA Program.

5.5.3 Expendable or consumable items necessary for the functional performance of structures, systems, and components are subjected to quality assurance requirements as specified in written procedures. These procedures include provisions for review and control in accordance with industry standards and specifications.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b>  Chapter 2.0	<b>REV. NO.</b>  11
	<b>PAGE 6 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

## 5.6 QA Program Documents

5.6.1 The QA Program shall be implemented with documented instructions, procedures, and drawings which include appropriate quantitative and qualitative acceptance criteria for determining that prescribed activities have been satisfactorily accomplished. Procedures shall include the control of the sequence of required inspections, tests, and other operations when important to quality. To change these controls, the individual procedure must be changed and shall require the same level of review and approval given to the original procedure. Such instructions, procedures, and drawings are reviewed and approved for compliance with requirements appropriate to their safety significance by individuals qualified to do so.

## 5.7 Personnel Indoctrination and Training

5.7.1 General indoctrination and training programs shall be provided for site personnel to assure that they are knowledgeable regarding quality programs and requirements. The training requirements for STPEGS personnel are described in UFSAR Section 13.2. Personnel performing complex, unusual, or potentially hazardous work shall be instructed in special indoctrination or briefing sessions. Emphasis shall be on special requirements for safety of personnel, radiation control and protection, unique features of equipment and systems, operating constraints, and control requirements in effect during performance of work. Where required by codes and standards, personnel are trained, qualified, and certified according to written procedures in the principles and techniques of performing specific activities.

## 5.8 Policies and Goals

5.8.1 It is the policy of HL&P, acting as licensee and Project Manager for the STPEGS, to assure that the design, procurement, construction, testing, and operation of the STPEGS are in conformance with specifications, procedures, codes, commitments and Nuclear Regulatory Commission (NRC) regulations. The



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b> Chapter 2.0	<b>REV. NO.</b> 11
	<b>PAGE 7 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

responsibility of each organization supporting the STPEGS is to ensure that the requirements stated in this QA Program are incorporated into procedures. Adherence to those procedures is mandatory for all STPEGS organizations and contractors or vendors providing items or services covered by the QA Program.

- 5.8.2 The OQAP identifies activities and establishes requirements for procedures which identify, report, and verify the resolution of quality problems. The implementing procedures call for the resolution of quality problems at the lowest possible authorized level. However, if a dispute is encountered in the resolution of a quality problem which cannot be resolved at lower levels, the General Manager, Nuclear Assurance & Licensing or Director, Quality shall present the problem to the Executive Vice President and General Manager, Nuclear, for resolution.

#### 5.9 Control of Activities

- 5.9.1 The OQAP requires Quality department review and/or approval of procedures which control selected activities. These procedures shall require the use of the proper equipment, completion of prerequisites for starting an activity, and suitable environment for performing the activity. Procedures will comply with the appropriate standards.
- 5.9.2 STPEGS personnel attend planning, scheduling, and status meetings as necessary to assure adequate quality coverage and program application exists.

#### 5.10 Management Review

- 5.10.1 The implementation of both line and OQAP requirements shall be verified through independent oversight activities. The Quality organization shall conduct independent oversight activities of the operating plant and of the interfacing organizations' activities.
- 5.10.2 Independent oversight of HL&P's implementation of the OQAP is conducted under the cognizance of the Nuclear Safety Review Board and results

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV. NO.
	Chapter 2.0	11
	PAGE 8 OF 15	
	EFFECTIVE DATE	

are transmitted to appropriate line and senior management, including the Executive Vice President and General Manager, Nuclear for review and/or action.

- 5.10.3 STPEGS may use the services of architect-engineer firms, Nuclear Steam Supply System (NSSS) suppliers, fuel fabricators, constructors, and others which provide or augment STPEGS efforts during operations. As applicable, the QA programs of such contractors or consultants shall be subject to review, evaluation, and acceptance by the Quality organization before initiation of activities affected by the program.

#### 5.11 Operations Quality Assurance Plan Changes

- 5.11.1 HL&P is committed to maintaining the OQAP as an effective and meaningful document to provide programmatic direction on STPEGS. Changes to the OQAP will be processed under 10CFR50.54(a).

#### 5.12 Computer Code Programs

- 5.12.1 The development, maintenance, and use of computer code programs will be controlled. Prior to use of a computer code program, the appropriateness of the program shall be verified. In addition, all such programs shall be appropriately certified for use.

### 6.0 DOCUMENTATION

- 6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.4.

### 7.0 ATTACHMENTS

- 7.1 ATTACHMENT I - Regulatory Guide Table

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	<b>NUMBER</b>  Chapter 2.0	<b>REV. NO.</b>  11
	<b>PAGE 9 OF 15</b>	
	<b>EFFECTIVE DATE</b>	

## ATTACHMENT I

### REGULATORY GUIDE TABLE

The following represents STP's level of commitment with regard to the listed Regulatory Guides and associated ANSI Standards. This describes the extent to which the guides and standards are to be applied relative to whether application is the Full QA Program or the Basic QA Program. Where specific exception is taken, it will be documented in this Table. Applicability of specific paragraphs to the full or basic program are identified by parenthetical statements at the end of each paragraph.

Sections of Regulatory Guides and ANSI standards (which do not provide for "grading" in applicability sections), which contain requirements (as indicated by use of the word "shall") and for which STP does not take specific exception(s), will be implemented. (Applicable to both Full and Basic)

Sections of endorsed ANSI standards which contain requirements (as indicated by the word "shall") will be implemented (as prescribed in the "applicability" portions of these standards), consistent with the nature, scope and importance of the activity performed. (Applicable to both Full and Basic)

Regulatory Guide positions and ANSI standard sections, which contain recommendations (as indicated by use of the word "should"), will be implemented as appropriate depending on comprehensive risk management activities and good business practice. (Applicable to both Full and Basic)

STP has determined that equipment and components in the Basic category do not carry a high degree of safety significance and therefore, blanket exception is taken to Regulatory Guide positions which indicate that specific ANSI standard sections have sufficient safety significance to warrant treatment of "should" the same as "shall". The ANSI standard will be imposed as written and consideration given as indicated in the preceding paragraph. (Applicable to Basic only)

No.	Reg.Guide. Title	ANSI Standard
-----	------------------	---------------

1.8	Personnel Selection and Training (R/1-R, 9/75)	N18.1, 1971
-----	---	-------------

ANSI N18.1, Section 4.2.2 - The Operations Manager requirements regarding holding a senior reactor license may be met at STP by the Unit Operations Managers.

SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION  OPERATIONS QUALITY ASSURANCE PLAN  PROGRAM DESCRIPTION	NUMBER Chapter 2.0	REV. NO. 11
	PAGE 10 OF 15	
	EFFECTIVE DATE	

# ATTACHMENT I

## REGULATORY GUIDE TABLE

No.	Reg.Guide Title	ANSI Standard
1.30	Quality Assurance Requirements for the Installation, Inspection, and Testing of Instrumentation and Electric Equipment (R/0, 8/72)	N45.2.4, 1972
1.33	Quality Assurance Program Requirements (Operations) (R/2, 2/78)	ANS 3.2 N18.7, 1976

R.G.-1.33, position C.4 - The audit program as described in the Operations Quality Assurance Plan, Chapter 15 meets the intent of this position and require audits to be performed on a nominal biennial frequency.

R.G.-1.33, positions C.4.a,b,c - STP performs these audits in accordance with the nominal biennial frequency.

ANS 3.2/ANSI 18.7 - Sections 3.4.2 (first paragraph) and 5.2.17 - see R.G.-1.58 position regarding use of personnel not certified in accordance with ANSI N45.2.6, 1978 (Basic program only)

Section 5.2.7 - This section states in part, "...ensure quality at least equivalent to that specified in **original** design bases and requirements, material specifications and inspection requirements." In lieu of this STP will "...ensure quality at least equivalent to that specified in the **current approved** design bases and requirements, material specifications and inspection requirements."

Section 5.2.9 - These requirements are covered in the Plant Protection Program documents (i.e., Physical Security Plan, Safeguards Contingency Plan, and Training & Qualification).

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV. NO.
	Chapter 2.0	11
	PAGE 11 OF 15	
	EFFECTIVE DATE	

# ATTACHMENT I

## REGULATORY GUIDE TABLE

No.	Reg.Guide Title	ANSI Standard
1.37	Quality Assurance Requirements for Cleaning of Fluid Systems and Associated Components of Water-Cooled Nuclear Power Plants (R/0, 3/73)	N45.2.1, 1973
	<p>R.G.-1.37, position C.3 - The organization responsible for the selection of water quality will be an appropriate division within the Engineering Department.</p> <p>ANSI N45.2.1 - Section 2.4 - see R.G.-1.58 position regarding use of personnel not certified in accordance with ANSI N45.2.6, 1978 (Basic program only)</p> <p>Section 3.1.2(1) - With regard to the requirement to have a "... lighting level (background plus supplementary lighting) of at least 100 foot candles." It is STP's normal practice that the lighting level for determining "metal clean" of accessible surfaces of piping and components is determined by the personnel performing the inspection.</p> <p>ANSI N45.2.1, Section 3.1.2(1) (Con't.) - Typically, lighting is provided by use of a standard two-cell flashlight supplemented by other lighting as deemed necessary.</p>	
1.38	Quality Assurance Requirements for Packaging, Shipping, Receiving, Storage, and Handling of Items of Water-Cooled Nuclear Power Plants (R/2, 5/77)	N45.2.2, 1972
	<p>R.G.-1.38, position C.1 - STP takes exception to the statement "...when supplemented by the guidelines identified Regulatory Position 2, provide..." See generic exception taken in paragraph 4 of this table. (Basic program only)</p>	
1.39	Housekeeping Requirements for Water-Cooled Nuclear Power Plants (R/2, 9/77)	N45.2.3, 1973

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV. NO.
	Chapter 2.0	11
	PAGE 12 OF 15	
	EFFECTIVE DATE	

# ATTACHMENT I

## REGULATORY GUIDE TABLE

No.	Reg. Guide Title	ANSI Standard
1.54	Quality Assurance Requirements for Protective Coatings Applied to Water-Cooled Nuclear Power Plants (R/0, 6/73)	N101.4, 1972
	ANSI N101.4 - Section 6.6.5 - This section states in part, "The accepted method of determining film thickness for magnetic substrates shall be the DFT measurement; the WFT measurement shall be used for guide purposes only." STP uses <b>either</b> DFT or WFT for determining film thickness for magnetic substrates.	
1.58	Qualification of Nuclear Power Plants Inspection, Examination, and Testing Personnel (R/1, 9/80)	N45.2.6, 1978
	R.G.-1.58, position C.1 - For Basic program implementation, personnel may perform inspections, examinations, and tests provided they are experienced, task qualified journeymen or supervisors and they did not perform or directly supervise the activity being inspected, examined, or tested. These personnel shall meet the training and qualification requirements of the discipline training program.	
	R.G.-1.58, positions C.2, C.2.a and b - STP uses SNT-TC-1A 1980.	
	ANSI N45.2.6 - For Basic program implementation - see R.G.-1.58, position C.1	
1.64	Quality Assurance Requirements for the Design of Nuclear Power Plants (R/2, 6/76)	N45.2.11, 1974
	ANSI N45.2.11, Section 11 - Auditing of design activities is accomplished in accordance with the applicable requirements of R.G.s 1.33, 1.144, and 1.146 and their associated ANSI standards as committed to in this table.	



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV.
	Chapter 2.0	NO.
	PAGE 13 OF 15	11
	EFFECTIVE DATE	

# ATTACHMENT I

## REGULATORY GUIDE TABLE

No.	Reg.Guide Title	ANSI Standard
-----	-----------------	---------------

1.88	Collection, Storage and Maintenance of Nuclear Power Plant Quality Assurance Records (R/2, 10/78)	N45.2.9, 1974
------	---	---------------

R.G.-1.88, position C.2 - STP does not make any specific commitment to the use of the NFPA document.

ANSI N45.2.9, Section 5.6 - Records generated for Basic program implementation may be stored in facilities that do not meet the strict requirements of this section. These record storage facilities shall provide reasonable protection from destruction caused by fire, flooding, tornadoes, insects, rodents, and possible deterioration due to extreme variations in temperature and humidity conditions.

Section 5.7 - Auditing of activities associated with quality assurance records' storage system effectiveness is accomplished in accordance with the applicable requirements of R.G.s 1.33, 1.144, and 1.146 and associated ANSI standards as committed to in this table.

1.94	QA Requirements for Installation, Inspection, and Testing of Structural Concrete and Structural Steel During the Construction Phase Nuclear Power Plants (R/1, 4/76)	N45.2.5, 1974
------	--	---------------

ANSI N45.2.5, Section 2.4 - For Basic program implementation, see R.G.-1.58, position C.1.

Section 4.8 - states "Pumped concrete must be sampled from the pump line discharge." In lieu of this statement, in-process strength samples of pumped concrete shall be taken at the delivery point. Correlation tests of air content, slump, and temperature shall be performed to verify these plastic properties of the concrete at the placement point in accordance with the following frequency requirements:

- a. A minimum of two correlation tests for each pumped placement exceeding 200 yd<sup>3</sup>.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV. NO.
	Chapter 2.0	11
	PAGE 14 OF 15	
	EFFECTIVE DATE	

# ATTACHMENT I

## REGULATORY GUIDE TABLE

No.	Reg.Guide Title	ANSI Standard
1.94 cont b.	Otherwise, a minimum of two correlation tests per week when any individual pumped placement during a week requires delivery of more than one truckload of concrete.	
c.	During a week when a pumped placement exceeds 200 yd <sup>3</sup> , the correlation tests on that placement satisfy the weekly requirement for performing two correlation tests as specified in item b, above.	
	<p>If the correlation test results show a concrete property not meeting the specification limits and/or tolerances at the point of placement, the frequency of correlation testing shall be increased to 100 yd<sup>3</sup>. If two consecutive correlation tests exceed the specified limit for slump, air content, or temperature, the condition shall be documented, Design Engineering notified within 24 hours of completion of the placement and return control of the concrete by in-process testing at the point of placement per ANSI N45.2.5-1974.</p> <p>Samples and frequency for Cadweld testing shall be in accordance with ACI-359/ASME Section III, Division 2, issued for trial use and comment in 1973, including Addenda 1 through 6, (see Sections 3.8.1.6.3 and 3.8.3.6.2).</p> <p>The testing frequency of sleeves with filler metal (Cadwelds) complies with UFSAR sections 3.8.1.6.3 and 3.8.3.6.2.</p>	
1.116	Quality Assurance Requirements for Installation, Inspection, and Testing of Mechanical Equipment and Systems (R/O-R, 6/76)	N45.2.8, 1975

ANSI N45.2.8, Section 2.7 - For Basic program implementation, see R.G.-1.58, position C.1.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROGRAM DESCRIPTION</b>	NUMBER	REV. NO.
	Chapter 2.0	11
	PAGE 15 OF 15	
	EFFECTIVE DATE	

# ATTACHMENT I

## REGULATORY GUIDE TABLE

No.	Reg.Guide Title	ANSI Standard
1.123	Quality Assurance Requirements for Control of Procurement of Items and Services for Nuclear Power Plants (R/1, 7/77)	N45.2.13, 1976
	R.G.-1.123, position C.5 - see positions for R.G.-1.33	
1.144	Auditing of Quality Assurance Programs for Nuclear Power Plants (R/1, 9/80)	N45.2.12, 1977
1.146	Qualification of Quality Assurance Program Audit Personnel for Nuclear Power Plants (R/0, 8/80)	N45.2.23, 1978
	R.G.-1.144, position C.3.a(1) - see positions for R.G.-1.33	
	C.3.a(2) - not applicable	
	C.6 - STP uses audits as well as other independent oversight activities to verify implementation of required corrective action.	

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONDUCT OF PLANT OPERATION</b>	<b>NUMBER</b>  Chapter 3.0	<b>REV. NO.</b>  7
	<b>PAGE 1 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

1.1 The purpose of this chapter is to prescribe the requirements and responsibilities for the conduct of plant operations at the South Texas Project Electric Generating station (STPEGS).

## 2.0 SCOPE

2.1 This chapter applies to all personnel performing activities associated with structures, systems, and components during the operations phase of the STPEGS.

2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

3.1 None

## 4.0 REFERENCES

4.1 STPEGS Technical Specifications

4.2 QQAP Chapter 2.0, Att. I

4.3 UFSAR 13.5.2.1 paragraph 4, Emergency Operating Procedures

4.4 QQAP Chapter 14.0, Records Control

4.5 10CFR100, Reactor Site Criteria

## 5.0 REQUIREMENTS

5.1 Activities affecting structures, systems, and components shall be conducted in accordance with written, approved procedures.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONDUCT OF PLANT OPERATION</b>	<b>NUMBER</b>  Chapter 3.0	<b>REV. NO.</b>  7
	<b>PAGE 2 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

- 5.1.1 Procedural compliance and requirements for procedure use shall be prescribed in writing. Measures shall be established by which temporary changes to approved procedures can be made, including the designation of a person(s) authorized to approve such changes. Temporary changes which clearly do not change the intent of the approved procedure shall be made in accordance with Reference 4.1.
- 5.1.2 Guidance shall be provided to identify the manner in which procedures are to be implemented. Examples of such guidance include identification of those tasks that require:
  - 5.1.2.1 The written procedure to be present and followed step by step while the task is being performed.
  - 5.1.2.2 The operator to have committed the procedural steps to memory.
  - 5.1.2.3 Verification of completion of significant steps by initial or signatures on checkoff lists.
- 5.1.3 The types of procedures that shall be present and referred to directly are those developed for extensive or complex tasks where reliance on memory cannot be trusted (e.g., reactor startup, tasks which are infrequently performed, and tasks in which operations must be performed in a specified sequence). Necessary data shall be recorded as the task is performed.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONDUCT OF PLANT OPERATION</b>	NUMBER	REV. NO.
	Chapter 3.0	7
	PAGE 3 OF 5	
	EFFECTIVE DATE	

5.1.4 Temporary procedures may be issued to direct operations during testing, refueling, maintenance, and modifications; to provide guidance in unusual situations not within the scope of the normal procedures; and to ensure orderly and uniform operations for short periods when the plant, a system, or a component is performing in a manner not covered by existing detailed procedures or has been modified or extended in such a manner that portions of existing procedures do not apply. Temporary procedures shall include designation of the period of time during which the procedures are to be used and shall be subject to the same review and approval process as permanent procedures.

5.1.5 Emergency Operating Procedures shall be prepared in accordance with Reference 4.3.

## 5.2 Operating Orders

5.2.1 A mechanism shall be provided for issuing management instructions which have short-term applicability and which require dissemination. Such instructions, sometimes referred to as special orders, operating orders, or standing orders should encompass special operations, job-turnover and relief, data taking, publications and their distribution, plotting process parameters, personnel actions, or other similar matters. These shall not be used in lieu of, or to modify existing procedures.

5.2.2 A mechanism shall be provided for management to issue information and direction to the oncoming evening and night shifts. These night orders shall be signed and dated by a responsible supervisor. These shall not be used in lieu of, or to modify existing procedures.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONDUCT OF PLANT OPERATION</b>	NUMBER	REV. NO.
	Chapter 3.0	7
	PAGE 4 OF 5	
	EFFECTIVE DATE	

### 5.3 Shift Operations

- 5.3.1 The responsibilities and authorities of Licensed Operations Personnel shall be specified in plant procedures. These procedures shall include responsibilities and authorities for startup, shutdown, and operation of the reactor and associated equipment, for observance of instrumentation and for implementation of the Emergency Plan (Refer to Reference 4.1). The cognizant Shift Supervisor shall be responsible for maintaining sufficient knowledge of system or equipment tests or inspections in progress to control the overall plant operation. Personnel performing tests or inspections shall keep the Shift Supervisor or Control Room Operator advised of the current status of tests or inspections in progress which may affect plant operations.
- 5.3.2 When operating during normal, abnormal or emergency conditions, the operator shall rely on plant instrumentation, unless proven to be incorrect. When operating parameters are not as expected, the unit shall be placed in a known safe condition. A manual reactor trip or safety system actuation shall be initiated if system parameters for reactor trip or safety systems exceed their actuation setpoint and automatic actuation does not occur.
- 5.3.3 In the event of an emergency not covered by an approved procedure, operations personnel shall take action to minimize personnel injury, damage to the facility, and maintain offsite exposures within the requirements of 10CFR100.

### 5.4 Equipment Control

- 5.4.1 Procedures shall provide for control of equipment as necessary to maintain personnel and reactor safety and to avoid unauthorized operation of equipment. These procedures shall require control measures such as locking or tagging to secure and identify the control status of equipment, and responsibility and action necessary for isolating the equipment.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONDUCT OF PLANT OPERATION</b>	NUMBER	REV. NO.
	Chapter 3.0	7
	PAGE 5 OF 5	
	EFFECTIVE DATE	

These procedures shall require independent verifications where appropriate to ensure these measures have been correctly implemented.

5.4.2 Procedures shall provide for the identification of required tests and inspections and provide documentary evidence that the tests and inspections have been performed prior to considering the affected system operable.

5.4.3 Permission to release equipment or systems for maintenance shall be granted by designated operations personnel. These operations personnel shall verify before release that, based on a review of the plant technical specifications, the system or component can be released for the time period that it may be out of service. The requirements for equipment operability stated in Reference 4.1 shall be met.

## 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.4.

## 7.0 ATTACHMENTS

7.1 None



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALIFICATION, TRAINING AND CERTIFICATION OF PERSONNEL</b>	<b>NUMBER</b>  Chapter 4.0	<b>REV. NO.</b>  7
	<b>PAGE 1 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish requirements for qualification, training, and certification of personnel whose activities may affect structures, systems, components and activities at the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter provides for the qualification, training, and certification of personnel performing activities related to the structures, systems and components under the jurisdiction of the Operations Quality Assurance Plan (OQAP).
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 OQAP Chapter 2.0, Att. I
- 4.2 SNT-TC-1A, Recommended Practice for Nondestructive Personnel Qualification and Certification
- 4.3 10CFR55 Operator's Licenses
- 4.4 ASME Section XI, Rules for Inservice Inspection of Nuclear Power Plant Components
- 4.5 OQAP Chapter 14.0, Records Control
- 4.6 INPO ACAD 92-004, Guidelines for the Conduct of Training and Qualification Activities

## 5.0 REQUIREMENTS

### 5.1 General

- 5.1.1 Position qualification requirements shall be established for personnel in accordance with References 4.1, 4.2, 4.3, 4.4.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALIFICATION, TRAINING AND CERTIFICATION OF PERSONNEL</b>	<b>NUMBER</b>  Chapter 4.0	<b>REV. NO.</b>  7
	<b>PAGE 2 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

5.1.2 Programs shall be developed for the qualification, training, and certification of personnel. The programs shall provide for:

5.1.2.1 Establishing individual training files.

5.1.2.2 Documented certification, when required (e.g., NRC licensed personnel, NDE personnel).

5.1.2.3 Continuing training and retraining.

## 5.2 General Employee Training

5.2.1 A general employee training program shall be developed and administered to personnel requiring unescorted access within the protected and/or vital areas. This program shall address but not be limited to the following:

5.2.1.1 Job related procedures and instructions

5.2.1.2 QA program indoctrination

5.2.1.3 Radiological health and safety

5.2.1.4 Industrial safety and fire protection

5.2.1.5 Emergency Plan

5.2.1.6 Security program

5.2.2 Temporary personnel employed at the STPEGS shall be trained in the above areas to the extent necessary to assure satisfactory performance of their duties.

## 5.3 Specialized Training Programs

5.3.1 NRC licensed operators shall be qualified, trained and certified in accordance with Reference 4.1 and 4.3.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALIFICATION, TRAINING AND CERTIFICATION OF PERSONNEL</b>	NUMBER	REV. NO.
	Chapter 4.0	7
	PAGE 3 OF 3	
	EFFECTIVE DATE	

5.3.2 Inspection, testing and examination personnel shall be qualified, trained, and certified in accordance with Reference 4.1.

5.3.3 Nondestructive examination personnel shall receive training which meets the requirements of Reference 4.2 and 4.4.

5.3.4 Audit personnel shall be qualified, trained and certified to the requirements of Reference 4.1.

5.3.5 Other personnel shall be qualified, trained and certified commensurate with the functions they perform (e.g., welding, coating, chemical cleaning, maintenance, etc.).

5.4 Experienced personnel may be considered for exemption from prerequisite training. Training exemptions shall be controlled in accordance with approved station procedures.

5.5 Procedures shall provide for the evaluation of performance of employees to determine the capabilities of the individual to meet established qualification requirements.

5.6 Procedures shall provide for the recertification of appropriate personnel in accordance with applicable standards.

5.7 Training and certification of personnel, to the degree necessary for the activity, shall be completed prior to assignment of work on items or activities.

#### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.5.

#### 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	<b>NUMBER</b>  Chapter 5.0	<b>REV. NO.</b>  5
	<b>PAGE 1 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish requirements for the conduct of maintenance and installation controls for modifications on structures, systems, and components at the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter is applicable to maintenance and the installation of modifications, including related activities such as special processes (e.g., welding, cleaning, and housekeeping), of structures, systems, and components subject to the controls of this QQAP.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 QQAP Chapter 2.0, Att. I
- 4.2 QQAP Chapter 3.0, Conduct of Plant Operations
- 4.3 QQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.4 QQAP Chapter 8.0, Control and Issuance of Documents
- 4.5 QQAP Chapter 12.0, Instrument and Calibration Control
- 4.6 QQAP Chapter 14.0, Records Control
- 4.7 QQAP Chapter 13.0, Control of Conditions Adverse to Quality

## 5.0 REQUIREMENTS

- 5.1 Maintenance, the installation of modifications, and related activities which may affect the functioning of structures, systems, or components shall:

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	<b>NUMBER</b>  Chapter 5.0	<b>REV. NO.</b>  5
	<b>PAGE 2 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

5.1.1 Be performed in a manner to ensure quality equivalent to that specified in design bases and requirements, materials specifications, and inspection requirements.

5.1.2 Be preplanned and performed in accordance with written procedures, documented instructions, or drawings appropriate to the circumstances which conform to applicable codes, standards, specifications, and criteria, and:

5.1.2.1 Address controls which assure quality of maintenance and modification installation activities (for example: inspections, measurements, tests, welding, heat treatment, cleaning, nondestructive examination, and personnel qualifications) and contain provisions to document the performance thereof.

5.1.2.2 Contain measures which identify the inspection and test status of material, equipment, and components used in maintenance and modification installation activities.

5.1.2.3 Assure that the equipment has been returned to prescribed operating status at the completion of the work which includes verification of functional acceptability.

5.1.2.4 Be performed by or under the supervision of qualified personnel and in such a manner that the activity can be safely performed under the existing plant operating conditions.

5.1.2.5 Be performed only after authorized release of equipment in accordance with procedures that meet the requirements of Reference 4.2.

5.1.2.6 Provide measures for the protection of workers and equipment, including personnel entry into enclosed spaces such as tanks and voids.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	NUMBER	REV. NO.
	Chapter 5.0	5
	PAGE 3 OF 7	
	EFFECTIVE DATE	

5.1.2.7 Provide means of preventing unauthorized operation of equipment (e.g., locking or tagging).

5.1.2.8 Assure control of temporary modifications (e.g., blank flanges or temporary electrical jumpers).

5.1.2.9 Provide a method of ensuring that required tests and inspections are complete prior to return to service of the item on which the work was performed.

5.1.3 Assure procedures, and changes thereto, are reviewed and approved in accordance with Reference 4.4.

## 5.2 Preventive Maintenance

5.2.1 A preventive maintenance program shall be maintained which prescribes the frequency and type of maintenance to be performed. This program is based on service conditions, manufacturer's recommendations, and equipment performance experience.

## 5.3 Corrective Maintenance

5.3.1 Equipment failures, malfunctions and degradation shall be corrected in accordance with Reference 4.7. This shall include determination of root cause and implementation of recurrence controls, as appropriate.

5.3.2 Replacement components of a new type shall receive adequate testing or be of a design for which experience indicates a high probability of satisfactory performance.

5.3.3 Consideration should be given to an augmented testing and inspection program following a large scale component replacement (or repair) until a suitable level of performance has been demonstrated.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	NUMBER	REV. NO.
	Chapter 5.0	5
	PAGE 4 OF 7	
	EFFECTIVE DATE	

#### 5.4 Emergency Maintenance

Should operating conditions occur which warrant immediate corrective maintenance in order to prevent or mitigate the release of radioactive material, hazards to personnel, or extensive equipment damage, then the following shall apply:

- 5.4.1 Direct action shall be taken to stabilize the condition. Procedures shall designate those operating individuals responsible for authorizing this initial action.
- 5.4.2 Once the condition has stabilized, the initial action taken shall be documented and reviewed in accordance with approved procedures. If the initial action taken is judged to be incorrect or inadequate, alternative action shall be taken.

#### 5.5 Control of Special Process

5.5.1 Special processes include manufacturing processes, inspections, tests, and others which require qualification of the procedures, technique or personnel to control the quality of the process. Special processes (e.g., welding, heat treating, chemical cleaning, protective coating, and nondestructive examination) shall be performed in accordance with applicable codes, standards, specifications, criteria and other special requirements.

5.5.1.1 Written procedures shall be established and utilized to assure these activities are accomplished in a controlled manner.

5.5.1.2 Special processes shall be performed by qualified personnel using qualified procedures. Personnel shall be qualified under Reference 4.3. Procedures and equipment shall be qualified under applicable codes and standards, or if not covered, the qualification requirements shall be defined.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	NUMBER	REV. NO.
	Chapter 5.0	5
	PAGE 5 OF 7	
	EFFECTIVE DATE	

5.5.1.3 Records shall be maintained and kept current for the qualification of procedures, equipment, and personnel associated with special processes. Records shall be in sufficient detail to clearly define the procedures, equipment, or personnel being qualified, criteria or requirements used for qualification, and the individual approving the qualification.

5.5.1.4 Procedures shall provide for the control of special process identification indicators, such as welders stamps, as appropriate.

#### 5.5.2 Control of Outside Contractors

5.5.2.1 Qualified outside organizations may be employed to perform special processes and shall be required to conform to the requirements described in this chapter. Special process procedures submitted by an outside organization in accordance with procurement document requirements shall receive a technical review by the responsible site organization.

#### 5.6 Housekeeping and Cleanness Control

5.6.1 Housekeeping and cleanness control practices shall be established which assure that:

5.6.1.1 The nature of work activities, conditions, and environments that can affect the quality of structures, systems, and components is controlled. Control measures shall be established to exclude the entry of foreign material into a closed system and to ensure that foreign material is removed before the area is closed.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	NUMBER	REV. NO.
	Chapter 5.0	5
	PAGE 6 OF 7	
	EFFECTIVE DATE	

5.6.1.2 Appropriate cleaning materials, equipment processes, and procedures are used to assure that the quality of an item is not degraded as a result of housekeeping or cleaning practices or techniques and provide for the disposal of combustible material and debris to support fire protection.

5.6.1.3 Access is controlled to prevent foreign material introduction during the maintenance or modification of systems.

- o Cleaning following maintenance or modification of radioactively contaminated systems or equipment shall require special consideration for radioactive contamination control and storage of radioactive waste.
- o Prior to closure of designated systems or components, an inspection shall be conducted to assure cleanness. The results of the inspection shall be documented.

5.6.1.4 Where necessary, special cleaning requirements associated with certain equipment are addressed in appropriate procedures.

## 5.7 Documents Associated with Maintenance/Modifications

5.7.1 Documents, such as maintenance, modifications, and installation procedures, maintenance requests, drawings, specifications and others shall be issued, reviewed and controlled in accordance with Reference 4.4.

5.7.2 Maintenance, modification, and installation documents shall be traceable to the structure, system or component repaired, replaced, or maintained and shall as a minimum contain the following:

5.7.2.1 Description of components.

5.7.2.2 Description of work

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>MAINTENANCE, INSTALLATION OF MODIFICATIONS, AND RELATED ACTIVITIES</b>	<b>NUMBER</b>  Chapter 5.0	<b>REV. NO.</b>  5
	<b>PAGE 7 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

5.7.2.3 Names of responsible persons doing work.

5.7.2.4 Traceability of parts used.

5.7.2.5 Reference to measuring and test equipment used.

5.7.2.6 Inspection and test status.

#### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.6.

#### 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DESIGN AND MODIFICATION CONTROL</b>	NUMBER	REV. NO.
	Chapter 6.0	7
	PAGE 1 OF 5	
	EFFECTIVE DATE	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish the requirements and responsibilities for design and modification control of structures, systems, or components at the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter applies to the design and modification activities associated with the preparation and review of design documents including the translation of applicable Code of Federal Regulation requirements and design bases into design documents.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 STPEGS Technical Specifications
- 4.2 OQAP Chapter 5.0, Maintenance, Installation of Modifications, and Related Activities
- 4.3 OQAP Chapter 14.0, Records Control
- 4.4 10CFR50.59, Changes, Tests and Experiments
- 4.5 OQAP Chapter 13.0, Control of Conditions Adverse to Quality
- 4.6 OQAP Chapter 2.0, Program Description

## 5.0 REQUIREMENTS

- 5.1 Measures shall be established to document selection of design inputs. Changes to specified design inputs, including identification of their source, shall be identified and documented. As the design evolves, unreviewed safety question evaluations shall be performed as required by Reference 4.4.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DESIGN AND MODIFICATION CONTROL</b>	<b>NUMBER</b>  Chapter 6.0	<b>REV NO.</b>  7
	<b>PAGE 2 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

5.2 Measures shall be established to control design activities to assure design inputs are translated into design documents such as specifications, drawings, procedures, or instructions.

5.2.1 Design activities involving reactor physics; stress, thermal, hydraulic, and accident analysis; materials compatibility; and accessibility for maintenance, inservice inspection, and repair will be performed according to approved procedures by appropriately qualified individuals. Results of analyses will be appropriately verified and documented.

5.2.2 Design documents shall include appropriate quality standards. If an alternate quality requirement is used (e.g., other than the originally specified quality standard) the change shall be documented and approved.

5.2.3 Design analyses shall be sufficiently detailed as to purpose, method, assumptions, design input, references, units, and status (preliminary or final) such that a technically qualified person can review and understand the analyses and verify the adequacy of the results without recourse to the originator.

5.2.4 A review for application suitability of materials, parts, equipment, and processes essential to the functions of structures, systems, and components is done as part of the design document preparation and review process. The procedures which govern the preparation and review of design documents require that valid industry standards and specifications be used for this review. Review of standard off-the-shelf commercial materials, parts, and equipment for suitability of application with structures, systems, and components will be conducted before selection.

5.3 Measures shall be established to identify and control design interface among participating organizations (internal and external).



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DESIGN AND MODIFICATION CONTROL</b>	<b>NUMBER</b>  Chapter 6.0	<b>REV. NO.</b>  7
	<b>PAGE 3 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

5.4 Measures shall be established to verify adequacy of design and design changes.

5.4.1 The design process shall include verification by qualified persons to assure that the design is adequate and meets specified design input. Design control procedures shall specify requirements for the selection and performance of design verification methods. Design verification shall be either by design review, alternate calculation, qualification testing, or a combination of these. The depth of design verification shall be commensurate with the importance of the system or component to plant safety, complexity of the design, and similarity of design to previous designs.

5.4.1.1 If the verification method performed is only through qualification testing, the following are required.

- o Procedures shall provide criteria that specify when verification should be by test.
- o Prototype, component, or feature testing shall be performed as early as possible before installation of plant equipment, or before the point when the installation would become irreversible.
- o Verification by test shall be performed under conditions that simulate the most adverse design conditions as determined by analysis.

5.4.2 Design verification shall be performed by competent individuals or groups other than those who performed the original design.

5.4.3 Design verification should not be performed by individuals that have immediate supervisory responsibility for the individual performing the design; have specified a singular design approach; have ruled out certain design considerations; or have established the design inputs for that particular design aspect.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DESIGN AND MODIFICATION CONTROL</b>	NUMBER	REV. NO.
	Chapter 6.0	7
	PAGE 4 OF 5	
	EFFECTIVE DATE	

- 5.4.4 Design verification will normally be performed prior to release for procurement, manufacture, installation, or use by another organization in other design activities. Exceptions shall be justified and documented. Procedures shall control the justification of exceptions and the completion of the verification of all affected design output documents prior to relying on the component, system, or structure to perform its function.
- 5.5 Measures shall be established to control the approval, issuance, and changes of design documents to prevent the inadvertent use of superseded design information.
- 5.6 Changes made to design documents are reviewed and approved by the same groups or organization which reviewed and approved original design documents. If the organization which originally approved a particular design document is no longer responsible, another organization may be designated if competent in the specific design area, has access to pertinent background information and has an adequate understanding of the requirements and intent of the original design.
- 5.7 Conditions adverse to quality found in approved design documents, including design methods, that could adversely affect structures, systems, or components shall be documented and action taken to correct and prevent recurrence, in accordance with Reference 4.5.
- 5.8 Measures shall be established for the identification and control of deviations from specified quality standards.
- 5.9 Measures shall be established which assure that maintenance and modifications associated with design changes which may affect the functioning of structures, systems, or components are performed in a manner to ensure quality at least equivalent to that specified in the UFSAR or current design bases and requirements, unless changed by GQA categorization and appropriate evaluations are completed.
- 5.10 Measure shall be established to maintain the list of structures, systems, and components current after modifications are made.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>DESIGN AND MODIFICATION CONTROL</b>	<b>NUMBER</b>  Chapter 6.0	<b>REV. NO.</b>  7
	<b>PAGE 5 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

5.11 Measures shall be established to assure that only appropriately verified, qualified and controlled computer codes are authorized for use.

#### 5.12 Modifications

5.12.1 Modifications to structures, systems, and components shall be controlled, reviewed, and approved.

5.12.2 Installation and testing of modifications shall be performed in accordance with Reference 4.2 and approved procedures. These procedures shall contain provisions as appropriate to ensure quality of installation and appropriate post modification testing.

5.12.3 Structures, systems, and components shall not be declared operable after a modification until the following provisions are satisfied:

5.12.3.1 Affected procedures are revised and distributed to appropriate users.

5.12.3.2 Appropriate personnel are trained.

5.13 Modifications will be checked against the design change documentation for proper implementation prior to closing out the design change process.

### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.3.

### 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 1 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish the requirements for procurement of items and services for the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter applies to the procurement of items and services for use at STPEGS which are subject to the controls of this QA program. These activities include procurement document control, bid evaluation, vendor evaluation, verification of vendor activities and receiving inspection.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 10CFR50, Appendix B
- 4.2 10CFR21, Reporting of Defects and Noncompliance
- 4.3 QQAP Chapter 2.0, Att. I
- 4.4 EPRI NP-5652 (NCIG-07), Guideline for the Utilization of Commercial Grade Items in Nuclear Safety Related Application
- 4.5 QQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.6 QQAP Chapter 13.0, Control of Conditions Adverse to Quality
- 4.7 QQAP Chapter 14.0, Records Control

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b>  Chapter 7.0	<b>REV. NO.</b>  7
	<b>PAGE 2 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

## 5.0 REQUIREMENTS

### 5.1 Procurement Document Preparation, Review and Control

5.1.1 Responsibility for procurement is a joint effort of all the departments within the Nuclear Group. The department requesting the material or service provides technical content and quality requirements. Design Engineering/Nuclear Purchasing & Material Management is responsible to provide input to the requesting department on technical content and quality requirements, as requested. Quality will concur with all changes to quality requirements.

5.1.2 The sequence of preparation, review, approval, and issuance of procurement documents is generally as follows:

#### 5.1.2.1 Purchase Requisitions

- Purchase requisition forms shall be used to initiate the procurement of materials, parts, components, and services. Procurement may be initiated by any Nuclear Group personnel.
- Purchase requisitions shall include material and component identification requirements, drawings, specifications, standards, inspection and test requirements, and special process instructions as appropriate.
- Purchase requisitions for materials, parts, components, or services shall be reviewed by the cognizant technical organization to verify that adequate technical and quality requirements have been specified.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 3 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

- The reviews for technical and quality requirements shall be performed by someone other than the originator of the requisition. Quality will concur with all changes to quality requirements.

#### 5.1.2.2 Purchase Orders and Contracts

- Purchase orders and contracts are prepared and issued by Nuclear Purchasing and Material Management and establish for the suppliers the technical and quality requirements which must be met.
- Purchase orders and contracts shall accurately reflect the technical and quality requirements established by the purchase requisition. If, during the bid negotiations with the supplier, it becomes necessary or commercially desirable to change the technical or quality requirements, such changes shall be presented for approval to the cognizant technical organization which approved the original requirements.

#### 5.1.2.3 Change Controls

- Changes to procurement document quality and technical requirements shall require a review and approval equivalent to that of the original document. Commercial consideration changes not affecting the technical or quality requirements do not require review and concurrence by the originator.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 4 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

5.1.3 For the procurement of spare or replacement parts, equipment, materials, and services, the quality and technical requirements shall be equal to or greater than the design basis requirements for the original part, equipment, materials or services; except where less stringent quality or technical requirements may be established based on specific evaluations and justification. The cognizant technical organization shall document such justification.

5.1.3.1 Items may be procured as Commercial Grade Items (CGIs) if a documented engineering evaluation indicates the CGI will provide equivalent performance, or if identified as "basic" coverage items as a result of Graded Quality Assurance (GQA) categorization. CGI dedication will comply with established procedures designed to satisfy the requirements of 10CFR21.

5.1.3.2 The cognizant technical organization shall verify that quality requirements are correctly stated, verifiable, and controllable; that acceptance/rejection criteria are included; and that the documents have been prepared, reviewed, and approved in accordance with STPEGS QA Program requirements.

## 5.2 Procurement Document Content

5.2.1 Procurement document control measures shall assure that appropriate regulatory requirements, design bases, and other requirements are included in the procurement process. The following shall be included or invoked by reference in procurement documents as appropriate:

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 5 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

- 5.2.1.1 Applicable regulatory, code, and design requirements, including material and component identification requirements, drawings, specifications, standards, inspection and test requirements, special process instructions and handling, preservation, cleaning, storage, packaging and shipping requirements. These requirements shall equal or exceed the original requirements (unless changed by established design control processes or GQA categorization, as appropriate) and be sufficient to preclude repetition of defects, unless otherwise specified and documented.
- 5.2.1.2 Extent that supplier QA program shall comply with 10CFR50, Appendix B or the QA program requirements of other nationally recognized codes and standards, as applicable; or for CGIs to be dedicated for safety related use by HL&P based on the results of a survey of the vendor's controls, the vendor's HL&P approved and/or surveyed program.
- 5.2.1.3 Requirements for supplier documents, such as instructions, procedures, drawings, specifications, inspection and test records, and suppliers' QA records to be prepared, submitted, or be made available for review and/or approval by STPEGS personnel.
- 5.2.1.4 Requirements for suppliers to maintain the status of required inspections or tests throughout the manufacturing process to preclude inadvertent bypassing of inspections and tests.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 6 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

5.2.1.5 Requirements for HL&P's right of access to suppliers' facilities and work documents for inspection and audit.

5.2.1.6 Requirements for extending applicable STPEGS procurement requirements to lower-tier suppliers and subcontractors, including HL&P's access to facilities and records.

5.2.1.7 Requirements for supplier reporting to STPEGS nonconformances to procurement document requirements and conditions for their disposition.

5.2.1.8 Requirements for the retention, control, and maintenance of supplier QA records that are not maintained by HL&P. Supplier-furnished records shall include:

- Documentation (e.g., certification) that identifies the purchased item and the specific procurement requirements (e.g., codes, standards, and specifications) met by the item.
- Documentation identifying any procurement requirements that have not been met.
- A description of those nonconformances from procurement requirements dispositioned "accept-as-is" or "repair".

5.2.1.9 Requirement for the supplier to submit a copy of its QA program description (does not apply for CGIs).

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 7 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

5.2.1.10 Requirements for the performance of maintenance and receipt inspection checks where applicable.

5.2.1.11 Applicability of 10CFR21 reporting requirements.

- The reporting requirements of 10CFR21 do not apply to vendors of CGIs to be dedicated for use by HL&P.

### 5.3 Bid Evaluation

5.3.1 Bid Evaluations shall be performed to evaluate adherence to technical and quality assurance requirements.

### 5.4 Supplier Selection

5.4.1 Suppliers of items (for CGIs, when basis for dedication includes commercial grade survey) or services shall be required to submit copies of their QA program description for evaluation prior to the issuance of a purchase order or execution of a contract, and acceptability shall be documented. The process by which suppliers are judged as being a capable procurement source is described as follows:

5.4.1.1 Procurement source evaluation and selection involves Quality, Engineering, NPM, and STPEGS plant personnel, as appropriate. These organizations participate in the qualification evaluation of suppliers in accordance with written procedures.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 8 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

#### 5.4.1.2

Measures for the evaluation and selection of procurement sources shall be specified in procedures and may vary depending upon the complexity and risk significance of the item or service. When procurement source evaluations are performed, the information to be considered shall include one or more of the following:

- Experience of users of identical or similar products of the prospective supplier, other utility or approved contractor audits/evaluations, audits/evaluations by cooperative utility groups, American Society of Mechanical Engineers (ASME) Certificates of Authorization, STPEGS records accumulated in previous procurement actions, and STPEGS product operating experience may be used in this evaluation. When other utility, contractor or cooperative utility audits/evaluations are used, the documentation will be obtained and reviewed. Supplier history shall reflect recent capability. Previous favorable experience with suppliers may be an adequate basis for judgments attesting to suppliers' capability.
- An evaluation of the suppliers' current quality records supported by documented qualitative and quantitative information which can be objectively evaluated. This may include review and evaluation of the suppliers' QA Program Manual, procedures, and responses to questionnaires, as appropriate.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b> Chapter 7.0	<b>REV. NO.</b> 7
	<b>PAGE 9 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

- A source evaluation of the suppliers' technical and quality capability as determined by a direct evaluation of facilities and personnel (audit, survey, or surveillance) and quality program implementation. Resolution or a commitment to resolve unacceptable technical or quality requirements identified by the bid evaluation or vendor evaluation shall be obtained prior to the award of a purchase order or contract.

5.4.1.3 Procurement source evaluations involve a review of technical and quality considerations to an extent considered appropriate by each participant. Technical considerations include the design or manufacturing capability and technical ability of suppliers to produce or provide the design, service, item or component. Quality considerations include one of the previously stated methods of supplier evaluation and a consideration of a suppliers' current quality program or capabilities.

5.4.1.4 A documented quality assurance evaluation of a vendor's quality program shall be performed to assure it meets the appropriate requirements of 10CFR50 Appendix B, or where applicable, other nationally recognized codes and standards, or, for CGIs, to assure the program provides adequate control over established critical characteristics.

5.4.1.5 Vendors may be placed on the Approved Vendors List after passing this evaluation.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b>  Chapter 7.0	<b>REV. NO.</b>  7
	<b>PAGE 10 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

5.4.1.6 A vendor shall not be issued a purchase order or contract unless they have been accepted for placement on the Approved Vendors List or an exception has been approved by the Director, Quality.

5.4.1.7 Service organizations which will supply only manpower and no other service are not required to be on the Approved Vendors List or have an STPEGS approved quality assurance program as long as the supplied personnel are trained and work under the auspices of the STPEGS Operations Quality Assurance Plan.

5.4.2 Each vendor on the Approved Vendors List shall be periodically evaluated by Quality as provided by Reference 4.3.

5.4.2.1 A vendor may be removed from the Approved Vendors List if evaluation determines the vendor is unacceptable, the vendor requests removal or by direction of the Director, Quality.

5.4.3 Planning of verification activities to be employed for item or service acceptance shall begin during the purchase requisition or contract preparation and review stage. The extent of the verification activities will vary and be a function of the relative safety significance, complexity of the purchased item or service, and the supplier's past performance. The verification activities may include vendor surveillance, receipt inspection, or post-installation testing. Verification activities are planned to assure conformance to procurement document requirements. Procedures shall establish the organizational responsibilities for identifying required verifications and methods, performing and documenting the verification activities.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	NUMBER	REV. NO.
	Chapter 7.0	7
	PAGE 11 OF 14	
	EFFECTIVE DATE	

5.4.3.1 Vendor surveillance shall be performed using surveillance plans developed in accordance with procedures with appropriate input from the cognizant technical organization. The surveillance plan shall specify the characteristics or processes to be witnessed, inspected or verified, and accepted; the method of surveillance; and the documentation required.

5.4.3.2 Vendor surveillance inspections may be waived by the Director, Quality.

5.4.3.3 Vendor related reports shall be evaluated to determine the effectiveness of the vendor's quality assurance program.

## 5.5 Receiving Inspection

5.5.1 Received purchased items shall be inspected for shipping damage and the requirements of ANSI N45.2.2 Section 5.2.1 and the applicable attributes of Section 5.2.2.

5.5.2 Receiving inspection shall be coordinated with vendor surveillance inspection. If vendor surveillance inspection is not performed or did not address all applicable attributes, receipt inspection shall be performed and shall include the applicable additional attributes listed in ANSI N45.2.2 Section 5.2.2, except for commercial grade items dedicated by survey which shall be receipt inspected as required by the procurement document.

5.5.3 Receiving inspection checklists shall be developed using the requirements specified in the procurement documents and applicable attributes of ANSI N45.2.2.

5.5.4 Statistical sampling methods may be used for groups of similar items. Sampling shall comply with nationally recognized methods or approved engineering alternates.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b>  Chapter 7.0	<b>REV. NO.</b>  7
	<b>PAGE 12 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

5.5.5 Receiving inspections shall be performed by personnel trained and qualified in accordance with Reference 4.5. Technical assistance shall be provided by Nuclear Generation or Nuclear Engineering as applicable.

5.5.6 Receiving inspection activities shall include:

5.5.6.1 Identifying materials, parts, and components and their status upon receipt by tagging or other acceptable means of identification, or segregating and controlling items in receiving hold areas separate from the storage facilities for acceptable items. Identification of items shall correspond to the identification required by procurement documents and be noted on receiving documentation.

5.5.6.2 Verification of items for this acceptance, including examination for shipping damage, correctness of identification, and specified quality documentation.

5.5.6.3 Inspecting or testing, where appropriate, using approved procedures and calibrated tools, gauges, and measuring equipment for verification acceptance of items, including off-the-shelf items.

5.5.6.4 Items determined to be acceptable for use shall be identified with an "accept" tag or other acceptable means of identification prior to release for storage or use.

5.5.6.5 Received items which do not conform to procurement documents are controlled and segregated (if practical) and processed in accordance with Reference 4.6.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b>  Chapter 7.0	<b>REV. NO.</b>  7
	<b>PAGE 13 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

5.5.7 Acceptance by post-installation test may be utilized following one of the preceding verification methods. Post-installation testing may be used for acceptance verification when it is difficult to verify item quality characteristics, the item requires an integrated system checkout or test, or the item cannot demonstrate its ability to perform when not in use. Engineering specifications shall be used for developing post-installation test instruction requirements and acceptance documentation. Post-in-tallation testing is the responsibility of the Plant Managers, STPECS, and is witnessed by Quality personnel at specified hold points.

#### 5.5.8 Acceptance of Procured Items and Services

5.5.8.1 Acceptance of items and services shall be based on one or more of the following:

- Written certifications
- Supplier audit
- Source inspection
- Receiving inspection/testing
- Commercial Grade Item dedication
- Vendor surveillance
- Post-installation test

5.5.9 Documented evidence from the supplier that procured items meet procurement quality requirements such as codes, standards, or specifications will be maintained at the plant site. Such evidence shall be provided by the supplier, at the time of source or receipt inspection, for review and verification before acceptance. The documented evidence will be retrievable and available at the plant site prior to installation or use of the procured item, unless otherwise controlled in accordance with Reference 4.6.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>PROCUREMENT</b>	<b>NUMBER</b>  Chapter 7.0	<b>REV. NO.</b>  7
	<b>PAGE 14 OF 14</b>	
	<b>EFFECTIVE DATE</b>	

## 5.6 Vendor Surveys, Surveillance and Audit

5.6.1 Suppliers Certificates of Conformance are periodically evaluated by audits, independent inspections, surveys, or tests to assure that they are valid and results are documented. When acceptance is based upon supplier audit or vendor surveillance, documented evidence shall be furnished to the plant receiving organization.

5.6.1.1 Acceptance by vendor surveillance may be considered when the item or service is vital to plant safety; or the quality characteristics are difficult to verify after receipt; or the item or service is complex in design, manufacture, inspection, or test. Vendor surveillance involves a physical presence to monitor, by observation, designated activities for the purpose of evaluating supplier performance and product acceptance.

5.6.2 The STPEGS survey and audit program provide for periodic scheduled audits or surveys of suppliers, the site procurement program, contractors, subcontractors, and others performing work. The audit and survey schedule is prepared and updated by Quality. Frequency of these surveys and audits is based upon the safety, complexity, and quality requirements, and as a minimum shall be in compliance with Reference 4.3.

## 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.7.

## 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL AND ISSUANCE OF DOCUMENTS</b>	NUMBER	REV. NO.
	Chapter 8.0	6
	PAGE 1 OF 4	
	EFFECTIVE DATE	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish the requirements for review, approval, distribution and use of documents such as instructions, procedures and drawings, including changes thereto for the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter is applicable to documents which control activities for the licensing, operation, testing, maintenance, and plant modification of the STPEGS. These documents include, but are not limited to, instructions; procedures; specifications; drawings; vendor manuals; status registers (such as drawing lists, equipment list); procurement documents; design documents; design change requests; as-built documents; non-conformance and deficiency reports; Updated Final Safety Analysis Report and program manuals (such as QQAP, Emergency Plan, Inservice Inspection Plan, etc.).
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 QQAP Chapter 6.0, Design and Modification Control
- 4.2 QQAP Chapter 14.0, Records Control
- 4.3 QQAP Chapter 2.0, Att. I

## 5.0 REQUIREMENTS

- 5.1 Procedures shall be established which identify the organizations or individuals responsible for the preparation, review, approval, and issuance of documents and changes thereto.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL AND ISSUANCE OF DOCUMENTS</b>	<b>NUMBER</b>  Chapter 8.0	<b>REV. NO.</b>  6
	<b>PAGE 2 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

- 5.2 Departments responsible for program-implementing documents shall be required to provide and assure the necessary review and approval, prior to use, for instructions, procedures, and drawings. Review and approval assures that issued documents include proper quality and technical requirements, and are correct for their intended use. Additionally, individual departments are responsible for controlling documents generated or reviewed in the department for which the department has preparation and final approval or external interface responsibility.
- 5.3 Document reviews shall be performed by appropriately qualified personnel with access to pertinent background information to establish a basis for an adequate review. Nuclear Assurance shall review selected documents for quality requirements.
- 5.4 Procedures shall establish controlled distribution of documents and changes thereto including:
  - 5.4.1 Establishing current and updated distribution lists.
  - 5.4.2 Personnel or organizations acknowledging receipt and insertion of controlled documents and changes thereto.
  - 5.4.3 Controlling documents to avoid the use of outdated or inappropriate documents.
  - 5.4.4 Establishing and maintaining master document lists identifying the current revision of documents.
  - 5.4.5 Temporary changes.
- 5.5 Documents shall be available and used at work locations by individuals or organizations performing activities when required based upon the nature of the work. Clearly identified controlled copies of documents shall be available at the point of use prior to commencing activities.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL AND ISSUANCE OF DOCUMENTS</b>	<b>NUMBER</b>  Chapter 8.0	<b>REV. NO.</b>  6
	<b>PAGE 3 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

5.6 Revisions or changes to documents shall be reviewed and approved by the same organizations that performed the original review and approval unless other organizations are designated and have knowledge of the requirements and intent of the original document. Personnel using a document to perform activities are responsible for assuring the documents being used are the correct revision prior to such use.

5.7 Safety-related procedures shall be maintained in an accurate and usable condition. Changes to safety-related procedures shall be made as necessary. The root cause of significant deficiencies regarding safety-related procedures shall be identified and corrected. The following activities provide ongoing confirmation of this.

5.7.1 Applicable plant procedures shall be reviewed following an unusual incident such as an accident, an unexpected transient, significant operator error, or equipment malfunction and following any modification to a system.

5.7.2 Non-routine procedures (procedures such as emergency operation procedures, off-normal procedures, procedures which implement the Emergency Plan, and other procedures whose usage may be dictated by an event) shall be reviewed at least every two years and revised as appropriate.

5.7.3 At least every two years, quality assurance audits and other independent oversight activities shall review a representative sample of the routine plant procedures that are used more frequently than every two years. These reviews shall ensure the acceptability of the procedures and verify that the procedure review and revision program is being implemented effectively. The root cause of significant deficiencies shall be determined and corrected.

5.7.4 Routine plant procedures that have not been used for two years shall be reviewed before use to determine if changes are necessary or desirable.

5.8 Procedures shall be developed for the control and distribution of vendor/contractor documents such as approved drawings, specifications, technical manuals

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL AND ISSUANCE OF DOCUMENTS</b>	<b>NUMBER</b> Chapter 8.0	<b>REV. NO.</b> 6
	<b>PAGE 4 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

and instructions.

5.9 Control of design documents is addressed in Reference 4.1.

#### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.2.

#### 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF MATERIAL</b>	<b>NUMBER</b>  Chapter 9.0	<b>REV. NO.</b>  6
	<b>PAGE 1 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to describe requirements and assign responsibility for control of material at the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter applies to identification, control and traceability of material, parts and components during receipt, storage, handling, issuance, installation and shipping activities.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 OQAP Chapter 2.0, Att. I
- 4.2 OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.3 OQAP Chapter 7.0, Procurement
- 4.4 OQAP Chapter 14.0, Records Control

## 5.0 REQUIREMENTS

- 5.1 Material, equipment, and components shall be handled, stored, shipped, cleaned, and preserved to assure that the quality of items is maintained from fabrication through installation.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF MATERIAL</b>	<b>NUMBER</b>  Chapter 9.0	<b>REV. NO.</b>  6
	<b>PAGE 2 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

## 5.2 Identification and Traceability Requirements

5.2.1 Physical identification of material (including consumables), parts and components shall be used whenever possible or practical and identification shall be traceable to the appropriate documentation such as drawings, specifications, purchase orders, manufacturing and inspection documents, deviation reports, and physical and chemical test reports.

5.2.2 Identification marking requirements include:

5.2.2.1 Where physical identification marking is used, the marking shall be clear, unambiguous and indelible and shall be applied in such a manner as not to affect the function of the item.

5.2.2.2 Markings shall be transferred to each part of an item whenever possible or practical when subdivided and shall not be hidden or obliterated by surface treatment or coatings unless other means of identification are substituted (e.g., color coding).

5.2.2.3 Procedures shall specify that identification be maintained, either on the item or on records traceable to the item, and verified as required throughout fabrication, erection, installation, and use of the item. The identification must be verified and documented prior to release for fabrication, erection, installation and/or use of the item.

## 5.3 Material Storage

5.3.1 Measures shall be established for the control of items in storage which include: storage location, storage levels, procedures which require periodic surveillance of stored items to verify specific protective environmental requirements, inspection results, item care and protective measures, personnel access to storage areas, and material issues.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF MATERIAL</b>	<b>NUMBER</b>  Chapter 9.0	<b>REV. NO.</b>  6
	<b>PAGE 3 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

Control of items in storage shall comply with the intent of the requirements of Reference 4.1. Storage conditions commensurate with the safety classification of the materials will be maintained.

- 5.3.2 Procedures shall be developed for storage of chemicals, reagents, lubricants, and other consumable materials which will be used in conjunction with systems. Items having limited shelf or operating life shall be identified and controlled to preclude the use of expired items.

#### 5.4 Material Handling

- 5.4.1 Measures shall be developed for handling of items which, because of weight, size, susceptibility to shock damage or other conditions, require special handling.
- 5.4.2 Measures shall be established to rate and inspect hoisting and handling equipment in accordance with Reference 4.1.

#### 5.5 Shipping

- 5.5.1 Measures shall be established for the packaging, loading and transportation of items off-site in accordance with Reference 4.1.

#### 5.6 Housekeeping

- 5.6.1 Measures shall be established for housekeeping activities in the storage areas which include: zone designation, environment control, work area cleanliness, fire protection, inspection, and surveillance. These measures shall meet the requirements of Reference 4.1.

- 5.7 Personnel performing handling, preservation, storage, cleaning, packaging, shipping, and inspection to the requirements of this chapter shall be trained and qualified per Reference 4.2.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF MATERIAL</b>	<b>NUMBER</b>  Chapter 9.0	<b>REV. NO.</b>  6
	<b>PAGE 4 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.4.

7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSPECTION</b>	<b>NUMBER</b> Chapter 10.0	<b>REV. NO.</b> 7
	<b>PAGE 1 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to prescribe the requirements and the responsibilities for inspection.

## 2.0 SCOPE

- 2.1 This chapter is applicable to inspection activities associated with systems, structures and components at the South Texas Project Electric Generating Station (STPEGS).
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.2 OQAP Chapter 12.0, Instrument and Calibration Control
- 4.3 OQAP Chapter 14.0, Records Control
- 4.4 OQAP Chapter 2.0, Att. I

## 5.0 REQUIREMENTS

### 5.1 Inspection

- 5.1.1 Inspections shall be performed by written and approved procedures. The inspection criteria established for performing inspections and the detail of the inspection process shall be determined based on the complexity of the activity and possible safety impact to the plant. Qualification of individuals performing inspections shall be in accordance with Reference 4.1. These individuals shall be other than those who performed or directly supervised the activity being inspected. Inspection requirements may be included as a part of the document controlling the activity, or a separate inspection procedure prepared to

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSPECTION</b>	<b>NUMBER</b> Chapter 10.0	<b>REV. NO.</b> 7
	<b>PAGE 2 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

specify, as appropriate, the inspection performance requirements as noted below.

- 5.1.1.1 Identification of characteristics and activities to be inspected
- 5.1.1.2 Acceptance and rejection criteria
- 5.1.1.3 Inspection process utilized
- 5.1.1.4 Identification of procedures, drawings, specifications, and revisions utilized
- 5.1.1.5 Specification of the necessary measuring and test equipment including accuracy and calibration due dates as applicable
- 5.1.2 Examples of the activities subject to inspection include:
  - 5.1.2.1 Special processes
  - 5.1.2.2 Modifications
  - 5.1.2.3 Receipt of materials, parts and components
  - 5.1.2.4 Maintenance
  - 5.1.2.5 Packaging, shipping and handling of radioactive waste material
- 5.1.3 Process Monitoring
  - 5.1.3.1 Process monitoring of work activities, equipment, and personnel shall be utilized as a control method when direct inspection of processed items is impossible or impracticable. Monitoring shall be performed to verify that activities are performed in accordance with documented instructions, procedures, drawings, and specifications.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSPECTION</b>	<b>NUMBER</b> Chapter 10.0	<b>REV. NO.</b> 7
	<b>PAGE 3 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

#### 5.1.4 Supporting Inspections

5.1.4.1 Both inspections and process monitoring shall be used when control of the activity is inadequate without both. The need for such monitoring shall be determined prior to initiation of the activity, if possible, or may be stipulated later if circumstances warrant.

#### 5.1.5 Mandatory Inspections

5.1.5.1 Mandatory inspection holdpoints are established by the organization performing the work, Engineering, or by Quality personnel. Witnessing or inspection of hold points by Quality shall be accomplished before work can proceed. Plant procedures and work instructions shall be reviewed by Quality personnel for concurrence with the established mandatory hold points.

5.1.5.2 Quality also establishes notification points for the purpose of being informed of upcoming activities (e.g., prior to the start of a test) where a mandatory holdpoint may not be appropriate, but Quality involvement may be desired.

5.1.6 Inspection results are reviewed and approved by qualified personnel to verify that the inspection requirements were satisfied.

5.1.7 Inspection activities shall be documented and as a minimum, shall identify the following:

5.1.7.1 Item inspected

5.1.7.2 Date of inspection

5.1.7.3 Inspector

5.1.7.4 Type of observation/inspection

5.1.7.5 Results and acceptability

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSPECTION</b>	<b>NUMBER</b>  Chapter 10.0	<b>REV. NO.</b>  7
	<b>PAGE 4 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

5.1.7.6 Reference to information on action taken in connection with nonconformances

5.1.7.7 Test equipment used

5.1.8 Inspection requirements for modifications, repairs, and replacements shall be equivalent to the inspection requirements of the original design or approved alternatives.

5.1.9 Procedures shall be reviewed by personnel sufficiently knowledgeable in the requirements of the activity to ensure that the necessary hold points are designated.

5.1.10 Measuring and test equipment utilized as part of the inspection process shall be controlled by the requirements of Reference 4.2.

5.1.11 Acceptance

5.1.11.1 Procedures shall be established for processing, evaluation, and final acceptance of inspection data. The qualified inspector performing the inspection is responsible for the immediate evaluation and acceptability of inspection results. Designated individuals or groups are responsible for reviewing and evaluating inspection results including recording of data, computations, drawings, or specification interpretations.

## 5.2 Nondestructive Examination (NDE)

5.2.1 NDE shall be performed in accordance with procedures which address the applicable requirements of ASME, ASTM, or other appropriate codes and standards.

5.2.2 The applicable requirements of Section 5.1 shall apply to the performance, evaluation, and documentation of NDE results.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSPECTION</b>	<b>NUMBER</b> Chapter 10.0	<b>REV. NO.</b> 7
	<b>PAGE 5 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

### 5.3 Inspection Status

5.3.1 The status of individual item inspections shall be identifiable through the use of stamps, tags, labels, routing cards or documentation traceable to the item.

### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.3.

### 7.0 ATTACHMENTS

7.1 None



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>TEST CONTROL</b>	<b>NUMBER</b> Chapter 11.0	<b>REV. NO.</b> 6
	<b>PAGE 1 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish requirements for testing of structures, systems, and components.

## 2.0 SCOPE

- 2.1 This chapter is applicable to the testing of structures, systems, and components during the operational phases to demonstrate compliance with design and operational requirements.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 South Texas Project Electric Generating Station (STPEGS) Technical Specifications
- 4.2 OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.3 OQAP Chapter 12.0, Instrument and Calibration Control
- 4.4 OQAP Chapter 14.0, Records Control
- 4.5 OQAP Chapter 2.0, Att. I

## 5.0 REQUIREMENTS

- 5.1 The test programs shall be developed to demonstrate that plant structures, systems, and components will perform in accordance with design requirements.
  - 5.1.1 Tests performed following maintenance or modification shall satisfy the original design or test requirements or an engineering approved alternative.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>TEST CONTROL</b>	<b>NUMBER</b> Chapter 11.0	<b>REV. NO.</b> 6
	<b>PAGE 2 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

- 5.1.2 Test programs include operability tests, surveillance tests, and equipment tests, including those associated with plant maintenance, modification, procedure changes, and the acceptance of purchased material.
- 5.2 Procedures shall be developed to control tests of structures, systems, and components to assure satisfactory service upon completion of maintenance or modifications.
- 5.3 Procedures shall be developed to schedule and control surveillance testing of those items and systems required by Reference 4.1.
- 5.4 Test procedures shall provide, as necessary, for the following:
  - 5.4.1 The requirements and acceptance limits contained in applicable licensing, design and procurement documents.
  - 5.4.2 Instructions for performing the test, including prerequisites, test sequence, and caution or safety notes, and shall be in sufficient detail so that the test operator's interpretation is not required.
  - 5.4.3 Calibrated test equipment with the accuracy required for performing the activity.
  - 5.4.4 Provisions for documenting or recording test data and results
  - 5.4.5 Acceptance criteria.
  - 5.4.6 Inspection hold and/or notification points for inspection/witness by Nuclear Assurance.
  - 5.4.7 Provisions for assuring the test prerequisites have been met.
  - 5.4.8 Provisions for control of jumpers, lifted leads, blank flanges, strainers or safety tags, etc.
  - 5.4.9 Provisions for returning a system to normal configuration upon completion of the test.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>TEST CONTROL</b>	<b>NUMBER</b>  Chapter 11.0	<b>REV. NO.</b>  6
	<b>PAGE 3 OF 4</b>	
	<b>EFFECTIVE DATE</b>	

5.4.10 Environmental conditions shall be noted in test procedures, as appropriate.

5.5 Measuring and Test equipment (M&TE) used during test activities shall be controlled in accordance with Reference 4.3.

5.6 Procedures shall be developed to ensure that test data and results are reviewed by a qualified individual(s) and are evaluated for compliance with applicable test acceptance criteria.

5.7 Personnel performing test activities, including developing and implementing test procedures and evaluating and reporting test results, shall be qualified in accordance with Reference 4.2.

5.8 Administrative procedures shall provide for identification of structure, system, and component test status through the use of status indicators (e.g., clearance tags, markings, records) to assure only items that have passed required tests are used or operated.

5.9 Test records, where applicable, shall include:

5.9.1 Identification of items or systems tested.

5.9.2 Date of test.

5.9.3 Tester and data recorder identification.

5.9.4 Type of observation/test.

5.9.5 Test results and acceptability.

5.9.6 References to nonconformances and corrective action.

5.9.7 Person reviewing and evaluating test results.

5.9.8 Test equipment used.

## 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.4.

SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION  OPERATIONS QUALITY ASSURANCE PLAN  TEST CONTROL	NUMBER Chapter 11.0	REV. NO. 6
	PAGE 4 OF 4	
	EFFECTIVE DATE	

7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSTRUMENT AND CALIBRATION CONTROL</b>	<b>NUMBER</b>  Chapter 12.0	<b>REV. NO.</b>  6
	<b>PAGE 1 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish requirements to ensure measuring and test equipment (M&TE), and installed instrument and control devices used in activities or structures, systems and components are properly controlled, maintained, and calibrated at the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter is applicable to equipment used to measure, test, evaluate, and inspect items and systems during operational phases and to installed instrument and control devices used to measure, record, and control plant operations.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.2 OQAP Chapter 14.0, Records Control
- 4.3 OQAP Chapter 2.0, Att. I

## 5.0 REQUIREMENTS

- 5.1 Procedures shall be developed to establish the method and interval of calibration for installed instrument and control devices. The calibration method and interval shall be based on the type of equipment, stability, and reliability characteristics, required accuracies and other conditions affecting calibration.

**SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION**

NUMBER

Chapter 12.0

REV.

NO.

6

**OPERATIONS QUALITY ASSURANCE PLAN**

PAGE 2 OF 3

**INSTRUMENT AND CALIBRATION CONTROL**EFFECTIVE  
DATE

- 5.2 Procedures shall be developed for the control and calibration of measuring and test equipment at prescribed intervals or prior to use. Reference standards having known valid relationships to national standards shall be used. Each organization shall be responsible for assuring that the measuring and test equipment (MTE) it uses has been calibrated to the accuracy required for its intended use.
- 5.3 Reference standards shall have an uncertainty (error) requirement of no more than 1/4 of the tolerance of the equipment or device being calibrated. When commercial standards with the required uncertainty error are not available, a reference standard may be used if the standard error tolerance is equal to or less than the error tolerance of the equipment being calibrated. The basis of this acceptance shall be documented and authorized by responsible management. In those cases where a reference standard is not traceable to a national standard because a national standard does not exist, the basis for calibration shall be documented.
- 5.4 Measuring and test equipment shall be uniquely identified. The records directly traceable to the equipment shall indicate the date of calibration, the identity of the person who calibrated the equipment, the results of the calibration and the next calibration due date.
- 5.4.1 A calibration label will be attached to measuring and test equipment to indicate the calibration due date. If this label interferes with the equipment function or is impractical, the calibration label will be attached to the equipment case.
- 5.5 Measures shall be established to trace the use of each item of measuring and test equipment. When measuring and test equipment or installed instrument and control devices are found out of calibration, an evaluation shall be made and documented for the validity of previous inspection and test results and for the acceptability of items previously inspected or tested.
- 5.6 Measuring and test equipment, installed instruments and control devices suspected or known to be in error or defective shall be immediately removed from service or properly tagged to indicate the error or defect.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>INSTRUMENT AND CALIBRATION CONTROL</b>	<b>NUMBER</b>  Chapter 12.0	<b>REV. NO.</b>  6
	<b>PAGE 3 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

- 5.7 Measuring and test equipment, installed instruments and control devices consistently found to be out of calibration shall be repaired or replaced.
- 5.8 Measuring and test equipment shall be handled and stored commensurate with their environmental and sensitivity requirements.
- 5.9 Measuring and test equipment which becomes lost shall be considered out of tolerance and upon its recovery, it shall be recalibrated.
- 5.10 Personnel calibrating measuring and test equipment and installed instrument and control devices shall be qualified per Reference 4.1.
- 5.11 Contractors and vendors, who provide their own measuring and test equipment, shall have a program that meets the requirements of this chapter.
- 5.12 This chapter does not require the calibration and control of rulers, tape measures, levels and other such devices if normal commercial practices provide adequate accuracy.
- 5.13 Inspection, test, maintenance, repair, and other procedures shall include provisions to assure that M&TE used in activities affecting quality are the proper range, type and accuracy.
- 5.14 Measuring and test equipment, utilized for chemical and radiological control purposes are not required to meet the requirements of this chapter, provided laboratory control practices are implemented to ensure accuracy of analyses.

#### 6.0 DOCUMENTATION

- 6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.2.

#### 7.0 ATTACHMENTS

- 7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF CONDITIONS ADVERSE TO QUALITY</b>	<b>NUMBER</b>  Chapter 13.0	<b>REV. NO.</b>  8
	<b>PAGE 1 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish requirements and responsibilities for the identification, documentation, evaluation, resolution, control and reporting of conditions adverse to quality.

## 2.0 SCOPE

- 2.1 This chapter applies to conditions adverse to quality discovered in items, services and activities under the scope of the Operations Quality Assurance Plan and the reporting of items to the Nuclear Regulatory Commission (NRC) in accordance with Title 10 Code of Federal Regulations.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 10CFR50, Appendix B
- 4.2 10CFR21, Reporting of Defects and Noncompliance
- 4.3 10CFR50.72, Immediate Notification Requirements for Operating Nuclear Power Reactors
- 4.4 10CFR50.73, Licensee Event Report System
- 4.5 South Texas Project Electric Generating Station (STPEGS) Technical Specifications
- 4.6 OQAP Chapter 14.0, Records Control
- 4.7 OQAP Chapter 2.0, Att. I

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF CONDITIONS ADVERSE TO QUALITY</b>	<b>NUMBER</b>  Chapter 13.0	<b>REV. NO.</b>  8
	<b>PAGE 2 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

## 5.0 REQUIREMENTS

- 5.1 All personnel working under the jurisdiction of the Operations Quality Assurance Plan are responsible for reporting conditions adverse to quality to appropriate management for resolution in accordance with approved procedures.
- 5.2 Procedures shall be developed for the control of items, services or activities which do not conform to established requirements. These procedures shall provide for the following:
  - 5.2.1 Identification and documentation of conditions adverse to quality.
  - 5.2.2 Identification of the requirements, source, or reference information being violated.
  - 5.2.3 Notification of responsible management.
  - 5.2.4 Control of conditions adverse to quality by tagging, segregation, administrative controls, or other appropriate means to prevent inadvertent installation, use, or continuation of the activity and removal of such controls when returned to service or availability.
  - 5.2.5 Resolution and/or disposition approved by authorized personnel prior to closing out the documentation and restoring to normal service.
    - 5.2.5.1 Material conditions adverse to quality disposition categories are:
      - o "Use-as-is"
      - o "Reject"
      - o "Rework" in accordance with documented procedures
      - o "Repair" in accordance with documented procedures

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF CONDITIONS ADVERSE TO QUALITY</b>	<b>NUMBER</b>  Chapter 13.0	<b>REV. NO.</b>  8
	<b>PAGE 3 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

- 5.2.5.2 "Use-as-is" and "repair" dispositions shall be approved and justified in writing by Engineering.
- 5.2.5.3 Evaluations shall be performed to ascertain recurrence control measures.
- 5.2.6 Documentation of the corrective action taken.
- 5.2.7 Review and/or verification of the corrective action by Nuclear Assurance and Licensing, as appropriate.
- 5.2.8 Repaired and reworked items shall be reinspected in accordance with applicable procedures. Reinspection results are documented on inspection reports or other work process control documents.
- 5.2.9 Installation of nonconforming material, parts, and components may be performed after the effect of their installation has been evaluated and the installation approved by Plant Management and Engineering. Nonconforming items which may not be installed are those which, because of their makeup and intended use, cannot be repaired or reworked after being installed and those which, if installed and later removed, would degrade that system, structure, or component. Once installed, nonconforming items are not energized, used, or placed in service until the action required by the disposition, including reinspection, has been completed or an engineering evaluation has been prepared to justify the intended use of the nonconforming item.
- 5.2.10 Conditions adverse to quality identified on installed items will be evaluated for operability.
- 5.2.11 Disputes over corrective action are normally resolved by Plant Management. Should this resolution not be satisfactory, the parties may elevate the matter to higher management for resolution.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF CONDITIONS ADVERSE TO QUALITY</b>	<b>NUMBER</b>  Chapter 13.0	<b>REV. NO.</b>  8
	<b>PAGE</b> 4 <b>OF</b> 5	
	<b>EFFECTIVE DATE</b>	

- 5.3 Procedures shall provide the following administrative controls:
- 5.3.1 Unique identification and numbering of conditions adverse to quality.
  - 5.3.2 Preparing and maintaining status reporting of conditions adverse to quality.
  - 5.3.3 Actions to be taken to assure timely corrective action on conditions adverse to quality.
- 5.4 Procedures which identify and track conditions adverse to quality shall require management review of each report to determine if the condition is significant. For significant conditions adverse to quality, the cause of the condition and the corrective action taken to preclude repetition shall be documented and reported to appropriate levels of management.
- 5.5 Measures shall be established for review and evaluation of conditions adverse to quality for reportability to the NRC as required by References 4.2, 4.3, and 4.4, as appropriate.
- 5.6 The authority to stop work has been assigned to the General Manager, Nuclear Assurance and Licensing for any activity being performed by company personnel or contractors which do not conform to established requirements.
- 5.7 Measures shall be established for the evaluation and trending of conditions adverse to quality. The results of these reviews and analyses are reported to the affected organization and executive management, and are audited by the Quality organization. Adverse trends shall be evaluated and processed in accordance with controlling procedures.

## 6.0 DOCUMENTATION

- 6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.6.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>CONTROL OF CONDITIONS ADVERSE TO QUALITY</b>	<b>NUMBER</b>  Chapter 13.0	<b>REV. NO.</b> 8
	<b>PAGE 5 OF 5</b>	
	<b>EFFECTIVE DATE</b>	

7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>RECORDS CONTROL</b>	<b>NUMBER</b> Chapter 14.0	<b>REV. NO.</b> 5
	<b>PAGE 1 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

1.1 The purpose of this chapter is to describe the requirements and the responsibilities for the collection, storage, retrieval, and maintenance of records.

## 2.0 SCOPE

2.1 This chapter is applicable to those records acquired and developed as a result of, or in support of, the South Texas Project Electric Generating Station (STPEGS).

2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

3.1 None

## 4.0 REFERENCES

4.1 OQAP Chapter 2.0, Att. I

## 5.0 REQUIREMENTS

5.1 Records shall be collected, filed, stored, maintained, and dispositioned in accordance with Reference 4.1.

5.1.1 Records include, but are not limited to: plant history; operating logs; records of principal maintenance and modification activities; reportable occurrences and other records required by the Technical Specifications; results of reviews, inspections, tests, audits, and material analyses; monitoring of work performance; qualification of personnel, procedures, and equipment; drawings, specifications, procurement documents, warehousing documents, calibration procedures and calibration reports; and nonconformance and corrective action reports.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>RECORDS CONTROL</b>	<b>NUMBER</b> Chapter 14.0	<b>REV. NO.</b> 5
	<b>PAGE 2 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

- 5.1.1.1 The records control program provides evidence that activities affecting quality are defined and implemented, and that inspection and test documents contain a description of the type of observation; the identification of inspector or data recorder; the date and inspection or test results; acceptability of the results; and reference any action taken in documenting or resolving any nonconformances.
- 5.2 Record storage facilities shall meet the requirements of Reference 4.1.
- 5.3 A list of record types and the classification of these record types as to retention period shall be maintained.
- 5.4 An index of stored records shall be maintained. The index shall include retention period and location of the records within the storage area. The STPEGS DTL (an electronic data base) is used as a record index/checklist. If a conflict of retention times exists between regulatory, standard, or technical specification requirements, the longer retention period shall be specified.
- 5.5 Records indexing systems shall provide sufficient cross-reference between the record and items or activities to which the record applies.
- 5.6 The receipt, processing, and handling of records shall be controlled by procedures.
- 5.7 To ensure that records are identifiable and retrievable, a computerized records management system has been developed. This system provides for a method to identify the document(s)/record(s) or document/record package(s) for retrieval purposes. The system also provides the ability to cross-reference the identification with other possible identifiers of the document (i.e., specification number, purchase order number, equipment number). Records may be stored on photographic, optical, or electronic media; the file locations of documents are available from the computer.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>RECORDS CONTROL</b>	<b>NUMBER</b> Chapter 14.0	<b>REV. NO.</b> 5
	<b>PAGE 3 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

5.8 Controlled access to the record storage facility shall be established.

5.9 Records may be corrected/supplemented in accordance with procedures which provide for appropriate review or approval by the originating or other authorized organization. Corrections/supplements shall include the date and identification of the person making the correction/supplement, shall be in ink and be entered in a manner such that the original information is not obliterated.

5.10 Organizations generating records are responsible for ensuring activities are documented accurately, legibly, and with sufficient traceability; and submitting designated documents for independent review prior to entering into the records system in accordance with appropriate procedures.

#### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with this chapter.

#### 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	<b>NUMBER</b>  Chapter 15.0	<b>REV. NO.</b>  7
	<b>PAGE 1 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to establish requirements for a system of independent oversight activities of quality assurance programs for the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter provides for implementing a program of independent oversight activities which includes audits, assessments, evaluations, performance monitoring, and surveillances to ensure the requirements of the Operations Quality Assurance Program are being properly implemented.
- 2.2 The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 QQAP Chapter 2.0, Att. I
- 4.2 QQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.3 QQAP Chapter 7.0, Procurement
- 4.4 QQAP Chapter 13.0, Control of Conditions Adverse to Quality
- 4.5 QQAP Chapter 14.0, Records Control

## 5.0 REQUIREMENTS

- 5.1 Independent Oversight Activities
  - 5.1.1 Procedures shall be developed to control independent oversight activities. These activities include, but are not limited to, audits, assessments, evaluations, performance monitoring, and surveillances.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	<b>NUMBER</b> Chapter 15.0	<b>REV. NO.</b> 7
	<b>PAGE 2 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

These activities shall be used to observe and verify that activities are accomplished in accordance with prescribed requirements.

## 5.2 Audits

5.2.1 A comprehensive audit program in compliance with Reference 4.1 shall be established and implemented by HL&P to verify internal and external quality activity compliance with the Operations QA Program. The audit program shall assure that applicable elements of the program have been developed, documented, and are effectively implemented and shall provide for reporting and reviewing audit results by appropriate levels of management. The following areas are included in the audit program:

- 5.2.1.1 Operation, maintenance, and modifications
- 5.2.1.2 Preparation, review, approval, and control of designs, specifications, procurement documents, instructions, procedures, and drawings
- 5.2.1.3 Material and special process control
- 5.2.1.4 Indoctrination and training programs
- 5.2.1.5 Implementation of operating and test procedures
- 5.2.1.6 Calibration of measuring and test equipment
- 5.2.1.7 Corrective action and nonconformance control
- 5.2.1.8 Performance of the plant staff, including training records
- 5.2.1.9 Plant inspection activities

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	<b>NUMBER</b> Chapter 15.0	<b>REV. NO.</b> 7
	<b>PAGE 3 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

5.2.2 Qualified personnel assigned auditing responsibilities shall be independent of any direct responsibility for the performance of the activities which they audit; shall be experienced or trained commensurate with the scope, complexity, or special nature of the activities to be audited; and shall be qualified in accordance with the requirements of Reference 4.2.

5.2.2.1 An audit team consists of one (or more) qualified person(s). A qualified lead auditor shall be appointed as the audit team leader. The audit team leader shall be responsible for the written plans, checklists, team orientation, audit notification, pre-audit conference, audit performance, post-audit conference, reporting, and follow-up activity to assure corrective action. The audit team leader shall promptly report conditions requiring immediate corrective action to the appropriate management of the audited organization. Other audit findings will be identified to the audited organization at the post-audit conference.

5.2.2.2 Other qualified personnel may assist in the conduct of audits, such as technical specialists or management representatives.

### 5.2.3 Internal Audits

5.2.3.1 Internal audits shall be conducted by the Quality Department and performed with a frequency commensurate with their safety significance, past performance and regulatory requirements. Audits are scheduled on a nominal biennial frequency. If a decision is made to extend an audit beyond that nominal frequency, the basis for that decision shall be documented.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	<b>NUMBER</b> Chapter 15.0	<b>REV. NO.</b> 7
	<b>PAGE 4 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

- 5.2.3.2 Review of the audit program shall be performed at least semiannually by the Nuclear Safety Review Board or by a management representative to verify that audits are being accomplished in accordance with the requirements of the QA Program.
- 5.2.3.3 Audit results shall be reviewed periodically by the Quality organization for quality trends and overall audit program effectiveness. The results of these reviews shall be reported to appropriate management in periodic summary reports.
- 5.2.3.4 Audited organizations are responsible for providing timely corrective action including action to prevent recurrence for programmatic problems identified by an audit.
- 5.2.4 Supplemental audits shall be conducted when:
  - 5.2.4.1 Significant changes are made to the quality assurance program.
  - 5.2.4.2 It is necessary to determine the root cause of problem areas which may impact the effectiveness of the quality assurance program.
  - 5.2.4.3 A systematic, independent assessment of program effectiveness is necessary.
  - 5.2.4.4 Requested by appropriate management.
- 5.2.5 Audit implementation shall include the following:
  - 5.2.5.1 Written notification to the audited organization of the audit, if an announced audit.
  - 5.2.5.2 Development of an individual audit plan/scope. The audit plan and any necessary reference documents shall be available to the audit team members.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	<b>NUMBER</b> Chapter 15.0	<b>REV. NO.</b> 7
	<b>PAGE 5 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

- 5.2.5.3 A pre-audit and post-audit conference with responsible organizational management.
- 5.2.5.4 Use of a checklist or procedure as a guide during the performance of the audit.
- 5.2.5.5 Identifying and documenting conditions adverse to quality.
- 5.2.5.6 Audit reports shall be prepared and submitted to the audited organization, senior management, and the Executive Vice President and General Manager, Nuclear within thirty days after the post-audit conference. The audit report shall address those items required by Reference 4.1.
- 5.2.5.7 Audited organizations provide timely and thorough corrective action and recurrence control to discrepancies identified during the audit. In the event that corrective action cannot be completed within thirty days, the audited organization's response shall include a scheduled date for the corrective action. Earlier dates for corrective action may be established if circumstances dictate.
- 5.2.5.8 Evaluation of corrective action for conditions adverse to quality and follow-up verification as appropriate.

### 5.3 Surveillance/Quality Performance Monitoring

- 5.3.1 Procedures and/or instructions shall be developed to control surveillance/quality performance monitoring activities. Surveillance/quality performance monitoring activities shall be used to observe and verify that activities are accomplished in accordance with prescribed procedures.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	<b>NUMBER</b>  Chapter 15.0	<b>REV. NO.</b>  7
	<b>PAGE 6 OF 7</b>	
	<b>EFFECTIVE DATE</b>	

5.3.2 Surveillance/quality performance monitoring activities will be performed on both units during refueling outages, startup activities, and normal and off-normal operational activities. Areas to be monitored will be determined based on safety significance, past performance, regulatory requirements, and customer request.

5.3.3 The frequency of site surveillance/quality performance monitoring activities is based upon the complexity of the activity, importance of the activity, and severity level of conditions noted during previous oversight activities.

5.3.4 Surveillance/quality performance monitoring results shall be documented and a summary shall be prepared and transmitted to responsible management.

#### 5.4 Assessments/Evaluations

5.4.1 Assessments are conducted annually in accordance with written procedures to assess Nuclear Assurance & Licensing's implementation of the Operations Quality Assurance Program.

5.4.1.1 These assessments will be conducted by organizations independent of the activities performed to assure the HL&P OQAP is being properly implemented.

5.4.1.2 The Nuclear Safety Review Board shall define the scope of the assessment and determine the schedule.

5.4.1.3 The results of these assessments will be transmitted to the Executive Vice President and General Manager, Nuclear.

5.4.2 Other assessments/evaluations may be performed to verify activities are accomplished in accordance with applicable requirements and prescribed procedures.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>QUALITY OVERSIGHT ACTIVITIES</b>	NUMBER	REV. NO.
	Chapter 15.0	7
	PAGE 7 OF 7	
	EFFECTIVE DATE	

5.4.2.1 These assessments/evaluations will be performed on areas based on their safety significance, past performance, regulatory requirements, and customer request.

5.4.2.2 Assessment/evaluation results shall be documented and transmitted to appropriate management.

5.5 An approved oversight plan shall be issued annually to include:

5.5.1 Activities/organizations to receive independent oversight.

5.5.2 Time frame in which the oversight activity will be conducted.

5.6 Conditions adverse to quality identified during an independent oversight activity shall be documented in accordance with Reference 4.4.

5.7 Personnel performing independent oversight activities shall be trained and qualified in accordance with Reference 4.2.

#### 6.0 DOCUMENTATION

6.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.5.

#### 7.0 ATTACHMENTS

7.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ASME CODE SECTION XI - REPAIRS AND REPLACEMENTS</b>	<b>NUMBER</b>  Chapter 17.0	<b>REV. NO.</b>  6
	<b>PAGE</b> 1 OF 3	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to prescribe requirements and responsibilities for repair and replacement activities governed by ASME Boiler and Pressure Vessel Code, Section XI, Rules for Inservice Inspection of Nuclear Power Plant Components.

## 2.0 SCOPE

- 2.1 This chapter is applicable to examination, repair and replacement activities performed on ASME Class 1, 2, and 3 components.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 ASME Code Section XI, Rules for Inservice Inspection of Nuclear Power Plant Components
- 4.2 QQAP Chapter 14.0, Records Control
- 4.3 Generic Letter 89-009, ASME Section III Component Replacements

## 5.0 RESPONSIBILITIES

- 5.1 The Vice President, Nuclear Generation is responsible for the planning, management, and control of the performance of repairs, replacements and tests.
- 5.2 The Vice President, Nuclear Engineering is responsible for developing the repair and replacement program including specifications for design, fabrication, testing, and examination.
- 5.3 The General Manager, Nuclear Assurance and Licensing is responsible for providing qualified personnel to perform examinations of component repairs and replacements and verifying the requirements of this chapter are implemented.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ASME CODE SECTION XI - REPAIRS AND REPLACEMENTS</b>	<b>NUMBER</b>  Chapter 17.0	<b>REV. NO.</b>  6
	<b>PAGE</b> 2 OF 3	
	<b>EFFECTIVE DATE</b>	

## 6.0 REQUIREMENTS

- 6.1 Repair and replacement activities required by Reference 4.1 shall be conducted in accordance with written and approved procedures or instructions.

Areas to be addressed include:

- 6.1.1 Accessibility for component examination, repair or replacement.
- 6.1.2 Identification of system boundaries and code class for each component.
- 6.1.3 The method for interfacing with the authorized nuclear inspection agency.
- 6.1.4 Qualification of nondestructive examination methods.
- 6.1.5 Qualification requirements for nondestructive examination personnel.
- 6.1.6 Qualification requirements for welders and welding operators.
- 6.1.7 Qualification of welding procedures.
- 6.1.8 Conduct of examinations and inspections.
- 6.1.9 A component repair or replacement package including installation and test procedures and quality assurance requirements.
- 6.1.10 Conduct of system pressure and functional tests.
- 6.1.11 A component replacement package including specifications for design, fabrication and examination as applicable for the replacements.
- 6.1.12 Preparation, submittal and retention of required records and reports.
- 6.1.13 Procurement, in accordance with Reference 4.3, of component replacements not available in full compliance with ASME code stamping and documentation requirements.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ASME CODE SECTION XI - REPAIRS AND REPLACEMENTS</b>	<b>NUMBER</b> Chapter 17.0	<b>REV. NO.</b> 6
	<b>PAGE</b> 3 OF 3	
	<b>EFFECTIVE DATE</b>	

7.0 DOCUMENTATION

7.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.2.

8.0 ATTACHMENTS

8.1 None

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ASME CODE SECTION XI - INSERVICE INSPECTION AND TESTING</b>	<b>NUMBER</b>  Chapter 18.0	<b>REV. NO.</b>  7
	<b>PAGE 1 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

## 1.0 PURPOSE

- 1.1 The purpose of this chapter is to prescribe requirements and responsibilities for the inservice examination and testing programs at the South Texas Project Electric Generating Station (STPEGS).

## 2.0 SCOPE

- 2.1 This chapter applies to the inservice examination and testing of Class 1, 2 and 3 pressure retaining components and component supports as specified in Section XI of the ASME Boiler and Pressure Vessel Code and additional ISI commitments as specified in the UFSAR.

## 3.0 DEFINITIONS

- 3.1 None

## 4.0 REFERENCES

- 4.1 ASME Code Section XI, Rules for Inservice Inspection of Nuclear Power Plant Components
- 4.2 10CFR50.55a, Codes and Standards
- 4.3 OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
- 4.4 OQAP Chapter 14.0, Records Control

## 5.0 RESPONSIBILITIES

- 5.1 The Vice President, Nuclear Engineering is responsible for developing and implementing the inservice examination and testing programs as required by ASME Code Section XI.
- 5.2 The General Manager, Nuclear Assurance and Licensing is responsible for verifying the implementation of the inservice examination and testing programs through appropriate quality oversight activities, interfacing with the Authorized Inspection Agency, and performance of nondestructive examinations as requested by Nuclear Engineering.

<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ASME CODE SECTION XI - INSERVICE INSPECTION AND TESTING</b>	<b>NUMBER</b>  Chapter 18.0	<b>REV. NO.</b>  7
	<b>PAGE 2 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

## 6.0 REQUIREMENTS

6.1 The inservice examination and testing programs consist of plans and implementing procedures for the examination and testing of Class 1, 2, and 3 pressure retaining components and their supports and the inservice testing of Class 1, 2, and 3 pumps and valves.

### 6.1.1 Examination and Testing of Pressure Retaining Components and Component Supports

6.1.1.1 Nuclear Engineering shall develop plans for examination and testing of Class 1, 2, and 3 components and their supports. These plans shall prescribe the requirements for nondestructive examinations and tests and the schedule for their performance.

6.1.1.2 Inspection plans (e.g., specifications, vendor documents, etc.) shall be developed which identify the nature and extent of examination and testing activities including the acceptance criteria which must be met.

6.1.1.3 Procedures shall be developed which provide measures for the performance of activities identified in the plans.

### 6.1.2 Inservice Testing of Pumps and Valves and System Pressure Testing

6.1.2.1 Nuclear Engineering shall develop the Inservice Testing Program for pumps and valves and the System Pressure Testing Program. These programs shall include the requirements and the schedule for their performance.

6.1.3 Examination and test results shall be evaluated by specified personnel and verified by the Authorized Nuclear Inservice Inspector.



<b>SOUTH TEXAS PROJECT ELECTRIC GENERATING STATION</b>  <b>OPERATIONS QUALITY ASSURANCE PLAN</b>  <b>ASME CODE SECTION XI - INSERVICE INSPECTION AND TESTING</b>	<b>NUMBER</b> Chapter 18.0	<b>REV. NO.</b> 7
	<b>PAGE 3 OF 3</b>	
	<b>EFFECTIVE DATE</b>	

- 6.1.4 Coordination of involved HL&P departments, including the use of contractors for the performance, documentation and evaluation of inservice inspection activities, shall be controlled by approved procedures.
- 6.1.5 When contractors are used to perform activities within the scope of this section, their quality assurance program shall be approved by Houston Lighting & Power.
- 6.1.6 Exceptions to code examination and testing requirements shall be documented in accordance with Reference 4.2.
- 6.1.7 Personnel performing examinations and tests shall be qualified as required by Reference 4.1 and Reference 4.3.
- 6.1.8 Plans and reports for inservice examinations and tests shall be submitted to the appropriate regulatory and enforcement authorities as required by Section XI.

## 7.0 DOCUMENTATION

- 7.1 Procedures which are generated as required by this chapter shall identify the records which are required to implement and document those activities. The records shall be controlled in accordance with Reference 4.4.

## 8.0 ATTACHMENTS

- 8.1 None

ATTACHMENT 2  
SUMMARY OF CHANGES  
BETWEEN CURRENTLY APPROVED OQAP  
AND THIS SUBMITTAL

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 1 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
APPROVAL	HEADER	CHANGE	REVISION TO 13
APPROVAL		INSERT	<b>Executive Vice President and General Manager, Nuclear</b>
TOC	HEADER	CHANGE	REVISION TO 13
	HEADER	CHANGE	EFFECTIVE DATE TO
TOC	CENTER	DELETE	<b>Chapters Requiring NRC Approval</b>
	Definitions	CHANGE	Effective Chapter Revision from 6 to 7
	Definitions	CHANGE	Effective Revision Date to
	CH. 1.0	CHANGE	Effective Chapter Revision from 8 to 9
	CH. 1.0	CHANGE	Effective Revision Date to
	CH. 2.0	CHANGE	Effective Chapter Revision from 10 to 11
	CH. 2.0	CHANGE	Effective Revision Date to
	CH. 3.0	CHANGE	Effective Chapter Revision from 6 to 7
	CH. 3.0	CHANGE	Effective Revision Date to
	CH. 4.0	CHANGE	Effective Chapter Revision from 6 to 7
	CH. 4.0	CHANGE	Effective Revision Date to
	CH. 5.0	CHANGE	Effective Chapter Revision from 4 to 5

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 2 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	CH. 5.0	CHANGE	Effective Revision Date to
	CH. 6.0	CHANGE	Effective Chapter Revision from 6 to <b>7</b>
	CH. 6.0	CHANGE	Effective Revision Date to
	CH. 7.0	CHANGE	Effective Chapter Revision from 6 to <b>7</b>
	CH. 7.0	CHANGE	Effective Revision Date to
	CH. 8.0	CHANGE	Effective Chapter Revision from 5 to <b>6</b>
	CH. 8.0	CHANGE	Effective Revision Date to
	CH. 9.0	CHANGE	Effective Chapter Revision from 5 to <b>6</b>
	CH. 9.0	CHANGE	Effective Revision Date to
	CH. 10.0	CHANGE	Effective Chapter Revision from 6 to <b>7</b>
	CH. 10.0	CHANGE	Effective Revision Date to
	CH. 11.0	CHANGE	Effective Chapter Revision from 5 to <b>6</b>
	CH. 11.0	CHANGE	Effective Revision Date to
	CH. 12.0	CHANGE	Effective Chapter Revision from 5 to <b>6</b>
	CH. 12.0	CHANGE	Effective Revision Date to
	CH. 13.0	CHANGE	Title from Deficiency Control to <b>Control of Conditions</b> <b>Adverse to Quality</b>

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 3 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	CH. 13.0	CHANGE	Effective Chapter Revision from 7 to <b>8</b>
	CH. 13.0	CHANGE	Effective Revision Date to
	CH. 14.0	CHANGE	Effective Chapter Revision from 4 to <b>5</b>
	CH. 14.0	CHANGE	Effective Revision Date to
	CH. 15.0	DELETE	Title - "Quality <b>Assurance</b> <b>Overview Activities</b> "
	CH. 15.0	INSERT	Title - "Quality <b>Oversight</b> <b>Activities</b> "
	CH. 15.0	CHANGE	Effective Chapter Revision from 6 to <b>7</b>
	CH. 15.0	CHANGE	Effective Revision Date to
	CH. 17.0	CHANGE	Effective Chapter Revision from 5 to <b>6</b>
	CH. 17.0	CHANGE	Effective Revision Date to
	CH. 18.0	CHANGE	Effective Chapter Revision from 6 to <b>7</b>
DEFINIT	Commercial Grade Item	DELETE	<b>a. Is not subject to design or specification requirements that are unique to the nuclear power industry/ and</b>  <b>b. Is used in applications other than in the nuclear power industry; and</b>

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 4 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			c. Is to be procured from a manufacturer or supplier on the basis of specifications set forth in the manufacturer's published product description (i.e., catalog).
	Commercial Grade Item	INSERT	<p>A structure, system, or component, or part thereof that affects its safety function, that was not designed and manufactured as a basic component.</p> <p>Commercial grade items do not include items where the design and manufacturing process require in-process inspections and verifications to ensure that defects or failures to comply are identified and corrected (i.e., one or more critical characteristics of the item cannot be verified.)</p>
CH. 1.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components designated as "Full", "Targeted", or "Basic".

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 5 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
CH. 2.0			Unless noted otherwise, the sections for Chapter 2.0 have been completely replaced as noted. Sections that are not specified have remained as shown in the previous revision. The "header" for each page has been changed to reflect the new revision number and effective date.
	2.1	INSERT	<p>The QA Program is implemented and controlled in accordance with the Operations Quality Assurance Plan (OQAP) and is applicable to structures, systems, and components to an extent consistent with their importance to safety, and complies with the requirements of 10CFR50, Appendix B and other program commitments as appropriate.</p> <p>Graded Quality Assurance is one element of STPEG's Comprehensive Risk Management (CRM) Program. Graded Quality Assurance provides the process by which risk-based methodology [i.e., Probabilistic Safety Assessment (PSA)], deterministic insight and performance-based information analyses are combined to provide direction as to what levels of programmatic controls are needed for structures, systems, and components, and as to the levels of first line and independent oversight needed to provide necessary assurance</p>



USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 6 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			that items will operate safely and activities are accomplished as prescribed. The CRM Program is implemented by Working Groups who provide risk-informed, performance-based recommendations to an Expert Panel. The Expert Panel is a multi-discipline group comprised of high-level management representing Design and Systems Engineering, Nuclear Licensing, Industry Relations, Risk and Reliability Analysis, Quality, and Plant Management. The Expert Panel is chartered with guiding the implementation of the CRM Program.
			The QA Program is implemented in three graded applications (i.e., "Full", "Targeted", and "Basic").
			"Full" program controls are applied to structures, systems, and components determined to be "high" safety significant/risk important.
			"Targeted" program controls are applied to non-safety related structures, systems, and components which are categorized "high" or "medium" safety significant/risk important and to structures, systems, and components which are categorized "low" or "not"

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 7 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			safety significant/risk important and quality-related. "Full" program controls are applied in a selected manner and specifically "Targeted" at those characteristics or attributes of the structure, system, or component which render it significant or important.
			"Basic" program controls are applied to safety-related structures, systems, and components which are categorized as "medium" or "low" safety significant/risk important.
			<u>NOTE:</u> An analysis to determine which level of program controls is appropriate must be completed prior to designation as "Targeted" or "Basic". Until these analyses are complete for items currently covered by the OQAP, "Full" program controls will be applied across the board.
2.2		INSERT	The QA Program will also extend, as applicable and/or determined by STP management, to programs including 10CFR71, Subpart H (except design and fabrication of NRC certified radioactive waste shipping casks), ASME Boiler and Pressure Vessel Code, Sections

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 8 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			III and XI; and to quality-related areas as defined herein including the Fire Protection Program, Emergency Plan, Radiological Environmental Monitoring Program, Radwaste Management Program, Computer Program Verification and Control, Seismic and Environmental Equipment Qualification Programs, Radiation Protection Program, and Station Blackout (SBO) systems and equipment.
	3.1	INSERT	<u>Full program controls</u> - The highest levels of program controls and oversight that are to be afforded to safety-related structures, systems, and components determined to be "high" safety significant/risk important. These are in full compliance with the requirements of 10CFR50, Appendix B, and additionally represent compliance with the applicable commitments relative to USNRC Regulatory Guides and ANSI Standards which they endorse. These controls provide the highest levels of program controls and line/independent oversight and are designed to provide a high degree of assurance that items perform safely and activities are accomplished as expected. They reflect controls as

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 9 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			committed in Attachment I.
3.2		INSERT	<u>Targeted program controls</u> - A level of program controls and oversight applied to non-safety related structures, systems, and components which are categorized "high" or "medium" safety significant/risk important and to structures, systems, and components which are categorized "low" or "not" safety significant/risk important and quality-related. These controls are selected elements of the "Full" program applied in a selected manner and specifically "Targeted" at those characteristics or attributes of the structure, system, or component which render it significant or important. These controls provide a high degree of assurance that the structure, system, or component will perform their specific function and the important elements of the activities are accomplished as expected. They reflect selected controls as committed in Attachment I.
3.3		INSERT	<u>Basic program controls</u> - "Basic" program controls are applied to safety-related structures, systems, and components which are categorized as "medium" or

USQE 96-0001  
QQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 10 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			"low" safety significant/risk important and are subject to the controls of the QA program as committed in Attachment I. These controls are defined as good business practices which reflect the most economical and efficient means of conducting business and are designed to provide assurance that structures, systems, and components perform, and activities are accomplished, as expected.
	5.1	INSERT	The QQAP is prepared to prescribe the STPEGS QA Program.
	5.1.1	INSERT	The QQAP shall provide quality program policies to be implemented for the STPEGS. The QQAP assigns responsibilities necessary for the attainment of quality assurance objectives and the verification of conformance to established requirements.
	5.1.2	INSERT	The QA Program shall be in effect throughout the operating life of the STPEGS.
	5.1.3	INSERT	The Executive Vice President and General Manager, Nuclear has overall responsibility for quality assurance.

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 11 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.1.4	INSERT	The General Manager, Nuclear Assurance and Licensing (NA&L), is responsible for the development and maintenance of the OQAP.
	5.2	INSERT	Organizational Independence
	5.2.1	INSERT	The reporting arrangement utilized by the NA&L Organization ensures that those personnel performing independent oversight have the organizational freedom to:
	5.2.1.1	INSERT	Identify quality problems.
	5.2.1.2	INSERT	Initiate, recommend, or provide solutions.
	5.2.1.3	INSERT	Verify implementation of solutions.
	5.2.2	INSERT	Personnel verifying compliance with quality requirements do not have direct responsibility for the performance of or directly supervise the activity being verified.
	5.3	INSERT	QA Program
	5.3.1	INSERT	The operations phase of the STPEGS includes design, engineering, procurement, fabrication, repair, testing, operation, maintenance, refueling, inservice inspection, and modification. The OQAP requires that HL&P,

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 12 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			its contractors, subcontractors, and vendors comply with the criteria established by 10CFR50, Section 50.55a; 10CFR50, Appendix A, General Design Criterion (GDC) 1; 10CFR50, Appendix B, and 10CFR71, Sub-Part H (except design and fabrication of NRC certified radioactive waste shipping casks).
			It is the intent of HL&P to comply, as applicable, with the Regulatory Guides (RG) and implementing American National Standards Institute (ANSI) N45.2 daughter standards, as defined in Attachment I.
	5.4	INSERT	Delegation of QA Functions
	5.4.1	INSERT	The OQAP may be executed in whole or part by subcontract personnel. However, STPEGS will retain responsibility for the total quality assurance program, and NA&L personnel will perform appropriate oversight activities of subcontracted activities.
	5.5	INSERT	Identification of Safety Significant Structures, Systems, and Components



USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 13 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.5.1	INSERT	The program described herein is applied to activities affecting the safety functions of those structures, systems, and components which prevent, or mitigate the consequences of postulated accidents that could cause undue risk to the health and safety of the public. The structures, systems, and components controlled are listed in UFSAR Section 3.2, along with their associated fire protection systems. UFSAR Section 3.2 also identifies those structures, systems, and components which may not represent a safety significant concern but to which the STPEGS OQAP is applied.
	5.5.2	INSERT	The fire protection QA Program is part of the overall STPEGS Operations QA Program. Fire protection QA Program criteria are implemented as part of the HL&P Operations QA Program.
	5.5.3	INSERT	Expendable or consumable items necessary for the functional performance of structures, systems, and components are subjected to quality assurance requirements as specified in written procedures. These procedures include provisions for review and control in accordance with industry standards and specifications.

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 14 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.6	INSERT	QA Program Documents
	5.6.1	INSERT	The QA Program shall be implemented with documented instructions, procedures, and drawings which include appropriate quantitative and qualitative acceptance criteria for determining that prescribed activities have been satisfactorily accomplished. Procedures shall include the control of the sequence of required inspections, tests, and other operations when important to quality. To change these controls, the individual procedure must be changed and shall require the same level of review and approval given to the original procedure. Such instructions, procedures, and drawings are reviewed and approved for compliance with requirements appropriate to their safety significance by individuals qualified to do so.
	5.7	INSERT	Personnel Indoctrination and Training
	5.7.1	INSERT	General indoctrination and training programs shall be provided for site personnel to assure that they are knowledgeable regarding quality programs and requirements. The training

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 15 of 41

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			requirements for STPEGS personnel are described in UFSAR Section 13.2. Personnel performing complex, unusual, or potentially hazardous work shall be instructed in special indoctrination or briefing sessions. Emphasis shall be on special requirements for safety of personnel, radiation control and protection, unique features of equipment and systems, operating constraints, and control requirements in effect during performance of work. Where required by codes and standards, personnel are trained, qualified, and certified according to written procedures in the principles and techniques of performing specific activities.
	5.8	INSERT	Policies and Goals
	5.8.1	INSERT	It is the policy of HL&P, acting as licensee and Project Manager for the STPEGS, to assure that the design, procurement, construction, testing, and operation of the STPEGS are in conformance with specifications, procedures, codes, commitments and Nuclear Regulatory Commission (NRC) regulations. The responsibility of each organization supporting the STPEGS is to ensure that the

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 16 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			requirements stated in this QA Program are incorporated into procedures. Adherence to those procedures is mandatory for all STPEGS organizations and contractors or vendors providing items or services covered by the QA Program.
	5.8.2	INSERT	The OQAP identifies activities and establishes requirements for procedures which identify, report, and verify the resolution of quality problems. The implementing procedures call for the resolution of quality problems at the lowest possible authorized level. However, if a dispute is encountered in the resolution of a quality problem which cannot be resolved at lower levels, the General Manager, Nuclear Assurance & Licensing or Director, Quality shall present the problem to the Executive Vice President and General Manager, Nuclear, for resolution.
	5.9	INSERT	Control of Activities
	5.9.1	INSERT	The OQAP requires Quality department review and/or approval of procedures which control selected activities. These procedures shall require the use of the proper equipment, completion of

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 17 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			prerequisites for starting an activity, and suitable environment for performing the activity. Procedures will comply with the appropriate standards.
	5.9.2	INSERT	STPEGS personnel attend planning, scheduling, and status meetings as necessary to assure adequate quality coverage and program application exists.
	5.10	INSERT	Management Review
	5.10.1	INSERT	The implementation of both line and OQAP requirements shall be verified through independent oversight activities. The Quality organization shall conduct independent oversight activities of the operating plant and of the interfacing organizations' activities.
	5.10.2	INSERT	Independent oversight of HL&P's implementation of the OQAP are conducted under the cognizance of the Nuclear Safety Review Board and results are transmitted to appropriate line and senior management, including the Executive Vice President and General Manager, Nuclear for review and/or action.

USQE 96-0001  
QQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 18 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.10.3	INSERT	STPEGS may use the services of architect-engineer firms, Nuclear Steam Supply System (NSSS) suppliers, fuel fabricators, constructors, and others which provide or augment STPEGS efforts during operations. As applicable, the QA programs of such contractors or consultants shall be subject to review, evaluation, and acceptance by the Quality organization before initiation of activities affected by the program.
	5.11	INSERT	Operations Quality Assurance Plan Changes
	5.11.1	INSERT	HL&P is committed to maintaining the QQAP as an effective and meaningful document to provide programmatic direction on STPEGS. Changes to the QQAP will be processed under 10CFR50.54(a).
	5.12	INSERT	Computer Code Programs
	5.12.1	INSERT	The development, maintenance, and use of computer code programs will be controlled. Prior to use of a computer code program, the appropriateness of the program shall be verified. In addition, all such programs shall be appropriately

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 19 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			certified for use.
	7.1	INSERT	<b>ATTACHMENT I - Regulatory Guide Table</b>
	ATT. I	INSERT	Insert the attachment
CH. 3.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	2.1	DELETE	This chapter applies to all personnel engaged in quality-related activities associated with the operation of the STPEGS.
	2.1	INSERT	This chapter applies to all personnel performing activities associated with structures, systems, and components during the operations phase of the STPEGS.
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.2	DELETE	Regulatory Guide 1.33, Quality Assurance Program Requirements (Operations)
	4.2	INSERT	OQAP Chapter 2.0, Att. I
	5.1	DELETE	, as delineated in Reference 4.2



USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 20 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.1.3	INSERT	parentheses () around e.g., reactor startup, tasks which are infrequently performed, and tasks in which operations must be performed in a specified sequence
	5.2.1	INSERT	Add the following as the last sentence of the paragraph: <b>These shall not be used in lieu of, or to modify existing procedures.</b>
	5.2.2	INSERT	Add the following as the last sentence of the paragraph: <b>These shall not be used in lieu of, or to modify existing procedure.</b>
CH. 4.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	quality-related
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.1	DELETE	Regulatory Guide 1.8, Personnel Selection and Training
	4.1	INSERT	OQAP Chapter 2.0, Att. I

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 21 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	4.2	DELETE	Regulatory Guide 1.58, Qualification of Nuclear Power Plant Inspection, Examination and Testing Personnel
	4.2	INSERT	SNT-TC-1A, Recommended Practice for Nondestructive Personnel Qualification and Certification
	4.3	DELETE	Regulatory Guide 1.146, Qualification of Quality Assurance Program Audit Personnel for Nuclear Power Plant
	4.3	INSERT	10CFR55 Operator's Licenses
	4.4	DELETE	SNT-TC-1A, Recommended Practice for Nondestructive Personnel Qualification and Certification
	4.4	INSERT	ASME Section XI, Rules for Inservice Inspection of Nuclear Power Plant Components
	4.5	DELETE	10CFR55 Operator's Licenses
	4.5	INSERT	OQAP Chapter 14.0, Records Control
	4.6	DELETE	ASME Section XI, Rules for Inservice Inspection of Nuclear Power Plant Components
	4.6	INSERT	INPO ACAD 92-004, Guidelines for the Conduct of Training and Qualification Activities

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 22 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	4.7	DELETE	OQAP Chapter 14.0, Records Control
	4.8	DELETE	INPO ACAD 92-004, Guidelines for the Conduct of Training and Qualification Activities
	5.1.1	CHANGE	Reference 4.1, 4.2, 4.3, 4.4, 4.5, and 4.6 to Reference 4.1, 4.2, 4.3, 4.4.
	5.1.2.2	CHANGE	i.e. to e.g.
	5.3.1	CHANGE	4.5 to 4.3
	5.3.2	CHANGE	4.2 to 4.1
	5.3.3	CHANGE	4.4 and 4.6 to 4.2 and 4.4
	5.3.4	CHANGE	4.3 to 4.1
	5.7	DELETE	quality-related
	6.1	CHANGE	4.7 to 4.5
CH. 5.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	quality-related
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.1	DELETE	Regulatory Guide 1.33, Quality Assurance Program Requirements (Operations)

USQE 96-0001  
QQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 23 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	4.1	INSERT	QQAP Chapter 2.0, Att. I
	4.7	INSERT	QQAP Chapter 13.0, Control of Conditions Adverse to Quality
	5.1.1	DELETE	original and , or a documented engineering approved alternative.
	5.2.1	DELETE	and experience with comparable equipment. It will be revised and updated as operating experience is gained.
	5.2.1	INSERT	and equipment performance experience.
	5.3.1	DELETE	The cause of malfunctions shall be promptly determined, evaluated, and recorded.
	5.3.1	INSERT	Equipment failures, malfunctions and degradation shall be corrected in accordance with Reference 4.7. This shall include determination of root cause and implementation of recurrence controls, as appropriate.
	5.3.3	DELETE	Where unproven reliability of a new or repaired component which could affect nuclear safety exists, consideration should be given to an augmented testing and inspection program until a suitable level of performance has been demonstrated.

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 24 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.3.3	INSERT	Consideration should be given to an augmented testing and inspection program following a large scale component replacement (or repair) until a suitable level of performance has been demonstrated.
	5.5.1.2	INSERT	At the end of the third sentence: , or if not covered, the qualification requirements shall be defined.
	5.5.2.1	DELETE	At the end of the last sentence: <b>engineering organization.</b>
	5.5.2.1	INSERT	At the end of the last sentence: <b>site organization.</b>
	5.6.1.1	DELETE	<b>prevent and extraneous</b>
	5.6.1.1	INSERT	<b>exclude and foreign</b>
	5.7.2.2	DELETE	<b>done including parts used</b>
CH. 6.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	The purpose of this chapter is to establish the requirements and responsibilities for design control of new structures, systems or components, and modification control of existing structures, systems, or components at the South Texas Project Electric Generating

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 25 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			Station (STPEGS).
	1.1	INSERT	The purpose of this chapter is to establish the requirements and responsibilities for design and modification control of structures, systems, or components at the South Texas Project Electric Generating Station (STPEGS).
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.5	INSERT	OQAP Chapter 13.0, Control of Conditions Adverse to Quality
	4.6	INSERT	OQAP Chapter 2.0, Program Description
	5.1	DELETE	10CFR50.59
	5.1	INSERT	Reference 4.4
	5.2.4	DELETE	<b>quality-related</b> (two places)
	5.4.1	DELETE	First sentence, delete the word <b>design</b> used before the word verification
	5.4.1	INSERT	At the end of the second sentence... <b>methods</b> .

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 26 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.4.3	DELETE	However, the supervisor may perform the verification if the supervisor is the only technically qualified individual and the need for the supervisor to perform the review is approved and documented in advance by the supervisor's management.
	5.5	DELETE	Design documents include design drawings and specifications, vendor documents, setpoints with tolerances and design limits.
	5.7	DELETE	Errors and deficiencies found in approved design documents, including design methods, that could adversely affect quality-related structures, systems, or components shall be documented and action taken to correct and prevent the recurrence of deficiencies.
	5.7	INSERT	Conditions adverse to quality found in approved design documents, including design methods, that could adversely affect structures, systems, or components shall be documented and action taken to correct and prevent recurrence, in accordance with Reference 4.5.



USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 27 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.9	DELETE	Measures shall be established which assure that maintenance and modifications associated with design changes which may affect the functioning of quality-related structures, systems, or components are performed in a manner to ensure quality at least equivalent to that specified in the UFSAR or other original design bases and requirements.
	5.9	INSERT	Measures shall be established which assure that maintenance and modifications associated with design changes which may affect the functioning of structures, systems, or components are performed in a manner to ensure quality at least equivalent to that specified in the UFSAR or current design bases and requirements, unless changed by GQA categorization.
	5.10	DELETE	quality-related
	5.12.1	DELETE	quality-related
	5.12.3	DELETE	Quality-related
	5.13	DELETE	Plant

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 28 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
CH. 7.0			The "header" for each page has been changed to reflect the new revision number and effective date.
	2.1	DELETE	This chapter applies to the procurement of quality-related items and services, and commercial items procured for dedication and use in a nuclear safety-related application.
	2.1	INSERT	This chapter applies to the procurement of items and services for use at STPEGS which are subject to the controls of this QA program.
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.3	DELETE	ANSI N45.2.12/Reg. Guide 1.144, Auditing of Quality Assurance Programs for Nuclear Power Plants
	4.3	INSERT	OQAP Chapter 2.0, Att. I
	4.4	DELETE	ANSI N45.2.13/Reg. Guide 1.123, Quality Assurance Requirements for Control of Procurement of Items and Services for Nuclear Power Plants

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 29 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	4.4	INSERT	EPRI NP-5652 (NCIG-07), Guideline for the Utilization of Commercial Grade Items in Nuclear Safety Related Application
	4.5	DELETE	ANSI N45.2.2/Reg.Guide 1.138, Packaging, Shipping, Receiving, Storage and Handling of Items for Water- Cooled Nuclear Power Plants
	4.5	INSERT	OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
	4.6	DELETE	ANSI N18.7/Reg. Guide 1.33, Administrative Controls and Quality Assurance for the Operational Phase of Nuclear Power Plants
	4.6	INSERT	OQAP Chapter 13.0, Control of Conditions Adverse to Quality
	4.7	DELETE	EPRI NP-5652 (NCIG-07), Guideline for the Utilization of Commercial Grade Items in Nuclear Safety Related Application
	4.7	INSERT	OQAP Chapter 14.0, Records Control
	4.8	DELETE	OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
	4.9	DELETE	OQAP Chapter 13.0, Deficiency Control

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 30 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	4.10	DELETE	OQAP Chapter 14.0, Records Control
	5.1.1	DELETE	quality-related
	5.1.2.1	DELETE	First bulleted item: <b>quality-related and , Commercial Grade Items (CGI).</b>
	5.1.2.1	DELETE	Third bulleted item: <b>Purchase requisitions for quality-related materials, parts, components, services, or CGIs...</b>
	5.1.2.1	INSERT	<b>Purchase requisitions for materials, parts, components, or services</b>
	5.1.2.1	CHANGE	Separate the second paragraph of the third bulleted item and make a fourth bulleted item.
	5.1.2.1	REPLACE	In the new fourth bulleted item, replace <b>QA</b> with <b>Quality</b>
	5.1.2.2	CHANGE	In the second bulleted item: change <b>Purchase Requisitions</b> to <b>purchase requisitions</b>
	5.1.2.3	DELETE	<b>Additions, modifications, exceptions, and other</b>
	5.1.2.3	CHANGE	Change the word <b>changes</b> to upper case <b>Changes</b>

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 31 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

CHAPTER	LOCATION	ACTION	TEXT
	5.1.3.1	DELETE	Safety-related items may be procured as CGIs if a documented engineering evaluation indicates the CGI will provide equivalent performance.
	5.1.3.1	INSERT	Items may be procured as CGIs if a documented engineering evaluation indicates the CGI will provide equivalent performance, or if identified as "basic" coverage items as a result of Graded Quality Assurance (GQA) categorization.  CGI dedication will comply with established procedures designed to satisfy the requirements of 10CFR21.
	5.2.1	DELETE	Originating and reviewing organization procedures shall require that
	5.2.1	CHANGE	The last sentence will begin with: <b>The following shall...</b>
	5.2.1.1	DELETE	In the first sentence, directly before the word material: <b>applicable</b> . In the last sentence: <b>and be sufficient to preclude repetition of defects</b> .
	5.2.1.1	INSERT	Directly after "original requirements" in the last sentence: <b>(unless changed by GQA categorization) and be</b>

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 32 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
			sufficient to preclude repetition of defects, unless otherwise specified and documented.
	5.2.1.4	DELETE	of quality-related items
	5.2.1.8	INSERT	First bulleted item, directly after the word Documentation: (e.g., certification)
	5.4.1	DELETE	quality-related
	5.4.1	INSERT	Between "items" and "or services": (for CGIs, when basis for dedication includes commercial grade survey)
	5.4.1.4	INSERT	At the end of the section add: , or for CGIs, to assure the program provides adequate control over established critical characteristics.
	5.4.2	DELETE	evaluated by Quality Assurance at least once each twelve months as provided by Reference 4.4.
	5.4.2	INSERT	periodically evaluated by Quality as provided by Reference 4.3.
	5.4.2.1	DELETE	Assurance
	5.4.3.1	DELETE	QA
	5.4.3.2	DELETE	Assurance
	5.5.5	CHANGE	Reference 4.8 to Reference 4.5

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 33 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.5.6.5	CHANGE	Reference 4.9 to Reference 4.6
	5.5.7	CHANGE	QC to Quality
	5.5.8.1	INSERT	Additional bulleted item: Commercial Grade Item dedication
	5.5.9	DELETE	OQAP Chapter 13.0, Paragraph 5.2.9
	5.5.9	INSERT	Reference 4.6.
	5.6.2	DELETE	Entire paragraph text
	5.6.2	INSERT	The STPEGS survey and audit program provide for periodic scheduled audits or surveys of suppliers, the site procurement program, contractors, subcontractors, and others performing work. The audit and survey schedule is prepared and updated by Quality. Frequency of these surveys and audits is based upon the safety, complexity, and quality requirements, and as a minimum shall be in compliance with Reference 4.3.
	6.1	CHANGE	Reference 4.10 to Reference 4.7
CH. 8.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	quality-related
	2.1	DELETE	quality



USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 34 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.3	INSERT	OQAP Chapter 2.0, Att. I
	5.1	DELETE	quality related
	5.4.5	DELETE	to procedures
	5.5	DELETE	quality-related
	5.6	DELETE	quality related
CH. 9.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.1	DELETE	ANSI N45.2.2/Reg. Guide 1.38, Packaging, Shipping, Receiving, Storage and Handling of Items for Nuclear Power Plants
	4.1	INSERT	OQAP Chapter 2.0, Att. I
	4.2	DELETE	ANSI N45.2.3/Reg. Guide 1.39, Housekeeping During the Construction Phase of Nuclear Power Plants

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 35 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	4.2	INSERT	OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
	4.3	DELETE	OQAP Chapter 4.0, Qualification, Training and Certification of Personnel
	4.3	INSERT	OQAP Chapter 7.0, Procurement
	4.4	DELETE	OQAP Chapter 7.0, Procurement
	4.4	INSERT	OQAP Chapter 14.0, Records Control
	4.5	DELETE	OQAP Chapter 14.0, Records Control
	5.1	DELETE	Quality-related
	5.3.2	DELETE	quality-related
	5.6.1	CHANGE	Reference 4.2 to Reference 4.1
	5.6.1	DELETE	warehouse
	5.6.1	INSERT	storage
	5.7	CHANGE	Reference 4.3 to Reference 4.2
	6.1	CHANGE	Reference 4.5 to Reference 4.4
CH. 10.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	2.1	DELETE	quality-related

USQE 96-0001  
QQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 36 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.4	INSERT	QQAP Chapter 2.0, Att. I
	5.1.1	DELETE	and do not report to the same immediate supervisor
	5.1.3	DELETE	When inspections associated with normal operations of the plant are performed by individuals other than those who performed or directly supervised the work, but are within the same group, the following controls apply:
	5.1.3.1	DELETE	The quality of the work can demonstrated through a functional test when the activity involves breaching a pressure-retaining item.
	5.1.3.2	DELETE	The qualification criteria for inspection personnel are reviewed and found acceptable by the Quality organization prior to initiating the inspection.
	5.1.4	RENUMBER	5.1.3
	5.1.4.1	RENUMBER	5.1.3.1
	5.1.3.1	DELETE	quality-related

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 37 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.1.5	RENUMBER	<b>5.1.4</b>
	5.1.5.1	RENUMBER	<b>5.1.4.1</b>
	5.1.6	RENUMBER	<b>5.1.5</b>
	5.1.6.1	RENUMBER	<b>5.1.5.1</b>
	5.1.5.1	DELETE	<b>QA/QC</b>
	5.1.5.1	INSERT	<b>Quality</b>
	5.1.6.2	RENUMBER	<b>5.1.5.2</b>
	5.1.5.2	DELETE	<b>QC</b>
	5.1.5.2	INSERT	<b>Quality</b>
	5.1.7	RENUMBER	<b>5.1.6</b>
	5.1.8	RENUMBER	<b>5.1.7</b>
	5.1.8.1	RENUMBER	<b>5.1.7.1</b>
	5.1.8.2	RENUMBER	<b>5.1.7.2</b>
	5.1.8.3	RENUMBER	<b>5.1.7.3</b>
	5.1.8.4	RENUMBER	<b>5.1.7.4</b>
	5.1.8.5	RENUMBER	<b>5.1.7.5</b>
	5.1.8.6	RENUMBER	<b>5.1.7.6</b>
	5.1.8.7	RENUMBER	<b>5.1.7.7</b>
	5.1.9	RENUMBER	<b>5.1.8</b>
	5.1.10	RENUMBER	<b>5.1.9</b>

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 38 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.1.11	RENUMBER	5.1.10
	5.1.12	RENUMBER	5.1.11
	5.1.12.1	RENUMBER	5.1.11.1
	5.2.2	DELETE	, Inspection,
CH. 11.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	quality-related
	2.1	DELETE	quality-related
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.5	INSERT	OQAP Chapter 2.0, Att. I
	5.2	DELETE	quality-related
	5.8	CHANGE	i.e., to e.g.,
	5.9.6	DELETE	taken
	5.9.6	INSERT	corrective before action
CH. 12.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	quality-related
	2.1	DELETE	quality-related

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 39 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.3	INSERT	OQAP Chapter 2.0, Att. I
	5.5	INSERT	In the second sentence, after equipment or installed instrument and control devices
CH. 13.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	Title	CHANGE	Control of Conditions Adverse to Quality
	1.1	DELETE	deficiencies
	1.1	INSERT	conditions adverse to quality
	2.1	DELETE	deficiencies
	2.1	INSERT	conditions adverse to quality
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance.
	4.7	INSERT	OQAP Chapter 2.0, Att. I
	5.1	DELETE	identified deficiencies
	5.1	INSERT	conditions adverse to quality

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 40 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.2.1	DELETE	the deficient condition
	5.2.1	INSERT	conditions adverse to quality
	5.2.4	DELETE	the deficient item or activity, deficient, and the item is
	5.2.4	INSERT	conditions adverse to quality
	5.2.5	DELETE	nonconformance and the item
	5.2.5.1	DELETE	nonconformance disposition
	5.2.5.1	INSERT	conditions adverse to quality disposition
	5.2.5.2	DELETE	of nonconforming items
	5.2.5.2	INSERT	an s to disposition to make it plural
	5.2.8	DELETE	Reinspection of repaired and reworked items shall be to criteria as stringent as those applied to the original work.
	5.2.8	INSERT	Repaired and reworked items shall be reinspected in accordance with applicable procedures.
	5.2.10	DELETE	Nonconformances
	5.2.10	INSERT	Conditions adverse to quality
	5.3	DELETE	of deficiencies
	5.3.1	DELETE	deficiencies



USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 41 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.3.1	INSERT	conditions adverse to quality
	5.3.2	DELETE	deficiencies
	5.3.2	INSERT	conditions adverse to quality
	5.3.3	DELETE	deficiencies
	5.3.3	INSERT	conditions adverse to quality
	5.4	DELETE	deficiencies
	5.4	INSERT	conditions adverse to quality
	5.5	DELETE	deficiencies
	5.5	INSERT	conditions adverse to quality
	5.7	DELETE	plant deficiencies
	5.7	INSERT	conditions adverse to quality
	5.7	DELETE	QA
	5.7	INSERT	Quality
CH. 14.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	1.1	DELETE	quality-related
	2.1	DELETE	quality-related
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 42 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

CHAPTER	LOCATION	ACTION	TEXT
	4.1	DELETE	ANSI N45.2.9/Reg. Guide 1.88, Requirements for the Collection, Storage, and Maintenance of Nuclear Power Plant Quality Assurance Records.
	4.1	INSERT	OQAP Chapter 2.0, Att. I
	5.7	DELETE	QA
CH. 15.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	Title	CHANGE	QUALITY OVERSIGHT ACTIVITIES
	1.1	DELETE	overview
	1.1	INSERT	oversight
	2.1	DELETE	overview
	2.1	INSERT	oversight
	2.2	INSERT	The requirements of this chapter are applicable for structures, systems, and components to an extent consistent with their importance to safety.
	4.1	DELETE	UFSAR Table 3.12-1
	4.1	INSERT	OQAP Chapter 2.0, Att. I
	4.4	DELETE	Deficiency
	4.4	INSERT	of Conditions Adverse to Quality

USQE 96-0001  
QQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 43 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.1	DELETE	overview
	5.1	INSERT	<b>Oversight</b>
	5.1.1	DELETE	overview
	5.1.1	INSERT	<b>oversight</b>
	5.2.3.1	INSERT	<b>Audits are scheduled on a nominal biennial frequency. If a decision is made to extend an audit beyond that nominal frequency, the basis for that decision shall be documented.</b>
	5.2.5.5	DELETE	audit deficiencies
	5.2.5.5	INSERT	<b>conditions adverse to quality</b>
	5.2.5.6	INSERT	<b>, senior management, and the Executive Vice President and General Manager, Nuclear</b>
	5.2.5.8	DELETE	deficiencies
	5.2.5.8	INSERT	<b>conditions adverse to quality</b>
	5.3.3	DELETE	overview
	5.3.3	INSERT	<b>oversight</b>
	5.4.3	DELETE	<b>Assessments and audits may be interchangeable provided the scope is appropriate and approved by the Director, Quality.</b>
	5.5	DELETE	overview

USQE 96-0001  
OQAP CHANGE QA-028  
SUMMARY OF CHANGES  
Page 44 of 44

---

ALL CHANGES ARE IN BOLD TYPE

---

<u>CHAPTER</u>	<u>LOCATION</u>	<u>ACTION</u>	<u>TEXT</u>
	5.5	INSERT	<b>oversight</b>
	5.5.1	DELETE	<b>be overviewed</b>
	5.5.1	INSERT	<b>receive independent oversight.</b>
	5.5.2	DELETE	<b>overview</b>
	5.5.2	INSERT	<b>oversight</b>
	5.6	DELETE	<b>Nonconforming equipment, components, parts, materials, activities or documentation and overview</b>
	5.6	INSERT	<b>Conditions adverse to quality and oversight</b>
	5.7	DELETE	<b>overview</b>
	5.7	INSERT	<b>oversight</b>
CH. 17.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
CH. 18.0	The "header" for each page has been changed to reflect the new revision number and effective date.		
	5.2	DELETE	<b>overview</b>
	5.2	INSERT	<b>oversight</b>