

UNITED STATES NUCLEAR REGULATORY COMMISSION  
GENERAL PUBLIC UTILITIES NUCLEAR CORPORATION  
THREE MILE ISLAND NUCLEAR STATION, UNIT 2  
DOCKET NO. 50-320  
NOTICE OF ISSUANCE OF AMENDMENT TO  
FACILITY OPERATING LICENSE

I.

GPU Nuclear Corporation, Metropolitan Edison Company, Jersey Central Power and Light Company and Pennsylvania Electric Company (collectively, the licensee) are the holders of Facility Operating License No. DPR-73, which had authorized operation of the Three Mile Island Nuclear Station, Unit 2 (TMI-2) at power levels up to 2772 megawatts thermal. The facility, which is located in Londonderry Township, Dauphin County, Pennsylvania, is a pressurized water reactor previously used for the commercial generation of electricity.

II.

By Order for Modification of License, dated July 20, 1979, the licensee's authority to operate the facility was suspended and the licensee's authority was limited to maintenance of the facility in the present shutdown cooling mode (44 FR 45271). By further Order of the Director, Office of Nuclear Reactor Regulation, dated February 11, 1980, a new set of formal license requirements was imposed to reflect the post-accident condition of the facility and to assure the continued maintenance of the current safe, stable, long-term cooling condition of the facility (45 FR 11292).

8602130192 860127  
PDR ADOCK 05000320  
P PDR

The new requirements imposed on the licensee by the February 11, 1980 Order of the Director of Nuclear Reactor Regulation were issued as the Recovery Mode Proposed Technical Specifications (PTS), and have been revised, in part, in subsequent Amendments of Order. In response to the notice of opportunity to request a hearing provided by the Order of the Director, Office of Nuclear Reactor Regulation, dated February 11, 1980, several petitions for leave to intervene were filed and a prehearing conference was conducted on July 7, 1980. Subsequent to that time, discussions with the recognized parties have led to mutual agreement in the areas of concern, resulting in the resolution of all outstanding issues and the withdrawal of all petitions.

On November 8, 1985, the Atomic Safety and Licensing Board issued an Order entitled "Granting Joint Motion to Approve Stipulation, Dismissing ECNP and Dismissing Proceeding." This order approved the joint stipulation entered into by the Environmental Coalition on Nuclear Power (ECNP) the last remaining intervenor, the NRC Staff and the Licensee for the purpose of resolving all remaining proposed contentions and consequently terminated the proceeding.

### III.

In light of the termination of this proceeding, the NRC staff is now formally amending the License (Facility Operating License No. DPR-73) to include those Proposed Technical Specifications issued by the Order of the Director, Nuclear Reactor Regulation, dated February 11, 1980, as amended from time to time by Amendments of Order. Each of these revisions to the PTS was

issued with a supporting staff safety evaluation as were the corresponding Amendments of Order. Appropriate environmental reviews of each action were performed as well. The staff has concluded in these safety evaluations that the PTS, as amended, impose appropriate limitations on the licensee to assure the continued maintenance of the facility in a safe shutdown condition.

IV.

Accordingly, pursuant to the Atomic Energy Act of 1954, as amended, Facility Operating License No. DPR-73 is hereby amended to incorporate the Recovery Mode Proposed Technical Specifications as Appendix A to said license. The supporting documents approving the previous revisions to the Proposed Technical Specifications are available for inspection at the Commission's Public Document Room, 1717 H Street, NW, Washington, DC 20555, and at the Commission's Local Public Document Room at the State Library of Pennsylvania, Government Publications Section, Education Building, Commonwealth and Walnut Streets, Harrisburg, Pennsylvania 17126. This license amendment is effective as of the date of its issuance.

Dated at Middletown, Pennsylvania this 27th day of January, 1986

FOR THE NUCLEAR REGULATORY COMMISSION

*William D. Travers*

William D. Travers  
Director  
TMI-2 Cleanup Project Directorate  
Division of PWR Licensing-B  
Office of Nuclear Reactor Regulation



Enclosure 2

UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D.C. 20555

January 27, 1986


Docket No. 50-320

Docketing and Service Section  
Office of the Secretary of the Commission

SUBJECT: Three Mile Island Nuclear Station, Unit 2  
Operating License No. DPR-73; Docket No. 50-320  
Notice of Issuance of Amendment to Facility Operating License

Two signed originals of the Federal Register Notice identified below are enclosed for your transmittal to the Office of the Federal Register for publication. Additional conformed copies ( ) of the Notice are enclosed for your use.

- ☐ Notice of Receipt of Application for Construction Permit(s) and Operating License(s).
- ☐ Notice of Receipt of Partial Application for Construction Permit(s) and Facility License(s): Time for Submission of Views on Antitrust Matters.
- ☐ Notice of Availability of Applicant's Environmental Report.
- ☐ Notice of Proposed Issuance of Amendment to Facility Operating License.
- ☐ Notice of Receipt of Application for Facility License(s); Notice of Availability of Applicant's Environmental Report; and Notice of Consideration of Issuance of Facility License(s) and Notice of Opportunity for Hearing.
- ☐ Notice of Availability of NRC Draft/Final Environmental Statement.
- ☐ Notice of Limited Work Authorization.
- ☐ Notice of Availability of Safety Evaluation Report.
- ☐ Notice of Issuance of Construction Permit(s).
- ☒ Notice of Issuance of Facility Operating License(s) or Amendment(s).
- ☐ Other: \_\_\_\_\_

  
William D. Travers, Director  
TMI-2 Cleanup Project Directorate  
Division of PWR Licensing-B  
Office of Nuclear Reactor Regulation

Enclosure:  
As Stated



Enclosure 3

Previously  
NUREG-0432

THREE MILE ISLAND NUCLEAR STATION UNIT 2

Technical Specifications

Appendix "A"

to

License No. DPR-73

## INDEX

### DEFINITIONS

<u>SECTION</u>	<u>Page</u>
<u>1.0 DEFINITIONS</u>	
1.1 DEFINED TERMS.....	1-1
1.2 RECOVERY OPERATIONS PLAN.....	1-1
1.3 RECOVERY MODE.....	1-1
1.4 ACTION.....	1-1
1.5 OPERABLE - OPERABILITY.....	1-1
1.6 REPORTABLE OCCURRENCE.....	1-1
1.7 CONTAINMENT INTEGRITY.....	1-2
1.8 CHANNEL CALIBRATION.....	1-2
1.9 CHANNEL CHECK.....	1-2
1.10 CHANNEL FUNCTIONAL TEST.....	1-2
1.11 STAGGERED TEST BASIS.....	1-2
1.12 FREQUENCY NOTATION.....	1-2
1.13 FIRE SUPPRESSION WATER SYSTEM.....	1-2
1.14 REVIEW SIGNIFICANCE.....	1-3
1.15 CORE ALTERATION.....	1-4
1.16 LOSS TO AMBIENT.....	1-4
1.17 ACCIDENT GENERATED WATER.....	1-4
FREQUENCY NOTATION (TABLE 1.2).....	1-5

SAFETY LIMITS

---

SECTION

PAGE

2.1 SAFETY LIMITS

Reactor Coolant System Pressure..... 2-1

BASES

---

2.1 SAFETY LIMITS

Reactor Coolant System Pressure..... B 2-1

## INDEX

### LIMITING CONDITIONS FOR OPERATION

<u>SECTION</u>	<u>PAGE</u>
<u>3.0 APPLICABILITY</u> .....	3.0-1
<u>3.1 WATER INJECTION COOLING AND REACTIVITY CONTROL SYSTEMS</u>	
3.1.1 BORATION CONTROL	
Borated Cooling Water Injection.....	3.1-1
Boron Concentration.....	3.1-1
3.1.3 CONTROL ASSEMBLIES	
Mechanisms.....	3.1-2
<u>3.3 INSTRUMENTATION</u>	
3.3.1 NEUTRON MONITORING INSTRUMENTATION	
Intermediate and Source Range Neutron Flux Monitors.....	3.3-1
3.3.2 ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION.....	3.3-1
3.3.3 MONITORING INSTRUMENTATION	
Radiation Monitoring Instrumentation.....	3.3-3
Seismic Instrumentation.....	3.3-3
Meteorological Instrumentation.....	3.3-3
Essential Parameters Monitoring Instrumentation.....	3.3-6
Post-accident Instrumentation.....	3.3-6
Chlorine Detection Systems.....	3.3-6
Fire Detection.....	3.3-7
<u>3.4 REACTOR COOLANT SYSTEM</u>	
3.4.1 REACTOR COOLANT LOOPS.....	3.4-1
3.4.2 REACTOR VESSEL WATER LEVEL MONITORING.....	3.4-1
3.4.9 PRESSURE/TEMPERATURE LIMITS	
Reactor Coolant System.....	3.4-1
<u>3.5 COMMUNICATIONS</u>	
3.5.1 CONTROL ROOM.....	3.5-1

## INDEX

### LIMITING CONDITIONS FOR OPERATION

<u>SECTION</u>	<u>PAGE</u>
<u>3.6 CONTAINMENT SYSTEMS</u>	
3.6.1 PRIMARY CONTAINMENT	
Containment Integrity.....	3.6-1
Containment Air Locks.....	3.6-1
Internal Pressure.....	3.6-1
Air Temperature.....	3.6-2
3.6.3 CONTAINMENT PURGE EXHAUST SYSTEM	
3.6.4 COMBUSTIBLE GAS CONTROL	
Hydrogen Analyzers.....	3.6-2
Hydrogen Purge Cleanup System.....	3.6-2
<u>3.7 PLANT SYSTEMS</u>	
3.7.1 FEEDWATER SYSTEM.....	3.7-1
3.7.2 SECONDARY SERVICES CLOSED COOLING WATER SYSTEM.....	3.7-1
3.7.3 CLOSED CYCLE COOLING WATER SYSTEM	
Nuclear Services Closed Cycle Cooling System.....	3.7-1
Decay Heat Closed Cooling Water System.....	3.7-2
Mini Decay Heat Removal System.....	3.7-2
3.7.4 NUCLEAR SERVICE RIVER WATER SYSTEM.....	3.7-2
3.7.6 FLOOD PROTECTION.....	3.7-3
3.7.7 CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM.....	3.7-4
3.7.9 SEALED SOURCES.....	3.7-5
3.7.10 FIRE SUPPRESSION SYSTEMS	
Fire Suppression Water System.....	3.7-6
Deluge/Sprinkler Systems.....	3.7-8
Halon System.....	3.7-9
Fire Hose Stations.....	3.7-9
3.7.11 PENETRATION FIRE BARRIERS.....	3.7-11



## INDEX

### LIMITING CONDITIONS FOR OPERATION

---

<u>SECTION</u>	<u>PAGE</u>
<u>3.8 ELECTRICAL POWER SYSTEMS</u>	
3.8.1 A.C. SOURCES.....	3.8-1
3.8.2 ONSITE POWER DISTRIBUTION SYSTEMS	
A.C. Distribution.....	3.8-4
D.C. Distribution.....	3.8-4
<u>3.9 RADIOACTIVE WASTE STORAGE</u>	
3.9.1 SPENT FUEL STORAGE POOL "A" WATER LEVEL MONITORING.....	3.9-1
3.9.2 SPENT FUEL STORAGE POOL "A" WATER LEVEL.....	3.9-1
3.9.3 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL MONITORING.....	3.9-2
3.9.4 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL.....	3.9-2
3.9.12.1 FUEL HANDLING BUILDING/AUXILIARY BUILDING AIR CLEANUP SYSTEMS.....	3.9-1
3.9.13 ACCIDENT GENERATED WATER.....	3.9-2
3.9.14 REACTOR BUILDING SUMP WATER.....	3.9-2
<u>3.10 CRANE OPERATIONS</u>	
3.10.1 CONTAINMENT BUILDING.....	3.10-1
3.10.2 FUEL HANDLING BUILDING.....	3.10-1

### SURVEILLANCE REQUIREMENTS

---

4.0 APPLICABILITY.....	4.0-1
------------------------	-------

## INDEX

### BASES

<u>SECTION</u>	<u>PAGE</u>
3/4.0 <u>APPLICABILITY</u> .....	B 3/4 0-1
3/4.1 <u>WATER INJECTION COOLING AND REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL AND BORATED COOLING WATER INJECTION....	B 3/4 1-1
3/4.1.3 CONTROL ASSEMBLIES.....	B 3/4 1-1
3/4.3 <u>INSTRUMENTATION</u>	
3/4.3.1 NEUTRON MONITORING INSTRUMENTATION.....	B 3/4 3-1
3/4.3.2 ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION.....	B 3/4 3-1
3/4.3.3 MONITORING INSTRUMENTATION.....	B 3/4 3-1
3/4.4 <u>REACTOR COOLANT SYSTEM</u>	
3/4.4.1 REACTOR COOLANT LOOPS.....	B 3/4 4-1
3/4.4.2 REACTOR VESSEL WATER LEVEL MONITORING.....	B 3/4 4-1
3/4.4.9 PRESSURE/TEMPERATURE LIMIT.....	B 3/4 4-1
3/4.5 <u>COMMUNICATIONS</u> .....	B 3/4 5-1
3/4.6 <u>CONTAINMENT SYSTEMS</u>	
3/4.6.1 PRIMARY CONTAINMENT.....	B 3/4 6-1
3/4.6.3 CONTAINMENT PURGE EXHAUST SYSTEM.....	B 3/4 6-1
3/4.6.4 COMBUSTIBLE GAS CONTROL.....	B 3/4 6-1
3/4.7 <u>PLANT SYSTEMS</u>	
3/4.7.1 FEEDWATER SYSTEM.....	B 3/4 7-1
3/4.7.2 SECONDARY SERVICES CLOSED COOLING WATER SYSTEM.....	B 3/4 7-1
3/4.7.3 CLOSED CYCLE COOLING WATER SYSTEM.....	B 3/4 7-1
3/4.7.4 NUCLEAR SERVICE RIVER WATER SYSTEM.....	B 3/4 7-1

## INDEX

### BASES

---

<u>SECTION</u>	<u>PAGE</u>
3/4.7.6 FLOOD PROTECTION.....	B 3/4 7-2
3/4.7.7 CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM.....	B 3/4 7-2
3/4.7.9 SEALED SOURCE CONTAMINATION.....	B 3/4 7-2
3/4.7.10 FIRE SUPPRESSION SYSTEMS.....	B 3/4 7-2
3/4.7.11 PENETRATION FIRE BARRIER.....	B 3/4 7-3
3/4.8 ELECTRICAL POWER SYSTEMS.....	B 3/4 8-1
3/4.9 RADIOACTIVE WASTE STORAGE	
3/4.9.1 SPENT FUEL STORAGE POOL "A" WATER LEVEL MONITORING.....	B 3/4 9-1
3/4.9.2 SPENT FUEL STORAGE POOL "A" WATER LEVEL.....	B 3/4 9-1
3/4.9.3 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL MONITORING.....	B 3/4 9-1
3/4.9.4 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL.....	B 3/4 9-1
3/4.9.12 FUEL HANDLING BUILDING/AUXILIARY BUILDING AIR CLEANUP SYSTEMS.....	B 3/4 9-1
3/4.9.13 ACCIDENT GENERATED WATER.....	B 3/4 9-1
3/4.10 DEFUELING OPERATIONS.....	B 3/4 10-1

## INDEX

### DESIGN FEATURES

---

<u>SECTION</u>	<u>PAGE</u>
<u>5.1 SITE</u>	
5.1.1 Exclusion Area.....	5-1
5.1.2 Low Population Zone.....	5-1
5.1.3 Site Boundary for Gaseous Effluents.....	5-1
5.1.4 Site Boundary for Liquid Effluents.....	5-1
<u>5.2 CONTAINMENT</u>	
5.2.1 Configuration.....	5-1
5.2.2 Design Pressure and Temperature.....	5-1
<u>5.4 REACTOR COOLANT SYSTEM</u>	
5.4.1 Design Pressure and Temperature.....	5-4
5.4.2 Volume.....	5-4
<u>5.5 METEOROLOGICAL TOWER LOCATION.....</u>	5-4

## INDEX

### ADMINISTRATIVE CONTROLS

<u>SECTION</u>	<u>PAGE</u>
<u>6.1 RESPONSIBILITY</u> .....	6-1
<u>6.2 ORGANIZATION</u>	
6.2.1 G PUNC Organization.....	6-1
6.2.2 TMI-2 Organization.....	6-1
<u>6.3 UNIT STAFF QUALIFICATIONS</u> .....	6-3
<u>6.4 TRAINING</u> .....	6-3
<u>6.5 REVIEW AND AUDIT</u>	
6.5.1 TECHNICAL REVIEW AND CONTROL	
6.5.1.10 Records.....	6-5
6.5.1.11 Qualifications.....	6-5
6.5.2 INDEPENDENT SAFETY REVIEW	
6.5.2.1 Function.....	6-5
6.5.2.5 Responsibilities.....	6-6
6.5.2.7 Records.....	6-7
6.5.3 AUDITS.....	6-7
6.5.3.2 Audit Records.....	6-7
6.5.4 SAFETY REVIEW GROUP	
6.5.4.1 Function.....	6-8
6.5.4.2 Organization.....	6-8
6.5.4.3 Responsibility.....	6-9
6.5.4.6 Authority.....	6-9
6.5.4.7 Qualifications.....	6-9
6.5.4.8 Record.....	6-10
<u>6.6 REPORTABLE OCCURRENCE ACTION</u> .....	6-9
<u>6.8 PROCEDURES</u> .....	6-10
<u>6.9 REPORTING REQUIREMENTS</u>	
6.9.1 ROUTINE REPORTS AND REPORTABLE OCCURRENCES.....	6-11
6.9.2 SPECIAL REPORTS.....	6-14



## INDEX

### ADMINISTRATIVE CONTROLS

---

<u>SECTION</u>	<u>PAGE</u>
<u>6.10 RECORD RETENTION</u> .....	6-14
<u>6.11 RADIATION PROTECTION PROGRAM</u> .....	6-16
<u>6.12 HIGH RADIATION AREA</u> .....	6-16

SECTION 1.0

DEFINITIONS

## 1.0 DEFINITIONS

---

### DEFINED TERMS

1.1 The DEFINED TERMS of this section appear in capitalized type and are applicable throughout these Technical Specifications.

### RECOVERY OPERATIONS PLAN

1.2 The RECOVERY OPERATIONS PLAN shall define the surveillance requirements to be performed to ensure equipment operability as required by the Limiting Conditions for Operation. This plan, and changes thereto, shall be approved by the Commission prior to implementation.

### RECOVERY MODE

1.3 The RECOVERY MODE shall correspond to a condition in which the reactor is subcritical with an average reactor coolant temperature of less than 200°F.

### ACTION

1.4 ACTION shall be those additional requirements specified as corollary statements to each specification and shall be part of the specifications.

### OPERABLE - OPERABILITY

1.5 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s). Implicit in this definition shall be the assumption that all necessary attendant instrumentation, controls, normal and emergency electrical power sources, cooling or seal water, lubrication or other auxiliary equipment, that are required for the system, subsystem, train, component or device to perform its function(s), are also capable of performing their related support function(s).

### REPORTABLE EVENT

1.6 A REPORTABLE EVENT shall be any of those conditions specified in Section 50.73 of 10 CFR Part 50.

## 1.0 DEFINITIONS

---

### CONTAINMENT INTEGRITY

1.7 CONTAINMENT INTEGRITY shall exist when:

- a. All penetrations required to be closed during accident conditions, except those listed in Table 3.6.2, are either:
  1. Capable of being closed by valves on each side of the penetration or by double valve isolation outside of the reactor building per procedures approved pursuant to Specification 6.8.2. Isolation valves inside the reactor building shall be capable of remote operation from a control station outside of the reactor building, or;
  2. Closed by manual valves, blind flanges, or deactivated automatic valves secured in their closed positions to provide double isolation of each penetration.
- b. The Equipment Hatch is closed and sealed.
- c. Each airlock is OPERABLE pursuant to Specification 3.6.1.3.
- d. The sealing mechanism associated with each penetration (e.g., welds, bellows or O-rings) is OPERABLE.

### CHANNEL CALIBRATION

1.8 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds with necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel including the sensor and alarm and/or trip functions, and shall include the CHANNEL FUNCTIONAL TEST. CHANNEL CALIBRATION may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

### CHANNEL CHECK

1.9 A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

## 1.0 DEFINITIONS

### CHANNEL FUNCTIONAL TEST

1.10 A CHANNEL FUNCTIONAL TEST shall be:

- a. Analog channels - the injection of a simulated signal into the channel as close to the primary sensor as practicable to verify OPERABILITY including alarm and/or trip functions.
- b. Bistable channels - the injection of a simulated signal into the channel sensor to verify OPERABILITY including alarm and/or trip functions.

### STAGGERED TEST BASIS

1.11 A STAGGERED TEST BASIS shall consist of:

- a. A test schedule for n systems, subsystems, trains or designated components obtained by dividing the specified test interval into n equal subintervals,
- b. The testing of one system, subsystem, train or designated components at the beginning of each subinterval.

### FREQUENCY NOTATION

1.12 The FREQUENCY NOTATION specified for the performance of surveillance requirements shall correspond to the intervals defined in Table 1.2.

### FIRE SUPPRESSION WATER SYSTEM

1.13 A FIRE SUPPRESSION WATER SYSTEM shall consist of: a water source; gravity tank or pumps; and distribution piping and associated sectionalizing control or isolation valves. Such valves shall include yard hydrant curb valves, and the first valve upstream of the water flow alarm device on each sprinkler, hose standpipe or spray system riser.

### REVIEW SIGNIFICANT

1.14 REVIEW SIGNIFICANT items shall consist of items that are Important to Safety, or proposed changes to Technical Specifications, License, Special Orders or Agreements, Recovery Operations Plan, Organization Plan, or involve an Unreviewed Safety Question or a Significant Environmental Impact. Also, those system operating procedures and associated emergency, abnormal, alarm response procedures which require NRC approval. In addition, those activities not covered by an NRC approved system description, SER or TER and which exceed PEIS values.



## DEFINITIONS

---

### CORE ALTERATION

1.15 CORE ALTERATION shall be the movement or manipulation of any reactor component (including fuel) within the reactor pressure vessel with the vessel head removed and fuel in the vessel. Suspension of CORE ALTERATION shall not preclude completion of movement of a component to a safe conservative position.

### LOSS-TO AMBIENT

1.16 LOSS-TO-AMBIENT is a passive cooling mode by which decay heat, generated by the reactor core, is removed and transferred to the surrounding environment by air and passive components (i.e., Reactor Vessel) inside the Reactor Building.

### ACCIDENT GENERATED WATER

1.17 ACCIDENT GENERATED WATER, as defined in the settlement of the City of Lancaster litigation, is:

- (a) Water that existed in the TMI-2 Auxiliary, Fuel Handling, and Containment Buildings including the primary system as of October 16, 1979, with the exception of water which as a result of decontamination operations becomes commingled with non-accident generated water such that the commingled water has a tritium content of 0.025  $\mu\text{Ci/ml}$  or less before processing;
- (b) Water that has a total activity of greater than one  $\mu\text{Ci/ml}$  prior to processing except where such water is originally non-accident water and becomes contaminated by use in cleanup;
- (c) Water that contains greater than 0.025  $\mu\text{Ci/ml}$  of tritium before processing.

1.18 LICENSED OPERATOR (OL) - any individual who possesses an NRC operator's license pursuant to Title 10, Code of Federal Regulations, Part 55, "Operators Licenses."

1.19 SENIOR LICENSED OPERATOR (SOL) - any individual who possesses an NRC Senior Operator's license pursuant to Title 10, Code of Federal Regulations, Part 55, "Operators Licenses."

1.20 FUEL HANDLING SENIOR LICENSED OPERATOR (SOL-FH) - an individual licensed by the Nuclear Regulatory Commission to supervise fuel handling and core alterations operations.

TABLE 1.2  
FREQUENCY NOTATION

<u>NOTATION</u>	<u>FREQUENCY</u>
S	At least once per 12 hours.
D	At least once per 24 hours.
W	At least once per 7 days.
M	At least once per 31 days.
Q	At least once per 92 days.
SA	At least once per 184 days.
A	At least once per 12 months.
R	At least once per 18 months.
N.A.	Not applicable.

SECTION 2.0  
SAFETY LIMITS  
AND  
LIMITING SAFETY SYSTEM SETTINGS

## 2.0 SAFETY LIMITS

---

### 2.1 SAFETY LIMITS

#### 2.1.3 REACTOR COOLANT SYSTEM PRESSURE

Not applicable.

BASES  
FOR  
SAFETY LIMITS



NOTE

The summary statements contained in this section provide the bases for the specifications of Section 2.0 and are not considered a part of these Technical Specifications as provided in 10 CFR 50.36.

## 2.1 SAFETY LIMITS

### BASES

---

#### 2.1.3 REACTOR COOLANT SYSTEM PRESSURE

The reactor coolant system is currently open to the reactor building atmosphere. Should reactor coolant system repressurization become necessary during the course of the recovery, a maximum pressure rating will be specified by an NRC approved safety evaluation.

SECTIONS 3.0 AND 4.0  
LIMITING CONDITIONS FOR OPERATION  
AND  
SURVEILLANCE REQUIREMENTS

### 3 LIMITING CONDITIONS FOR OPERATION

#### 3.0 APPLICABILITY

##### LIMITING CONDITIONS FOR OPERATION

---

3.0.1 Limiting Conditions for Operation and ACTION requirements shall be applicable during the RECOVERY MODE or other conditions specified for each specification.

3.0.2 Adherence to the requirements of the Limiting Condition for Operation and/or associated ACTION within the specified time interval shall constitute compliance with the specification. In the event the Limiting Condition for Operation is restored prior to expiration of the specified time interval, completion of the ACTION statement is not required.

3.0.3 In the event a Limiting Condition for Operation and/or associated ACTION requirements cannot be satisfied because of circumstances in excess of those addressed in the specification, initiate appropriate actions to rectify the problem to the extent possible under the circumstances, and take all other actions necessary to maintain the unit in a stable condition; and submit a report to the Commission pursuant to the requirements of Section 50.73 of 10 CFR Part 50.

## LIMITING CONDITIONS FOR OPERATION

### 3.1 WATER INJECTION COOLING AND REACTIVITY CONTROL SYSTEMS

#### 3.1.1 BORATION CONTROL

##### BORATED COOLING WATER INJECTION

3.1.1.1 The following systems, capable of injecting borated cooling water into the Reactor Coolant System, shall be OPERABLE with:

- a. Two operable flowpaths downstream from the Borated Water Storage Tank and common drop line.
- b. Dedicated on-site equipment for a Reactor Building Sump Recirculation System:
- c. The BWST shall contain at least 390,000 gallons of borated water except as changed per procedures approved pursuant to Specification 6.8.2 at a minimum temperature of 50 degrees Fahrenheit and a boron concentration of between 4350 and 6000 ppm.

##### APPLICABILITY: RECOVERY MODE

##### ACTION:

- a. With one flowpath from the BWST inoperable, restore to operable status or establish an alternate flowpath within 72 hours.
- b. With both flowpaths from the BWST inoperable, suspend all operations involving CORE ALTERATIONS and/or the Reactor Coolant System and restore the inoperable flowpaths to OPERABLE status within 72 hours.
- c. With the dedicated Reactor Building Sump Recirculation System inoperable, restore to operable status within 7 days.
- d. With the BWST water volume or boron concentration out-of-specification, suspend all operations involving CORE ALTERATIONS and/or the Reactor Coolant System and restore the BWST to specification within 72 hours.

## LIMITING CONDITIONS FOR OPERATION

---

### BORON CONCENTRATION

3.1.1.2 The boron concentration of the coolant in all filled portions of the Reactor Coolant System shall be maintained between 4350 and 6000 ppm and at a temperature above 50°F.

APPLICABILITY: RECOVERY MODE

#### ACTION:

If either of the above conditions are not satisfied (Boron Concentration between 4350 and 6000 ppm and temperature above 50°F) immediately suspend all activities involving CORE ALTERATION or the Reactor Coolant System and take action in accordance with procedures approved pursuant to Specification 6.8.2 to restore the concentration to within acceptable limits.

3.1.1.3 The boron concentration of the water in all filled portions of the Fuel Transfer Canal (deep end) and the Spent Fuel Storage Pool "A" shall be maintained between 4350 and 6000 ppm.

APPLICABILITY: RECOVERY MODE

#### ACTION

If the above condition is not satisfied (Boron Concentration between 4350 and 6000 ppm), take action necessary to restore the boron concentration to within acceptable limits.

### 3.1.3 CONTROL ASSEMBLIES

#### MECHANISMS

3.1.3.1 deleted.



## LIMITING CONDITIONS FOR OPERATION

### 3.3 INSTRUMENTATION

#### 3.3.1 NEUTRON MONITORING INSTRUMENTATION

##### INTERMEDIATE AND SOURCE RANGE NEUTRON FLUX MONITORS

3.3.1.1 As a minimum, the intermediate and source range neutron monitoring instrumentation channels of Table 4.3-1 shall be OPERABLE.

APPLICABILITY: RECOVERY MODE

ACTION:

- a. With the number of source range neutron monitoring channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement of Table 4.3-1, restore inoperable channel to OPERABLE status within 30 days. If the inoperable channel cannot be restored to OPERABLE status within 30 days, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 30 days outlining the cause of the malfunction and the plans for monitoring the condition of the core.
- b. With no source range neutron monitoring channels OPERABLE, suspend all activities involving CORE ALTERATION, verify compliance with the boron concentration requirements of Specification 3.1.1.2 at least once per 24 hours by a mass balance calculation and at least once per 7 days by a chemical analysis and restore at least one source range neutron monitoring channel to operable status within 7 days. If not restored to operable status within 7 days, promptly, but not later than 30 days from loss of operability, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2, outlining the cause of the malfunction(s), the plans for monitoring the condition of the core and the plans for resumption of activities involving CORE ALTERATIONS.
- c. With no intermediate range neutron monitoring channels OPERABLE, restore at least one intermediate range channel to OPERABLE status within 7 days. If not restored to OPERABLE status within 7 days, promptly, but not later than 30 days from loss of OPERABILITY, prepare and submit a special report to the Commission pursuant to Specification 6.9.2, outlining the cause of the malfunction(s) and the plans for monitoring the condition of the core.

#### 3.3.2 ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION

3.3.2.1 The Engineered Safety Feature Actuation System (ESFAS) instrumentation channels shown in Table 4.3-2 shall be OPERABLE with their Trip Setpoints set in accordance with the values shown in the Trip Setpoint column of Table 4.3-2.

Table 3.3-1

NEUTRON MONITORING INSTRUMENTATION

TRANSFERRED TO TABLE 4.3-1 OF THE RECOVERY OPERATIONS PLAN

TABLE 3.3-3

ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION

TRANSFERRED TO TABLE 4.3-2 OF THE RECOVERY OPERATIONS PLAN

TABLE 3.3-4

ENGINEERED SAFETY FEATURE ACTUATION SYSTEMS INSTRUMENTATION TRIP SETPOINTS

TRANSFERRED TO TABLE 4.3-2 OF THE RECOVERY OPERATIONS PLAN

## LIMITING CONDITIONS FOR OPERATION

APPLICABILITY: RECOVERY MODE.

ACTION:

- a. With an ESFAS instrumentation channel trip setpoint less conservative than the value shown in the Allowable Values column of Table 4.3-2 declare the channel inoperable and apply the applicable ACTION requirement of Table 4.3-2 until the channel is restored to OPERABLE status with the trip setpoint adjusted consistent with the Trip Setpoint Value.
- b. With an ESFAS instrumentation channel inoperable, take the action shown in Table 4.3-2.

### 3.3.3 MONITORING INSTRUMENTATION

#### RADIATION MONITORING INSTRUMENTATION

3.3.3.1 The radiation monitors listed in Table 4.3-3 of the RECOVERY OPERATIONS PLAN shall be OPERABLE

APPLICABILITY: As Required in Table 4.3-3 of the RECOVERY OPERATIONS PLAN.

ACTION:

As Required in Table 4.3-3 of the RECOVERY OPERATIONS PLAN.

#### SEISMIC INSTRUMENTATION

3.3.3.3 Deleted

#### METEOROLOGICAL INSTRUMENTATION

3.3.3.4 The meteorological monitoring instrumentation channels shown in Table 4.3-5 of the RECOVERY OPERATIONS PLAN shall be OPERABLE.

APPLICABILITY: RECOVERY MODE

ACTION:

With any of the above required meteorological monitoring channels inoperable, restore the inoperable channel(s) to OPERABLE status within 8 hours.

TABLE 3.3-7

SEISMIC MONITORING INSTRUMENTATION

DELETED

TABLE 3.3-8

METEOROLOGICAL MONITORING INSTRUMENTATION

Transferred to Table 4.3-5 of the Recovery Operations Plan.

## LIMITING CONDITIONS FOR OPERATION

### ESSENTIAL PARAMETERS MONITORING INSTRUMENTATION

3.3.3.5 The Essential Parameters Monitoring Instrumentation shall be OPERABLE in accordance with the requirements of Table 4.3-7 of the RECOVERY OPERATIONS PLAN.

APPLICABILITY: RECOVERY MODE.

#### ACTION:

- a. With the exception of the Reactor Vessel Water Level Monitoring instrumentation, the Spent Fuel Storage Pool "A" Water Level monitoring instrumentation, and the Fuel Transfer Canal (Deep End) Water Level monitoring instrumentation, for instrumentation not in accordance with the requirements of Table 4.3-7 of the RECOVERY OPERATIONS PLAN, restore the inoperable instrument(s) to the requirements of Table 4.3-7 of the RECOVERY OPERATIONS PLAN within 72 hours.
- b. The operability requirements for the Reactor Vessel Water Level monitoring instrumentation shall be as specified in specification 3.4.2.
- c. The operability requirements for the Spent Fuel Storage Pool "A" Water Level Monitoring instrumentation shall be as specified in specification 3.9.1.
- d. The operability requirements for the Fuel Transfer Canal (Deep End) Water Level monitoring instrumentation shall be as specified in specification 3.9.3.

### POST-ACCIDENT INSTRUMENTATION

3.3.3.6 Deleted.

### CHLORINE DETECTION SYSTEMS

3.3.3.7 Two chlorine detection systems, with their alarm/trip setpoints adjusted to actuate at a chlorine concentration of less than or equal to 5 ppm, shall be OPERABLE:

- a. One at the air intake tunnel, and
- b. One at the Control Room air supply duct.

APPLICABILITY: RECOVERY MODE.

#### ACTION: 1

With one or more chlorine detection systems inoperable, within 1 hour initiate and maintain operation of the Control Room Emergency Ventilation System in the recirculation mode of operation; restore the inoperable detection system to OPERABLE status within 30 days.



## LIMITING CONDITIONS FOR OPERATION

### FIRE DETECTION

3.3.3.8 As a minimum, the fire detection instrumentation for each fire detection zone shown in Table 4.3-11 of the RECOVERY OPERATIONS PLAN shall be OPERABLE.

APPLICABILITY: RECOVERY MODE

### ACTION:

With the number of OPERABLE fire detection instruments less than required by Table 4.3-11 of the RECOVERY OPERATIONS PLAN, insure that an alternate instrument with the same coverage is OPERABLE, or;

1. Within 1 hour, establish a fire watch patrol to inspect the zone with the inoperable instrument(s) at least once per hour, and
2. Restore the inoperable instrument(s) to OPERABLE status within 14 days.

TABLE 3.3-9

REMOTE SHUTDOWN MONITORING INSTRUMENTATION

Contents of this Table moved to Table 4.3-7  
of the Recovery Operation Plan

TABLE 3.3-10

POST-ACCIDENT MONITORING INSTRUMENTATION

Deleted

TABLE 3.3-11

FIRE DETECTION INSTRUMENTS

Transferred to Table 4.3-11 of the Recovery Operations Plan

## LIMITING CONDITIONS FOR OPERATION

### 3.4 REACTOR COOLANT SYSTEM

#### REACTOR COOLANT LOOPS

3.4.1 The Reactor Coolant System shall be operated in accordance with procedures approved pursuant to Specification 6.8.2.

APPLICABILITY: RECOVERY MODE.

#### ACTION:

None except as provided in Specification 3.0.3.

#### REACTOR VESSEL WATER LEVEL MONITORING

3.4.2 As a minimum two independent reactor vessel level monitoring instruments shall be OPERABLE.

APPLICABILITY: RECOVERY MODE WITH THE RV HEAD REMOVED

#### ACTION

- a. With only one reactor vessel level monitoring instrument OPERABLE, terminate all activities involving changes in the reactor coolant system water volume, restore the system to OPERABLE status within 72 hours.
- b. With no reactor vessel level monitoring instrument OPERABLE, terminate all activities involving changes in the reactor coolant system water volume. Restore the system to OPERABLE status within 24 hours.

#### SAFETY VALVES

3.4.3 Deleted.

### 3.4.9 PRESSURE/TEMPERATURE LIMITS

#### REACTOR COOLANT SYSTEM

3.4.9.1 The Reactor Coolant System shall be maintained between a  $T_{avg}$  of less than 200°F and greater than 50°F.

3.4.9.2 The Reactor Coolant System shall remain open to the reactor building atmosphere unless repressurization is approved in a safety evaluation submitted to the NRC. This safety evaluation and associated procedures approved pursuant to Specification 6.8.2 shall specify the maximum pressure limits and over-pressure protection that is required.

## LIMITING CONDITIONS FOR OPERATION

---

APPLICABILITY: RECOVERY MODE

ACTION:

With the Reactor Coolant System temperature exceeding the temperature limits, immediately adjust the Reactor Coolant System temperature to within limits and submit a report pursuant to Specification 3.0.3.



## LIMITING CONDITIONS FOR OPERATION

---

### 3.5 COMMUNICATIONS

#### 3.5.1 Control Room

Direct communication shall be maintained between the Control Room or the Command Center and personnel in the Reactor Building. As stated in Table 6.2-1, the additional SOL or SOL limited to fuel handling, notwithstanding location, will have direct communications with personnel in the Reactor Building performing CORE ALTERATIONS.

APPLICABILITY: During CORE ALTERATIONS

ACTION:

When direct communication between the Control Room or the Command Center and personnel in the Reactor Building as stated in the above specification cannot be maintained, suspend all operations involving CORE ALTERATIONS and restore communications to OPERABLE status.

## LIMITING CONDITIONS FOR OPERATION

### 3.6 CONTAINMENT SYSTEMS

#### 3.6.1 PRIMARY CONTAINMENT

##### CONTAINMENT INTEGRITY

3.6.1.1 Primary CONTAINMENT INTEGRITY shall be maintained unless it is not required per procedures approved pursuant to Specification 6.8.2.

APPLICABILITY: RECOVERY MODE.

##### ACTION:

With containment integrity required and one containment isolation valve per containment penetration open or inoperable, maintain the affected penetration(s) closed with either:

- a. At least one deactivated automatic valve secured in the isolation position, or
- b. At least one closed manual valve, or a blind flange.

##### CONTAINMENT AIR LOCKS

3.6.1.3 Each containment air lock shall be OPERABLE with:

- a. Both doors closed except when the air lock is being used for transit entry and exit through the containment, then at least one air lock door shall be closed unless otherwise specified per procedures approved pursuant to Specification 6.8.2.
- b. Deleted

APPLICABILITY: RECOVERY MODE.

##### ACTION:

With an air lock inoperable, maintain at least one door closed and restore the air lock to OPERABLE status within 24 hours.

##### INTERNAL PRESSURE

3.6.1.4 Primary containment pressure shall be maintained from 0 psig to not less than 12.2 psia.

## LIMITING CONDITIONS FOR OPERATION

---

APPLICABILITY: RECOVERY MODE.

ACTION:

With the containment internal pressure outside the above limits, restore the internal pressure to within the limits within 1 hour.

AIR TEMPERATURE

3.6.1.5 Primary containment average air temperature shall be maintained between 50°F and 130°F.

APPLICABILITY: RECOVERY MODE.

ACTION:

With the containment average air temperature outside the above limits, restore the average air temperature to within the limits within 24 hours.

3.6.3 CONTAINMENT PURGE EXHAUST SYSTEM

3.6.3.1 One train of the Containment Purge Exhaust System shall be OPERABLE.

APPLICABILITY: During Purge Operations

ACTION:

With no Containment Purge Exhaust train OPERABLE, secure the Containment Purge System and restore one train to OPERABLE status within 7 days.

3.6.4 COMBUSTIBLE GAS CONTROL

3.6.4.1 Deleted

HYDROGEN PURGE CLEANUP SYSTEM

3.6.4.3 Deleted

Figure 3.6-1

Minimum Allowable Containment Pressure as a Function of BWST Temperature  
and Containment Average Air Temperature

DELETED

TABLE 3.6-2  
PENETRATIONS WITHOUT DOUBLE ISOLATION

<u>Penetration</u>	<u>Function</u>	<u>System</u>
R-573* R-574* R-575* R-576*	Reactor Coolant Pump Seal Water Supply	MU
R-577* R-579* R-584* R-587* R-580*	Reactor Building Air Unit Cooling Water	RR
R-583* R-586*	Reactor Building Spray Inlet Line	BS
R-589* R-590*	Deca / Heat Coolant Supply	DH
R-591* R-592*	High Pressure Injection	MU
R-537*	Nitrogen and Fill to Core Flooding Tank	CF
R-539*	Leakage Cooling	DC
R-542*	Pressurizer Auxiliary Spray	DH
R-544*	Nitrogen and Fill to Core Flooding Tank	CF
R-557*	Nuclear Services Closed Cooling Water to Reactor Coolant Pump Oil and Motor Coolers	NS
R-559*	Intermediate Closed Cooling Water to Roller Nut Drive Cooling Coils	IC
R-563*	Intermediate Closed Cooling System	IC
R-566*	Service Air	SA
R-570* R-572*	High Pressure Injection	MU

<u>Penetration</u>	<u>Function</u>	<u>System</u>
R-545A# R-554C# R-571C#	Building Pressure	BS
R-562C#	Building Spray System Pressure System	BS
R-593# R-594#	Sump Penetration Sleeve and Drain Line	DH
R-616# R-623#	Auxiliary Feedwater Lines	EF
R-617# R-618#	Feedwater Lines	FW
R-619# R-620# R-621# R-622#	Steam Lines	MS

Codes: BS-- Reactor Building Spray  
 CF-- Core Flooding  
 DC-- Decay Heat Closed Cooling Water  
 DH-- Decay Heat Removal  
 EF-- Emergency Feedwater  
 FW-- Feedwater  
 IC-- Intermediate Closed Cooling Water  
 MU-- Makeup and Purification  
 RR-- Reactor Building Emergency Cooling - River Water  
 SA-- Station Service Air  
 MS-- Main Steam  
 NS-- Nuclear Services Closed Cooling Water

\* Penetrations which utilize a check valve inside containment as a containment isolation valve

# Penetrations which have single valve isolation

†



LIMITING CONDITIONS FOR OPERATION

---

3.7 PLANT SYSTEMS

3.7.1 FEEDWATER SYSTEM

Deleted by Amendment of Order Dated April 1, 1982.

3.7.2 SECONDARY SERVICES CLOSED COOLING WATER SYSTEM

Deleted by Amendment of Order Dated April 1, 1982.

3.7.3 CLOSED CYCLE COOLING WATER SYSTEM

NUCLEAR SERVICES CLOSED CYCLE COOLING SYSTEM

3.7.3.1 Deleted.

DECAY HEAT CLOSED COOLING WATER SYSTEM

3.7.3.2 Deleted.

MINI DECAY HEAT REMOVAL SYSTEM (MDHRS)

3.7.3.3 Deleted.

LIMITING CONDITIONS FOR OPERATION

---

3.7.4 NUCLEAR SERVICE RIVER WATER SYSTEM

3.7.4.1 Two independent Nuclear Service River Water loops shall be OPERABLE.

APPLICABILITY: RECOVERY MODE.

ACTION: -

With one Nuclear Service River Water loop inoperable, restore the inoperable loop to OPERABLE status within 72 hours.

## LIMITING CONDITIONS FOR OPERATION

---

### 3.7.6 FLOOD PROTECTION

3.7.6.1 Flood protection shall be provided for all Safety Related systems, components and structures when the water level of the Susquehanna River exceeds 301 feet Mean Sea Level USGS datum, at the river water intake structure of Three Mile Island Nuclear Station, Unit 1.

APPLICABILITY: At all times.

ACTION:

- a. With the water level at the Unit 1 Intake Structure approaching 301 feet Mean Sea Level USGS datum:
  1. Initiate patrol and inspection of the dikes surrounding the site for signs of deterioration such as undermining or excessive seepage.
  2. Inform the Site Operations Director (SOD) and as directed by the SOD:
    - a) Prepare all flood panels and door seals for installation,
    - b) Check all building floor drains and pumps to ensure proper operation,
    - c) Commence daily soundings of the Intake Screen House Floor,
    - d) Check all water tight doors to ensure proper operation,
    - e) Fill all outdoor storage tanks to inhibit floatation, and
    - f) Arrange for alternate supplies of diesel fuel oil and ensure fuel storage tanks are filled.
    - g) Check that all containers are sealed and secure in the Southeast Storage Facility.
- b. With the water level at the Unit 1 Intake Structure exceeding 301 feet and approaching 302 feet Mean Sea Level USGS datum:
  1. Ensure all door seals and flood panels are installed and all water tight doors are closed within 2 hours,
  2. Inform the Director Site Operations.

## LIMITING CONDITIONS FOR OPERATION

### 3.7.7 CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM

3.7.7.1 The Control Room Ventilation and Emergency Air Cleanup System shall be OPERABLE with:

- a. Two Control Room supply Fans and associated cooling coils,
- b. Two Control Room Bypass Fans,
- c. One charcoal adsorber and HEPA filter train, and
- d. Two isolation dampers in the outside air intake duct.
- e. The Control Room air inlet radiation monitor OPERABLE.

APPLICABILITY: RECOVERY MODE

#### ACTION:

- a. With one Control Room Supply Fan or its associated cooling coil inoperable, restore the inoperable fan and/or cooling coil to OPERABLE status within 7 days.
- b. With one Control Room Bypass Fan inoperable restore the inoperable fan to OPERABLE status within 7 days.
- c. With the filter train inoperable, restore the filter train to OPERABLE status within 24 hours.
- d. With one isolation damper in the outside air intake duct inoperable, restore the inoperable damper to OPERABLE status or close the duct within 4 hours by use of at least one isolation damper secured in the closed position.
- e. With the Control Room Air Inlet Radiation Monitor inoperable, restore it to OPERABLE status or place the Control Room Emergency Air Cleanup System in the recirculation mode of operation within 4 hours.

## LIMITING CONDITIONS FOR OPERATION

---

### 3.7.9 SEALED SOURCES

#### SEALED SOURCE INTEGRITY

3.7.9.1 Each sealed source containing radioactive material either in excess of 100 microcuries of beta and/or gamma emitting material or 5 microcuries of alpha emitting material (except as noted in 4.7.9.2) shall be free of  $\geq 0.005$  microcuries of removable contamination.

APPLICABILITY: RECOVERY MODE

#### ACTION:

- a. Each sealed source with removable contamination in excess of the above limit shall be immediately withdrawn from use and:
  1. Either decontaminated and repaired, or
  2. Disposed of in accordance with Commission Regulations.
- b. The provisions of Specification 3.0.3 are not applicable.

## LIMITING CONDITIONS FOR OPERATION

### 3.7.10 FIRE SUPPRESSION SYSTEMS

#### FIRE SUPPRESSION WATER SYSTEM

3.7.10.1 The FIRE SUPPRESSION WATER SYSTEM shall be OPERABLE with;

- a. At least 2 of the following 4 high pressure pumps shall be OPERABLE with their discharge aligned to the fire suppression header:
  1. Unit 1 Circulating Water Flume Diesel Fire Pump
  2. Unit 1 River Water Intake Diesel Fire Pump
  3. Unit 2 River Water Intake Diesel Fire Pump
  4. Unit 1 River Water Intake Motor Fire Pump
- b. Two (2) separate water supplies of the following four (4) shall be available with at least 90,000 gallons each:
  1. Altitude Tank
  2. Unit 1 Circulating Water Flume
  3. Unit 1 River Water Intake Structure
  4. Unit 2 River Water Intake Structure
- c. An OPERABLE flow path capable of taking suction from a water supply and transferring the water through distribution piping with OPERABLE sectionalizing control or isolation valves to the yard hydrant curb valves and the first valve ahead of the water flow alarm device on each sprinkler, hose standpipe, or spray system riser required to be OPERABLE per Specification 3.7.10.2 and 3.7.10.4.

APPLICABILITY: RECOVERY MODE

ACTION:

- a. With 3 pumps or 3 water supplies inoperable, restore the inoperable equipment to OPERABLE status within 7 days.



LIMITING CONDITIONS FOR OPERATION

---

FIRE SUPPRESSION WATER SYSTEM (Continued)

ACTION (Continued)

- b. With the Fire Suppression Water System otherwise inoperable:
1. Establish a backup Fire Suppression Water System within 24 hours.
  2. Deleted.

## LIMITING CONDITIONS FOR OPERATION

### DELUGE/SPRINKLER SYSTEMS

3.7.10.2 The Deluge and/or Sprinkler Systems located in the following areas shall be OPERABLE:

- a. Diesel Generator Fuel Oil Tanks
- b. Diesel Generator Building Air Intake
- c. Air Intake Tunnel (Deluge - 2 of the 3 zones)
- d. Hydrogen Purge Exhaust Filter AH-F-34#
- e. Reactor Building Purge Exhaust Filters AH-F-31A/B#
- f. Control Room Bypass Filter AH-F-5
- g. Diesel Generator Rooms
- h. Fuel Handling Building Exhaust Filter AH-F-14A/B#
- i. Waste gas disposal filter WDG-F-1
- j. Auxiliary Building exhaust filters AH-F-10A/B#
- k. Southeast Storage Facility\*\*\*

APPLICABILITY: RECOVERY MODE.

#### ACTION:

With one or more of the above required deluge and/or sprinkler systems inoperable, establish a roving (at least once per hour) fire watch with backup fire suppression equipment for the unprotected area(s) within 1 hour; restore the system to OPERABLE status within 14 days.

\*\*\*This facility's Action Statement shall require a roving fire watch once per 24 hours instead of once per hour.

#Supply line may be isolated by a single manually operated valve.

## LIMITING CONDITIONS FOR OPERATION

---

### HALON SYSTEM

3.7.10.3 The following Halon systems shall be OPERABLE with the storage tanks having at least 95% of full charge weight and 90% of full charge pressure (corrected to 70°F).

- a. Cable Room and Transformer Room - Control Building 305' elevation.
- b. Air Intake Tunnel (4 Zones)

APPLICABILITY: RECOVERY MODE

#### ACTION:

With one or more of the above required Halon systems inoperable, establish a roving (at least once per hour) fire watch\* with backup fire suppression equipment for the unprotected area(s) within 1 hour; restore the system to OPERABLE status within 14 days.

### FIRE HOSE STATIONS

3.7.10.4 The fire hose stations listed in Table 4.7-1 of the RECOVERY OPERATIONS PLAN shall be OPERABLE:

APPLICABILITY: RECOVERY MODE

#### ACTION:

With one or more of the fire hose stations shown in Table 4.7-1 inoperable, route an additional equivalent capacity fire hose to the unprotected area(s) from an OPERABLE hose station within 1 hour.

---

\*Except in the air intake tunnel where a fire watch is not required.

TABLE 3.7-4

FIRE HOSE STATIONS

Transferred to Table 4.7-1 of the Recovery Operations Plan

## LIMITING CONDITIONS FOR OPERATION

---

### PENETRATION FIRE BARRIERS

3.7.11 All Penetration Fire Barriers protecting Safety Related areas shall be functional.

APPLICABILITY: RECOVERY MODE

#### ACTION:

With one or more of the above-required Penetration Fire Barriers non-functional:

1. Establish a roving (at least once per hour) fire watch on at least one side of the affected penetration within 1 hour, except areas inaccessible due to occupational exposure considerations and
2. For those areas inaccessible due to occupational exposure considerations, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 30 days outlining the cause of the malfunction and the means for ensuring an adequate firewatch is maintained in the affected area and for restoring the fire barrier(s) to a functional status.

## LIMITING CONDITIONS FOR OPERATION

### 3.8 ELECTRICAL POWER SYSTEMS

#### 3.8.1 A.C. SOURCES

3.8.1.1 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. Two physically independent circuits between the offsite transmission network and the onsite Class 1E distribution system.
- b. Two separate and independent Class 1E diesel generators each with:
  1. A separate day fuel tank containing a minimum volume of 500 gallons of fuel.
  2. A separate fuel storage system containing a minimum volume of 19,000 gallons of fuel.
  3. A separate fuel transfer pump.

APPLICABILITY: RECOVERY MODE.

#### ACTION:

- a. With either an offsite circuit or diesel generator of the above required A.C. electrical power sources inoperable, demonstrate the OPERABILITY of the remaining A. C. sources by performing Surveillance Requirements 4.8.1.1.1 and 4.8.1.1.2.a.4 in accordance with the applicable row in the Testing Frequency Matrix of Table 3.8-1; restore the full complement of the above required A.C. electrical power sources to OPERABLE status within 7 days.
- b. With one offsite circuit and one diesel generator or two offsite circuits or two diesel generators of the above required A. C. electrical power sources inoperable, demonstrate the OPERABILITY of the remaining A.C. sources by performing Surveillance Requirements 4.8.1.1.1 and 4.8.1.1.2.a.4 in accordance with the applicable two rows in the Testing Frequency Matrix of Table 3.8-1; restore at least one of the inoperable sources to OPERABLE status in accordance with the Restoration Time Matrix of Table 3.8-2. Restore the full complement of the above required A.C. electrical power sources to OPERABLE status within 7 days from the time of initial loss.



TABLE 3.8-1  
TESTING FREQUENCY MATRIX

		Component Testing Frequencies			
		a <sub>1</sub>	a <sub>2</sub>	b <sub>1</sub>	b <sub>2</sub>
I N O P E R A B L E	C O M P O N E N T	a <sub>1</sub>		*	**
		a <sub>2</sub>	*		**
		b <sub>1</sub>	*	*	*
		b <sub>2</sub>	*	*	*

Key:

- a<sub>1</sub> Offsite power circuit No. 1
- a<sub>2</sub> Offsite power circuit No. 2
- b<sub>1</sub> Class IE diesel generator (Red)
- b<sub>2</sub> Class IE diesel generator (Green)

- \*Within 12 hours
- \*\*Within 12 hours unless the diesel generator has been demonstrated OPERABLE per Surveillance Requirement 4.8.1.1.2 within the previous 7 days, then demonstration of diesel generator operability is not required.

TABLE 3.8-2  
RESTORATION TIME MATRIX

		Restore One Component (Hours)	Restore Other Component (days)
Combination of Two Inoperable Components	aa	24	7
	ab	12	7
	bb	12	7

Note: a and b above correspond to components described in Specification 3.8.1.1, items a and b respectively.

## LIMITING CONDITIONS FOR OPERATION

---

### 3.8.2 ONSITE POWER DISTRIBUTION SYSTEMS

#### A.C. DISTRIBUTION

3.8.2.1 The following A.C. electrical busses listed in Section 4.8.2.1 of the RECOVERY OPERATIONS PLAN shall be OPERABLE and energized with tie breakers open (unless closed in accordance with procedures approved pursuant to Specification 6.8.2) between redundant busses.

APPLICABILITY: RECOVERY MODE.

#### ACTION:

With less than the above complement of A.C. busses OPERABLE, restore the inoperable bus to OPERABLE status within 8 hours.

## LIMITING CONDITIONS FOR OPERATION

### D.C. DISTRIBUTION

3.8.2.3 The following D.C. bus trains shall be energized and OPERABLE with tie breakers between bus trains open (unless closed in accordance with approved procedures):

TRAIN "A" consisting of 250/125-volt D.C. bus 2-1DC, 250/125-volt D.C. battery bank A and a full capacity charger.

TRAIN "B" consisting of 250/125-volt D.C. bus 2-2DC, 250/125-volt D.C. battery bank B, and a full capacity charger.

APPLICABILITY: RECOVERY MODE.

### ACTION:

- a. With one 250/125-volt D.C. bus inoperable, restore the inoperable bus to OPERABLE status within 2 hours.
- b. With one 250/125-volt D.C. battery and/or its charger inoperable, restore the inoperable battery and/or charger to OPERABLE status within 2 hours.

## LIMITING CONDITIONS FOR OPERATION

### 3.9 RADIOACTIVE WASTE STORAGE

#### SPENT FUEL STORAGE POOL "A" WATER LEVEL MONITORING

3.9.1 Two independent Spent Fuel Storage Pool "A" water level monitoring instruments shall be OPERABLE.

APPLICABILITY: Whenever any Canister containing core material is in the Spent Fuel Storage Pool "A".

ACTION:

- a. With only one Spent Fuel Storage Pool "A" water level monitoring instrument OPERABLE, immediately verify that the water level is within limits, re-verify the level at least once per 24 hours and restore a second instrument to OPERABLE status within 7 days.
- b. With no Spent Fuel Storage Pool "A" water level monitoring instruments OPERABLE, terminate all activities involving any Canister containing core material in or over Spent Fuel Storage Pool "A" and all operations involving changes in Spent Fuel Storage Pool "A" water inventory and restore at least one instrument to OPERABLE status within 24 hours.

#### SPENT FUEL STORAGE POOL "A" WATER LEVEL

3.9.2 The water level in Spent Fuel Storage Pool "A" shall be maintained as specified per NRC approved procedures.

APPLICABILITY: Whenever any Canister containing core material is in the Spent Fuel Storage Pool "A".

ACTION:

With Spent Fuel Storage Pool "A" water level not in accordance with approved procedures, terminate all activities involving any Canister containing core material in or over Spent Fuel Storage Pool "A" and restore the water level to within specification within 24 hours.

#### FUEL TRANSFER CANAL (DEEP END) WATER LEVEL MONITORING

3.9.3 Two independent Fuel Transfer Canal (deep end) water level monitoring instruments shall be OPERABLE.

APPLICABILITY: Whenever any Canister containing core material and/or the plenum assembly is in the Fuel Transfer Canal (deep end).

ACTION:

- a. With only one Fuel Transfer Canal (deep end) water level monitoring instrument OPERABLE, immediately verify that the water level is within limits, re-verify the level at least once per 24 hours and restore a second instrument to OPERABLE status within 7 days.



## LIMITING CONDITIONS FOR OPERATION

- b. With no Fuel Transfer Canal (deep end) water level instruments OPERABLE, terminate all activities involving any Canister containing core material in or over the Fuel Transfer Canal (deep end) and/or all activities involving the plenum assembly and all operations involving changes in the Fuel Transfer Canal (deep end) water inventory and restore one inoperable instrument to OPERABLE status within 24 hours.

### FUEL TRANSFER CANAL (DEEP END) WATER LEVEL

3.9.4 The water level in the Fuel Transfer Canal (deep end) shall be maintained at the level specified per NRC approved procedures.

APPLICABILITY: Whenever any Canister containing core material and/or the plenum assembly is in the Fuel Transfer Canal (deep end).

#### ACTION:

With the Fuel Transfer Canal (deep end) water level not in accordance with approved procedures, terminate all activities involving any Canister containing core material in or over the Fuel Transfer Canal (deep end) and/or all activities involving the plenum assembly and restore the water level to within specification within 24 hours.

### FUEL HANDLING BUILDING/AUXILIARY BUILDING AIR CLEANUP SYSTEMS

3.9.12.1 The Fuel Handling Building Air Cleanup Exhaust System shall be OPERABLE with exhaust ventilation flow through the HEPA filters during system operation. The Fuel Handling Building Air Cleanup Exhaust System is OPERABLE when two of the four system air cleanup exhaust fans are OPERABLE.

APPLICABILITY: RECOVERY MODE

#### ACTION:

- a. With the Fuel Handling Building Air Cleanup Exhaust System inoperable due to flow requirements, return the flow to within acceptable limits within four (4) hours or;
- b. With the Fuel Handling Building Air Cleanup Exhaust System inoperable (other than as allowed in paragraph 3.9.12.1 a above), suspend all operations involving movement of liquid and gaseous radioactive wastes in the Fuel Handling Building (other than sampling evolutions required by the Technical Specifications or RECOVERY OPERATIONS PLAN) until the system is restored to OPERABLE status.



## LIMITING CONDITIONS FOR OPERATION

---

3.9.12.2 The Auxiliary Building Air Cleanup Exhaust System shall be OPERABLE with exhaust ventilation flow through the HEPA filters during system operation. The Auxiliary Building Air Cleanup Exhaust System is OPERABLE when two of the four system air cleanup exhaust fans are OPERABLE.

APPLICABILITY: RECOVERY MODE

ACTION:

- a. With the Auxiliary Building Air Cleanup Exhaust System inoperable due to flow requirements, return the flow to within acceptable limits within four (4) hours or;
- b. With the Auxiliary Building Air Cleanup Exhaust System inoperable (other than as allowed in paragraph 3.9.12.2 a above), suspend all operations involving movement of liquid and gaseous radioactive wastes in the Auxiliary Building (other than sampling evolutions required by the Technical Specifications or RECOVERY OPERATIONS PLAN) until the system is restored to OPERABLE status.

### ACCIDENT GENERATED WATER

3.9.13 Discharge of ACCIDENT GENERATED WATER shall be prohibited until approved by the NRC. ACCIDENT GENERATED WATER shall be discharged in accordance with procedures approved pursuant to Specification 6.8.2.

APPLICABILITY: RECOVERY MODE

ACTION:

None except as provided in Specification 3.0.3.

### REACTOR BUILDING SUMP WATER

3.9.14 Deleted.

## LIMITING CONDITIONS FOR OPERATION

---

### 3.10 CRANE OPERATIONS

#### CONTAINMENT BUILDING

3.10.1 Loads in excess of 2400 lbs. shall be prohibited from travel over the following areas unless a docketed Safety Evaluation for the activity is approved by the NRC:

- a. reactor vessel
- b. incore instrument seal table and guide tubes (includes travel by polar crane block)
- c. deep end of the Fuel Transfer Canal
- d. any Canister that contains core material regardless of its location
- e. areas not previously analyzed in a docketed, NRC approved load drop analysis

APPLICABILITY: RECOVERY MODE

#### ACTION:

With the requirements of the above specification not satisfied, place the crane load in a safe condition and correct the circumstances which caused or allowed the Limiting Condition for Operations to be exceeded prior to continuing crane operations limited by Specification 3.10.1. Prepare and submit a special report to the Commission pursuant to Specification 6.9.2 within the next 30 days.

#### FUEL HANDLING BUILDING

3.10.2 Loads in excess of 2400 lbs. shall be prohibited from travel over the following areas unless a docketed Safety Evaluation for the activity is approved by the NRC:

- a. any area of the spent fuel storage pool which contains one or more Canisters which contain core material
- b. any Canister that contains core material, regardless of its location
- c. areas not previously analyzed in a docketed, NRC approved load drop analysis

## LIMITING CONDITIONS FOR OPERATION

---

APPLICABILITY: RECOVERY MODE

ACTION:

With the requirements of the above specification not satisfied, place the crane load in a safe condition and correct the circumstances which caused or allowed the Limiting Condition for Operations to be exceeded prior to continuing crane operations limited by Specification 3.10.2. Prepare and submit a special report to the Commission pursuant to Specification 6.9.2 within the next 30 days.

BASES  
FOR  
LIMITING CONDITIONS FOR OPERATION  
SURVEILLANCE REQUIREMENTS

NOTE

The summary statements contained in this section provide the bases for the Specifications of Section 3.0 and 4.0 and are not considered a part of these Technical Specifications as provided in 10 CFR 50.36.

### 3/4.0 APPLICABILITY

#### BASES

---

The specifications of this section provide the general requirements applicable to each of the Limiting Conditions for Operation and Surveillance Requirements within Section 3/4.

3.0.1 This specification defines the applicability of each specification in terms of the RECOVERY MODE or other specified conditions and is provided to delineate specifically when each specification is applicable.

3.0.2 This specification defines those conditions necessary to constitute compliance with the terms of an individual Limiting Condition for Operation and associated ACTION requirement.

3.0.3 This specification delineates the ACTION to be taken for circumstances not directly provided for in the ACTION statements or when the provisions of the stated ACTION statement are not or cannot be complied with. The intent of this specification is to require that inoperable equipment be restored to an OPERABLE status in a prompt manner, that the unit be maintained in stable conditions, and that the Commission be promptly notified of such conditions.

4.0.1 This specification provides that surveillance activities necessary to insure the Limiting Conditions for Operation are met and will be performed during the RECOVERY MODE or other conditions for which the Limiting Conditions for Operation are applicable.

4.0.2 The provisions of this specification provide allowable tolerances for performing surveillance activities beyond those specified in the nominal surveillance interval. These tolerances are necessary to provide operational flexibility because of scheduling and performance considerations. The phrase "at least" associated with a surveillance frequency does not negate this allowable tolerance value and permits the performance of more frequent surveillance activities.

The tolerance values, taken either individually or consecutively over 3 test intervals, are sufficiently restrictive to ensure that the reliability associated with the surveillance activity is not degraded beyond that obtained from the nominal specified interval.



## APPLICABILITY

### BASES

---

4.0.3 The provisions of this specification set forth the criteria for determination of compliance with the OPERABILITY requirements of the Limiting Conditions for Operations. Under this criteria, equipment, systems or components are assumed to be OPERABLE if the associated surveillance activities have been satisfactorily performed within the specified time interval. Nothing in this provision is to be construed as defining equipment, systems or components OPERABLE, when such items are found or known to be inoperable although still meeting the Surveillance Requirements.

### 3.4.1 WATER INJECTION COOLING AND REACTIVITY CONTROL SYSTEMS

#### BASES

---

#### 3/4.1.1 BORATION CONTROL AND BORATED COOLING WATER INJECTION

The limitation on minimum boron concentration ensures that the core will remain subcritical under all credible conditions which may exist during the long-term cooling mode. The maximum boron concentration is provided to ensure that precipitation of boron will not occur in the RCS and thereby cause possible flow restrictions. The specification requires the OPERABILITY of systems capable of injecting borated cooling water into the RCS within the required boron concentration limits. The required volume of borated water in the BWST provides sufficient water to keep the core covered in the event of an unsolatable leak from the reactor vessel. The specified water volume is sufficient to provide a continuous supply of water to the vessel during the interim period before the recirculation flowpath from the Reactor Building Sump can be placed in service. Minimum boron concentration limits have been provided for the Refueling Canal (deep end) and Spent Fuel Storage Pool "A" to provide assurance that any event involving these volumes of water will not result in a margin of safety less than that analyzed for the reactor vessel.

#### 3/4.1.3 CONTROL ASSEMBLIES

All full-length control rods were fully inserted as a result of the reactor trip on March 28, 1979. This Specification has been deleted since the reactor vessel head has been removed.

### 3/4.3 INSTRUMENTATION

#### BASES

---

#### 3/4.3.1 NEUTRON MONITORING INSTRUMENTATION

The neutron monitoring instrumentation, which was included in the normal Reactor Protection System Instrumentation, provides information regarding the shutdown status of the core and it will be used to monitor changes in neutron generation.

#### 3/4.3.2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

Except for automatic starting of the diesel generators on loss of offsite power, all automatic features of the ESFAS instrumentation have been defeated. This action prevents inadvertent actuation of the ESF systems. The diesel generators will start automatically on loss of offsite power.

#### 3/4.3.3 MONITORING INSTRUMENTATION

##### 3/4.3.3.1 RADIATION MONITORING INSTRUMENTATION

The OPERABILITY of the radiation monitoring channels ensures that 1) the radiation levels are continually measured in the areas served by the individual channels and 2) the alarm or automatic action is initiated when the radiation level trip setpoint is exceeded.

##### 3/4.3.3.3 SEISMIC INSTRUMENTATION

Deleted.

## INSTRUMENTATION

### BASES

---

#### 3/4.3.3.4 METEOROLOGICAL INSTRUMENTATION

The OPERABILITY of the meteorological instrumentation ensures that sufficient meteorological data is available for estimating potential radiation doses to the public as a result of routine or accidental release of radioactive materials to the atmosphere. This capability is required to evaluate the need for initiating protective measures to protect the health and safety of the public. This instrumentation is consistent with the recommendations of Regulatory Guide 1.23, "Onsite Meteorological Programs," February 1972.

#### 3/4.3.3.5 ESSENTIAL PARAMETERS MONITORING INSTRUMENTATION

The OPERABILITY of the Essential Parameters Monitoring Instrumentation ensures that sufficient information is available on selected plant parameters to monitor and assess these variables. Neutron monitoring and Reactor Coolant System temperature indication are provided outside the Control Room in the event that Control Room habitability is lost. This is consistent with General Design Criterion 19 of 10 CFR 50, Appendix A.

#### 3/4.3.3.6 POST-ACCIDENT INSTRUMENTATION

Deleted.

#### 3/4.3.3.7 CHLORINE DETECTION SYSTEMS

The OPERABILITY of the chlorine detection systems ensures that an accidental chlorine release will be detected promptly and the Control Room Emergency Ventilation System will automatically isolate the Control Room and initiate its operation in the recirculation mode to provide the required protection. The Chlorine Detection Systems required by this specification are consistent with the recommendations of Regulatory Guide 1.95, "Protection of Nuclear Power Plant Control Room Operators Against an Accidental Chlorine Release," February 1975.

## INSTRUMENTATION

### BASES

---

#### 3/4.3.3.8 FIRE DETECTION INSTRUMENTATION

OPERABILITY of the Fire Detection Instrumentation ensures that adequate warning capability is available for the prompt detection of fires. This capability is required in order to detect and locate fires in their early stages. Prompt detection of fires will reduce the potential for damage to Safety Related equipment and is an integral element in the overall facility fire protection program.

In the event that a portion of the Fire Detection Instrumentation is inoperable, the establishment of frequent fire patrols in the affected areas is required to provide detection capability until the inoperable instrumentation is returned to service.

### 3/4.4 REACTOR COOLANT SYSTEM

#### BASES

---

#### 3/4.4.1 REACTOR COOLANT LOOPS

Alternative methods are available for removal of reactor decay heat. These methods include use of the Decay Heat Removal System, the Mini Decay Heat Removal System, and the "Loss to Ambient" cooling mode. Either of these cooling methods provides adequate cooling of the reactor and each method is available for decay heat removal. Procedures have been prepared and approved for use of these cooling methods.

#### 3/4.4.2 REACTOR VESSEL WATER LEVEL MONITORING

The Reactor Vessel Water Level Monitor ensures that indication is available to monitor for changes in reactor vessel water level. This device will provide warning of a leak from the Reactor Coolant System or unexplained increases in Reactor Coolant System inventory which could result in a boron dilution event. Two independent monitors are required to provide redundancy and to minimize the necessity to discontinue processing because of instrument failures.

#### 3/4.4.3 SAFETY VALVES

Deleted.

#### 3/4.4.9 PRESSURE/TEMPERATURE LIMIT

The Reactor Coolant System pressure and temperature will be controlled in accordance with approved procedures to prevent a nonductile failure of the Reactor Coolant System while at the same time preventing precipitation of the boron used to maintain subcriticality.

During the RECOVERY MODE, the Reactor Coolant System boundary will be modified periodically to meet recovery objectives. Whenever the Reactor Coolant System is not vented (open to the atmosphere), overpressure protection will be provided to ensure that the allowable RCS pressure is not exceeded.

Reactor coolant chemistry surveillance requirements are included in the RECOVERY OPERATIONS PLAN. These requirements provide assurance that localized corrosion or pitting in crevice areas, which could tend to promote stress corrosion cracking in heat affected zones of welds in stainless steel piping or components, will not occur.



## BASES

---

### 3/4.5 COMMUNICATIONS

The requirements for communications capability ensure that personnel in the Reactor Building can be promptly informed of significant changes in facility status or core reactivity conditions during CORE ALTERATIONS.

### 3/4.6 CONTAINMENT SYSTEMS

#### BASES

---

#### 3/4.6.1 PRIMARY CONTAINMENT

##### 3/4.6.1.1 CONTAINMENT INTEGRITY

Primary CONTAINMENT INTEGRITY is maintained as required per procedure to ensure that radioactive materials in the Containment Building are not released to the environment in an uncontrolled manner.

##### 3/4.6.1.3 CONTAINMENT AIR LOCKS

The containment air locks must be maintained OPERABLE to provide CONTAINMENT INTEGRITY. These air locks will be used during entries into the containment to ensure that radioactive materials are not being released to the environs. The preferred method for ensuring that radioactive materials are not released during these entries is to maintain at least one door closed at all times; however, to permit the passage of long items into the reactor building, both doors may be open simultaneously in accordance with procedures approved pursuant to Specification 6.8.2.

##### 3/4.6.1.4 INTERNAL PRESSURE

The negative pressure limit provides assurance that the Containment will not exceed its design negative pressure differential. The positive pressure limit provides assurance that leakage from the Containment will be limited for off-site dose consideration. During periods when both doors in either or both personnel air locks are open, the containment purge system will be operating to maintain Containment pressure within the limits of the Technical Specification.

##### 3/4.6.1.5 AIR TEMPERATURE

The average air temperature of the Containment atmosphere is currently being maintained between 50°F and 130°F. This condition will maximize the service life of the instrumentation and equipment installed in the Containment and ensure that Reactor Coolant System temperature does not drop below 50°F via LOSS-TO-AMBIENT. This temperature will ensure that boron will remain in solution. Continued OPERABILITY of these items is required to continue monitoring and mitigating the March 28, 1979 incident.

##### 3/4.6.3 CONTAINMENT PURGE EXHAUST SYSTEM

The OPERABILITY requirements for the Containment Purge Exhaust System ensure that during Containment purge operations all radioactive particulate material will be filtered through the HEPA filters prior to release to the atmosphere.

## CONTAINMENT SYSTEMS

### BASES

---

#### 3/4.6.4 COMBUSTIBLE GAS CONTROL

The gas partitioner is provided to analyze the hydrogen concentration in the containment atmosphere so that actions can be initiated to reduce the hydrogen concentration if it approaches its flammable limit. If excessive hydrogen concentrations are detected, appropriate actions will be initiated to reduce the hydrogen concentration to a safe level.

### 3/4.7 PLANT SYSTEMS

#### BASES

---

##### 3/4.7.1 FEEDWATER SYSTEM

Deleted by Amendment of Order Dated April 1, 1982.

##### 3/4.7.2 SECONDARY SERVICES CLOSED COOLING WATER SYSTEM

Deleted.

##### 3/4.7.3 CLOSED CYCLE COOLING WATER SYSTEM

###### 3/4.7.3.1 NUCLEAR SERVICES CLOSED CYCLE COOLING SYSTEM

Deleted.

###### 3/4.7.3.2 DECAY HEAT CLOSED COOLING WATER SYSTEM

Deleted.

###### 3/4.7.3.3 MINI DECAY HEAT REMOVAL SYSTEM (MDHRS)

Deleted.

##### 3/4.7.4 NUCLEAR SERVICE RIVER WATER SYSTEM

The Nuclear Service River Water System uses river water to cool the diesel generators. Therefore, it must be OPERABLE also. This system rejects its heat to the river as the Ultimate Heat Sink.

##### 3/4.7.6 FLOOD PROTECTION

The limitation on flood protection ensures that facility protective actions will be taken in the event of flood conditions. The limit of elevation of 302 ft. Mean Sea Level USGS datum is the elevation at which facility flood control measures are required to be taken to provide protection to Safety Related equipment.

## PLANT SYSTEMS

### BASES

---

#### 3/4.7.7 CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM

The OPERABILITY of the control room emergency air cleanup system ensures that 1) the ambient air temperature does not exceed the allowable temperature for continuous duty rating for the equipment and instrumentation cooled by this system and 2) the control room will remain habitable for operations personnel during and following all credible accident conditions. The OPERABILITY of this system in conjunction with control room design provisions is based on limiting the radiation exposure to personnel occupying the control room to 5 rem or less whole body, or its equivalent. This limitation is consistent with the requirements of General Design Criterion 19 of Appendix "A", 10 CFR 50.

#### 3/4.7.9 SEALED SOURCE CONTAMINATION

The limitation on removable contamination for sources requiring leak testing, including alpha emitters, is based on 10CFR70.39(c) limits for plutonium. This limitation will ensure that leakage from byproduct, source, and Special Nuclear Material sources will not exceed allowable intake values.

#### 3/4.7.10 FIRE SUPPRESSION SYSTEMS

The OPERABILITY of the Fire Suppression Systems ensures that adequate fire suppression capability is available to confine and extinguish fires occurring in any portion of the facility where Safety Related equipment is located. The Fire Suppression System consists of the water system, spray and/or sprinklers, Halon and fire hose stations. The collective capability of the Fire Suppression System is adequate to minimize potential damage to Safety Related equipment and is a major element in the Facility Fire Protection Program. Any two of the four main fire pumps provide combined capacity greater than 3575 gpm.

In the event that portions of the Fire Suppression Systems are inoperable, alternate backup fire fighting equipment is required to be made available in the affected areas until the affected equipment can be restored to service.

In the event that the Fire Suppression Water System becomes inoperable, immediate corrective measures must be taken since this system provides the major fire suppression capability of the plant. The requirement for a Special Report to the Commission provides for timely evaluation of the acceptability of the corrective measures to provide adequate fire suppression capability for the continued operation of the nuclear plant.



## PLANT SYSTEMS

### BASES

---

#### 3/4.7.11 PENETRATION FIRE BARRIERS

The functional integrity of the Fire Barrier Penetration Seals ensures that fires will be confined or adequately retarded from spreading to adjacent portions of the facility. This design feature minimizes the possibility of a single fire rapidly involving several areas of the facility prior to detection and extinguishment. The Fire Barrier Penetration Seals are a positive element in the facility fire protection program and are subject to periodic inspections.

During periods of time when the seals are not functional, a continuous fire watch is required to be maintained in the vicinity of the affected seal until the seal is restored to functional status.



## BASES

---

### 3/4.8 ELECTRICAL POWER SYSTEMS

The OPERABILITY of the A.C. and D.C. power sources and associated distribution systems during operation ensures that sufficient power will be available to supply the Safety Related equipment required to maintain the unit in stable conditions during recovery from the March 28, 1979 accident.

### 3/4.9 RADIOACTIVE WASTE STORAGE

#### BASES

---

#### 3/4.9.1 SPENT FUEL STORAGE POOL "A" WATER LEVEL MONITORING

Spent Fuel Storage Pool Water "A" Level Monitoring instrumentation has been provided to assure the capability to monitor water level in the Spent Fuel Storage Pool "A".

#### 3/4.9.2 SPENT FUEL STORAGE POOL "A" WATER LEVEL

The water level in the Spent Fuel Storage Pool "A" has been established to limit the dose rate, due to the storage of Canisters, to acceptable levels.

#### 3/4.9.3 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL MONITORING

Fuel Transfer Canal Water Level Monitoring instrumentation has been provided to assure the capability to monitor water level in the deep end of the Fuel Transfer Canal.

#### 3/4.9.4 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL:

The water level in the Fuel Transfer Canal (deep end) has been established to limit the dose rate, due to the storage of the plenum assembly and Canisters, to acceptable levels.

#### 3/4.9.12 FUEL HANDLING BUILDING/AUXILIARY BUILDING AIR CLEANUP SYSTEMS

The requirements for the Fuel Handling/Auxiliary Building Air Cleanup Systems to be operating or OPERABLE ensure that all radioactive material released from the liquid radioactive wastes being stored in the new radwaste storage tanks which have been installed in the spent fuel storage pool or elsewhere in the Auxiliary Building will be filtered through the HEPA filters prior to release to the atmosphere.

#### 3/4.9.13 ACCIDENT GENERATED WATER

These specifications are provided to ensure compliance with the Commission's Statement of May 25, 1979, and the Commission's Statement of Policy and Notice of Intent to Prepare a Programmatic Environmental Impact Statement of November 21, 1979, which prohibit these actions pending evaluation of the environmental impacts of such actions. The PEIS issued in March, 1981, deferred a decision on the ultimate disposal of processed water. Further Commission action is necessary prior to release of ACCIDENT GENERATED WATER.

However, the Commission has recognized that there may be emergency situations, not at this time foreseen, which could require rapid action. In these situations, the Commission has indicated its intention to consult with the Council on Environmental Quality to the extent practicable.

### 3/4.9 RADIOACTIVE WASTE STORAGE

#### BASES

---

ACCIDENT GENERATED WATER, as defined in the settlement of the City of Lancaster litigation, is:

- (a) Water that existed in the TMI-2 Auxiliary, Fuel Handling, and Containment Buildings including the primary system as of October 16, 1979, with exception of water which as a result of decontamination operations becomes commingled with non-accident generated water such that the commingled water has a tritium content of 0.025  $\mu\text{Ci/ml}$  or less before processing;
- (b) Water that has a total activity of greater than one  $\mu\text{Ci/ml}$  prior to processing except where such water is originally non-accident water and becomes contaminated by use in cleanup;
- (c) Water that contains greater than 0.025  $\mu\text{Ci/ml}$  of tritium before processing.

3/4.9.14 Deleted.

### 3/4.10 DEFUELING OPERATIONS

#### BASES

---

#### 3/4.10 CRANE TRAVEL - CONTAINMENT BUILDING

A load drop into the Reactor Vessel may cause reconfigurations of the core debris and/or structural damage which could hinder recovery efforts. A load drop on the Incore Instrument Seal Table and/or guide tubes may result in an unisolable leak from the Reactor Vessel. The restriction on movement of loads in excess of the nominal weight of a fuel or control rod assembly and associated handling tool over these areas is to mitigate the potential consequences stated above in the event this load is dropped.

RECOVERY OPERATIONS PLAN

TMI-2

## INDEX

### SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>4.1 WATER INJECTION COOLING AND REACTIVITY CONTROL SYSTEMS</u>	
4.1.1 BORATION CONTROL	
4.1.1.1 Borated Cooling Water Injection.....	4.1-1
4.1.1.2 Boron Concentration.....	4.1-3
4.1.3 CONTROL ASSEMBLIES	
4.1.3.1 Rod Positions.....	4.1-3
<u>4.3 INSTRUMENTATION</u>	
4.3.1 NEUTRON MONITORING INSTRUMENTATION.....	4.3-1
4.3.2 ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION.....	4.3-1
4.3.3 MONITORING INSTRUMENTATION	
4.3.3.1 Radiation Monitoring Instrumentation.....	4.3-1
4.3.3.3.1 Seismic Instrumentation.....	4.3-6
4.3.3.4 Meteorological Instrumentation.....	4.3-8
4.3.3.5 Essential Parameters Monitoring Instrumentation.....	4.3-8
4.3.3.6 Post-accident Instrumentation.....	4.3-8
4.3.3.7 Chlorine Detection Systems.....	4.3-8
4.3.3.8 Fire Detection.....	4.3-12
<u>4.4 REACTOR COOLANT SYSTEM</u>	
4.4.1 REACTOR COOLANT LOOPS.....	4.4-1
4.4.2 REACTOR VESSEL WATER LEVEL MONITORING.....	4.4-1
4.4.9 PRESSURE/TEMPERATURE LIMITS	
4.4.9.1 Reactor Coolant System.....	4.4-1



## INDEX

### SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
4.5 COMMUNICATIONS.....	4.5-1
<u>4.6 CONTAINMENT SYSTEMS</u>	
4.6.1 PRIMARY CONTAINMENT	
4.6.1.1 Containment Integrity.....	4.6-1
4.6.1.3 Containment Air Locks.....	4.6-1
4.6.1.4 Internal Pressure.....	4.6-2
4.6.1.5 Air Temperature.....	4.6-2
4.6.3 CONTAINMENT PURGE EXHAUST SYSTEM.....	4.6-2
4.6.4 COMBUSTIBLE GAS CONTROL	
4.6.4.1 Hydrogen Analyzers.....	4.6-3
4.6.4.3 Hydrogen Purge Cleanup System.....	4.6-3
<u>4.7 PLANT SYSTEMS</u>	
4.7.1 FEEDWATER SYSTEM.....	4.7-1
4.7.2 SECONDARY SERVICES CLOSED COOLING WATER SYSTEM.....	4.7-1
4.7.3 CLOSED CYCLE COOLING WATER SYSTEM	
4.7.3.1 Nuclear Services Closed Cycle Cooling System.....	4.7-1
4.7.3.2 Decay Heat Closed Cooling Water System.....	4.7-2
4.7.3.3 Mini Decay Heat Removal System.....	4.7-2
4.7.4 NUCLEAR SERVICE RIVER WATER SYSTEM.....	4.7-3
4.7.6 FLOOD PROTECTION.....	4.7-3
4.7.7 CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM.....	4.7-4
4.7.9 SEALED SOURCES.....	4.7-6
4.7.10 FIRE SUPPRESSION SYSTEMS	
4.7.10.1.1 Fire Suppression Water System.....	4.7-7
4.7.10.2 Deluge/Sprinkler Systems.....	4.7-9
4.7.10.3.1 Halon System.....	4.7-9
4.7.10.4 Fire Hose Stations.....	4.7-10
4.7.11 PENETRATION FIRE BARRIERS.....	4.7-10

## INDEX

### SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>	<u>PAGE</u>
<u>4.8 ELECTRICAL POWER SYSTEMS</u>	
4.8.1 A.C. SOURCES.....	4.8-1
4.8.2 ONSITE POWER DISTRIBUTION SYSTEMS	
4.8.1.1 A.C. Distribution.....	4.8-2
4.8.2.2.1 D.C. Distribution.....	4.8-2
<u>4.9 LIQUID RADIOACTIVE WASTE STORAGE</u>	
4.9.1 SPENT FUEL STORAGE POOL WATER "A" LEVEL MONITORING.....	4.9-1
4.9.2 SPENT FUEL STORAGE POOL WATER "A" LEVEL.....	4.9-1
4.9.3 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL MONITORING.....	4.9-1
4.9.4 FUEL TRANSFER CANAL (DEEP END) WATER LEVEL.....	4.9-1
4.9.12 FUEL HANDLING BUILDING/AUXILIARY BUILDING AIR CLEANUP SYSTEMS..	4.9-1

Section 4.0  
Surveillance Requirements

## SURVEILLANCE REQUIREMENTS

4.0.1 Surveillance Requirements of the RECOVERY OPERATIONS PLAN shall be applicable during the RECOVERY MODE or other conditions specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement. The Surveillance Requirements shall be performed to demonstrate compliance with the OPERABILITY requirements of the Limiting Conditions for Operations and in accordance with the RECOVERY OPERATIONS PLAN; however, the RECOVERY OPERATIONS PLAN shall not be considered a part of these technical specifications. Changes to the RECOVERY OPERATIONS PLAN shall be approved by the NRC prior to implementation.

4.0.2 Each Surveillance Requirement of the RECOVERY OPERATIONS PLAN shall be performed within the specified time interval with:

- a. A maximum allowable extension not to exceed 25% of the surveillance interval, and
- b. A total maximum combined interval time for any 4 consecutive tests not to exceed 3.25 times the specified surveillance interval.

4.0.3 Performance of a Surveillance Requirement within the specified time interval shall constitute compliance with OPERABILITY requirements for a Limiting Condition for Operation and associated ACTION statements unless otherwise required by the specification.

## SURVEILLANCE REQUIREMENTS

### 4.1 WATER INJECTION COOLING AND REACTIVITY CONTROL SYSTEMS

#### 4.1.1 BORATION CONTROL

##### BORATED COOLING WATER INJECTION

4.1.1.1 The systems capable of injecting borated cooling water into the Reactor Coolant System shall be demonstrated OPERABLE:

- A. At least once per 31 days by verifying that each accessible (per occupational exposure considerations) valve in each flowpath that is not locked, sealed, or otherwise secured in position, is in its correct position.
- B. At least once per 7 days by:
  - 1. Verifying the boron concentration in the BWST is between 4350 and 6000 ppm.
  - 2. Verifying the contained borated water volume in the BWST is at least 390,000 gallons:
- C. At least once per 24 hours by verifying the BWST temperature is at least 50 degrees Fahrenheit when the outside temperature is less than 50 degrees Fahrenheit.
- D. At least once per 6 months by verifying the pumps associated with the Reactor Building Sump Recirculation System produce sufficient head and flow to meet makeup requirements.

SURVEILLANCE REQUIREMENTS

---

This page deleted.



## SURVEILLANCE REQUIREMENTS

---

### BORON CONCENTRATION

4.1.1.2 The boron concentration of all filled portions of the Reactor Coolant System and the Refueling Canal shall be determined to be within the specified limits by:

- a. Determining the boron concentration of the coolant in the filled portions to be between 4350 and 6000 ppm by:
  1. A mass balance calculation at least once per 24 hours.
  2. A chemical analysis at least once per 7 days.
- b. Verifying the temperature of the coolant in the filled portions of the Reactor Coolant System to be greater than 50°F at least once per 12 hours.
- c. Deleted

4.1.1.3 The boron concentration of the water filled portions of the Fuel Transfer Canal (deep end) and Spent Fuel Storage Pool "A" shall be determined to be within the specified limits by:

- a. Determining the boron concentration of the water in the filled portions of the Fuel Transfer Canal (deep end) and the Spent Fuel Storage Pool "A" to be between 4350 and 6000 ppm by a chemical analysis at least once per 7 days.

### 4.1.3 CONTROL ASSEMBLIES

4.1.3.1 With the Reactor Vessel Head and the Control Rod Drive Mechanisms removed or disconnected from the reactor vessel there is no surveillance required.

## SURVEILLANCE REQUIREMENTS

---

### 4.3 INSTRUMENTATION

#### 4.3.1 NEUTRON MONITORING INSTRUMENTATION

4.3.1.1 Each intermediate and source range neutron monitoring instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations during RECOVERY MODE and at the frequency shown in Table 4.3-1.

#### 4.3.2 ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION

4.3.2.1 Each ESFAS instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations during RECOVERY MODE and at the frequencies shown in Table 4.3-2.

#### 4.3.3 MONITORING INSTRUMENTATION

##### RADIATION MONITORING INSTRUMENTATION

4.3.3.1 Each radiation monitoring instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION AND CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4.3-3.

4.3.3.2 Deleted.

4.3.3.3 Deleted.

##### SEISMIC INSTRUMENTATION

4.3.3.3.1 Deleted.

4.3.3.3.2 Deleted.

TABLE 4.3-1

NEUTRON MONITORING INSTRUMENTATION

FUNCTIONAL UNIT	CHANNEL CHECK	CHANNEL CALIBRATION	CHANNEL FUNCTIONAL TEST	TOTAL NO. OF CHANNELS	CHANNELS TO TRIP	MINIMUM CHANNELS OPERABLE	READ OUT LOCATIONS
1. Intermediate Range, Neutron Flux and Rate	S	R <sup>(1)</sup>	M	2	0	1	Cab. 217 + Control Room
2. Source Range, Neutron Flux and Rate	S	R <sup>(1)</sup>	M	2	0	2	Cab 217 <sup>(2)</sup> + Control Room

NOTES

(1) - Neutron detectors and all channel components located inside containment may be excluded from CHANNEL CALIBRATION.

(2) - Only one readout required at Cabinet 217.

TABLE 4.3-2  
ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION

FUNCTIONAL UNIT	TOTAL NO. OF CHANNELS	CHANNELS TO TRIP	MINIMUM CHANNELS OPERABLE	ACTION	CHANNEL CHECK	CHANNEL CALIBRATION	CHANNEL FUNCTIONAL TEST
1. LOSS OF POWER							
a. 4.16 kv Emergency Bus Undervoltage (Loss of Voltage)							
1. Emergency Bus #2-1E and 2-2E	2/Bus	2/B <sub>us</sub>	2/B <sub>us</sub>	1	S	R	M
2. Emergency Bus #2-3E and 2-4E	2/Bus	1/Bus	2/Bus	2	S	NA	NA

ACTION 1 - With the number of OPERABLE channels one less than the Total Number of Channels, place the inoperable channel in the tripped condition within 4 hours.

ACTION 2 - None except as provided in Specification 3.0.3.

ENGINEERED SAFETY FEATURE ACTUATION SYSTEMS INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>TRIP SETPOINT</u>	<u>ALLOWABLE VALUES</u>
1. LOSS OF POWER		
a. 4.16 kv Emergency Bus Undervoltage (Loss of Voltage)		
1. Emergency Bus #2-1E and 2-2E	2278 ± 69 volts with a 1.5 ± .15 second time delay	2278 ± 114 volts with a 1.5 ± 0.2 second time delay
2. Emergency Bus #2-3E and 2-4E	2278 ± 69 volts with a 1.5 ± .15 second time delay	2278 ± 114 volts with a 1.5 ± 0.2 second time delay

TABLE 4.3-3

RADIATION MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

FUNCTIONAL UNIT	CHANNEL CHECK	CHANNEL CALIBRATION	CHANNEL FUNCTIONAL TEST	MINIMUM CHANNELS OPERABLE	APPLICABILITY	ACTION
1. CONTAINMENT						
a. Reactor Building Purge Sampler (AMS-3)	D	SA	W	1	Note 1	Note 3
b. Reactor Building Equipment Doors (AMS-3)	D	SA	W	1	Note 10	Note 7
c. Deleted						
d. CACE Vent Monitor	D	SA	W	1	Note 1	Note 9
2. FUEL HANDLING BUILDING EXHAUST MONITORS (HPR-221A or HPR-221B)						
a. Gaseous Activity	S	R	M	1	Note 5	Note 6
b. Particulate Activity	S	R	M	1	Note 5	Note 6
3. SDS MONITORS						
a. Process Monitor (IX04)	S	R	M	1	Note 1	Note 4
b. Area Monitor (IX03)	S	SA	M	1	Note 1	Note 2
4. Deleted						

(See following pages for notes)

TABLE 4.3-3 (Cont'd)

RADIATION MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
5. FUEL TRANSFER CANAL						
a. Criticality Monitor	S	R	M	1	Note 11	Note 12
6. FUEL POOL "A"						
a. Criticality Monitor	S	R	M	1	Note 11	Note 12
7. FUEL HANDLING BUILDING TRUCK BAY						
a. Criticality Monitor	S	R	M	1	Note 11	Note 12

(See following pages for Notes)



TABLE 4.3-3 (Con't)

RADIATION MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

## NOTES:

- 1) During operation of the monitored system.
- 2) If monitor becomes inoperable, repair or replace by equivalent equipment within 12 hours. If not completed within 12 hours terminate operation of the monitored system and restore the inoperable monitor(s) to operable status.
- 3) Restore the inoperable monitor(s) to operable status within 72 hours.
- 4) If ion exchange effluent monitor is inoperable, sample on 4 hour frequency for gross beta. If inoperable longer than 24 hours then terminate operation of ion exchange system and restore the inoperable monitor to operable status.
- 5) With radioactive waste in the fuel handling building.
- 6) With the required instrumentation inoperable, suspend all operations involving movement of radioactive wastes in the fuel handling building, restore the inoperable equipment to OPERABLE status within 48 hours.
- 7) With the AMS-3 inoperable, close at least one of the Reactor Building Equipment Doors and restore the inoperable equipment to operable status prior to the reopening of both Equipment Doors.
- 8) Deleted
- 9) Two filter trains and associated monitors are normally available. If one monitor becomes inoperable, discontinue operation through the effected filter train and transfer operations by the operable filter train. If both monitors become inoperable, repair or replace by equivalent equipment within twelve (12) hours or conduct air sampling using alternate methods on a four (4) hour frequency. If repair or replacement is not completed within seven (7) days, terminate operation of the system until at least one monitor is returned to operable status.
- 10) With both reactor building equipment hatch airlock doors open simultaneously.

TABLE 4.3-3 (Con't)

RADIATION MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

NOTES: (con't)

- 11) During either of the following operations:
    - a. Handling of canisters containing core material.
    - b. Handling of any heavy load over canisters containing core materials.
  - 12) With less than one channel operable, terminate the following operations:
    - a. Handling of canisters containing core material. \*
    - b. Handling of any heavy load over canisters containing core material.
- \* This shall not prohibit placing a canister in transit in a safe storage location.

TABLE 4.3-4

SEISMIC MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENT

Deleted

## SURVEILLANCE REQUIREMENTS

### METEOROLOGICAL INSTRUMENTATION

4.3.3.4 Each of the meteorological monitoring instrumentation channels shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.3-5.

### ESSENTIAL PARAMETERS MONITORING INSTRUMENTATION

4.3.3.5 Each of the Essential Parameters Monitoring Instrumentation channels shall be demonstrated OPERABLE by performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.3-7.

### POST-ACCIDENT INSTRUMENTATION

4.3.3.6 Deleted

### CHLORINE DETECTION SYSTEMS

4.3.3.7 Each chlorine detection system shall be demonstrated OPERABLE by performance of a CHANNEL CHECK at least once per 12 hours, and a CHANNEL FUNCTIONAL TEST at least once per 31 days. At least once per 18 months, the following inspections and maintenance shall be performed:

- a. Check constant head bottle level and refill as necessary,
- b. Clean the sensing cells,
- c. Check flow meter operation and clean or replace filters and air lines as necessary,
- d. Check air pump for proper operation, and
- e. Verify that the detector responds to HCL.

TABLE 4.3-5

METEOROLOGICAL MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>MINIMUM OPERABLE</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>
1. WIND SPEED			
a. Nominal Elev. 100 ft	1	D	SA
2. WIND DIRECTION			
a. Nominal Elev. 100 ft.	1	D	SA
3. AIR TEMPERATURE - DELTA T			
a. Nominal Elev. 33 ft.	1	D	SA
b. Nominal Elev. 150 ft.	1	D	SA

TABLE 4.3-6

REMOTE SHUTDOWN MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

DELETED



TABLE 4.3-7

ESSENTIAL PARAMETERS MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

INSTRUMENT	CHANNEL CHECK	CHANNEL <sup>(1)</sup> CALIBRATION	READOUT LOCATION(S)	MINIMUM OPERABLE CHANNELS
1. Reactor Building Pressure	S	R	Control Room	2
2. Reactor Vessel Water Level	S/W <sup>(2)</sup>	SA	Control Room (2)	2 <sup>(2)</sup>
3. Incore Thermocouples	S	R	Control Room or Cable Room	2
4. Reactor Building Water Level	NA	SA	Control Bldg. Area West	1
5. Borated Water Storage Tank Level	S	R	Control Room	1
6. Steam Generator Level	NA	NA	NA	1/Generator
7. Spent Fuel Storage Pool "A" Water Level	S/W <sup>(2)</sup>	SA	Control Room (2) or Fuel Handling Bldg	2 <sup>(2)</sup>
8. Fuel Transfer Canal (deep end) Water Level	S/W <sup>(2)</sup>	SA	Control Room (2) or Reactor Bldg	2 <sup>(2)</sup>

(See following page for notes)

THREE MILE ISLAND - UNIT 2

4.3-10

Change No. 31

TABLE 4.3-7 (Cont'd)

ESSENTIAL PARAMETERS MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

Notes:

!!

- 1) Nuclear detectors and all channel components located inside containment may be excluded from CHANNEL CALIBRATION.
- 2) One channel may consist of a visual indication such as a level stand pipe. Seven day surveillance applies to visual indication only. Visual indication readout may be in the Reactor Building, or Fuel Handling Building, or by remote television.

THIS PAGE DELETED

THREE MILE ISLAND - UNIT 2

4.3-11

September 23, 1985  
Change No. 29

## SURVEILLANCE REQUIREMENTS

---

### FIRE DETECTION

4.3.3.8.1 Each of the required fire detection instruments shall be demonstrated OPERABLE at least once per 6 months by performance of a CHANNEL FUNCTIONAL TEST.

4.3.3.8.2 The NFPA Code 71 supervised circuits supervision associated with the detector alarms of each of the required fire detection instruments shall be demonstrated OPERABLE at least once per 6 months.

4.3.3.8.3 The nonsupervised circuits between the local panels in Surveillance Requirements 4.3.3.8.2 and the control room shall be demonstrated OPERABLE at least once per 31 days.

4.3.3.8.4 In lieu of Specification 4.3.3.8.2, fire detection instrument for the Southeast Storage Facility shall have circuitry per procedures approved pursuant to Specification 6.8.2.

TABLE 4.3-11  
FIRE DETECTION INSTRUMENTS

Instrument Location	Required Instruments			Alternate Instrument		
	Heat	Flame	Smoke	Heat	Flame	Smoke
1. Auxiliary Building	NA	NA	2	NA	NA	2
2. Control Building						
351' Elevation	NA	NA	1	NA	NA	3
331' Elevation (Control Room)	NA	NA	1	NA	NA	1
305', 293', 260' Elevations	NA	NA	1	NA	NA	7
3. Control Building Area	NA	NA	1	NA	NA	3
4. Diesel Generator Building						
A Diesel	NA	1	1	NA	NA	1
B Diesel	NA	1	1	NA	NA	1
5. Fuel Handling Building	NA	NA	3	NA	NA	1
6. Reactor Building						
RC-P-1A/2A	NA	NA	1	NA	NA	1
RC-P-1B/2B	NA	NA	1	NA	NA	2
	NA	NA	1	NA	NA	2
7. River Water Pump House	NA	1	1	NA	NA	2
8. Service Building	NA	NA	3	NA	NA	3
9. Deleted						
10. Southeast Areas Storage Facility	NA	NA	2	NA	NA	2

## SURVEILLANCE REQUIREMENTS

---

### 4.4 REACTOR COOLANT SYSTEM

#### REACTOR COOLANT LOOPS

4.4.1 Verify that surveillance of the Reactor Coolant System is being performed in accordance with procedures approved pursuant to Technical Specification 6.8.2.

#### 4.4.2 REACTOR VESSEL WATER LEVEL MONITORING

4.4.2 The Reactor Vessel Water Level Monitoring Instrumentation shall be demonstrated OPERABLE as required by Table 4.3-7.

#### SAFETY VALVES

4.4.3 Deleted.

### 4.4.9 PRESSURE/TEMPERATURE LIMITS

#### REACTOR COOLANT SYSTEM

4.4.9.1.1 Deleted.

4.4.9.1.2 Deleted.

4.4.9.1.3 Deleted.

4.4.9.1.4 The pH of the reactor coolant shall be determined to be greater than or equal to 7.5 and less than 8.4 at least once per 7 days.

4.4.9.1.5 The chloride concentration in the reactor coolant shall be determined to be less than or equal to 5 ppm at least once per 7 days.



## SURVEILLANCE REQUIREMENTS

---

### 4.5 COMMUNICATIONS

4.5.1 Verify that communications channels are OPERABLE between the Control Room or the Command Center and personnel in the Reactor Building once each day prior to the initiation of any activities involving CORE ALTERATIONS. Also verify that the additional SOL or SOL limited to fuel handling has OPERABLE communication channels once each day prior to the initiation of any activities involving core alterations. |

## SURVEILLANCE REQUIREMENTS

---

### 4.6 CONTAINMENT SYSTEMS

#### 4.6.1 PRIMARY CONTAINMENT

##### CONTAINMENT INTEGRITY

4.6.1.1 If required per procedures approved pursuant to Specification 6.8.2, primary CONTAINMENT INTEGRITY shall be demonstrated:

- a. At least once per 31 days by verifying per NRC approved procedures that:
  1. All penetrations not required to be open per approved procedures are closed by valves, blind flanges, or deactivated automatic valves secured in their positions.
- b. By verifying at least once per 31 days that the Containment Equipment Hatch is closed and sealed.
- c. By verifying that each Containment Air Lock is OPERABLE per Specification 3.6.1.3.

##### CONTAINMENT AIR LOCKS

4.6.1.3 Each containment air lock shall be demonstrated OPERABLE:

- a. After each opening, except when the air lock is being used for multiple entries, then at least once per 72 hours, by verifying less than or equal to 0.01 L seal leakage when the volume between the door seals is stabilized to a pressure of 6.5 psig.
- b. At least once per three months by performing a mechanical operability check of each airlock, including a visual inspection of the components and lubrication if necessary.
- c. Deleted

4.6.1.3.1 When both equipment hatch personnel airlock doors are opened simultaneously, verify the following conditions:

- a. The capability exists to expeditiously close at least one airlock door.
- b. The airlock doors and containment purge are configured to restrict the outflow of air in accordance with procedures approved pursuant to Tech Spec 6.8.2.
- c. The airlock doors are cycled to ensure mechanical operability within seven days prior to opening both doors.

INTERNAL PRESSURE

4.6.1.4.a The primary containment internal pressure shall be determined to be within the limits at least once per 12 hours, via the instrumentation listed in Table 4.3-7, except during periods when the containment building is open to the atmosphere.

4.6.1.4.b During periods when the containment building is open to the atmosphere, methods to ensure airflow into the containment building shall be implemented in accordance with procedures approved pursuant to Specification 6.8.2.

AIR TEMPERATURE

4.6.1.5 The primary containment average air temperature shall be the arithmetical average of the temperatures at the following locations and shall be determined at least once per 24 hours.

Location

- a. RB nominal Elev. 350' (1 temperature indication)
- b. RE nominal Elev. 330' (1 temperature indication)
- c. RB nominal Elev. 305' (1 temperature indication)

CONTAINMENT PURGE EXHAUST SYSTEM

4.6.3 The Containment Purge Exhaust System shall be demonstrated OPERABLE:

- a. At least once per 31 days during operation by verifying that the Purge Exhaust System in the normal operating mode meets the following conditions:
  - 1. Filter Pressure Drop: The d/p across the combined HEPA filters shall not exceed 6 inches water gauge while the system is operating.
- b. At least once per 18 months by verifying that the ventilation system meets the following conditions:
  - 1. Visually inspect each filter train and associated components in accordance with Section 5 of ANSI NS10-1980, as required by Regulatory Position C.5.a of Regulatory Guide 1.52, Revision 2, March 1978. The inspection should be performed prior to the DDP test of this section.
  - 2. Flow Test: Exhaust flow rate shall be within 18,000 cfm to 27,000 cfm operating band for each filter train with one filter train and one exhaust fan operating. Testing shall be in accordance with ANSI NS10-1980, Section 8.3.1, paragraphs 3 and 4.
  - 3. DDP Test: Each filter train shall be tested in accordance with Section 10 of ANSI NS10-1980, as required by Regulatory Position C.5.c of Regulatory Guide 1.52, Revision 2, March 1978.

NOTE: Installed system flow instrumentation is adequate for the test described in Section 4.6.3.b.3 above.

## SURVEILLANCE REQUIREMENTS

---

- c. After structural maintenance of the HEPA filter or charcoal adsorber housings, or following fire or chemical release in any ventilation zone communicating with the system by verifying that the ventilation system meets the following conditions:
  - 1. Filter Pressure Drop: Reverify the filter pressure drop surveillance prescribed in Section 4.6.3.a.1 for the affected filter train(s).
  - 2. DOP Test: Each affected filter train shall be retested in accordance with Section 4.6.3.b.3.
  - 3. Visual inspection in accordance with ANSI N510-1980 Section 5.
- d. After each complete or partial replacement of a HEPA filter bank by verifying that the ventilation system meets the following condition:
  - 1. DOP Test: Each affected filter train shall be retested in accordance with Section 4.6.3.b.3.

### 4.6.4 COMBUSTIBLE GAS CONTROL

#### HYDROGEN ANALYZERS

4.6.4.1 Deleted.

#### HYDROGEN PURGE CLEANUP SYSTEM

4.6.4.3 Deleted

SURVEILLANCE REQUIREMENTS

---

4.7 PLANT SYSTEMS

4.7.1 FEEDWATER SYSTEM

Deleted.

4.7.2 SECONDARY SERVICES CLOSED COOLING WATER SYSTEM

Deleted.

4.7.3 CLOSED CYCLE COOLING WATER SYSTEM

NUCLEAR SERVICES CLOSED COOLING SYSTEM

4.7.3.1 Deleted.

SURVEILLANCE REQUIREMENTS

---

DECAY HEAT CLOSED WATER SYSTEM

4.7.3.2 Deleted.

MINI DECAY HEAT REMOVAL SYSTEM (MDHRS)

4.7.3.3 Deleted.



## SURVEILLANCE REQUIREMENTS

### 4.7.4 NUCLEAR SERVICE RIVER WATER SYSTEM

4.7.4.1 Each Nuclear Service River Water Loop shall be demonstrated OPERABLE:

- a. At least once per 31 days by:
  1. Verifying that each pump starts and operates (unless already operating) for at least 15 minutes and, that during pump operation each pump develops a differential pressure of at least 23.8 psid.
  2. Verifying that each valve (manual, power operated or automatic) servicing safety related equipment that is not locked, sealed or otherwise secured in position, is in its correct position.
- b. At least once per 92 days by cycling each testable valve in the flow path through at least one complete cycle of full travel.

### 4.7.6 FLOOD PROTECTION

4.7.6.1.1 The water level at the Unit 1 intake structure shall be determined to be within the limit by:

- a. Measurement at least once per 24 hours when the water level is below elevation 301 feet Mean Sea Level USGS datum.
- b. Measurement at least once per 2 hours when the water level is equal to or above elevation 301 feet Mean Sea Level datum.

4.7.6.1.2 The dike surrounding the island and the dike erosion protection shall be:

- a. Inspected at least once per 6 months and within 31 days after every flood which exceeds 485,000 cfs at the Harrisburg gage. This inspection shall include:
  1. Dike slope and notation of any location where slope is steeper than 2:1.
  2. Depressions and notation of their size and location.
  3. Stone degradation and notation of any areas where splitting, spalling or weathering of stone appears excessive.
  4. Vegetation and notation of location, quantity, and type.
  5. Operability of inside and outside gates of the Southeast Drainage Culvert.

## SURVEILLANCE REQUIREMENTS

4.7.6.1.3 A Special Report shall be prepared and submitted to the Commission within 30 days if evidence of degradation is noted during an inspection. This report shall describe the extent and nature of the degradation and the plans and schedule for restoring the dike and erosion protection to a status equivalent to the original design provisions.

### 4.7.7 CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM

4.7.7.1 The Control Room Emergency Air Cleanup System shall be demonstrated OPERABLE:

- a. At least once per 12 hours by verifying that the control room air temperature is less than or equal to 100°F.
- b. At least once per 31 days by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes; and the pressure drop across the combined HEPA filters and charcoal adsorbers banks is less than six (6) inches water gauge while operating.
- c. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire or chemical release in any ventilation zone communicating with the system by:
  1. Verifying that the cleanup system satisfies the in-place testing acceptance criteria and uses the test procedures of Regulatory Positions C.5.a, C.5.c\* and C.5.d\* of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 14,350 cfm  $\pm$  10%.
  2. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Guide 1.52, Revision 2, March 1978, when performing Methyl Iodide, 30°C, 95% RH testing per Table 5-1 of ANSI N509-1980 meets an acceptable criteria of 5% penetration maximum.
  3. Verifying a system flow rate of 14,350 cfm  $\pm$  10% during system operation when tested in accordance with ANSI N510-1980, Section B.3.1 Paragraphs 3 and 4.
- d. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, when performing Methyl Iodide, 30°C, 95% RH testing per Table 5-1 of ANSI N509-1980 meets an acceptance criteria of 5% penetration maximum.

\*The prerequisites of Section 10.3 and 12.3 of ANSI-N510-1980 do not apply.

## SURVEILLANCE REQUIREMENTS

### CONTROL ROOM EMERGENCY AIR CLEANUP SYSTEM (Continued)

- e. At least once per 18 months by:
1. Verifying that the pressure drop across the combined HEPA filter and charcoal adsorber banks is less than 6 inches water gauge while operating the system at a flow rate of 14,350 cfm  $\pm$  10%.
  2. Verifying that on a control room air inlet radiation test signal or chlorine detection test signal, the system automatically switches into a recirculation mode of operation with flow through the HEPA filters and charcoal adsorber banks.
  3. Verifying that the system maintains the control room at a positive pressure of greater than or equal to 1/10 inch water gauge relative to the outside atmosphere during system operation.
- f. After each complete or partial replacement of a HEPA filter bank by verifying that the HEPA filter banks remove greater than or equal to 99.95% of the DOP when they are tested in-place in accordance with ANSI N510-1980\* Section 10 while operating the system at a flow rate of 14,350 cfm  $\pm$  10%.
- g. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorbers remove greater than or equal to 99.95% of a halogenated hydrocarbon refrigerant test gas when they are tested in-place in accordance with ANSI N510-1980,\* Section 12, while operating the system at a flow rate of 14,350 cfm  $\pm$  10%.

---

\*The prerequisites of Section 10.3 and 12.3 of ANSI-510-1980 do not apply.

## SURVEILLANCE REQUIREMENTS

### 4.7.9 SEALED SOURCES

4.7.9.1 Test Requirements - Each sealed source shall be tested for leakage and/or contamination by:

- a. The licensee, or
- b. Other persons specifically authorized by the Commission or an Agreement State.

The test method shall have a detection sensitivity of at least 0.005 microcuries per test sample.

4.7.9.2 Test Frequencies - Each category of sealed sources shall be tested at the frequency described below.

- a. Source in use (excluding startup sources and fission detectors previously subjected to core flux) - At least once per six months for all sealed sources containing radioactive material:
    1. With a half-life greater than 30 days (excluding Hydrogen 3) and
    2. In any form other than gas.
  - b. Stored sources not in use - Each sealed source and fission detector shall be tested prior to use or transfer to another licensee unless tested within the previous six months. Sealed sources and fission detectors transferred without a certificate indicating the last test date shall be tested prior to being placed into use.
  - c. Startup sources and fission detectors - Each sealed startup source and fission detector shall be tested within 31 days prior to being subjected to core flux or installed in the core and following repair or maintenance to the source.
- 4.7.9.3 Reports - A report shall be prepared and submitted to the Commission on an annual basis if sealed source or fission detector leakage tests reveal the presence of  $\geq 0.005$  microcuries of removable contamination.

## SURVEILLANCE REQUIREMENTS

### 4.7.10 FIRE SUPPRESSION SYSTEMS

#### FIRE SUPPRESSION WATER SYSTEM

4.7.10.1.1 The FIRE SUPPRESSION WATER SYSTEM shall be demonstrated OPERABLE:

- a. At least once per 7 days by verifying that at least 90,000 gallons of water are in the Altitude Tank, equivalent level in Unit 1 circulating water flume and/or equivalent level in the river.
- b. At least once per 31 days on a STAGGERED TEST BASIS by starting each pump and operating it for at least 20 minutes on recirculation flow.
- c. At least once per 31 days by verifying that each valve (manual, power operated or automatic) in the flow path is in its correct position.
- d. At least once per 12 months by:
  1. Running the full flow of one fire pump through all main header loops as a flush, and
  2. Cycling each testable valve in the flow path through at least one complete cycle of full travel.
- e. At least once per 18 months by performing a system functional test which includes simulated automatic actuation of the system (i.e., pumps start at set pressure  $\pm$  10 psig), and:
  1. Verifying that each pump develops at least 2500 gpm at a total dynamic head no more than 10% below that indicated on manufacturers curves.
  2. Cycling each valve in the flow path that is not testable during plant operation through at least one complete cycle of full travel, and
  3. Verifying that each high pressure pump starts (sequentially) to maintain the fire suppression water system pressure greater than or equal to 70 psig.
- f. At least once per 3 years by performing a flow test of the system in accordance with Chapter 5, Section 11 of the Fire Protection Handbook, 14th Edition, published by the National Fire Protection Association.



## SURVEILLANCE REQUIREMENTS

### FIRE SUPPRESSION WATER SYSTEM (Continued)

4.7.10.1.2 Each fire pump diesel engine shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying;
  1. Its associated fuel storage tank contains at least 250 gallons of fuel, and
  2. The diesel starts from ambient conditions and operates for at least 20 minutes.
- b. At least once per 92 days by verifying that a sample of diesel fuel from each fuel storage tank, obtained in accordance with ASTM-D270-65, is within the acceptable limits specified in Table 1 of ASTM D975-74 when checked for viscosity, water and sediment.
- c. At least once per 18 months, by:
  1. Subjecting each diesel to an inspection in accordance with procedures prepared in conjunction with its manufacturer's recommendations for the class of service, and
  2. Verifying each diesel starts from ambient conditions on the auto-start signal and operates for greater than or equal to 20 minutes while loaded with the fire pump.

4.7.10.1.3 Each fire pump diesel starting battery bank and charger shall be demonstrated OPERABLE:

- a. At least once per 7 days by verifying that:
  1. The electrolyte level of each battery is above the plates, and
  2. The overall battery voltage is greater than or equal to 24 volts.
- b. At least once per 92 days by verifying that the specific gravity is appropriate for continued service of the battery.
- c. At least once per 18 months by verifying that:
  1. The batteries, cell plates and battery racks show no visual indication of physical damage or abnormal deterioration, and
  2. The battery-to-battery and terminal connections are clean, tight, free of corrosion and coated with anti-corrosion material.



## SURVEILLANCE REQUIREMENTS

---

### DELUGE/SPRINKLER SYSTEMS

4.7.10.2 Each of the required deluge and/or sprinkler systems shall be demonstrated OPERABLE:

- a. At least once per 12 months by cycling each testable valve in the flow path through at least one complete cycle of full travel.
- b. At least once per 18 months:
  1. By performing a system functional test which includes tripping detectors and verifying actuation of trip devices on associated deluge valves. Deluge/sprinkler valves shall be inspected internally to verify operability in all instances where header flooding during the test is not practical.
  2. Cycling each valve in the flow path that is not testable during plant operation through at least one complete cycle of full travel.
  3. By visual inspection of the deluge headers to verify their integrity.
  4. By visual inspection of each nozzle to verify no blockage.
- c. At least one per 3 years by performing an air or gas flow test through each deluge header and verifying each deluge nozzle is unobstructed.

### HALON SYSTEM

4.7.10.3.1 The Cable Room and Transformer Room Halon system shall be demonstrated OPERABLE at least once per 6 months by verifying each Halon storage tank weight and pressure.

4.7.10.3.2 The Air Intake Tunnel Halon System shall be demonstrated OPERABLE:

- a. At least once per 6 months by verifying pressure in each halon storage tank, and
- b. At least once per 18 months by verifying storage tank weight.

## SURVEILLANCE REQUIREMENTS

---

### FIRE HOSE STATIONS

4.7.10.4 Each fire hose station listed in Table 4.7-1 shall be verified OPERABLE:

- a. At least once per 31 days by visual inspection of the station to assure all required equipment is at the station.
- b. At least once per 18 months by:
  1. Removing the hose for inspection and re-racking, and
  2. Replacement of all degraded gaskets in couplings.
- c. At least once per 3 years by:
  1. Partially opening each hose station valve to verify valve OPERABILITY and no flow blockage.
  2. Conducting a hose hydrostatic test at a pressure at least 50 psig greater than the maximum pressure available at that hose station.

### PENETRATION FIRE BARRIERS

4.7.11 The required (accessible per occupational exposure considerations) penetration fire barriers shall be verified to be functional:

- a. At least once per 18 months by a visual inspection.
- b. Prior to returning a penetration fire barrier to functional status following repairs or maintenance by performance of a visual inspection of the affected penetration fire barrier(s).

TABLE 4.7-1

FIRE HOSE STATIONS

Auxiliary Building

1. Fire hose near stairway at South end of building near Decay Heat Closed Cooling Surge Tank, 328' elevation.
2. Fire hose near entrance to Chemical Addition area, 328' elevation.
3. Fire hose near Miscellaneous Waste Holdup Tank room, 305' elevation.
4. Fire hose near Intermediate Closed Coolers, 305' elevation.
5. Fire hose near Evaporator Condensate Test Tank Room, 280' elevation.
6. Fire hose near Reactor Building Emergency Cooling Booster Pumps, 280' elevation.

Control Building Area

1. Fire hose near 480 Volt Bus 2-34 282'6" elevation.
2. Fire hose near entrance to Service Building 282'6" elevation.

Reactor Building\*

1. Deleted.
2. Deleted.
3. Fire hose near West stairway, 305' elevation.
4. Fire hose near Southwest stairway, 305' elevation.
5. Fire hose on East D-ring, 367' elevation.
6. Fire hose on West D-ring, 367' elevation.

Control Building

1. Fire hose near doorway on North wall, 305' elevation.

Fuel Hand Building

1. Fire hose on East wall, 347'6" elevation.

\*Fire hose stations in the Reactor Building shall be OPERABLE prior to initiating operations which generate combustible materials, and prior to initiating operations which involve the use of open flames, welding, boring, grinding, etc.

## SURVEILLANCE REQUIREMENTS

---

### 4.8 ELECTRICAL POWER SYSTEMS

#### 4.8.2 A.C. SOURCES

4.8.1.1.1 Each of the required independent circuits between the offsite transmission network and the onsite Class 1E distribution system shall be determined OPERABLE at least once per 7 days by verifying correct breaker alignments and indicated power availability.

4.8.1.1.2 Each diesel generator shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by:
    - 1. Verifying the fuel level in the day fuel tank.
    - 2. Verifying the fuel level in the fuel storage system.
    - 3. Verifying the fuel transfer pump can be started and transfers fuel from the storage system to the day tank.
    - 4. Verifying the Class 1E diesels start from ambient condition and accelerate to at least 900 rpm (ie 60 Hz on the generator) in less than or equal to 10 seconds.
    - 5. Verifying each Class 1E diesel generator is synchronized; loaded to greater than or equal to 3000 kw, and operates for greater than or equal to 60 minutes.
    - 6. Verifying the diesel generator is aligned to provide standby power to the associated emergency busses.
  - b. At least once per 92 days by verifying that a sample of diesel fuel obtained in accordance with ASTM-D270-63, from the fuel storage tank is within the acceptable limits specified in Table 1 of ASTM D975-74 when checked for viscosity, water and sediment.
- 4.8.1.1.3 Deleted.

## SURVEILLANCE REQUIREMENTS

### A.C. SOURCES (Continued)

4.8.1.1.4 Deleted.

### 4.8.2 ONSITE POWER DISTRIBUTION SYSTEMS

#### A.C. DISTRIBUTION

4.8.2.1 The specified A.C. busses shall be determined OPERABLE with tie breakers open between redundant busses at least once per 7 days by verifying correct breaker alignment and indicated power availability.

- 4160 volt Emergency Bus # 2-1E and 2-3E
- 4160 volt Emergency Bus # 2-2E and 2-4E
- 4160 volt Busses # 2-3 and 2-4
- 480 volt Emergency Bus # 2-11E, 2-12E and 2-31E
- 480 volt Emergency Bus # 2-21E, 2-22E and 2-41E
- 480 volt Busses # 2-32, 2-35, 2-36, 2-42, 2-45, and 2-46
- 120 volt A.C. Vital Bus # 2-1V
- 120 volt A.C. Vital Bus # 2-2V
- 120 volt A.C. Vital Bus # 2-3V
- 120 volt A.C. Vital Bus # 2-4V

#### D.C. DISTRIBUTION

4.8.2.2.1 Each D.C. bus train shall be determined OPERABLE and energized with tie breakers open at least once per 7 days by verifying correct breaker alignment and indicated power availability.

4.8.2.3.2 Each 250/125-volt battery bank and charger shall be demonstrated OPERABLE:

- a. At least once per 7 days by verifying that:
  - 1. The electrolyte level of each pilot cell is between the minimum and maximum level indication marks.
  - 2. The pilot cell specific gravity, corrected to 77°F and full electrolyte level, is greater than or equal to 1.20.
  - 3. The pilot cell voltage is greater than or equal to 2.13 volts.
  - 4. The overall battery voltage is greater than or equal to 250/125 volts.

## SURVEILLANCE REQUIREMENTS

---

### D.C. DISTRIBUTION (Continued)

- b. At least once per 92 days by verifying that:
  - 1. The voltage of each connected cell is greater than or equal to 2.13 volts under float charge and has not decreased more than 0.10 volts from the value observed during the original acceptance test.
  - 2. The specific gravity, correct to 77°F and full electrolyte level, of each connected cell is greater than or equal to 1.20 and has not decreased more than 0.01 from the value observed during the previous test.
  - 3. The electrolyte level of each connected cell is between the minimum and maximum level indication marks.
- c. At least once per 18 months by verifying that:
  - 1. The cells, cell plates and battery racks show no visual indication of physical damage or deterioration.
  - 2. The cell-to-cell and terminal connections are clean, tight and coated with anti-corrosion material.



## SURVEILLANCE REQUIREMENTS

### 4.9 LIQUID RADWASTE STORAGE

#### SPENT FUEL STORAGE POOL "A" WATER LEVEL MONITORING

4.9.1 The Spent Fuel Storage Pool "A" water level monitoring instrumentation shall be demonstrated OPERABLE as required by Table 4.3-7.

4.9.2 Verify that surveillance of Spent Fuel Storage Pool "A" water level is being performed in accordance with NRC approved procedures.

#### FUEL TRANSFER CANAL WATER LEVEL MONITORING

4.9.3 The Fuel Transfer Canal (deep end) water level monitoring instrumentation shall be demonstrated OPERABLE as required by Table 4.3-7.

4.9.4 Verify that surveillance of the Fuel Transfer Canal (deep end) water level is being performed in accordance with NRC approved procedures.

#### FUEL HANDLING BUILDING/AUXILIARY BUILDING AIR CLEANUP SYSTEMS

4.9.12.1 The Fuel Handling Building Air Cleanup Exhaust System shall be demonstrated OPERABLE:

A. At least once per 31 days by verifying that the Air Cleanup Exhaust System in the normal operating mode meets the following conditions:

- \*\* 1. Exhaust Flow Rate: With two filter trains and two exhaust fans in operation in the Fuel Handling Building flow rate shall be within the 36,000 cfm to 54,000 cfm operating band.
- 2. Filter Pressure Drop: While operating within the flow rate specified in 4.9.12.1.A.1 above, the d/p across the combined HEPA filters and charcoal adsorbers shall not exceed 6 inches water gauge.
- 3. Fuel Handling Building Pressure: Demonstrate that the system is capable of achieving a negative pressure within the building equal to or greater (more negative) than 1/8 inch water gauge with respect to atmospheric. It may be necessary to close doors and other building openings to achieve the required value.

\*\* With the fuel transfer tubes open and the Fuel Pool not flooded in accordance with NRC approved procedures, the FHB exhaust flowrate shall be maintained between 26,000 cfm and 54,000 cfm. This condition applies only during system operation (not during system surveillance testing) performed to the criteria of Tech Spec 4.9.12.1.A.

## SURVEILLANCE REQUIREMENTS

---

- B. At least once per 18 months by verifying that the ventilation system meets the following conditions:
1. Visually inspect each filter train and associated components in accordance with Section 5 of ANSI N510-1980, as required by Regulatory Position C.5.a of Regulatory Guide 1.52, Revision 2, March 1978. The inspection should be performed prior to the flow and DOP tests of this section.
  2. Flow Test: Exhaust flow rate shall be within 18,000 cfm to 27,000 cfm operating band for each filter train with one filter train and one exhaust fan operating. Testing shall be in accordance with ANSI N510-1980, Section 8.3.1, Paragraphs 3 and 4.
  3. DOP Test: Each filter train shall be tested in accordance with Section 10 of ANSI N510-1980, as required by Regulatory Position C.5.c of Regulatory Guide 1.52, Revision 2, March 1978. Flow through the filter train being tested shall be as prescribed for the flow test in Section 4.9.12.1.b.2 above.

NOTE: Installed system flow instrumentation is adequate for the test described in 4.9.12.1.b.3 above.

## SURVEILLANCE REQUIREMENTS

4. Fuel Handling Building Pressure: Demonstrate that the system is capable of achieving a negative pressure within the building equal to or greater (more negative) than 1/8 inch water gauge with respect to atmospheric. It may be necessary to close doors and other building openings to achieve the required value. A test instrument, such as an inclined manometer or equivalent, shall be used in the performance of this test.
- c. After structural maintenance of the HEPA filter or charcoal adsorber housings, or following fire or chemical release in any ventilation zone communicating with the system by verifying that the ventilation system meets the following conditions:
  1. Flow Test: Reverify exhaust flow rate for the affected filter train(s) per Section 4.9.12.1.b.2.
  2. Filter Pressure Drop: Reverify the filter pressure drop surveillance prescribed in Section 4.9.12.1.a.2 for the affected filter train(s)
  3. DOP Test: Each affected filter train shall be retested in accordance with Section 4.9.12.1.b.3.
- d. After each complete or partial replacement of a HEPA filter bank by verifying that the ventilation system meets the following conditions:
  1. DOP Test: Each affected filter train shall be retested in accordance with Section 4.9.12.1.b.3.

NOTE: Supply fans may be operated as desired except that the number of operating supply fans shall not exceed the number of operating exhaust fans.

### 4.9.12.2 The Auxiliary Building Air Cleanup Exhaust System shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that the air cleanup exhaust system in the normal operating mode meets the following conditions:
  1. Exhaust Flow Rate: With two filter trains and two exhaust fans in operation in the Auxiliary building flow rate shall be within the 54,000 cfm to 80,000 cfm operating band.
  2. Filter Pressure Drop: While operating within the flow rate specified in 4.9.12.2.a.1 above, the d/p across the combined HEPA filters and charcoal adsorbers shall not exceed 6 inches water gauge.

## SURVEILLANCE REQUIREMENTS

3. Auxiliary Building Pressure: Demonstrate that the system is capable of achieving negative pressure within the building equal to or greater (more negative) than 1/8 inch water gauge with respect to atmospheric. It may be necessary to close doors and other building openings to achieve the required value.
- b. At least once per 18 months by verifying that the ventilation system meets the following conditions:
  1. Visually inspect each filter train and associated components in accordance with Section 5 of ANSI N510-1980, as required by Regulatory Position C.5.a of Regulatory Guide 1.52, Revision 2, March 1978. The inspection should be performed prior to the flow and DOP tests of this section.
  2. Flow Test: Exhaust flow rate shall be within 27,000 cfm to 40,000 cfm operating band for each filter train with one filter train and one exhaust fan operating. Testing shall be in accordance with ANSI N510-1980, Section 8.3.1, Paragraphs 3 and 4.
  3. DOP Test: Each filter train shall be tested in accordance with Section 10 of ANSI N510-1980, as required by Regulatory Position C.5.c of Regulatory Guide 1.52, Revision 2, March 1978. Flow through the filter train being tested shall be as prescribed for the flow test in Section 4.9.12.2.b.2 above.

NOTE: Installed system flow instrumentation is adequate for the test described in 4.9.12.2.b.3. above.

4. Auxiliary Building Pressure: Demonstrate that the system is capable of achieving a negative pressure within the building equal to or greater (more negative) than 1/8 inch water gauge with respect to atmospheric. It may be necessary to close doors and other building openings to achieve the required value. A test instrument, such as an inclined manometer or equivalent, shall be used in the performance of this test.
- c. After structural maintenance of the HEPA filter or charcoal adsorber housing, or following fire or chemical release in any ventilation zone communicating with the system by verifying that the ventilation system meets the following conditions:
  1. Flow Test: Reverify exhaust flow rate for the affected filter train(s) per Section 4.9.12.2.b.2.
  2. Filter Pressure Drop: Reverify the filter pressure drop surveillance prescribed in Section 4.9.12.2.a.2 for the affected filter train(s).

## SURVEILLANCE REQUIREMENTS

---

3. DOP Test: Each affected filter train shall be retested in accordance with Section 4.9.12.2.b.3.
  - d. After each complete or partial replacement of a HEPA filter bank by verifying that the ventilation system meets the following conditions:
    1. DOP Test: Each affected filter train shall be retested in accordance with Section 4.9.12.2.b.3.
- NOTE: Supply fans may be operated as desired except that the number of operating supply fans shall not exceed the number of operating exhaust fans.

SECTION 5.0  
DESIGN FEATURES



## 5.0 DESIGN FEATURES

---

### 5.1 SITE

#### EXCLUSION AREA

5.1.1 The exclusion area is shown on Figure 5.1-1.

#### LOW POPULATION ZONE

5.1.2 The low population zone is shown on Figure 5.1-2.

#### SITE BOUNDARY FOR GASEOUS EFFLUENTS

5.1.3 The site boundary for gaseous effluents shall be as shown in Figure 5.1-3.

#### SITE BOUNDARY FOR LIQUID EFFLUENTS

5.1.4 The site boundary for liquid effluents shall be as shown in Figure 5.1-4.

### 5.2 CONTAINMENT


#### CONFIGURATION

5.2.1 The reactor containment building is a steel lined, reinforced concrete building of cylindrical shape, with a dome roof and having the following design features:

- a. Nominal inside diameter = 130 feet.
- b. Nominal inside height = 157 feet.
- c. Minimum thickness of concrete walls = 4 feet.
- d. Minimum thickness of concrete roof = 3.5 feet.
- e. Minimum thickness of concrete floor pad = 13.5 feet.
- f. Nominal thickness of steel liner = 1/2 inches.
- g. Net free volume =  $2.1 \times 10^6$  cubic feet.


#### DESIGN PRESSURE AND TEMPERATURE

5.2.2 The reactor containment building is designed and shall be maintained for a maximum internal pressure of 2 psig and a temperature of 286°F.

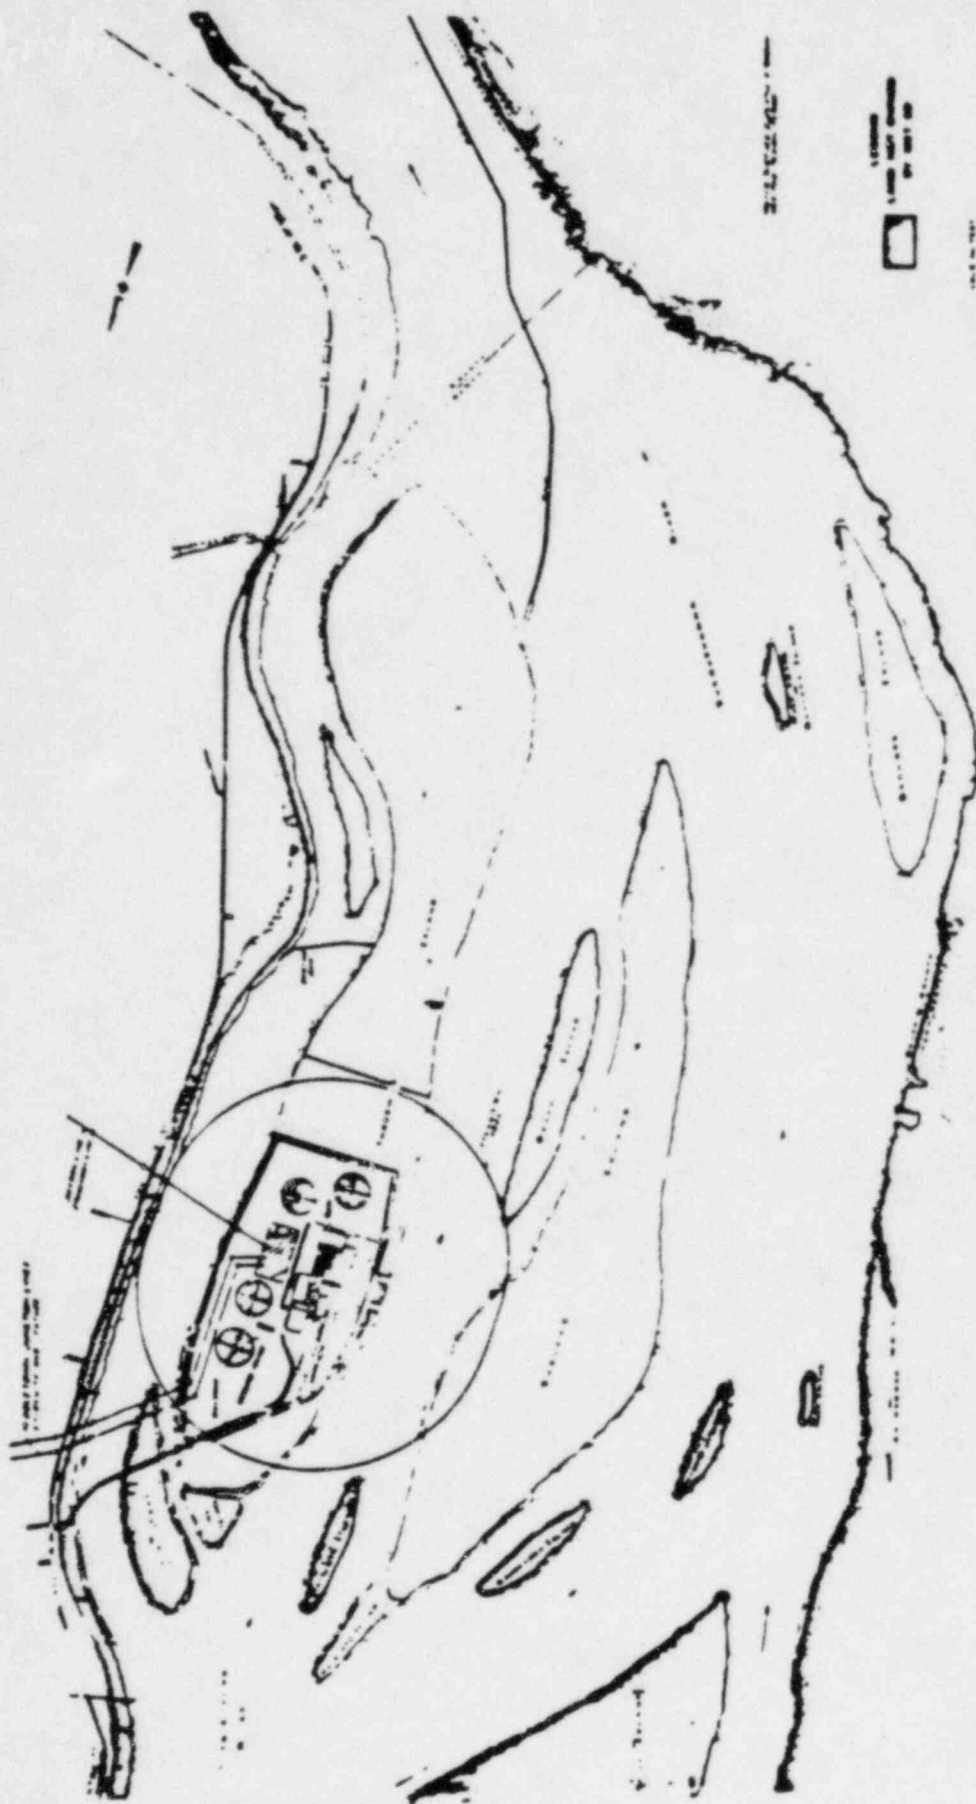

EXCLUSION AREA

FIGURE 5.1-1

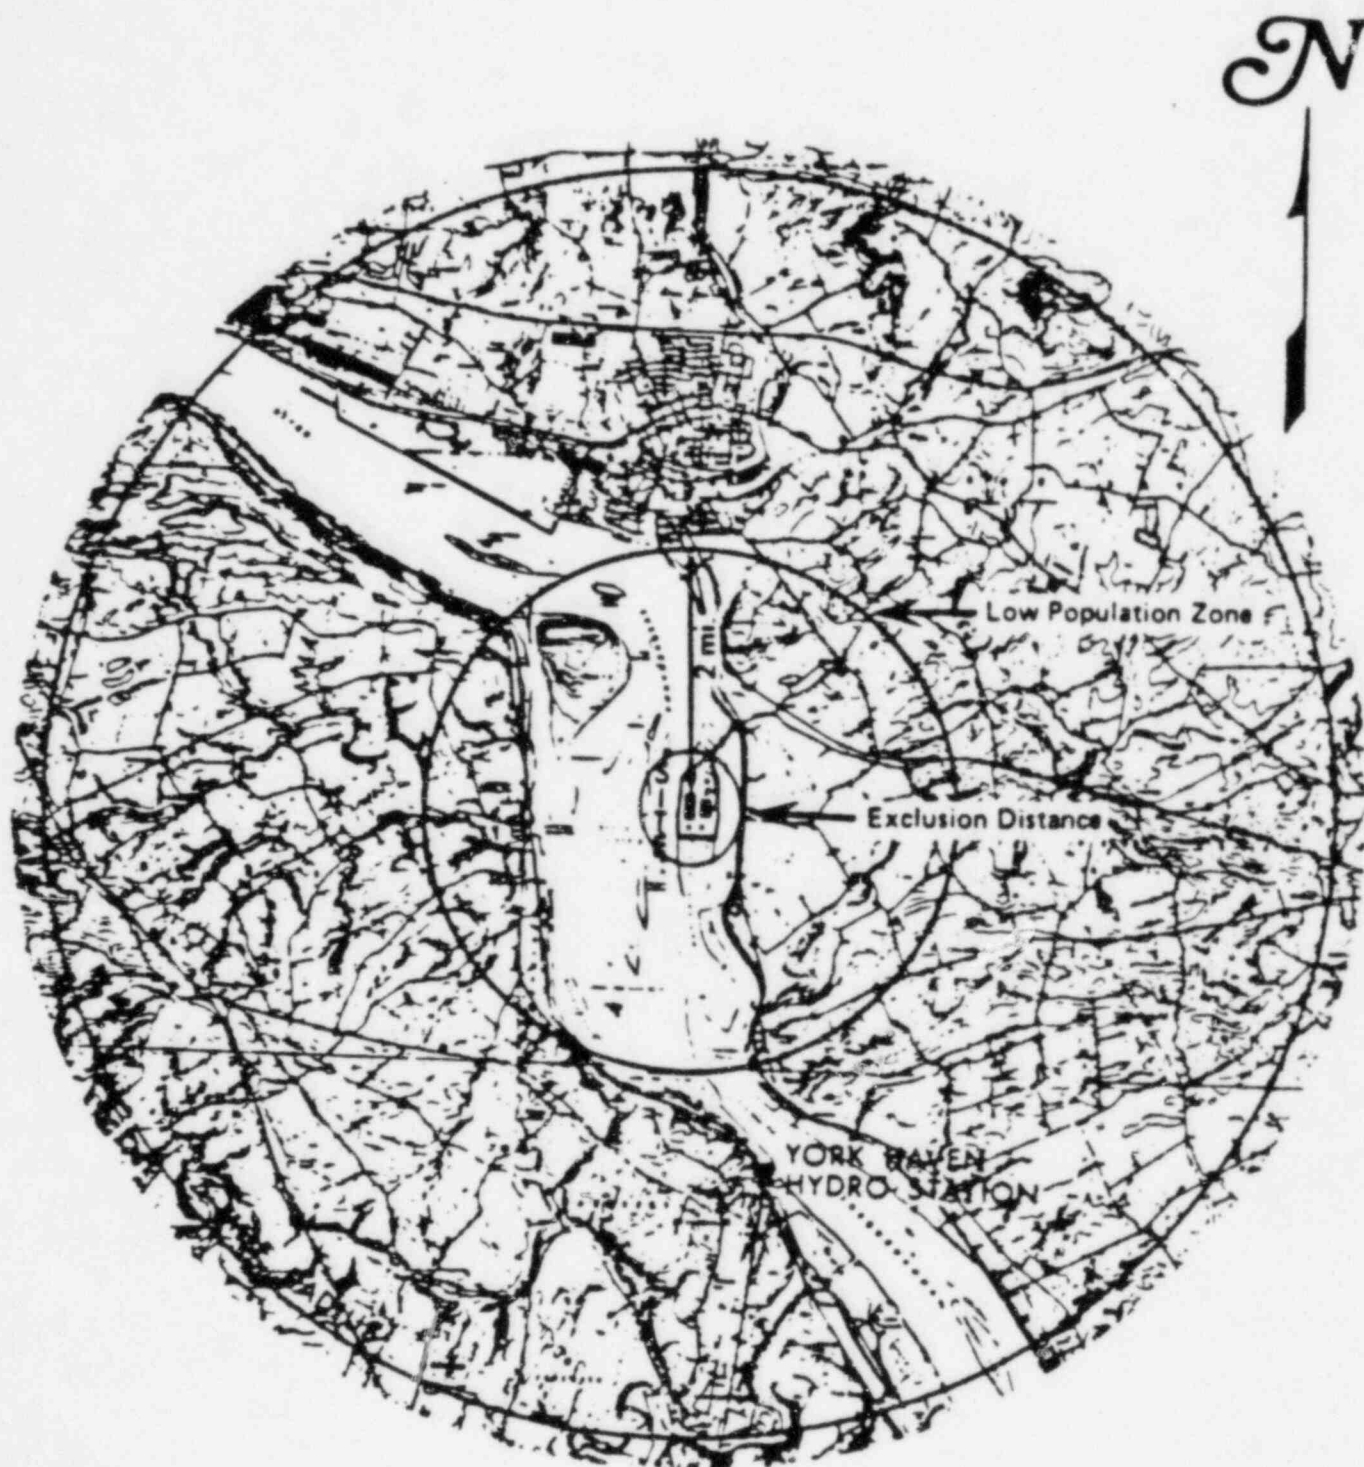

LOW POPULATION ZONE

FIGURE 5.1-2

## DESIGN FEATURES

---

### 5.4 REACTOR COOLANT SYSTEM

#### DESIGN PRESSURE AND TEMPERATURE


5.4.1 Deleted

#### VOLUME

5.4.2 The total water and steam volume of the reactor coolant system is  $12,180 \pm 200$  cubic feet at a nominal  $T_{avg}$  of  $525^{\circ}\text{F}$ .

### 5.5 METEOROLOGICAL TOWER LOCATION

5.5.1 The meteorological tower shall be located as shown on Figure 5.5-1.

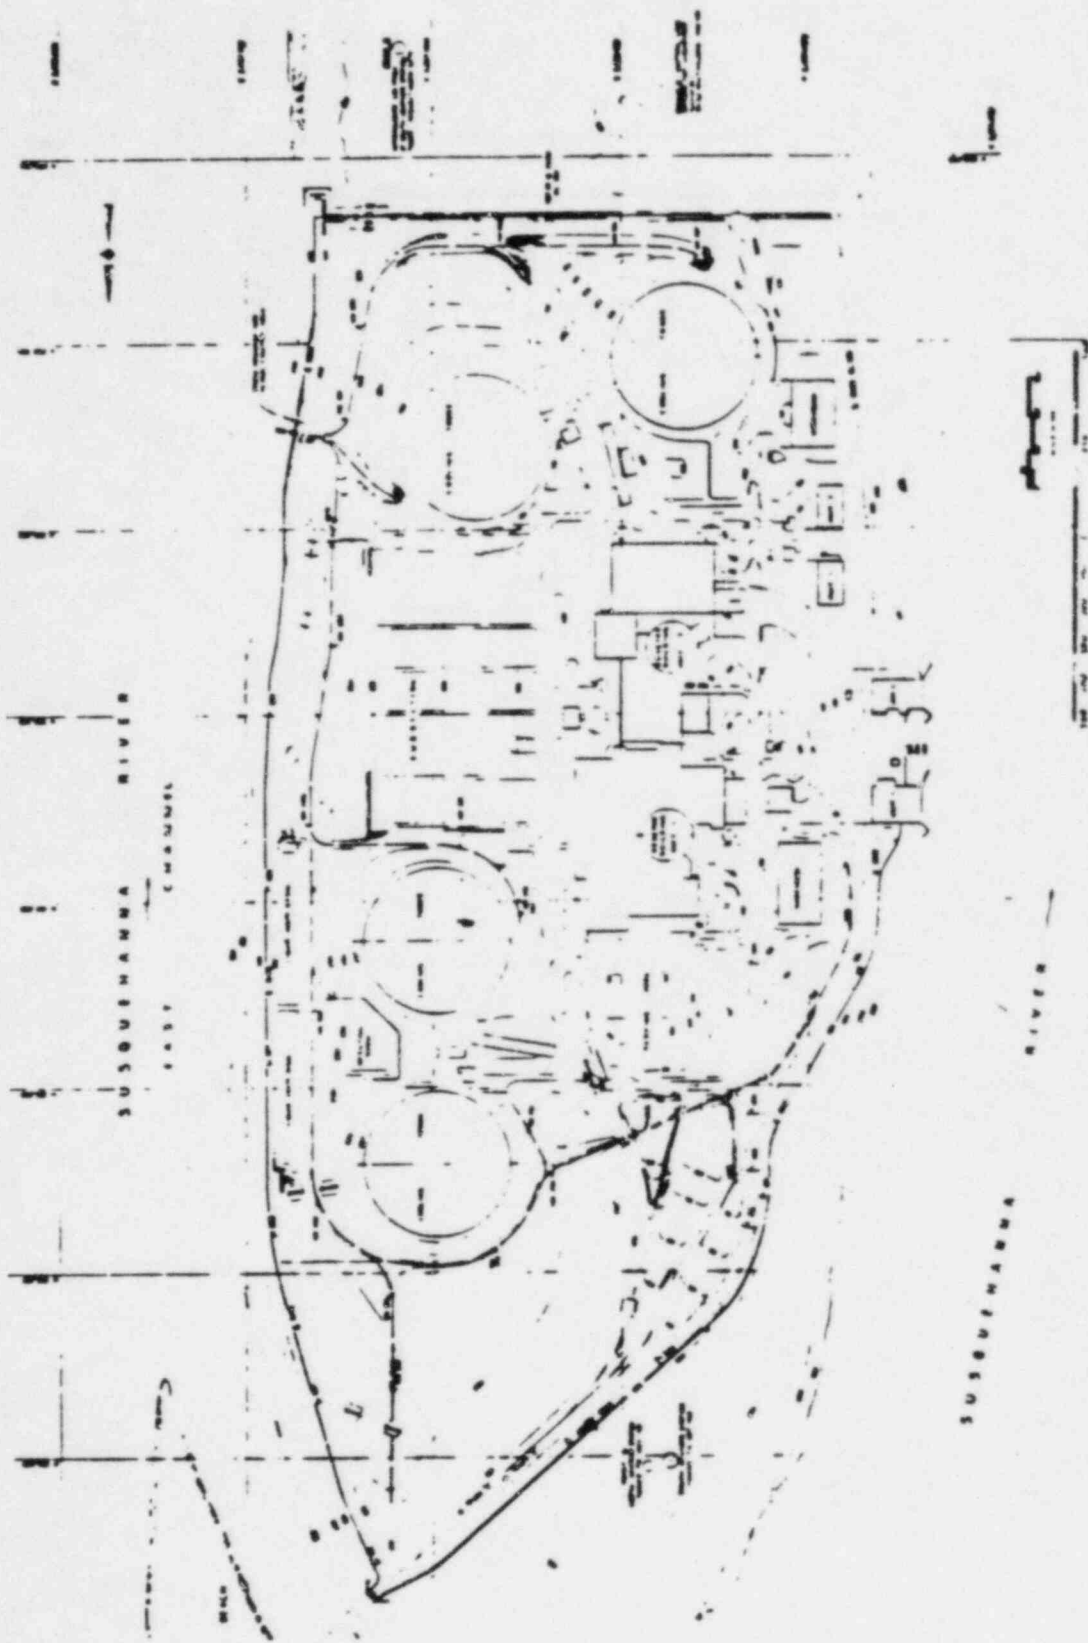

METEOROLOGICAL TOWER LOCATIONS

Figure 5.5-1

SECTION 6.0  
ADMINISTRATIVE CONTROLS



## 6.0 ADMINISTRATIVE CONTROLS

### 6.1 RESPONSIBILITY

6.1.1 The Office of the Director-TMI-2 consists of the Director-TMI-2 and the Deputy Director-TMI-2 and shall be responsible for overall unit operation and shall delegate in writing the succession to this responsibility during both of their absences.

### 6.2 ORGANIZATION

#### GPUNC ORGANIZATION

6.2.1 The GPU Nuclear Corporation (GPUNC) Organization for unit management and technical support shall be as shown on Figure 1-1 of the Organization Plan. The Organization Plan and changes thereto shall be approved by the NRC prior to implementation.

#### TMI-2 ORGANIZATION

6.2.2 The unit organization shall be shown on Figure 1-2 of the Organization Plan and:

- a. Each on duty shift shall be composed of at least the minimum shift crew composition shown in Table 6.2-1.
- b. At least one licensed Operator shall be in the control room when fuel is in the reactor.
- c. An individual qualified in radiation protection procedures shall be on site when fuel is in the reactor.
- d. A Site Fire Brigade of at least 5 members shall be maintained onsite at all times. The Site Fire Brigade shall not include 3 members of the minimum shift crew necessary for safe shutdown of the unit and any personnel required for other essential functions during a fire emergency.
- e. An individual qualified in radiation protection procedures shall be on site whenever Radioactive Waste Management activities are in progress.

## ADMINISTRATIVE CONTROLS

Table 6.2-1

MINIMUM SHIFT CREW COMPOSITION#

LICENSE CATEGORY	RECOVERY MODE
SOL	1*
OL	1
Non-Licensed	2

#Shift crew composition may be less than the minimum requirements for a period of time not to exceed 2 hours in order to accommodate unexpected absence of on duty shift crew members provided immediate action is taken to restore the shift crew composition to within the minimum requirements of Table 6.2-1.

\*During CORE ALTERATIONS an additional SOL or an SOL limited to fuel handling will be stationed on the operating floor, in the command center, or in the control room as specified in procedures approved pursuant to specification 6.8.2 to directly control the particular CORE ALTERATION activity being performed.

## ADMINISTRATIVE CONTROLS

---

### 6.3 UNIT STAFF QUALIFICATIONS

6.3.1 Each member of the unit staff shall meet or exceed the minimum qualifications of ANSI-N 18.1 of 1971 for comparable positions unless otherwise noted in the Technical Specifications.

6.3.2 The Radiological Controls Director TMI-2 or his deputy shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975. Each Radiological Controls Technician in responsible positions/Foreman shall meet or exceed the qualifications of ANSI 18.1-1971, paragraph 4.5.2/4.3.2, or be formally qualified through an NRC approved TMI-2 Radiation Controls training program. Individuals who do not meet ANSI 18.1-1971 Section 4.5.2 are not considered technicians for purposes of determining qualifications but are permitted to perform work for which qualification has been demonstrated. All Radiological Controls Technicians will be qualified through training and examination in each area or specific task related to their radiological controls functions prior to their performance of those tasks.

### 6.4 TRAINING

6.4.1 A retraining and replacement training program for the unit staff shall be maintained under the direction of the Plant Training Manager and shall meet or exceed the requirements and recommendations of Regulatory Guide 1.8 of 1977 and Appendix "A" of 10 CFR Part 55 except that Radiological Controls training may be under the direction of Vice President-Radiological and Environmental Controls.

6.4.2 A training program for the Fire Brigade shall be maintained under the direction of the Plant Training Manager and shall meet or exceed the requirements of Section 27 of the NFPA Code-1976.

### 6.5 REVIEW AND AUDIT

#### 6.5.1 Technical Review and Control

The Office of TMI-2 Division Director and Support Division Vice-Presidents within GPU Nuclear Corporation as indicated in Organization Plan Figure 1.1, shall be responsible for ensuring the preparation, review, and approval of documents required by the activities within their functional area of responsibility for TMI-2. Implementing approvals shall be performed at the cognizant section manager/director level or above. Independent safety review and audit shall be conducted in accordance with this Technical Specification.

Divisions other than the TMI-2 Division will perform the Independent Safety Review of their own procedures affecting TMI-2 in accordance with approved procedures except when they impact the operational status of unit systems or equipment (requires TMI-2 Division concurrence), a significant environmental impact (requires in line SRG and Environmental Licensing review), or represent an Unreviewed Safety Question (USQ) or Tech Spec change, including Recovery Operations Plan Change (requires in line SRG review and NRC approval).

## ADMINISTRATIVE CONTROLS

### ACTIVITIES

6.5.1.1 Each procedure required by Technical Specification 6.8 and other procedures including those for test and experiments and changes thereto shall be prepared by a designated individual(s)/group knowledgeable in the area affected by the procedure. Each such procedure, and changes thereto, shall be given a technical review by an individuals(s)/group other than the preparer, but who may be from the same organization as the individual who prepared the procedure or change.

6.5.1.2 Proposed changes to the Technical Specifications shall be reviewed by a knowledgeable individual(s)/group other than the individual(s)/group who prepared the change, and the SRG.

6.5.1.3 Proposed modifications to unit structures, systems and components shall be designed by an individual/organization knowledgeable in the areas affected by the proposed modification. Each such modification shall be technically reviewed by an individual/group other than the individual/group which designed the modification but may be from the same group as the individual who designed the modification.

6.5.1.4 Proposed tests and experiments shall be reviewed by a knowledgeable individual(s)/group other than the preparer but who may be from the same division as the individual who prepared the tests and experiments.

6.5.1.5 The Security Plan and implementing procedures shall be reviewed by a knowledgeable individual(s)/group other than the individual(s)/group which prepared them.

6.5.1.6 The Emergency Plan and implementing procedures shall be reviewed by a knowledgeable individual(s)/group other than the individual(s)/group which prepared them.

6.5.1.7 The Recovery Operations Plan and implementing procedures and changes thereto shall be reviewed by a knowledgeable individual/group other than the individual/group which prepared them.

6.5.1.8 Individuals responsible for reviews performed in accordance with 6.5.1.1 through 6.5.1.7 shall include a determination of whether or not additional cross-disciplinary review is necessary. If deemed necessary, such review shall be performed by the appropriate personnel.

6.5.1.9 Support Division procedures will be reviewed and approved in accordance with their Division level procedures. If the procedure/change impacts the operational status of unit systems or equipment, it must be concurred with by the TMI-2 Division. Unreviewed Safety Question, Technical Specification change (including Recovery Operations Plan change), or Significant Environmental Impact requires line TMI-2 Division and SRG review prior to implementation.

## ADMINISTRATIVE CONTROLS

### RECORDS

6.5.1.10 Written records of activities performed under specifications 6.5.1.1 through 6.5.1.8 shall be maintained in accordance with 6.10.

### QUALIFICATIONS

6.5.1.11 Responsible Technical Reviewers shall meet or exceed the qualifications of ANSI/ANS-3.1 - 1978 Section 4.4 for Reactor Engineering, Instrumentation and Control, Chemistry and Radiochemistry, Radiation Protection and Quality Assurance Reviewers or have seven (7) years of appropriate experience in the area of their specialty. All other RTRs shall meet Section 4.6, i.e., shall either, (1) have a Bachelor's Degree in Engineering or the physical sciences and three years of professional-level experience in the area being reviewed or, (2) have seven years of appropriate experience in the field of their specialty. An individual performing reviews may possess competence in more than one specialty area. Credit toward experience will be given for advanced degrees on a one-for-one basis up to a maximum of two years.

### 6.5.2 INDEPENDENT SAFETY REVIEW

#### FUNCTION

6.5.2.1 The Office of TMI-2 Division Director and Support Division Vice Presidents within GPU Nuclear Corporation as indicated in Organization Plan Figure 1.1 shall be responsible for ensuring the Independent Safety Review of the subjects described in 6.5.2.5 within his assigned area of safety review responsibility.

Divisions other than the TMI-2 Division will perform the Independent Safety Review of their own procedures affecting TMI-2 in accordance with approved procedures except when they impact the operational status of unit systems or equipment (requires TMI-2 Division concurrence), a significant environmental impact (requires in line SRG and Environmental Licensing review), or represent and Unreviewed Safety Question (USQ) or Tech. Spec. change, including Recovery Operations Plan Change (requires in line SRG review and NRC approval).

When the Preparer determines a procedure is not Review Significant, the signature of the RTR indicates concurrence with this determination.

6.5.2.2 Independent safety review shall be completed by an individual/group not having direct responsibility for the performance of the activities under review, but who may be from the same functionally cognizant organization as the individual/group performing the original work. For those TMI-2 Division documents determined to be Review Significant, the Independent Safety Review shall be performed by or under the cognizance of SRG.



## ADMINISTRATIVE CONTROLS

6.5.2.3 GPU Nuclear Corporation shall collectively have or have access to the experience and competence required to independently review subjects in the following areas:

- a. Nuclear Unit operations
- b. Nuclear engineering
- c. Chemistry and radiochemistry
- d. Metallurgy
- e. Instrumentation and control
- f. Radiological safety
- g. Mechanical engineering
- h. Electrical engineering
- i. Administrative controls and quality assurance practices
- j. Emergency plans and related organization, procedures and equipment
- k. Other appropriate fields such as radioactive waste operation associated with the unique characteristics of TMI-2.

6.5.2.4 Consultants may be utilized to provide expert advice.

## RESPONSIBILITIES

6.5.2.5 The following subjects shall be independently reviewed:

- a. Written safety evaluations of changes in the facility as described in the Safety Analysis Report, Technical Evaluation Reports, or docketed System Descriptions, changes in procedures as described in the Safety Analysis Report, Technical Evaluation Reports, or docketed System Descriptions, and tests or experiments not described in the Safety Analysis Report, Technical Evaluation Reports, or docketed System Descriptions, which are completed without prior NRC approval under the provisions of 10 CFR 50.59(a)(1). This review of items determined not to be Review Significant when performed by SRG is a supplemental review to verify that such changes, tests or experiments did not involve a change in the Technical Specifications or an Unreviewed Safety Question.
- b. Proposed changes in procedures, proposed changes to the facility, or proposed tests or experiments, any of which involves a change in the Technical Specifications or an Unreviewed Safety Question shall be reviewed by SRG prior to implementation. Changes to Review Significant procedures which revision is not deemed to be Review Significant shall not be required to be reviewed by SRG prior to implementation.
- c. Proposed changes to Technical Specifications or license amendments shall be reviewed by SRG prior to submittal to the NRC for approval.
- d. Violations, deviations, and reportable events which require either one or four hour immediate notification to the NRC. Such reviews are performed after the fact. Review of events covered under this subsection shall include results of any investigations made and the recommendations.



## ADMINISTRATIVE CONTROLS

resulting from such investigations to prevent or reduce the probability of recurrence of the event. SRG shall review all one or four hour immediate notifications and make recommendations as appropriate.

- e. Investigation of all reportable events including the preparation and forwarding of reports covering evaluation and recommendations to prevent recurrence, shall be reviewed by TMI-2 SRG.
- f. Special reviews, investigations or analyses and reports thereon as requested by the Office of the Director TMI-2 or other manager reporting directly to the Office of the Director TMI-2 shall be performed by TMI-2 SRG.
- g. Written summaries of audit reports in the area specified in section 6.5.3.
- h. Recognized indications of an unanticipated deficiency in some aspect of design or operation of structures, systems, or components, that could affect nuclear safety or radioactive waste safety.
- i. Any other matters involving safe operation of the nuclear power plant which the SRG deems appropriate for consideration, or which are referred to the SRG.

6.5.2.6 For those subjects which are REVIEW SIGNIFICANT the Independent Safety Review will be performed by an individual(s) meeting the qualifications of Section 6.5.4.7.

## RECORDS

6.5.2.7 Reports of reviews encompassed in Section 6.5.2.5 shall be maintained in accordance with 6.10.

### 6.5.3 Audits

6.5.3.1 Audits of unit activities shall be performed in accordance with the TMI-2 Recovery QA Plan. These audits shall encompass:

- a. The conformance of unit operations to provisions contained within the Technical Specifications and applicable license conditions. The audit frequency shall be at least once per 12 months.
- b. The performance, training and qualifications of the entire unit staff. The audit frequency shall be at least once per 12 months.
- c. The verification of the nonconformances and corrective actions program as related to actions taken to correct deficiencies occurring in unit equipment, structures, systems or methods of operation that affect nuclear safety. The audit frequency shall be at least once per 6 months.

## ADMINISTRATIVE CONTROLS

- d. The performance of activities required by the Recovery Quality Assurance Plan to meet the criteria of Appendix "B", 10 CFR 50. The audit frequency shall be at least once per 24 months.
- e. The Emergency Plan and implementing procedures. The audit frequency shall be at least once per 12 months.
- f. The Security Plan and implementing procedures. The audit frequency shall be at least once per 12 months.
- g. The Radiation Protection Plan and implementing procedures. The audit frequency shall be at least once per 12 months.
- h. The Fire Protection Program and implementing procedures. The audit frequency shall be at least once per 24 months.
- i. An independent fire protection and loss prevention program inspection and technical audit shall be performed annually utilizing either qualified offsite licensee personnel or an outside fire protection firm.
- j. An inspection and technical audit of the fire protection and loss prevention program, by an outside qualified fire consultant at intervals no greater than 3 years.
- k. Any other area of unit operation considered appropriate by the SRG, the Manager, SRG's immediate supervisor, other managers reporting directly to the Office of the Director TMI-2, the Office of the Director TMI-2, or the Office of the President - GPUNC. any other areas required to be audited by QA will be identified to the appropriate QA Management level.

## RECORDS

6.5.3.2 Audit reports encompassed by sections 6.5.3.1 shall be forwarded for action to the management positions responsible for the areas audited and SRG within 60 days after completion of the audit. SRG will review specified audits performed by QA and make corrective action recommendations as appropriate.

### 6.5.4 Safety Review Group (SRG)

## FUNCTION

6.5.4.1 The SRG shall be a full-time group of engineers, independent of the Site Operations of Engineering staff, and located onsite within the TMI-2 division. (See Organization Plan Figure 1.2.)

## ORGANIZATION

6.5.4.2 The TMI-2 SRG shall consist of the Manager, SRG and a minimum staff of 5 engineers.

## ADMINISTRATIVE CONTROLS

---

The SRG shall report within the TMI-2 Division independent of the unit operations and engineering functions, but no lower in the organization than one level below the Office of the Director TMI-2.

### RESPONSIBILITY

6.5.4.3 The Manager, SRG is advisory to the Office of the Director TMI-2. However, he has the authority and responsibility to bring to the attention of the Office of the President GPUNC any issues he believes are not being addressed with adequate consideration of nuclear or radiological safety.

6.5.4.4 The review functions of the SRG shall include:

- (1) the independent safety review activities stated in Section 6.5.2.5.
- (2) assessment of unit operations and performance and unit safety programs from a nuclear safety perspective.
- (3) any other matter involving safe nuclear operations at the nuclear power plant that the Manager, SRG, the Manager, SRG's immediate supervisor, or other managers reporting directly to the Office of the Director TMI-2 deem appropriate for consideration.

6.5.4.5 For those reviews requiring expertise outside that possessed by SRG, SRG is authorized to require reviews by other company groups as deemed appropriate by the Manager, SRG. SRG may also utilize consultant expertise as it deems appropriate.

### Authority

6.5.4.6 The SRG shall have access to the unit and unit records as necessary to perform its evaluations and assessments. Based on its reviews, the SRG shall provide recommendations to the management positions responsible for the areas reviewed. The SRG shall have authority to require independent reviews by other organizations as necessary to complete its functional responsibilities. The Manager, SRG is advisory to the Office of the Director TMI-2. However, he has the authority and responsibility to bring to the attention of the Office of the President any issues he believes are not being addressed with adequate consideration of nuclear or radiological safety.

### QUALIFICATIONS

6.5.4.7 The SRG engineers shall have either; (1) a Bachelor's Degree in Engineering or the Physical Sciences and five (5) years of professional level experience in the nuclear power field including technical supporting functions, or, (2) 9 years of appropriate experience. Credit toward experience will be given for advance degrees on a one-to-one basis up to a maximum of two years. The Manager, SRG, shall meet or exceed the requirements of section 4.7 of ANSI/ANS 3.1-1978.

## ADMINISTRATIVE CONTROLS

### RECORDS

6.5.4.8 Although day to day results of evaluations by the SRG are communicated directly to the responsible department by the SRG, special reports are prepared only for items deemed appropriate by SRG as concurred with by the Manager, SRG's immediate supervisor. These special reports of evaluations and assessments by SRG shall be prepared, approved, and then transmitted to the Office of the Director, TMI-2 and the management position responsible for the area reviewed through the Manager, SRG's immediate supervisor. These reports shall be maintained for the life of the operating license.

### 6.6 REPORTABLE EVENTS ACTION

6.6.1 The following actions shall be taken for REPORTABLE EVENTS:

- a. The Commission shall be notified and/or a report submitted pursuant to the requirements of Section 50.73 of 10 CFR Part 50, and
- b. Each REPORTABLE EVENT shall be reviewed by the SRG and a report submitted to the Manager, SRG's immediate supervisor and the Office of the Director TMI-2.
- c. Deleted.

### 6.7 SECTION DELETED

### 6.8 PROCEDURES

6.8.1 Written procedures shall be established, implemented and maintained covering the activities referenced below:

- a. The applicable procedures recommended in Appendix "A" of Regulatory Guide 1.33, Revision 2, February 1978.
- b. Recovery Operations Plan implementation.
- c. Surveillance and test activities of safety-related equipment and radioactive waste management equipment.
- d. Security Plan implementation.
- e. Emergency Plan implementation.
- f. Radiation Protection Plan implementation.
- g. Limiting the amount of overtime worked by plant staff members performing safety-related functions in accordance with the NRC policy statement on working hours as transmitted by Generic Letter 82-12.



## ADMINISTRATIVE CONTROLS

6.8.2.1 Each procedure and any change to any procedure prepared pursuant to 6.8.1, shall be prepared, reviewed and approved in accordance with 6.5 and will be reviewed periodically as required by ANSI 18.7 - 1976.

6.8.2.2 Procedures of 6.8.1.a and changes thereto which:

- a. Directly relate to core cooling, or
- b. Could cause the magnitude of radiological releases to exceed limits established by the NRC, or
- c. Could increase the likelihood of failures in systems important to nuclear safety and radioactive waste processing or storage, or
- d. Alter the distribution or processing of significant quantities of stored radioactivity or radioactivity being released through known flow paths.

Shall be subject to approval by the NRC prior to implementation.

6.8.3.1 Temporary changes to procedures of 6.8.1 may be made provided that:

- a. The intent of the original procedure control is not altered, and
- b. (1) For those procedures which affect the operational status of unit systems or equipment, the change is approved by two members of the unit management staff, at least one of whom holds a Senior Reactor Operator's License. If one of the two above signatures is not by a supervisory person within the Department having cognizance of the procedure being changed, the signature of that supervisory person within the department will also be required, or  
  
(2) For those procedures which do not affect the operational status of unit systems or equipment, the change is approved by two members of the responsible organization. If one of the two above signatures is not by a section manager/director within the Department having cognizance of the procedure being changed, the signature of that section manager/director within the department will also be required, and
- c. The change is documented, Independent Safety Review completed, and the required reviews and approvals are obtained within 14 days, and
- d. Those changes to procedures described by 6.8.2.2 are submitted to the NRC for review within 72 hours following approval by the management level specified for implementation by Section 6.5.1.9.

## 6.9 REPORTING REQUIREMENTS

### ROUTINE REPORTS AND REPORTABLE OCCURRENCES

6.9.1 In addition to the applicable reporting requirements of Title 10, Code of Federal Regulations, the following reports shall be submitted to the NRC Region I Administrator unless otherwise noted.

## ADMINISTRATIVE CONTROLS

### ANNUAL REPORTS<sup>1/</sup>

6.9.1.4 Annual reports covering the activities of the unit as described below during the previous calendar year shall be submitted prior to March 1 of each year.

6.9.1.5 Reports required on an annual basis shall include:

- a. A tabulation of the number of station, utility and other personnel (including contractors) receiving exposures greater than 100 mrem/yr and their associated man rem exposure according to work and job functions,<sup>2/</sup> e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling. The dose assignment to various duty functions may be estimates based on pocket dosimeter, TLD, or film badge measurements. Small exposures totalling less than 20% of the individual total dose need not be accounted for. In the aggregate, at least 80% of the total whole body dose received from external sources shall be assigned to specific major work functions.
- b. The following information on aircraft movements at the Harrisburg International Airport:
  1. The total number of aircraft movements (takeoffs and landings) at the Harrisburg International Airport for the previous twelve-month period.
  2. The total number of movements of aircraft larger than 200,000 pounds, based on a current percentage estimate provided by the airport manager or his designee.

### RADIATION SAFETY PROGRAM REPORT

6.9.1.6 Deleted.

### REPORTABLE OCCURRENCES

6.9.1.7 Deleted.

<sup>1/</sup> A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station.

<sup>2/</sup> This tabulation supplements the requirements of K20.407 of 10 CFR Part 20.



ADMINISTRATIVE CONTROLS

---

PROMPT NOTIFICATION WITH WRITTEN FOLLOWUP

6.9.1.8 Deleted.

THIRTY DAY WRITTEN REPORTS

6.9.1.9 Deleted.

## ADMINISTRATIVE CONTROLS

---

### REPORTING REQUIREMENTS FOR INCIDENT WHICH OCCURRED ON MARCH 28, 1979

6.9.1.10 Section Deleted. All reporting requirements completed.

### SPECIAL REPORTS

6.9.2 Special reports shall be submitted to the NRC Region I Administrator within the time period specified for each report.

### 6.10 RECORD RETENTION

6.10.1 The following records shall be retained for at least five years:

- a. Records of sealed source and fission detector leak tests and results.
- b. Records of annual physical inventory of all sealed source material of record.
- c. Records of changes made to the procedures required by Specifications 6.8.1.d and e.

6.10.2 The following records shall be retained as long as the Licensee has an NRC license to operate or possess the Three Mile Island facility.

- a. Records and logs of unit operation covering time interval at each power level.

## ADMINISTRATIVE CONTROLS

- b. Records and logs of principal maintenance activities, inspections, repair and replacement of principal items of equipment related to nuclear safety and radioactive waste systems.
- c. ALL REPORTABLE EVENTS submitted to the Commission.
- d. Records of surveillance activities, inspections and calibrations required by these Technical Specifications.
- e. Records of changes made to the procedures required by Specifications 6.8.1.a, b., c., and f.
- f. Radiation Safety Program Reports and Quarterly Recovery Progress Reports on the March 28, 1979 incident.
- g. Records of radioactive shipments.
- h. Records and logs of radioactive waste systems operations.
- i. Records and drawing changes reflecting facility design modifications made to systems and equipment described in the Safety Analysis Report, TER, SD, or Safety Evaluation previously submitted to NRC.
- j. Records of new and irradiated fuel inventory, fuel transfers and assembly burnup histories.
- k. Records of transient or operational cycles for those unit components designed for a limited number of transients or cycles.
- l. Records of reactor tests and experiments.
- m. Records of training and qualification for current members of the unit staff.
- n. Records of in-service inspections performed pursuant to these Technical Specifications.
- o. Records of Quality Assurance activities required by the Operating Quality Assurance Plan.
- p. Records of reviews performed for changes made to procedures or equipment or reviews of tests and experiments pursuant to 10 CFR 50.59.
- q. Records of meetings of the Plant Operation Review Committee (PORC) and the General Review Committee (GRC) and reports of evaluations prepared by the SRG.

## ADMINISTRATIVE CONTROLS

---

- r. Records of the incident which occurred on March 28, 1979.
- s. Records of unit radiation and contamination surveys.
- t. Records of radiation exposure for all individuals entering radiation control areas.
- u. Records of gaseous and liquid radioactive material released to the environs.

### 6.11 RADIATION PROTECTION PROGRAM

Personnel radiation protection shall be consistent with the requirements of 10 CFR Part 20 and the NRC approved Radiation Protection Plan.

### 6.12 HIGH RADIATION AREA

In lieu of the "control device" or "alarm signal" required by paragraph 20.203(c)(2) of 10 CFR 20, each high radiation area shall be controlled as specified in the Radiation Protection Plan.