

**Northeast
Nuclear Energy**

Rope Ferry Rd. (Route 156), Waterford, CT 06385

Millstone Nuclear Power Station
Northeast Nuclear Energy Company
P.O. Box 128
Waterford, CT 06385-0128
(203) 447-1791
Fax (203) 444-4277

The Northeast Utilities System


March 24, 1997

Docket No. 50-423
B16356

Re: 10CFR 50.73(a)(2)(i)

U. S. Nuclear Regulatory Commission
Document Control Desk
Washington, DC 20555

Millstone Nuclear Power Station Unit 3
Licensee Event Report 96-009-02
Submitted Pursuant to 10CFR 50.73(a)(2)(i)

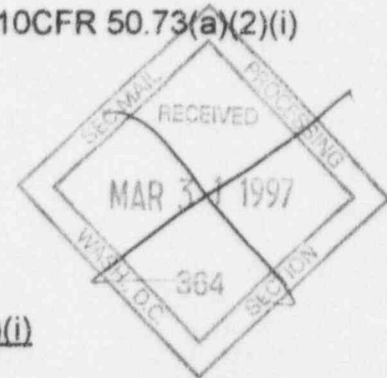

This letter forwards Supplement 2 to Licensee Event Report 96-009-00, documenting a condition that was determined at Millstone Unit No. 3 on April 23, 1996. This LER supplement is submitted pursuant to 10CFR 50.73(a)(2)(i). NNECO's commitments in response to this event are contained within Attachment 1 to this letter.

Should you have any questions regarding this submittal, please contact Mr. James M. Peschel at (860) 437-5840.

150040

Very truly yours,

NORTHEAST NUCLEAR ENERGY COMPANY


G. D. Hicks
Unit Director, Millstone Unit No. 3

JE221



U.S. Nuclear Regulatory Commission
B16356/Page 2

Attachment: 1) NNECO's commitments in response to LER 96-009-02
2) LER 96-009-02

cc: H. J. Miller, Region I Administrator
A. C. Cerne, Senior Resident Inspector, Millstone Unit No. 3
J. W. Andersen, NRC Project Manager, Millstone Unit No. 3
V. D. Travers, Dr., Director, Special Projects

Attachment 1

Millstone Nuclear Power Station, Unit No. 3
NNECO's Commitments
In Response To
(LER 96-009-02)

March 24, 1997

Enclosure
List of Regulatory Commitments

The following table identifies those actions committed to by NNECO in this document. Any other actions discussed in the submittal represent intended or planned actions by NNECO. They are described to the NRC for the NRC's information and are not regulatory commitments. Please notify the Manager - Nuclear Licensing at the Millstone Nuclear Power Station Unit No. 3 of any questions regarding this document or any associated regulatory commitments.

Number	Commitment	Due
B16356-01	The Shutdown Margin Monitors will be returned to operable status through application of a new Inverse Count Rate Ratio curve.	March 31, 1997
B16356-02	Procedure changes will either restore the original ICRR curve methodology, or the long term corrective action methodology will be implemented.	Prior to entry into Mode 2.

Docket No. 50-423
B16356

Attachment 2

Millstone Nuclear Power Station, Unit No. 3
NNECO's Submittal of
(96-009-02)

March 24, 1997