



VIRGINIA POWER

September 25, 1985

CERTIFIED MAIL  
RETURN RECEIPT REQUESTED

Mr. Ray R. Jenkins  
State Water Control Board  
Piedmont Regional Office  
2201 West Broad Street  
Richmond, Virginia 23230

Surry Power Station - NPDES Permit Exception

Dear Mr. Jenkins:

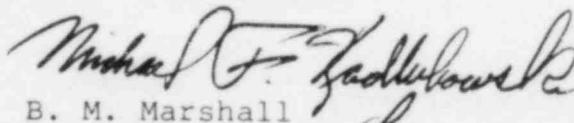
This is to confirm the NPDES permit exception at our Surry Power Station that was reported to you on September 9, 1985.

On September 7, 1985 at 2:00 p.m. the chlorine residual at outfall 011, the sewage treatment plant, was measured as 2.57 mg/l. The following sample of this effluent, taken at 10:00 a.m. on September 8, 1985, was measured as 2.59 mg/l. These results exceed the limitations of the range of 0.5 mg/l through 2.5 mg/l. for any two consecutive tests.

Results for the next sample, taken on the afternoon of September 8, 1985, were within the range limits, and subsequent test results were also within limitations. Therefore, no corrective action is planned at this time.

Should you have any questions regarding this exception, please do not hesitate to contact this department.

Very truly yours,

  
B. M. Marshall  
Manager  
Water Quality

cc: Dr. J. Nelson Grace, USNRC - Docket No. 50-280/50-281  
Mr. Harold R. Denton, USNRC - Docket No. 50-280/50-281 ✓  
Mr. Donald J. Burke, USNRC - Docket No. 50-280/50-281

8510040367 850925  
PDR ADOCK 05000280  
S PDR

IE23  
1/0