



Figure 1 Current lineup

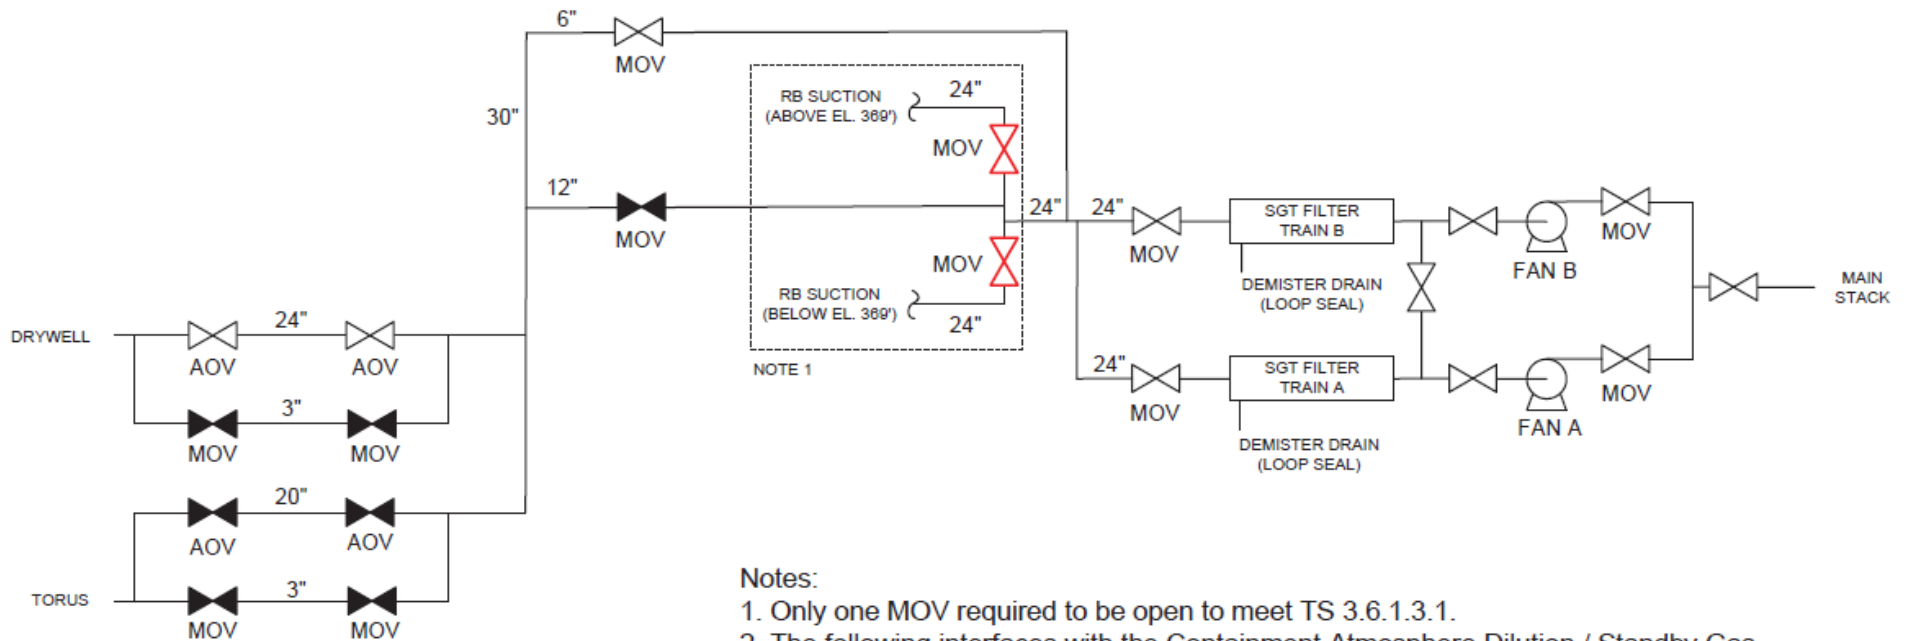

Notes:

1. Only one MOV required to be open to meet TS 3.6.1.3.1.
2. The following interfaces with the Containment Atmosphere Dilution / Standby Gas Treatment Systems are not depicted but are isolated during this operation:
 - Air for Decay Heat Cooling
 - Aux Gas Treatment System
 - HPCI Gland Seal Seal Exhauster
 - Hardened Containment Vent System
 - Main Steam Leakage Collection System

Figure 2 Revised lineup

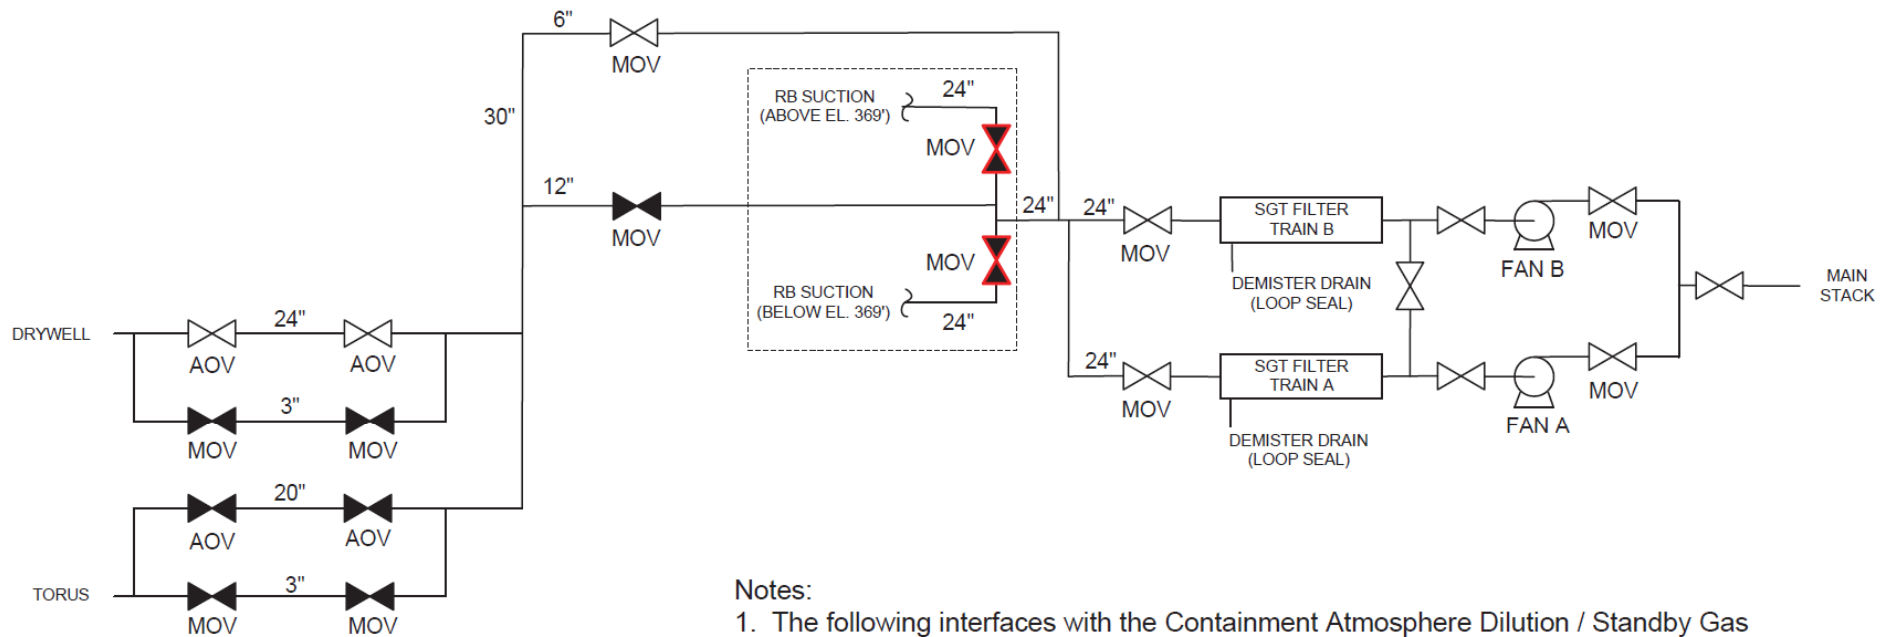

Notes:

1. The following interfaces with the Containment Atmosphere Dilution / Standby Gas Treatment Systems are not depicted but are isolated during this operation:

- Air for Decay Heat Cooling
- Aux Gas Treatment System
- HPCI Gland Seal Seal Exhauster
- Hardened Containment Vent System
- Main Steam Leakage Collection System