
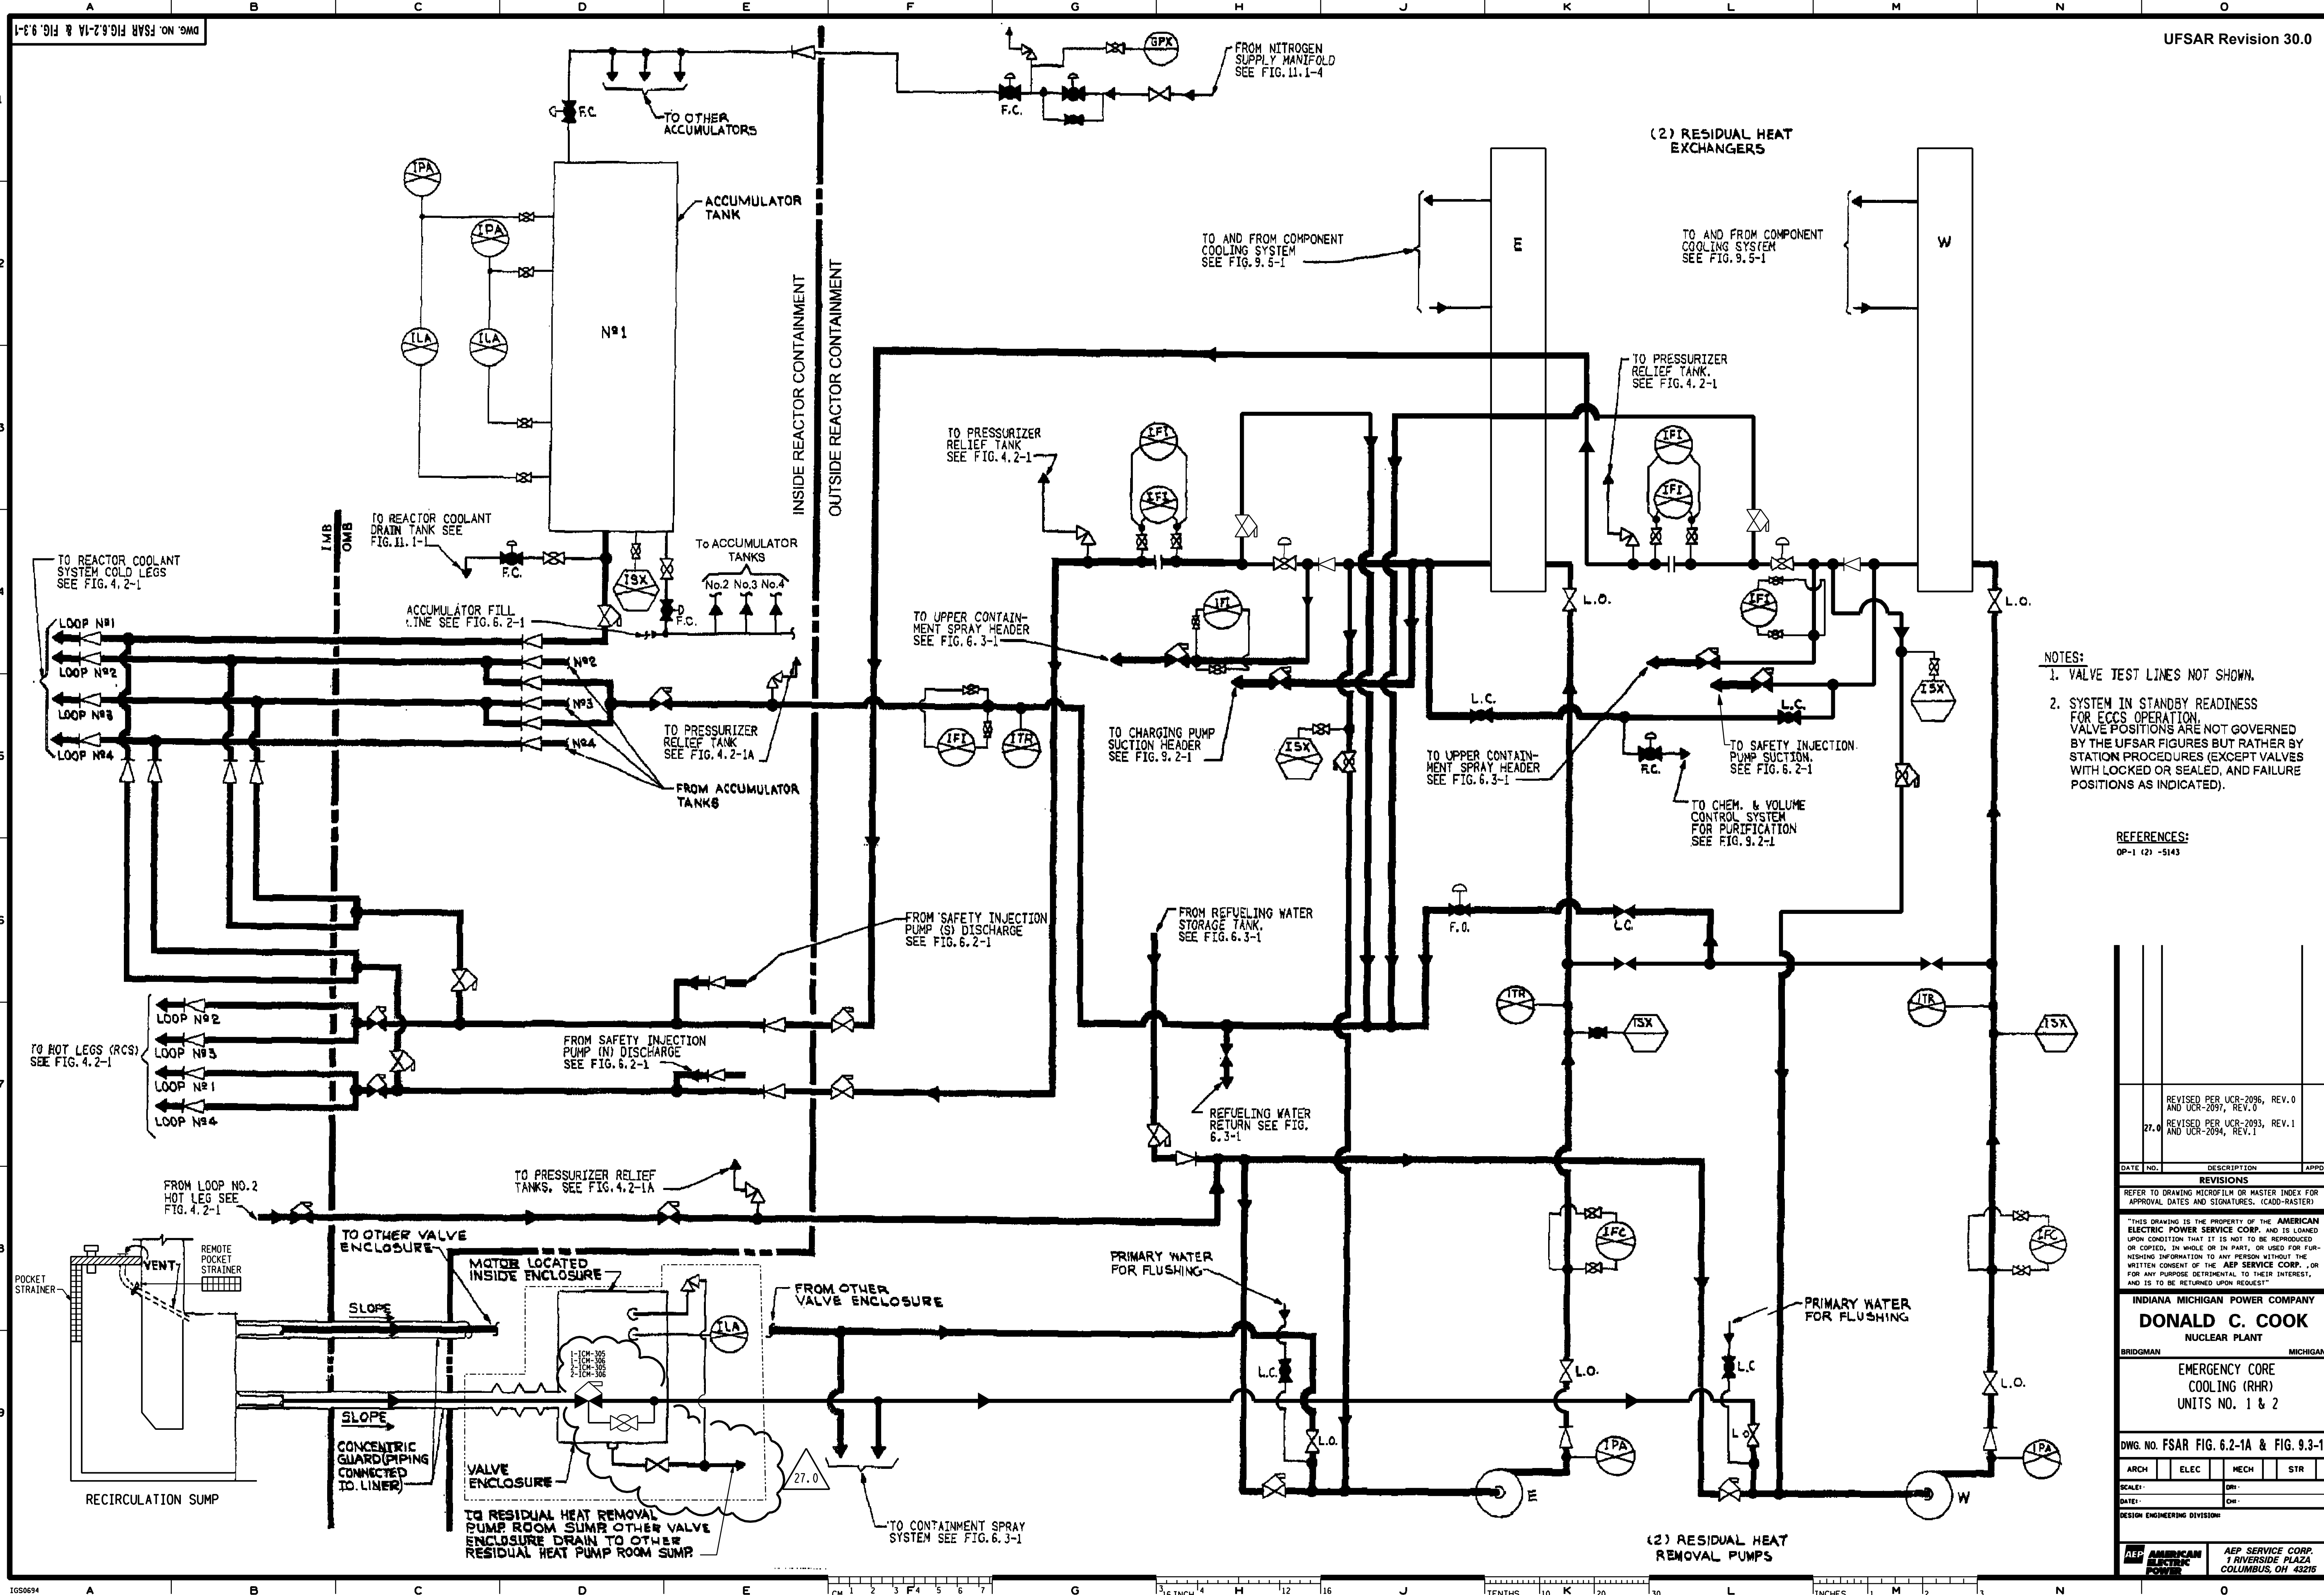
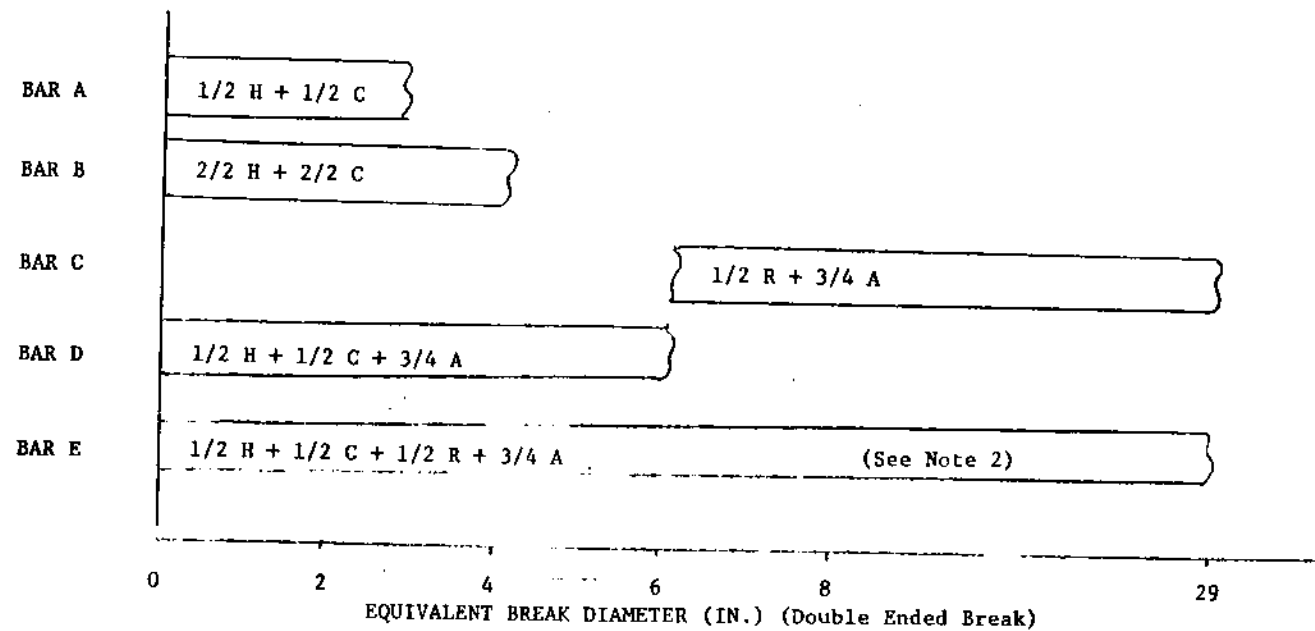


26.0	REVISED PER UCR-2076		
REVISIONS			
REFER TO DRAWING MICROFILM OR MASTER INDEX FOR APPROVAL DATES AND SIGNATURES. (CADD-MASTER)			
THIS DRAWING IS THE PROPERTY OF THE AMERICAN ELECTRIC POWER SERVICE CORP. AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE AEP SERVICE CORP. , OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST**			
INDIANA MICHIGAN POWER COMPANY			
DONALD C. COOK			
NUCLEAR PLANT			
BRIDGMAN		MICHIGAN	
FLOW DIAGRAM EMERG. CORE COOLING (SIS) UNIT NO 1 OR 2			
DWG. NO. FSAR FIG. 6.2-1			
ARCH	ELEC	MECH	STR
SCALE: -		ORI: -	
DATE: -		CHK: -	
DESIGN ENGINEERING DIVISION:			
 AMERICAN ELECTRIC POWER		AEP SERVICE CORP. 1 RIVERSIDE PLAZA COLUMBUS, OH 43215	



LEGEND: C = Centrifugal Charging/Safety Injection Pump (2 available)
 H = High Head Safety Injection Pump (2 available)
 A = Accumulator (4 available)
 R = Residual Heat Removal Pump (2 available)



NOTES: (1) For all cases above, 1/2 R is required for long term recirculation.
 (2) Case with minimum site emergency power available.

RANGE OF CORE PROTECTION PROVIDED BY VARIOUS
 COMPONENTS OF THE EMERGENCY CORE COOLING SYSTEM

FIGURE 6.2-2

July, 1982

SAFETY INJECTION
ACTUATION SIGNAL VS BREAK AREA

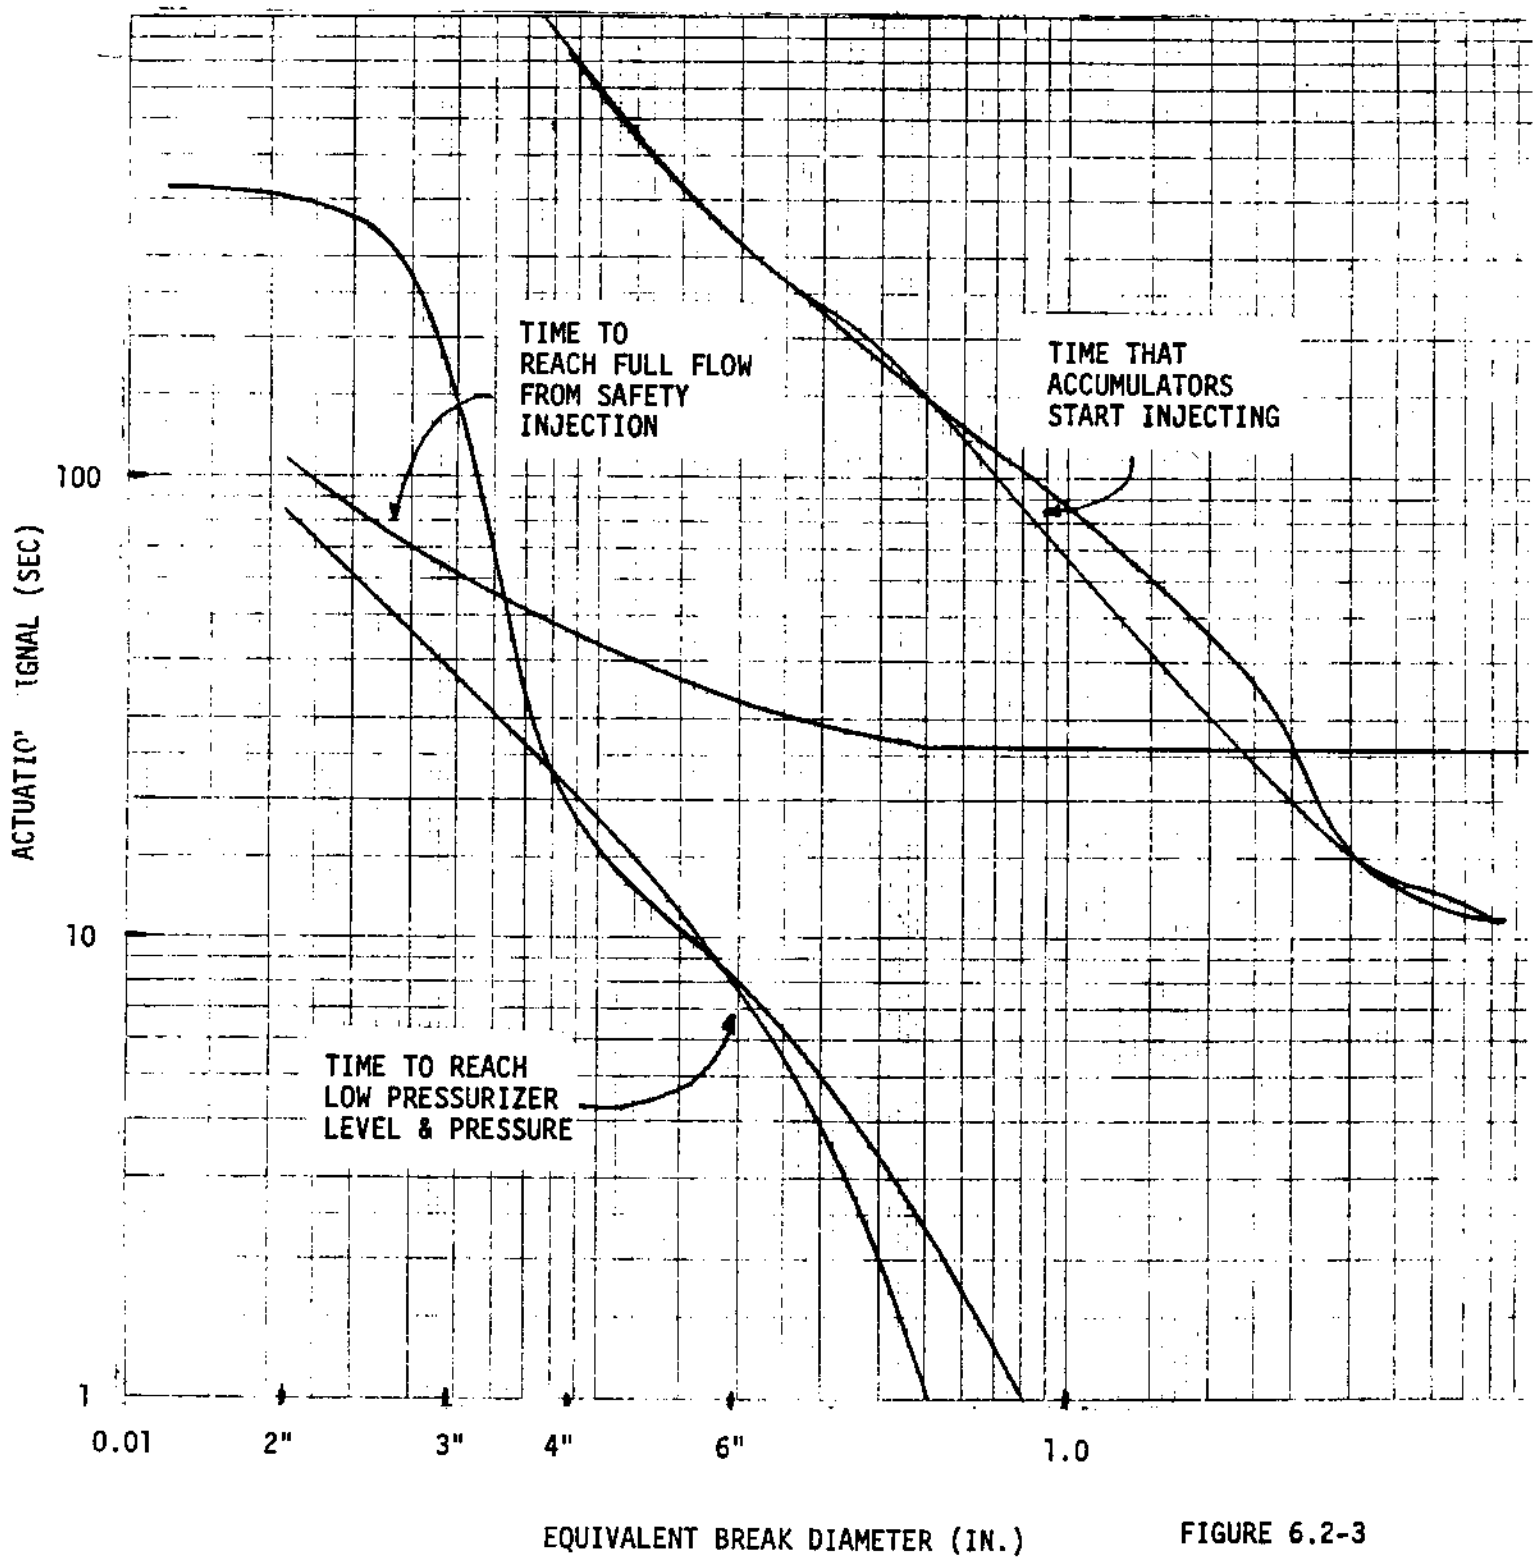


FIGURE 6.2-3

July, 1982

