

ENCLOSURE TO NL-21-030

**2020 Annual Radiological Environmental
Operating Report**

**ENTERGY NUCLEAR OPERATIONS, INC.
INDIAN POINT UNIT 1, 2, and 3 NUCLEAR POWER PLANTS
DOCKET Nos. 50-03, 50-247, and 50-286**



Plant: Indian Point Energy Center	Page 1 of 128
	YEAR: 2020
Docket Number: 50-003 (IP1), 50-247 (IP2), 50-286 (IP3)	
Annual Radiological Environmental Operating Report	

TABLE OF CONTENTS

	<u>Page</u>
1.0 EXECUTIVE SUMMARY	7
1.1 Introduction	8
1.2 Sampling and Analysis	8
1.3 Land Use Census	8
1.4 Summary of Results	9
1.5 Conclusions	9
2.0 INTRODUCTION	10
2.1 Overview	11
2.2 Site Description	12
2.3 Program Background	12
2.4 Program Objectives	12
3.0 RADIOLOGICAL ENVIRONMENTAL SAMPLING PROGRAM REQUIREMENTS	14
3.1 Sample Collection	15
3.2 Sample Analysis	15
3.3 Sample Collection and Analysis Methodology	15
3.3.1 Direct Radiation	15
3.3.2 Airborne Particulates and Radioiodine	16
3.3.3 Drinking Water	16
3.3.4 Ground Water	16
3.3.5 Soil	16
3.3.6 Broad Leaf Vegetation	16
3.3.7 Hudson River Water	16
3.3.8 Hudson River Bottom Sediment	17
3.3.9 Hudson River Shoreline Soil	17
3.3.10 Hudson River Aquatic Vegetation	17
3.3.11 Fish and Invertebrates	17
3.3.12 Land Use Census	17
3.4 Statistical Methodology	18
3.4.1 Lower Limit of Detection and MDC	18
3.4.2 Table Statistics	19

TABLE OF CONTENTS (continued)

	<u>Page</u>
4.0 INTERPRETATION AND TRENDS OF RESULTS	29
4.1 Direct Radiation	32
4.2 Airborne Particulates and Radioiodine	32
4.3 Drinking Water	33
4.4 Ground Water	33
4.5 Soil	33
4.6 Broad Leaf Vegetation	33
4.7 Hudson River Water	33
4.8 Hudson River Bottom Sediment	34
4.9 Hudson River Shoreline Soil	34
4.10 Hudson River Aquatic Vegetation	34
4.11 Fish and Invertebrates	34
4.12 Land Use Census	34
4.13 Conclusion	35
5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY	36
5.1 2020 Annual Radiological Monitoring Program Summary	37
5.2 Land Use Census	37
5.3 Sampling Deviations	37
5.4 Analytical Deviations	37
5.5 Special Reports	37
6.0 HISTORICAL TRENDS	97
7.0 INTERLABORATORY COMPARISON PROGRAM	116
7.1 Program Description – Teledyne Brown Engineering Environmental Services Comparison Programs	117
7.2 Acceptance Criteria	117
7.2.1 Analytics Sample Results Evaluation	117
7.2.2 ERA and MAPEP Sample Result Evaluation	118
7.3 Program Results Summary	118
7.4 Environmental TLD Quality Assurance	123
8.0 REFERENCES	125

LIST OF FIGURES

<u>FIGURE</u>	<u>TITLE</u>	<u>Page</u>
A-1	Sampling Locations (Within Two Miles)	23
A-2	Sampling Locations (Greater Than Two Miles)	24
A-3	Additional Sampling Locations	25
C-1	Direct Radiation, Annual Summary, 2009 to 2020	100
C-2	Radionuclides in Air – Gross Beta, 2009 to 2020	102
C-3	Radionuclides in Hudson River Water, Inlet & Discharge 2009 to 2020	104
C-4	Radionuclides in Drinking Water, 2009 to 2020	106
C-5	Radionuclides in Shoreline Soil, 2009 to 2020	108
C-6	Radionuclides in Broad Leaf Vegetation, 2009 to 2020	110
C-7	Radionuclides in Fish & Invertebrates, 2009 to 2020	112
C-9	Radionuclides in Bottom Sediment, 2009 to 2020	115

LIST OF TABLES

<u>TABLE</u>	<u>TITLE</u>	<u>Page</u>
A-1	Indian Point REMP Sampling Station Locations	20
A-2	Lower Limit of Detection (LLD) Requirements for Environmental Samples	26
A-3	Reporting Levels for Radioactivity Concentrations in Environmental Samples	28
B-1	Summary of Sampling Deviations - 2020	38
B-1a	2020 Air Sampling Deviations	39
B-1b	2020 Other Media Deviations	39
B-1c	2020 Changes to the REMP Program	40
B-2	Radiological Environmental Monitoring Program Summary Indian Point Energy Center – 2020	41
B-3	Direct Radiation, Quarterly Data – 2020	47
B-4	Direct Radiation, 2010 through 2020 Data	48
B-5	Direct Radiation, Inner and Outer Rings – 2020	49
B-6	Gross Beta Activity in Airborne Particulate Samples – 2020	50
B-7	Iodine-131 Activity in Airborne Charcoal Samples – 2020	52
B-8	Gamma Emitters in Airborne Particulate Samples – 2020	54
B-9	Radionuclides in Drinking Water Samples – 2020	59
B-10	Radionuclides in Groundwater Samples – 2020	63
B-11	Gamma Emitters in Soil Samples – 2020	64
B-12	Gamma Emitters in Broad Leaf Vegetation Samples – 2020	65
B-13	Radionuclides in River Water Samples – 2020	74
B-14	Gamma Emitters in Bottom Sediment Samples – 2020	80
B-15	Radionuclides in Shoreline Soil Samples – 2020	82
B-16	Gamma Emitters in Aquatic Vegetation Samples – 2020	85
B-17	Radionuclides in Fish / Invertebrates – 2020	88
B-18	Land Use Census, Residence & Milch Animal Results 2020	95
B-19	Land Use Census – 2020 – Unrestricted Area Boundary and Nearest Residences	96

LIST OF TABLES (Continued)

<u>TABLE</u>	<u>TITLE</u>	<u>Page</u>
C-1	Direct Radiation Annual Summary, 2009 – 2020	99
C-2	Radionuclides in Air, 2009 - 2020	101
C-3	Radionuclides in Hudson River Water, Inlet & Discharge 2009 to 2020	103
C-4	Radionuclides in Drinking Water, 2009 to 2020	105
C-5	Radionuclides in Shoreline Soil, 2009 to 2020	107
C-6	Radionuclides in Broad Leaf Vegetation, 2009 to 2020	109
C-7	Radionuclides in Fish & Invertebrates, 2009 to 2020	111
C-8	River Water Discharge Area Tritium, REMP vs Effluent	113
C-9	Radionuclides in Bottom Sediment, 2009 to 2020	114
D-2.1	Ratio of Agreement	118
D-3.1	Analytics Interlaboratory Comparison Program and Ratio of Agreement	119
D-3.2	DOE Interlaboratory Comparison Program and Ratio of Agreement	121
D-3.3	ERA Interlaboratory Comparison Program and Ratio of Agreement	122
D-4.1	Percentage of Individual Dosimeters That Passed EDC Internal Criteria, 2020	123
D-4.2	Mean Dosimeter Analysis (N=6), 2020	124
D-4.3	Summary of Independent Dosimeter Testing, 2020	124

Plant: Indian Point Energy Center	Year: 2020	Page 7 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 1.0

EXECUTIVE SUMMARY

Plant: Indian Point Energy Center	Year: 2020	Page 8 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

1.0 EXECUTIVE SUMMARY

1.1 INTRODUCTION

This report summarizes the results of the Radiological Environmental Monitoring Program (REMP) conducted in the vicinity of Indian Point Energy Center (IPEC) during the period from January 1 to December 31, 2020. The Indian Point site consists of Units 1, 2 and 3, which are operated by Entergy Nuclear Operations Inc. Unit 1 was retired as a generating facility in 1974, and its reactor is no longer operated. Unit 2 was permanently shutdown on April 30th 2020.

The REMP has been established to monitor/measure the radiation and radioactivity detectable in the environment that may be attributable to the operation of IPEC. This program, initiated in 1958, includes the collection, analysis, and evaluation of radiological data in order to assess the impact of IPEC on the environment.

1.2 SAMPLING AND ANALYSIS

The environmental sampling media collected in the vicinity of IPEC and at distant locations included air particulate filters and charcoal cartridges, soil, drinking water, ground water, broadleaf vegetation, river water, shoreline sediment, bottom sediment, aquatic vegetation, fish, and invertebrates.

During 2020 there were 1183 samples collected from the atmospheric, aquatic, and terrestrial environments. This includes 163 exposure measurements which were obtained using environmental thermoluminescent dosimeters (TLDs).

A small number of inadvertent issues were encountered in 2020 in the collection of environmental samples in accordance with the IPEC Offsite Dose Calculation Manual (ODCM). Equipment failures and electrical outages resulted in a small number of instances in which lower than normal sampling volumes were collected at the airborne monitoring stations. A full description of all discrepancies encountered with the environmental monitoring program is presented in the Table B-1 of this report.

There were 1343 analyses performed on the environmental media samples. The analyses of the 2020 Indian Point environmental samples were performed by several laboratories. Thermoluminescent dosimeters were analyzed by Environmental Dosimetry Company (formerly Stanford Associates) of Sterling, MA. Teledyne Brown Engineering, Inc. of Knoxville, TN performed all the remaining analyses for 2020. Samples were analyzed as required by the IPEC ODCM.

1.3 LAND USE CENSUS

The annual land use census in the vicinity of IPEC was conducted as required by the IPEC ODCM in May through October. No dairy animals whose milk is used for human consumption were identified within 5 miles of the Station during the census. Due to the difficulty of locating individual gardens and determining those having an area greater than 500 square feet, broadleaf sampling was performed. As allowed for in the ODCM, monthly broad leaf sampling may be used in lieu of a garden census.

Plant: Indian Point Energy Center	Year: 2020	Page 9 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

1.4 SUMMARY OF RESULTS

Samples collected as part of the IPEC REMP continued to contain detectable amounts of naturally-occurring and some man-made radioactive materials. Offsite ambient radiation measurements using environmental TLDs beyond the site boundary ranged between 45 and 65 milli-Roentgens (mR) per year. The range of ambient radiation levels observed with the TLDs is consistent with natural background radiation levels for New York.

Monitoring of the aquatic environment in the area of the station indicated the presence of the following potential station related radioactivity, tritium and cesium-137. Tritium was found in river water at the downstream mixing zone of the discharge canal at levels that were expected from routine plant operation, or other sources such as fallout from past weapons testing. Low-levels of cesium-137 were detected in Hudson River bottom sediment samples downstream of the discharge canal, as well as in the Off Verplanck, Lent's Cove, and Cold Spring locations. Low levels of cesium-137 were also detected in one soil and one shoreline soil sample. The levels detected were consistent with historical findings. No other plant related activity was detected in any offsite samples. The predominant radioactivity for all samples was from non-plant related sources, such as fallout from nuclear weapons tests and naturally occurring radionuclides.

1.5 CONCLUSIONS

The 2020 Radiological Environmental Monitoring Program for IPEC resulted in the collection and analysis of over a thousand environmental samples and measurements. The data obtained were used to determine the impact of IPEC's operation on the environment and on the general public.

In 2020 the only positive detectable plant related activity was two instances of low levels of H-3 detected in river water samples. An evaluation of direct radiation measurements, environmental sample analyses, and dose calculations demonstrates that all applicable federal criteria were met. Furthermore, radiation levels and resulting doses from station operation were a small fraction of those attributed to natural and man-made background radiation.

In summary, the levels of radionuclides in the environment surrounding Indian Point were within the historical ranges, i.e., previous levels resulting from natural and anthropogenic sources for the detected radionuclides. Further, IPEC operations in 2020 did not result in exposure to the public greater than the variability of environmental background levels.

Plant: Indian Point Energy Center	Year: 2020	Page 10 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 2.0

INTRODUCTION

Plant: Indian Point Energy Center	Year: 2020	Page 11 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

2.0 INTRODUCTION

2.1 Overview

The Radiological Environmental Monitoring Program (REMP) for 2020 performed by Entergy for the Indian Point Energy Center (IPEC) is discussed in this report. Since the operation of a nuclear power plant results in the release of small amounts of radioactivity and low levels of radiation, the Nuclear Regulatory Commission (NRC) requires a program to be established to monitor radiation and radioactivity in the environment (Reference 1). This report, which is submitted to the NRC annually per Indian Point Technical Specifications, summarizes the results of measurements of radiation and radioactivity in the environment in the vicinity of the IPEC and at distant locations during the period January 1 to December 31, 2020.

The REMP is used to measure the direct radiation and the airborne and waterborne pathway activity in the vicinity of the Indian Point site. Direct radiation pathways include radiation from buildings and plant structures, airborne and liquid material that might be released from the plant, cosmic radiation, and the naturally occurring radioactive materials in the ground. Analysis of thermoluminescent dosimeters (TLDs), used to measure direct radiation, indicated that there were no increased radiation levels attributable to plant operations.

The airborne pathway includes measurements of air, drinking water, and broad leaf vegetation samples. The airborne pathway measurements indicated that there was no adverse radiological impact to the surrounding environment attributed to Indian Point Station operations.

The waterborne pathway consists of Hudson River water, fish and invertebrates, aquatic vegetation, bottom sediment, and shoreline sediment. Measurements of the media comprising the waterborne pathway indicated that there was no adverse radiological impact to the surrounding environment attributed to Indian Point Station operations.

The ground water table is listed after the drinking water tables for ease of data comparison. However, ground water is not a dose pathway since it is not a drinking water pathway at IPEC. It should be noted that IPEC has an extensive Groundwater Monitoring Program which is described in the annual Radioactive Effluent Release Reports.

These results are reviewed by IPEC's staff and have been reported semiannually or annually to the Nuclear Regulatory Commission and others for over 30 years.

This report contains a description of the REMP for IPEC and the conduct of that program in 2020 as required by the IPEC ODCM. Also included are summaries and discussions of the results of the 2020 program, trend analyses (where appropriate), comparison to historical results and evaluation of any potential impact on the environment. Results of the annual land use census, as well as the inter-laboratory comparison program are included, per the ODCM requirements.

Plant: Indian Point Energy Center	Year: 2020	Page 12 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

2.2 Site Description

The Indian Point site occupies 239 acres on the east bank of the Hudson River on a point of land at Mile Point 42.6. The site is located in the Village of Buchanan, Westchester County, New York. Three nuclear reactors, Indian Point Unit Nos. 1, 2 and 3, and associated buildings occupy approximately 35 acres. Unit 1 began operation in 1962 and was retired as a generating facility in 1974. Units 2 and 3 began operation 1974 and 1978. Indian Point Units 1 and 2 are owned by Entergy Nuclear Indian Point 2, LLC and Unit 3 is owned by Entergy Nuclear Indian Point 3 LLC. All three units are operated by Entergy Nuclear, although only Units 2 and 3 continue to operate.

2.3 Program Background

Environmental monitoring and surveillance have been conducted at Indian Point since 1958, four years prior to the start-up of Unit 1. The pre-operational program was designed and implemented to determine the background radioactivity and to measure the variations in activity levels from natural and other sources in the vicinity, as well as fallout from atmospheric nuclear weapons tests. Thus, as used in this report, background levels consist of those resulting from both natural and anthropogenic sources of environmental radioactivity. Accumulation of this background data permits the detection and assessment of environmental activity attributable to plant operations.

2.4 Program Objectives

The current environmental monitoring program is designed to meet two primary objectives:

1. To enable the identification and quantification of changes in the radioactivity of the area.
2. To measure radionuclide concentrations in the environment attributable to operations of the Indian Point site.

To identify changes in activity, the environmental sampling schedule requires that analyses be conducted for specific environmental media on a regular basis. The radioactivity profile of the environment is established and monitored through routine evaluation of the analytical results obtained.

The REMP designates sampling locations for the collection of environmental media for analysis. These sample locations are divided into indicator and control locations. Indicator locations are established near the site, where the presence of environmental radioactivity of plant origin is most likely to be detected. Control locations are established farther away (and upwind/upstream, where applicable) from the site, where the level would not generally be affected by plant discharges. The use of indicator and control locations enables the identification of potential sources of detected radioactivity, thus meeting one of the program objectives.

Verification of expected radionuclide concentrations resulting from effluent releases attributable to the site is another objective of the REMP, which is met by meeting the two

Plant: Indian Point Energy Center	Year: 2020	Page 13 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

primary program objectives described above. Verifying projected concentrations through evaluating REMP data can be difficult since the environmental concentrations resulting from plant releases are typically too small to be detected. Plant related radionuclides were detected in 2020 in very low levels; however, residual radioactivity from atmospheric weapons tests and naturally occurring radioactivity were the predominant sources of radioactivity in the samples collected. Analysis of the 2020 REMP sample results confirms that environmental concentrations which could be attributed to radiological effluents were well below regulatory limits.

Plant: Indian Point Energy Center	Year: 2020	Page 14 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 3.0

RADIOLOGICAL ENVIRONMENTAL SAMPLING PROGRAM REQUIREMENTS

Plant: Indian Point Energy Center	Year: 2020	Page 15 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

3.0 RADIOLOGICAL ENVIRONMENTAL SAMPLING PROGRAM REQUIREMENTS

To achieve the objectives of the REMP and ensure compliance with the ODCM, sampling and analysis of environmental media are performed as outlined in Table A-1 and described in section 3.3.

3.1 Sample Collection

Entergy personnel perform collection of environmental samples for the Indian Point site, with the exception of fish/invertebrate samples. Collection of fish and invertebrate samples is performed by a contracted environmental vendor, Normandeau Associates, Inc.

Environmental media are sampled at the locations specified in Table A-1 and shown in Figures A-1, A-2, and A-3. The samples are analyzed according to criteria established in the ODCM. These requirements include: methods of sample collection; types of sample analysis; minimum sample size required; lower limit of detection, which must be attained for each medium, sample, or analysis type, and environmental concentrations requiring special reports.

Table A-1 provides the sampling station number, location, sector, and distance from Indian Point, sample designation code, and sample type. This table gives the complete listing of sample locations used in the 2020 REMP.

Three maps are provided to show the locations of REMP sampling. Figure A-1 shows the sampling locations within two miles of Indian Point. Figures A-2 and A-3 show the sampling locations within ten miles of Indian Point.

3.2 Sample Analysis

The analysis of the 2020 Indian Point environmental samples was performed by several laboratories. Thermoluminescent dosimeters were analyzed by Environmental Dosimetry Company (formerly Stanford Associates) of Sterling, MA. Teledyne Brown Engineering, Inc. of Knoxville, TN performed all the remaining analyses.

3.3 Sample Collection and Analysis Methodology

3.3.1 Direct Radiation

Direct gamma radiation is measured using integrating calcium sulfate thermoluminescent dosimeters (TLDs), which provide cumulative measurements of radiation exposure (i.e., total integrated exposures in milli-roentgen, mR) for a given period. The area surrounding the Indian Point site is divided into 16 compass sectors. Each sector has two TLD sample locations. The inner ring is located near the site boundary at approximately 1 mile (1.6 km). The outer ring is located at approximately 5 miles (8 km) from the site (6.7- 8.0 km), see Figures A-1 and A-2. Additional TLD locations include a control location at Roseton (20.7 miles north) and eight locations of special interest. In total, there are 41 TLD sample sites, designated DR-1 through DR-41, with two TLDs placed at each site. TLDs are collected and processed on a quarterly basis. The results are reported as mR per standard quarter (91 days). The data reported is the average of the two TLDs from each sample site.

Plant: Indian Point Energy Center	Year: 2020	Page 16 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

3.3.2 Airborne Particulates and Radioiodine

Air samples were taken at eight locations varying in distance from 0.28 to 20.7 miles (0.5 to 33 km) from the plant. These locations represent one control at sampling station 23 (A5) and seven indicator locations. In 2020 the air sampling station 44 Peekskill was moved to 108 Telcom Building. See table B-1C for further explanation. These indicator locations are at sampling stations 4 (A1), 5 (A4), 27, 29, 44, 94 (A2), 95 (A3), and 108. The locations are shown on Figures A-1, A-2, and A-3. The air samples are collected continuously by means of fixed air particulate filters followed by in-line charcoal cartridges. Both filters and cartridges are changed on a weekly basis. The filters are analyzed for gross beta and the cartridge samples for radioiodine. In addition, gamma spectroscopy analysis (GSA) is performed on quarterly composites of the air particulate filters.

3.3.3 Drinking Water

Samples of drinking water are collected monthly from the Camp Field Reservoir (3.4 miles NE, sample station 7, sample designation Wb1) and New Croton Reservoir (6.3 miles SE, sample station 8); see Figure A-2 and Figure A-3. Each monthly sample is approximately 4 liters and is analyzed for gross beta and gamma-emitting radionuclides. Monthly samples are composited quarterly and analyzed for tritium.

3.3.4 Groundwater Water

Groundwater samples are obtained semi-annually at Lafarge (106). Samples are analyzed for tritium, strontium-90, nickel-63 and by gamma spectroscopy.

3.3.5 Soil

Soil samples are collected from two indicator locations (sampling stations 94 and 95), and one control location (23) on an annual basis; see Figure A-3. They are approximately 2 kg in size and consist of about twenty 2-inch deep cores. The soil samples are analyzed by gamma spectroscopy.

3.3.6 Broad Leaf Vegetation

Broad Leaf vegetation samples are collected from three locations during the growing season. The indicator locations are sampling stations 94 (lc2) and 95 (lc1), and the control location is at sampling station 23 (lc3). See Figures A-1 and A-2. The samples are collected monthly, when available, and analyzed by gamma spectroscopy. These samples consist of at least 1 kg of leafy vegetation and are used in the assessment of the food product and milk ingestion pathways.

3.3.7 Hudson River Water

Hudson River water sampling is performed continuously at the intake structure (sampling station 9, Wa1) and at a point exterior to the discharge canal where Hudson River water and water from the discharge canal mix (sampling station 10, Wa2); see Figure A-1. In 2020 sampling station 9, Wa1 was relocated upstream to Roseton to serve as a better control. An automatic composite sampler is used to take representative samples. On a weekly basis, accumulated samples are taken from both sample points. These weekly river water samples are composited for monthly gamma spectroscopy analysis and quarterly for tritium analysis.

Plant: Indian Point Energy Center	Year: 2020	Page 17 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

3.3.8 Hudson River Bottom Sediment

Bottom sediment and benthos are sampled at four locations: three indicator locations (sampling stations 10, 17, and 28) and one control location (84), along the Hudson River, once each spring and summer; see Figure A-3. These samples are obtained using a Peterson grab sampler or similar instrument. The bottom sediment samples are analyzed by gamma spectroscopy.

3.3.9 Hudson River Shoreline Soil

Shoreline soil samples are collected at three indicator and two control locations along the Hudson River. The indicator locations are at sampling stations 53 (Wc1), 28, and 17. The control locations are at sampling stations 50 (Wc2) and 84. Figures A-1, A-2, and A-3 show these locations. The samples are gathered at a level above low tide and below high tide and are approximately 2-kg grab samples. These samples are collected at greater than 90 days apart and are analyzed by gamma spectroscopy and for strontium-90.

3.3.10 Hudson River Aquatic Vegetation

During the spring and summer, aquatic vegetation samples are collected from the Hudson River at two indicator locations (sampling stations 17 and 28) and one control location (84); see Figure A-3. Samples of aquatic vegetation are obtained depending on sample availability. These samples are analyzed by gamma spectroscopy.

3.3.11 Fish and Invertebrates

Fish and invertebrate samples are obtained from the Hudson River at locations upstream and downstream of the plant discharge. The indicator location (downstream sample point) is designated as sampling station 25 (lb1), and a second sampling station 107 is located further downstream. The control location (upstream) is at sampling station 23 (lb2). See Figures A-1 and A-2. These samples are collected in season or semiannually if they are not seasonal. The fish and invertebrates sampled are analyzed by gamma spectroscopy as well as for strontium-90 and for nickel-63.

3.3.12 Land Use Census

In addition to the sampling outlined in Table A-1, there is an environmental surveillance requirement that an annual land use census be performed. Each year a land use census consisting of milch animal and residence surveys is conducted during the growing season to determine the current utilization of land within 5 miles (8 km) of the site. These surveys are used to determine whether there are changes in existing conditions that warrant changing the sampling program. The results of the census are discussed in Section 4.12.

For example, the milch animal census is used to identify animals producing milk for human consumption within 5 miles (8 km) of Indian Point. This census consists of visual field surveys of the areas where a high probability of milch animals exists and confirmation through New York State records or with personnel such as feed suppliers who deal with farm animals and dairy associations.

Visual inspections are made of the 5-mile area around the Indian Point Site during routine sample collections and emergency plan equipment inspections in the area throughout the

Plant: Indian Point Energy Center	Year: 2020	Page 18 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

year. An extensive land survey is conducted of the 5-mile area in an attempt to identify new residential areas, commercial developments and to identify milch animals in pasture.

A garden census is not required, since the ODCM allows sampling of vegetation in two sectors near the site boundary in lieu of a garden census. The sectors are chosen to be in the pre-dominant wind directions with the highest predicted deposition rates.

3.4 Statistical Methodology

There are several statistical calculation methodologies used in evaluating the data from the Indian Point REMP. These methods include determination of Lower Limits of Detection (LLD) and the Minimum Detectable Concentration (MDC), and estimation of the mean and associated propagated error.

3.4.1 Lower Limit of Detection (LLD)

The LLD is the smallest concentration of radioactive material in a sample that will yield a net count above system background, and be detected with 95% probability, with a 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{\frac{2.71}{T_s} + 3.29 s_b * \sqrt{1 + (\frac{T_b}{T_s})}}{E * V * k * Y * e^{-\lambda t}}$$

Where:

LLD =	The lower limit of detection as defined above (as picocurie per unit mass or volume)
T_s =	The sample counting time in minutes
s_b =	The standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
T_b =	The background count time in minutes
E =	The counting efficiency (as counts per transformation)
V =	The sample size (in units of mass or volume)
k =	A constant for the number of transformations per minute per unit of activity (normally, 2.22E+6 dpm per uCi)
Y =	The fractional radiochemical yield (when applicable)
λ =	The radioactive decay constant for the particular radionuclide
t =	The elapsed time between midpoint of sample collection and time of counting

Note: The above LLD formula accounts for differing background and sample count times. The Radiological Environmental Monitoring Program, REMP, may use an LLD formula that assumes equal background and sample count times, when appropriate. The constants 2.71 and 3.29 and the general LLD equation were derived from References 2 and 3.

Plant: Indian Point Energy Center	Year: 2020	Page 19 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

The value of S_b used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma ray spectrometry, the background shall include the typical contributions of other radionuclides normally present in the samples. Typical values of E , V , Y , and t shall be used in the calculation. The background count rate is calculated from the background counts that are determined by a separate background count or in the case of gamma ray spectroscopy, from adjacent channels of the energy band of the gamma ray peak used for the quantitative analysis for that radionuclide.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement process and not as an a posteriori (after the fact) limit for a particular measurement. To document the post priori (after the fact) measurement statistics, the MDC is calculated after the measurement using the same equation as above.

To handle the a posteriori problem, a decision level must be defined. To minimize the number of false positives, a value is not considered positive unless it is greater than the MDC or 3 times the total standard deviation of the post priori measurement, where MDC is

the post priori (after the fact) measurement statistic calculated similar to the LLD equation listed above (for $T_b = T_s$, the term $3.29 s_b * [(1 + (T_b / T_s))^{1/2}] = 4.66 s_b$).

The ODCM required lower limits of detection (LLD) for Indian Point sample analyses are presented in Table A-2. These required lower limits of detection are not the same as the lower limits of detection or critical levels actually achieved by the laboratory. The laboratory's lower limits of detection and critical levels must be equal to or lower than the required levels presented in Table A-2.

Table A-3 provides the reporting level for radioactivity in various media. Sample results that exceed these levels and are due to plant operations require that a special report be submitted to the NRC.

3.4.2 Table Statistics

The averages shown in the summary table (Table B-2) are the averages of the positive values in accordance with the NRC's Branch Technical Position (BTP) to Regulatory Guide 4.8 (Reference 4). Samples with "<" values are not included in the averages.

It should be noted that this statistic for the mean using only positive values tends to strongly bias the average high, particularly when only a few of the data are measurably positive. The REMP data show few positive values; thus the corresponding means are biased high. Exceptions to this include direct radiation measured by TLDs and gross beta radioactivity in air, which show positive monitoring results throughout the year.

The historical data tables contain the annual averages of the positive values for each year for 2010 through 2020. The historical averages are calculated using only the positive values presented for 2010 through 2019. The 2020 average values are included in these historic tables for purposes of comparison.

TABLE A-1
INDIAN POINT REMPSAMPLING STATION LOCATIONS

SAMPLING STATION	SAMPLE DESIGNATION	LOCATION	DISTANCE	SAMPLE TYPES
3	DR8	Service Center Building	Onsite - 0.35 Mi (SSE) at 158°	Direct Gamma
4	A1	Algonquin Gas Line	Onsite - 0.28 Mi (SW) at 234°	Air Particulate
	A1			Radioiodine
5	A4	NYU Tower	Onsite - 0.88 Mi (SSW) at 208°	Air Particulate
	A4			Radioiodine
	DR10			Direct Gamma
7	Wb1	Camp Field Reservoir	3.4 Mi (NE) at 51°	Drinking Water
8	**	Croton Reservoir	6.3 Mi (SE) at 124°	Drinking Water
9****	Wa1	Plant Inlet (Hudson River Intake)*	20.7 Mi (N) at 357°	HR Water
10	Wa2	Discharge Canal (Mixing Zone)	Onsite - 0.3 Mi (WSW) at 249°	HR Water
	**			HR Bottom Sediment
14	DR7	Water Meter House	Onsite - 0.3 Mi (SE) at 133°	Direct Gamma
17	**	Off Verplanck	1.5 Mi (SSW) at 202.5°	HR Aquatic Vegetation
	**			HR Shoreline Soil
	**			HR Bottom Sediment
20	DR38	Cortlandt Yacht Club (AKA Montrose Marina)	1.5 Mi (S) at 180°	Direct Gamma
23	**	Roseton*	20.7 Mi (N) at 357°	Precipitation
	A5			Air Particulate
	A5			Radioiodine
	DR40			Direct Gamma
	lc3			Broad Leaf Vegetation
	**			Soil
	lb2			Fish & Invertebrates
25	lb1	Downstream	Downstream	Fish & Invertebrates
27	**	Croton Point	6.36 Mi (SSE) at 156°	Air Particulate
	**			Radioiodine
	DR41			Direct Gamma
28	**	Lent's Cove	0.45 Mi (ENE) at 069°	HR Shoreline Soil
	DR4			Direct Gamma
	**			HR Bottom Sediment
	**			HR Aquatic Vegetation
29	**	Grassy Point	3.37 Mi (SSW) at 196°	Air Particulate
	**			Radioiodine
	DR39			Direct Gamma
33	DR33	Hamilton Street (Substation)	2.88 Mi (NE) at 053°	Direct Gamma
34	DR9	South East Corner of Site	Onsite - 0.52 Mi (S) at 179°	Direct Gamma
35	DR5	Broadway & Bleakley Avenue	Onsite - 0.37 Mi (E) at 092°	Direct Gamma
38	DR34	Furnace Dock (Substation)	3.43 Mi (SE) at 141°	Direct Gamma

* = Control location

** = Locations listed do not have sample designation locations specified in the ODCM

HR = Hudson River

***= In 2020 Air sampler station 44 Peekskill was relocated to 108 Telcom. Bldg.

****= In 2020 River water station 9 Plant Inlet (Hudson River Intake) was moved to Roseton.

TABLE A-1
INDIAN POINT REMS SAMPLING STATION LOCATIONS

SAMPLING STATION	SAMPLE DESIGNATION	LOCATION	DISTANCE	SAMPLE TYPES
44***	**	Peekskill Gas Holder Bldg	1.84 Mi (NE) at 052°	Precipitation
	**			Air Particulate
	**			Radioiodine
50	Wc2	Manitou Inlet*	4.48 Mi (NNW) at 347°	HR Shoreline Soil
53	Wc1	White Beach	0.92 Mi (SW) at 226°	HR Shoreline Soil
	DR11			Direct Gamma
56	DR37	Verplanck - Broadway & 6th Street	1.25 Mi (SSW) at 202°	Direct Gamma
57	DR1	Roa Hook	2 Mi (N) at 005°	Direct Gamma
58	DR17	Route 9D - Garrison	5.41 Mi (N) at 358°	Direct Gamma
59	DR2	Old Pemart Avenue	1.8 Mi (NNE) at 032°	Direct Gamma
60	DR18	Gallows Hill Road & Sprout Brook Road	5.02 Mi (NNE) at 029°	Direct Gamma
61	DR36	Lower South Street & Franklin Street	1.3 Mi (NE) at 052°	Direct Gamma
62	DR19	Westbrook Drive (near the Community Center)	5.03 Mi (NE) at 062°	Direct Gamma
64	DR20	Lincoln Road - Cortlandt (School Parking Lot)	4.6 Mi (ENE) at 067°	Direct Gamma
66	DR21	Croton Avenue - Cortlandt	4.87 Mi (E) at 083°	Direct Gamma
67	DR22	Colabaugh Pond Road - Cortlandt	4.5 Mi (ESE) at 114°	Direct Gamma
69	DR23	Mt. Airy & Windsor Road	4.97 Mi (SE) at 127°	Direct Gamma
71	DR25	Warren Ave - Haverstraw	4.83 Mi (S) at 188°	Direct Gamma
72	DR26	Railroad Avenue & 9W - Haverstraw	4.53 Mi (SSW) at 203°	Direct Gamma
73	DR27	Willow Grove Road & Captain Faldermeyer Drive	4.97 Mi (SW) at 226°	Direct Gamma
74	DR12	West Shore Drive - South	1.59 Mi (WSW) at 252°	Direct Gamma
75	DR31	Palisades Parkway	4.65 Mi (NW) at 225°	Direct Gamma
76	DR13	West Shore Drive - North	1.21 Mi (W) at 276°	Direct Gamma
77	DR29	Palisades Parkway	4.15 Mi (W) at 272°	Direct Gamma
78	DR14	Rt. 9W across from R/S #14	1.2 Mi (WNW) at 295°	Direct Gamma
79	DR30	Anthony Wayne Park	4.57 Mi (WNW) at 296°	Direct Gamma
80	DR15	Route 9W South of Ayers Road	1.02 Mi (NW) at 317°	Direct Gamma
81	DR-28	Palisades Pkwy - Lake Welch Exit	4.96 Mi (WSW) at 310°	Direct Gamma
82	DR16	Ayers Road	1.01 Mi (NNW) at 334°	Direct Gamma
83	DR32	Route 9W - Fort Montgomery	4.82 Mi (NNW) at 339°	Direct Gamma
84	**	Cold Spring *	10.88 Mi (N) at 356°	HR Aquatic Vegetation
	**			HR Shoreline Soil
	**			HR Bottom Sediment
88	DR6	Reuter Stokes Pole #6	0.32 Mi (ESE) at 118°	Direct Gamma
89	DR35	Highland Ave & Sprout Brook Road (near rock cut)	2.89 Mi (NNE) at 025°	Direct Gamma

* = Control location

** = Locations listed do not have sample designation locations specified in the ODCM

HR = Hudson River

*** = In 2020 Air sampler station 44 Peekskill was relocated to 108 Telcom. Bldg.

**** = In 2020 River water station 9 Plant Inlet (Hudson River Intake) was moved to Roseton.

TABLE A-1
INDIAN POINT REMPSAMPLING STATION LOCATIONS

SAMPLING STATION	SAMPLE DESIGNATION	LOCATION	DISTANCE	SAMPLE TYPES
90	DR3	Charles Point	0.88 Mi (NE) at 047°	Direct Gamma
92	DR24	Warren Road - Cortlandt	3.84 Mi (SSE) at 149°	Direct Gamma
94	A2	IPEC Training Center	Onsite- 0.39 Mi (S) at 193°	Air Particulate
	A2			Radioiodine
	Ic2			Broad Leaf Vegetation
	**			Soil
95	A3	Meteorological Tower	Onsite - 0.46 Mi (SSW) at 208°	Air Particulate
	A3			Radioiodine
	Ic1			Broad Leaf Vegetation
	**			Soil
106	**	Lafarge Monitoring Well	0.63 mi SW	Groundwater
107	**	Vicinity of Haverstraw Bay	2.5 mi SSW (downstream)	Fish & Invertebrates
108***	**	Telecomm Bldg.	0.36 mi ESE	Air Particulate
				Radioiodine

* = Control location

** = Locations listed do not have sample designation locations specified in the ODCM

HR = Hudson River

***= In 2020 Air sampler station 44 Peekskill was relocated to 108 Telcom. Bldg.

****= In 2020 River water station 9 Plant Inlet (Hudson River Intake) was moved to Roseton.

FIGURE A-1
SAMPLING LOCATIONS
Within Two Miles of Indian Point

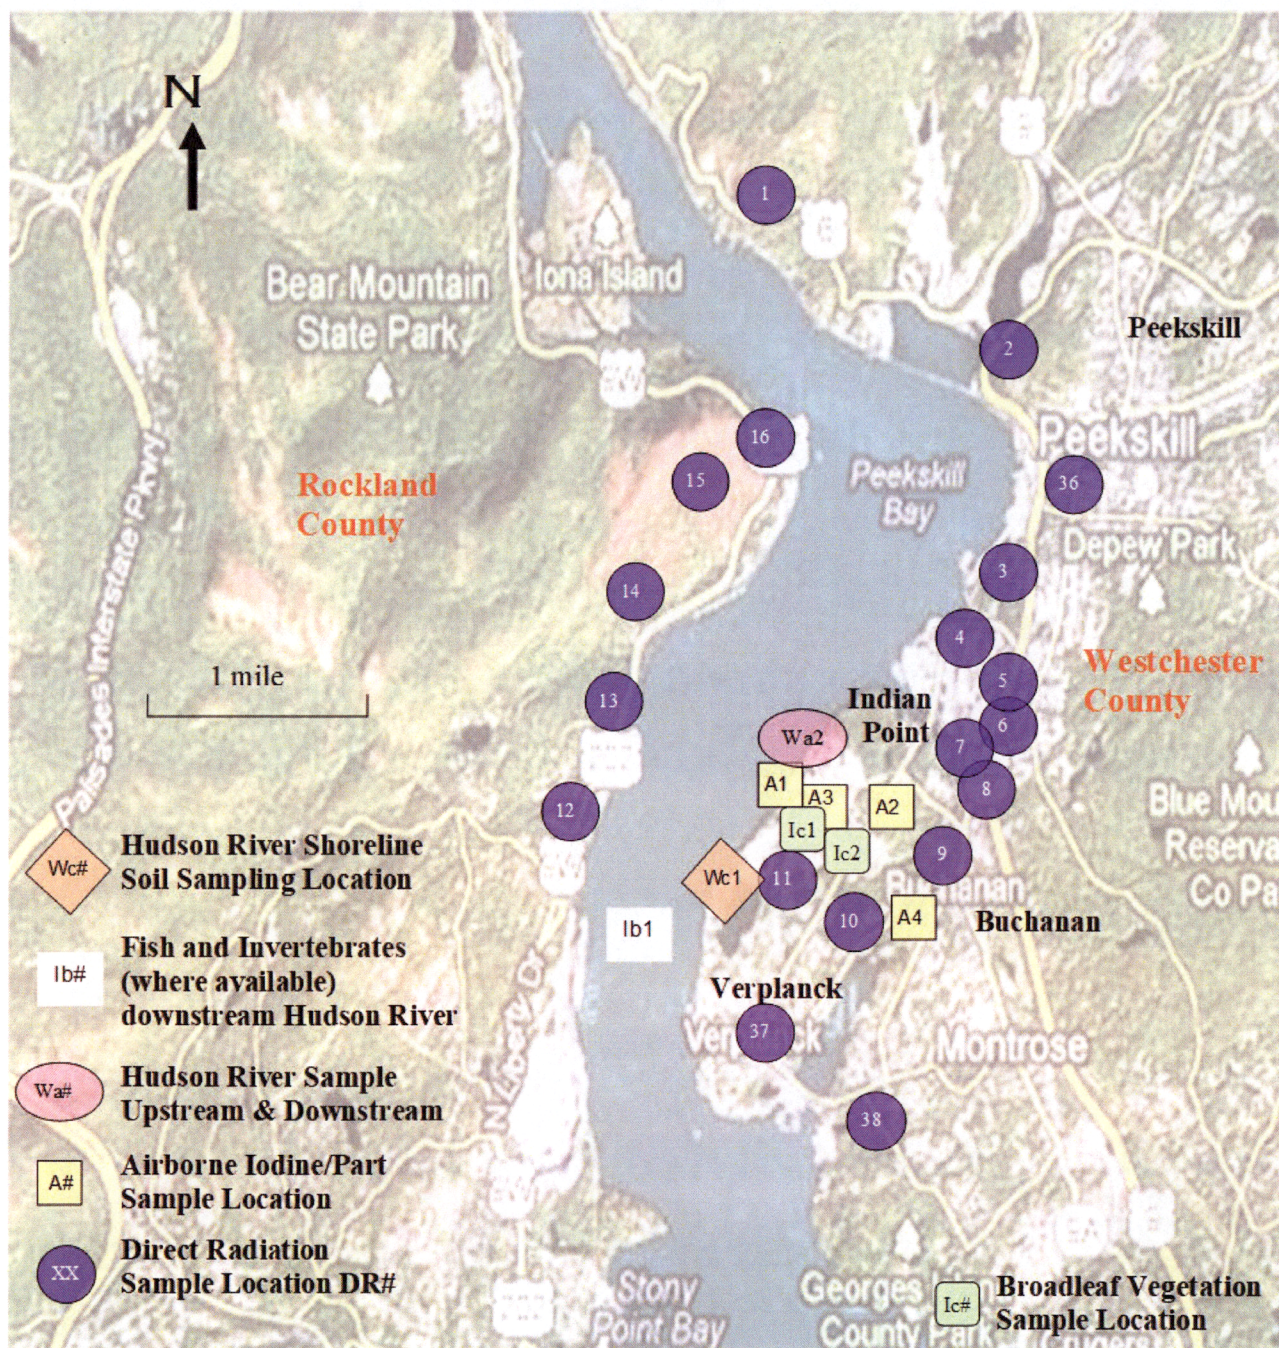


FIGURE A-2
SAMPLING LOCATIONS
 Greater than Two Miles from Indian Point

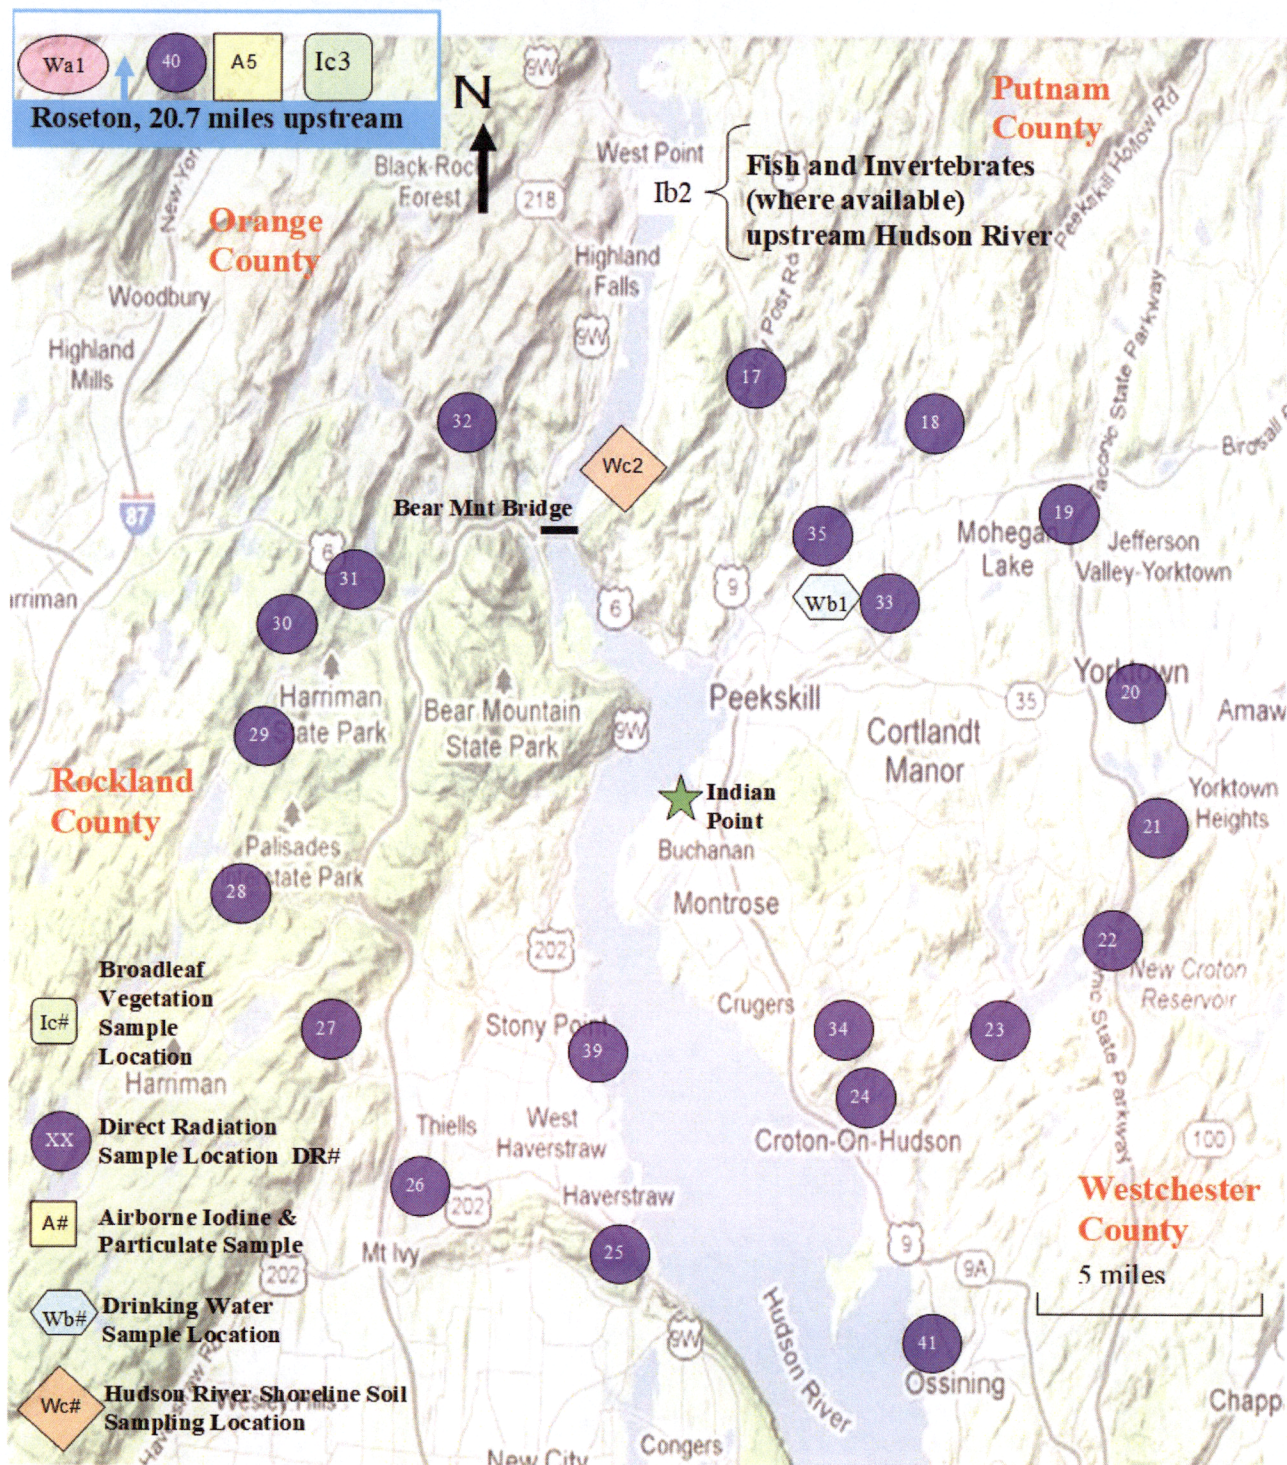


FIGURE A-3
SAMPLING LOCATIONS
Additional Sampling Locations

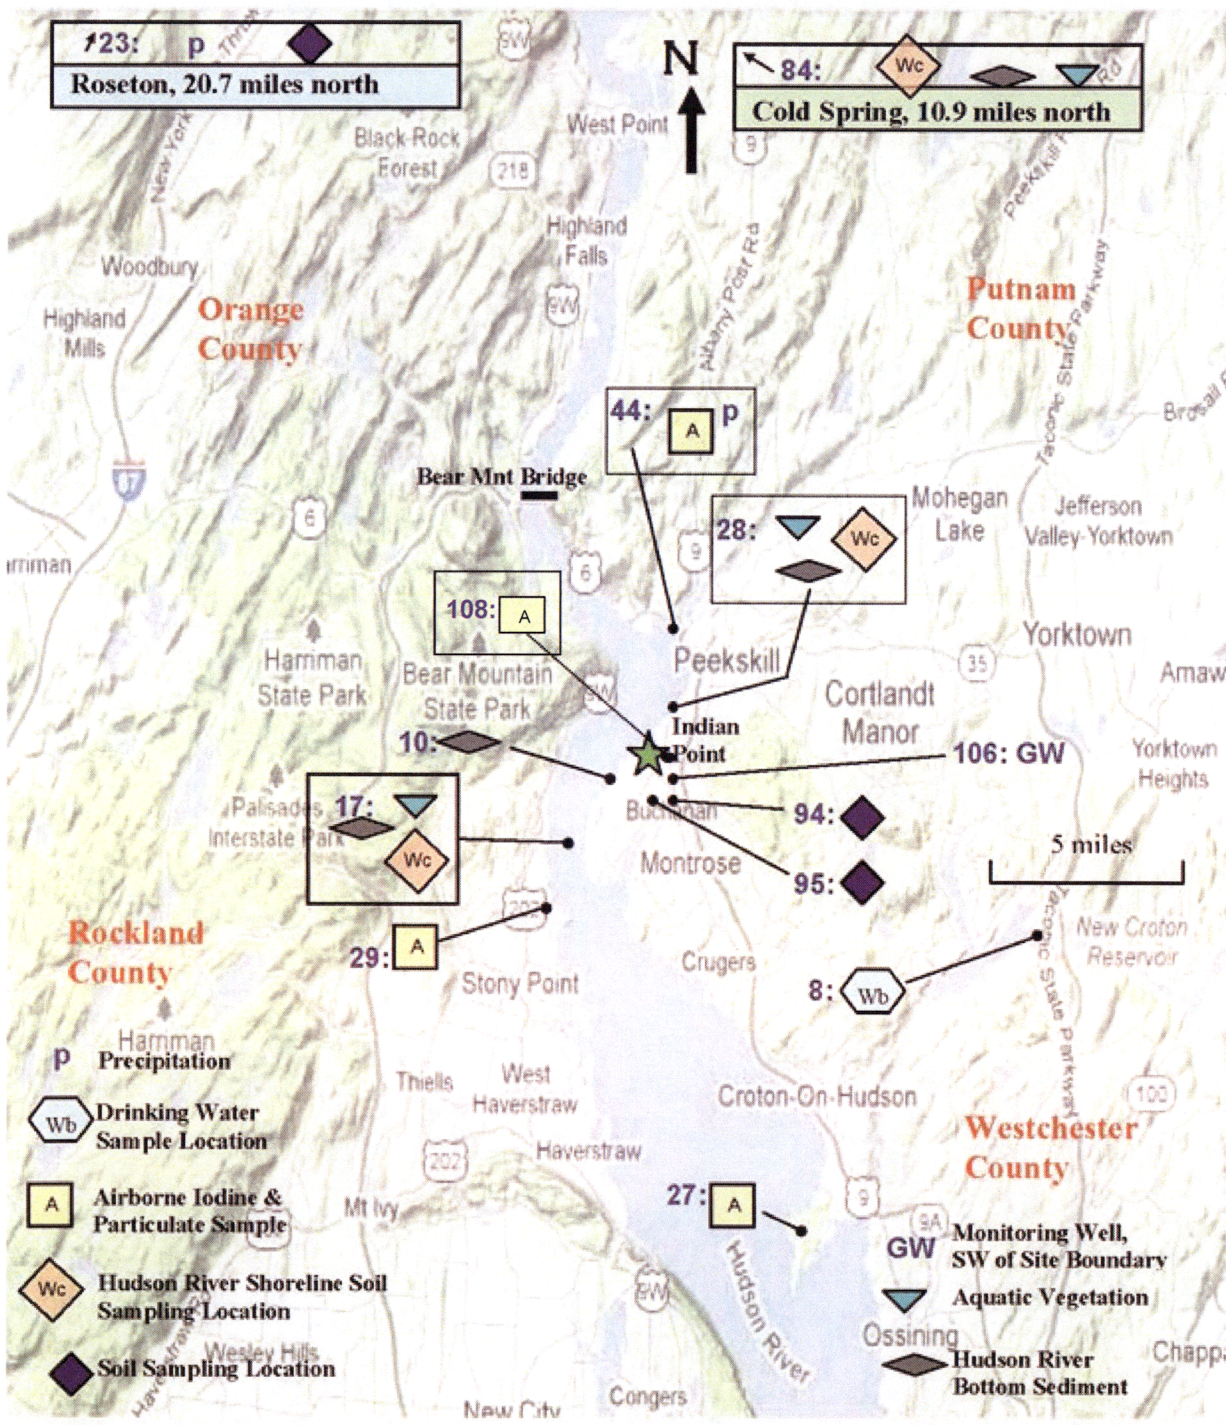


TABLE A-2
LOWER LIMIT OF DETECTION (LLD) REQUIREMENTS
FOR ENVIRONMENTAL SAMPLES

RADIONUCLIDE ANALYSIS	WATER (pCi/L)	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet)	MILK (pCi/L)	FOOD PRODUCTS (pCi/kg, wet)	SOIL or SEDIMENT (pCi/kg, dry)
Gross Beta	4	0.01				
H-3	2,000 (d)					
Mn-54	15		130			
Fe-59	30		260			
Co-58	15		130			
Co-60	15		130			
Ni-63 (f)	30		100			
Zn-65	30		260			
Sr-90 (f)	1		5			50
Zr-95	30					
Nb-95	15					
I-131	1 (d)	0.07		1	60	
Cs-134	15	0.05	130	15	60	150
Cs-137	18	0.06	150	18	80	180
Ba-140	60			60		
La-140	15			15		

Plant: Indian Point Energy Center	Year: 2020	Page 27 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE A-2

LOWER LIMIT OF DETECTION (LLD) REQUIREMENTS
FOR ENVIRONMENTAL SAMPLES

Table Notation

- (a) This list does not mean that only these nuclides are to be considered. Other peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Operating Report pursuant to the ODCM.
- (b) Required detection capabilities for thermoluminescent dosimeters used for environmental measurements are given in Regulatory Guide 4.13.
- (c) The LLD is defined as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable.

In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report pursuant to the ODCM.

- (d) These LLDs are for drinking water samples. If no drinking water pathway exists, the LLDs may be increased to 3,000 pCi/liter for H-3 and 15 pCi/liter for I-131.
- (e) These required lower limits of detection are associated only with the REMP requirements. The Radiological Ground Water Monitoring Program may involve unique reporting level criteria, independent of the REMP, and defined in station procedures.
- (f) Sr-90 and Ni-63 are included in this table due to their historical presence in ground water and possible migration to the environment.

TABLE A-3
REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS
IN ENVIRONMENTAL SAMPLES

RADIONUCLIDE ANALYSIS	WATER (pCi/L)	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet)	MILK (pCi/L)	FOOD PRODUCTS (pCi/kg, wet)
H-3	20,000 *				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Ni-63 ***	300		1,000		
Zn-65	300		20,000		
Sr-90 ***	8*		40		
Zr-95	400				
Nb-95	400				
I-131	2 *	0.9		3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-140	200			300	
La-140	200			300	

* Values provided are for drinking water pathways. If no drinking water pathway exists, higher values are allowed, as follows:

H-3	30,000 pCi/L (This is a 40 CFR 141 value)
Sr-90	12 pCi/L
I-131	20 pCi/L

** These reporting levels are associated only with the REMP requirements. The Radiological Ground Water Monitoring Program may involve unique reporting level criteria, independent of the REMP, and defined in station procedures.

*** Sr-90 and Ni-63 are included in this table due to their historical presence in ground water and possible migration to the environment

TABLE A-2
LOWER LIMIT OF DETECTION (LLD) REQUIREMENTS
FOR ENVIRONMENTAL SAMPLES

RADIONUCLIDE ANALYSIS	WATER (pCi/L)	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet)	MILK (pCi/L)	FOOD PRODUCTS (pCi/kg, wet)	SOIL or SEDIMENT (pCi/kg, dry)
Gross Beta	4	0.01				
H-3	2,000 (d)					
Mn-54	15		130			
Fe-59	30		260			
Co-58	15		130			
Co-60	15		130			
Ni-63 (f)	30		100			
Zn-65	30		260			
Sr-90 (f)	1		5			50
Zr-95	30					
Nb-95	15					
I-131	1 (d)	0.07		1	60	
Cs-134	15	0.05	130	15	60	150
Cs-137	18	0.06	150	18	80	180
Ba-140	60			60		
La-140	15			15		

Plant: Indian Point Energy Center	Year: 2020	Page 29 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 4.0

INTERPRETATION AND TRENDS OF RESULTS

Plant: Indian Point Energy Center	Year: 2020	Page 30 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

4.0 INTERPRETATION AND TRENDS OF RESULTS

The 2020 Radiological Environmental Monitoring Program (REMP) was conducted in accordance with Indian Point's Offsite Dose Calculation Manual ODCM. The ODCM contains requirements for the number and distribution of sampling locations, the types of samples to be collected, and the types of analyses to be performed for measurement of radioactivity.

The REMP at Indian Point includes measurements of radioactivity levels in the following environmental pathways.

Direct Gamma Radiation	Drinking Water
Groundwater	Soil
Broad Leaf Vegetation	Hudson River Water
Bottom Sediment	Shoreline Soil
Aquatic Vegetation	Fish and Invertebrates
Airborne Particulates and Radioiodine	

An annual land use and milch animal census is also part of the REMP.

To evaluate the contribution of plant operations to environmental radioactivity levels, other man-made and natural sources of environmental radioactivity, as well as the aggregate of past monitoring data, must be considered. It is not merely the detection of a radionuclide, but the evaluation of the location, magnitude, source, and history of its detection that determines its significance. Therefore, we have reported the data collected in 2020 and assessed the significance of the findings.

A summary of the results of the 2020 REMP is presented in Table B-2. This Table lists the mean and range of all positive results obtained for each of the media sampled at ODCM indicator and control locations. Discussions of these results and their evaluations are provided below.

The radionuclides detected in the environment can be grouped into three categories: (1) naturally occurring radionuclides; (2) radionuclides resulting from weapons testing and other non-plant related, anthropogenic sources; and (3) radionuclides that could be related to plant operations.

The environment contains a broad inventory of naturally occurring radionuclides which can be classified as, cosmic ray induced (e.g., Be-7) or geologically derived (e.g., Ra-226 and progeny, Th-228 and progeny, and K-40.) These radionuclides constitute the majority of the background radiation source and thus account for a majority of the annual background dose detected. Since the detected concentrations of these radionuclides were consistent at indicator and control locations, and unrelated to plant operations, their presence is noted only in the data tables and will not be discussed further.

The second group of radionuclides detected in 2020 consists of those resulting from past weapons testing in the earth's atmosphere. The more recent contamination events resulting from the Chernobyl and Fukushima accidents only indicated detectable activity shortly after their occurrences (Reference 5). However, weapons testing in the 1950's and 1960's resulted in a significant atmospheric radionuclide inventory, which, in turn, still contributes to the

Plant: Indian Point Energy Center	Year: 2020	Page 31 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

concentrations in the ecological systems. Although reduced in frequency, atmospheric weapons testing continued into the 1980's. The resultant radionuclide inventory of some radionuclides, although diminishing with time (e.g., through radioactive decay and natural dispersion processes), remains detectable.

In 2020, the detected radionuclides that may be attributable to past atmospheric weapons testing consisted of Cs-137 in several media. The levels detected were consistent with the historical levels of radionuclides resulting from weapons tests as measured in previous years.

The final group of radionuclides detected by the 2020 REMP comprises those that may be attributable to current plant operations. During 2020, Cs-137 and Tritium were the only potentially plant-related radionuclides detected in any environmental samples.

H-3 may be present in the local environment due to either natural occurrence, other man-made sources, or as a result of plant operations. Natural occurrence is very low (on the order of approximately 5 pCi/liter - well below typical detectable levels). The major source of H-3 is typically from above ground nuclear weapons testing, in the range of 50 to 150 pCi/liter). Other sources include weapons production and industrial uses where levels are highly dependent on the release rates and distance from the source term. One such industrial source is nuclear power plant operation. In 2020, very low levels of H-3 were detected in two river water samples.

Cs-137 is ubiquitous in the environment from atmospheric testing debris and a lesser amount from the Chernobyl accident. In 2020, there were seven detections of Cs-137 in bottom sediment and shoreline soil at indicator locations. Cs-137 was also detected in one soil samples obtained. In all cases, the Cs-137 concentrations, when detected, were consistent with historical values.

Strontium-90 (Sr-90) may also be present in the environment from atmospheric testing debris. Sr-90 was not detected in any of the fish, invertebrate, shoreline soil, or REMP groundwater samples.

I-131 is also produced in fission reactors, but can result from non-plant related anthropogenic sources, e.g., medical administrations, such as has been noted in previous years. I-131 was not detected in 2020 in aquatic or terrestrial vegetation indicator and control locations.

Co-58 and Co-60 are activation/corrosion products also related to plant operations. They are produced by neutron activation in the reactor core. Co-58 has a much shorter half-life than Co-60. If Co-58 and Co-60 are concurrently detected in environmental samples, then the source of these radionuclides is more likely the result of recent releases. When significant concentrations of Co-60 are detected but no Co-58, there is an increased likelihood that the Co-60 is due to residual Co-60 from past operations. There was no Co-58 or Co-60 detected in the 2020 REMP, although they were observed in historical data.

In the following sections, a summary of the results of the 2020 REMP is presented by sample medium and the significance of any positive findings discussed. As previously mentioned, Table B-2 provides an annual summary of the following media.

Plant: Indian Point Energy Center	Year: 2020	Page 32 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

4.1 Direct Radiation

The environmental TLDs used to measure the direct radiation were TLDs supplied and processed by Environmental Dosimetry Company. In 2020, the TLD program produced a consistent picture of ambient background radiation levels in the vicinity of the Indian Point Station. A summary of the annual TLD data is provided in Table B-2 and all the TLD data are presented in Tables B-3, B-4 and B-5. TLD sample site DR-40 is the control site for the direct radiation (DR) series of measurements.

Table B-3 provides the quarterly and annual average reported doses in mR per standard quarter for each of the direct radiation sample points, DR-1 through DR-41. Table B-4 provides the mean, standard deviation, minimum and maximum values in mR per year for the years 2011 through 2019. The 2020 means are also presented in Table B-4. Table B-5 presents the 2020 TLD data for the inner ring and outer ring of TLDs. The table also provides the sector for each of the DR sample points.

The 2020 mean value for the indicator direct radiation sample points was 14.0 mR per standard quarter – which is consistent with historical values. At those locations where the 2020 mean value was higher than historical means, they are within historical bounds for the respective locations.

The DR sample locations are arranged so that there are two concentric rings of TLDs around the Indian Point site. The inner ring (DR-1 to DR-16) is close to the site boundary. The outer ring (DR-17 to DR-32) has a radius of approximately 5 miles from the three Indian Point units. The results of the annual totals for these two rings of TLDs are provided in Table B-5. The annual average for the inner ring was 14.0 mR per standard quarter and also average for the outer ring was 14.2 mR per standard quarter. The control location average for 2020 was 15.4 mR per standard quarter.

Table C-1 and Figure C-1 present the 10-year historical averages for the inner and outer rings of TLDs. The 2020 averages are consistent with the historical data. The 2020 and previous years' data show that there is no measurable direct radiation in the environment due to the operation of the Indian Point site.

4.2 Airborne Particulates and Radioiodine

The results of the analyses of weekly air particulate filter samples for gross beta activity are presented in Table B-6 and the weekly charcoal cartridge analytical results are presented in Table B-7.

Gross beta activity was found in air particulate samples throughout the year at all indicator and control locations. The average gross beta activity for the nine indicator air sample locations was 0.013 pCi/m³ and the average for the control location was 0.013 pCi/m³. The activities detected were consistent for all locations, with no significant differences in gross beta activity in any sample due to location.

The results of the gamma spectral analyses (GSA) of the quarterly composites of these samples are shown in Table B-8. These quarterly composite air samples indicate that no

Plant: Indian Point Energy Center	Year: 2020	Page 33 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

reactor-related radionuclides were detected and that only Be-7, a naturally-occurring radionuclide was present at detectable levels.

The mean annual gross beta concentrations and Cs-137 concentrations in air for the past 10 years are presented in Table C-2. From this table and Figure C-2, it can be seen that the average 2020 gross beta concentration was consistent with historical levels. Cs-137 has not been detected since 1987. This is consistent with the trend of decreasing ambient Cs-137 concentrations in recent years.

From the data, it can be seen that no airborne radioactivity attributable to the operation of Indian Point was detected in 2020.

4.3 Drinking Water

Results of the gross beta, tritium and gamma spectroscopy analyses of the monthly drinking water samples are in Table B-9. Other than Gross Beta activity consistent with historical values, no radioactivity was detected in drinking water samples. This has historically been the case for the radionuclide results for this media. Operation of the Indian Point units had no detectable radiological impact on drinking water.

4.4 Ground Water

Data resulting from analysis of the groundwater samples for gamma emitters, tritium analysis, Ni-63 and Sr-90 are given in Table B-10. No plant related nuclides were noted in the sample.

4.5 Soil

Table B-11 contains the results of the soil samples for 2020. Other than naturally occurring radionuclides, very low levels of Cs-137 were detected in one soil sample consistent with historical results.

4.6 Broad Leaf Vegetation

Data from analysis of the 2020 samples are presented in Table B-12. Table C-6 contains an historical summary and Figure C-6 is an illustration of the broad leaf vegetation analysis results. There were no plant related nuclides detected in the 2020 samples. The detection of low levels of Cs-137 has occurred sporadically at indicator locations at relatively low concentrations for the past ten years, most likely the result of previous atmospheric weapons testing.

4.7 Hudson River Water

Data resulting from analysis of monthly Hudson River water samples for gamma emitters and quarterly composites of H-3 are presented in Tables B-13.

The only plant related activity detected was H-3; detected at low levels in two indicator samples. The levels are consistent with occasional historical detection of H-3 related to plant operation. Table C-3 shows historical H-3 concentrations at the plant inlet and discharge

points. Table C-8 contains a comparison of H-3 detected at the plant discharge (Hudson River Water mixing point) versus calculated quarterly average effluents concentrations. The

Plant: Indian Point Energy Center	Year: 2020	Page 34 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

data in table C-8 provides assurance that the REMP is indeed providing verification of the calculated radionuclide concentrations resulting from effluent releases attributable to the site.

4.8 Hudson River Bottom Sediment

Table B-14 contains the results of the analysis of bottom sediment samples for 2020. Cesium-137 was detected in five of six indicator station samples, and one of two control location samples. Detection of positive levels of Cs-137 in river bottom sediment is not unusual. Cs-137 is often detected in the control location sediments and therefore not likely due to plant releases.

Historical levels of Cs-137 in bottom sediment samples are shown in table C-9 and figure C-9. This data shows the continued detection of Cs-137 in bottom sediment samples at varying levels, and demonstrates that the levels observed during 2020 sampling are within the range of levels identified in historical samples.

4.9 Hudson River Shoreline Soil

Table B-15 contains the results of the gamma spectroscopic and strontium-90 analyses of the shoreline soil samples. In addition to the naturally occurring radionuclides, Cs-137 was identified in one of the Hudson River shoreline soil samples in 2020.

An historical look at Cs-137 detected in shoreline soil at indicator and control locations can be viewed in Table C-5 and Figure C-5. Cesium-137 has been present in this media, both at indicator and occasionally at the control location, at a consistent level over the past ten years. Cesium-134 and Cs-137 are both discharged from the plant in similar quantities. The lack of Cs-134 activity is an indication that the primary source of the Cs-137 in the shoreline soil is legacy contamination from weapons fallout.

Strontium-90 (Sr-90) was not detected in any of the six indicator location samples or any of the control location samples.

4.10 Hudson River Aquatic Vegetation

Table B-16 results show no plant related radionuclides were detected in any indicator or control aquatic vegetation samples in 2020. This is consistent with historical findings.

4.11 Fish and Invertebrates

Table B-17 contains the results of the analysis of fish and invertebrate samples for 2020. No plant related radionuclides were detected. This is consistent with historical results which are shown in table and figure C-7.

4.12 Land Use Census

A census was performed in the vicinity of Indian Point in 2020. This census consisted of a milch animal and a residence census. Results of this census are presented in Tables B-18 and B-19.

Plant: Indian Point Energy Center	Year: 2020	Page 35 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

The results of the 2020 census were generally same as the 2019 census results. Although in 2019, the presence of goats was noted on a property located less than 5.0 miles of IPEC, discussions with the owner of the property indicated that the goats did not produce milk for human consumption. Similar to 2019, it was noted in 2020 that no animals were producing milk for human consumption at this location or any other location within 5 miles to IPEC.

However, discussions with the owner for the 2020 land use surveys confirmed that the goats did not produce milk for human consumption and are therefore not milch animals.

The 2020 land use census indicated there were no new residences that were closer in proximity to IPEC.

The ODCM allows the sampling of broad leaf vegetation in two sectors at the site boundary in lieu of performing a garden census. Analysis results for these two sectors are discussed in Section 4.6 and presented in Table B-12, Table C-6 and Figure C-6.

4.13 Conclusion

The Radiological Environmental Monitoring Program is conducted each year to determine the radiological impact of Indian Point operations on the environment. The preceding discussions of the results of the 2020 REMP reveal that operations at the station did not result in an impact on the environment.

The 2020 REMP results demonstrate the relative contributions of different radionuclide sources, both natural and anthropogenic, to the environmental concentrations. The results indicate that the fallout from previous atmospheric weapons testing continues to contribute to detection of Cs-137 in some environmental samples. There are infrequent detections of plant related activity in the environs; however, the radiological levels are very low and are significantly less than those from natural background and other anthropogenic sources.

Plant: Indian Point Energy Center	Year: 2020	Page 36 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 5.0

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

Plant: Indian Point Energy Center	Year: 2020	Page 37 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

5.1 2020 Annual Radiological Environmental Monitoring Program Summary

The results of the 2020 radiological environmental sampling program are presented in Tables B-2 through B-17. Table B-2 is a summary table of the sample results for 2020. The format of this summary table conforms to the reporting requirements of the ODCM, NRC Regulatory Guide 4.8, and NRC Branch Technical Position to Regulatory Guide 4.8 (Reference 4). In addition, the data obtained from the analysis of samples are provided in Tables B-3 through B-17.

REMP samples were analyzed by various counting methods as appropriate. The methods are; gross beta, gamma spectroscopy analysis, liquid scintillation, radiochemical analysis, and TLD processing. Gamma spectroscopy analysis was performed for gamma emitting nuclides, including the following: Be-7, K-40, Mn-54, Co-58, Co-60, Fe-59, Zn-65, Zr-95, Nb-95, Ru-103, Ru-106, I-131, Cs-134, Cs-137, Ba/La-140, Ce-141, Ce-144, Ra-226 and Ac/Th-228. Radiochemical analyses were performed for H-3, Ni-63, Sr-90 and I-131 for specific media and locations as required in the ODCM.

5.2 Land Use Census

In accordance with Sections IP2-D3.5.2 and IP3-2.8 of the ODCM, a land use census was conducted to identify the nearest milch animal and the nearest residence. The results of the milch animal and land use census are presented in Tables B-18 and B-19, respectively. In lieu of identifying and sampling the nearest garden of greater than 50 m², at least three kinds of broad leaf vegetation were sampled near the site boundary in two sectors and at a designated control location (results are presented in Table B-12).

5.3 Sampling Deviations

During 2020, environmental sampling was performed for 10 unique media types addressed in the ODCM and for direct radiation. A total of 1183 samples of 1187 scheduled were obtained. Of the scheduled samples, 99.6% were collected and analyzed for the program. Sampling deviations are summarized in Table B-1. Discussions of the reasons for the deviations are provided in Table B-1a for the air samples, Table B-1b for other media, and Table B-1c for changes to the REMP program. Analytical deviations noted in Table B-6 and B-7 due to insufficient sample volumes as noted in Table B-1a.

5.4 Analytical Deviations

No analytical deviations were found in 2020.

5.5 Special Reports

No special reports were required under the REMP.

TABLE B-1
Summary of Sampling Deviations - 2020

MEDIA	TOTAL SCHEDULED SAMPLES	NUMBER OF DEVIATIONS*	SAMPLING EFFICIENCY %	NUMBER OF ANALYSES**	REASON FOR DEVIATION
MEDIA					
TLD	164	1	99%	163	See Table B-1b
PARTICULATES IN AIR	428	0	100%	461	N/A
CHARCOAL FILTER	428	0	100%	428	N/A
PRECIPITATION	N/A	N/A	N/A	N/A	See Table B-1b
DRINKING WATER	24	0	100%	56	N/A
GROUNDWATER SAMPLES	2	1	50%	4	See Table B-1b
SOIL	3	0	100%	3	N/A
BROAD LEAF VEGETATION	45	0	100%	45	N/A
HUDSON RIVER WATER	34	0	100%	46	N/A
SHORELINE SOIL	10	0	100%	20	N/A
HUDSON RIVER BOTTOM SEDIMENT	8	0	100%	8	N/A
AQUATIC VEGETATION	6	2	67%	4	See Table B-1b
FISH & INVERTEBRATES	35	0	100%	105	N/A
TOTALS	1187	4	99.6%	1343	

TOTAL NUMBER OF
SAMPLES COLLECTED =

1183

* Samples not collected or unable to be analyzed.

** Several sample types require more than one analysis

Plant: Indian Point Energy Center	Year: 2020	Page 39 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-1a
2020 Air Sampling Deviations

LOCATION	DATE	PROBLEM / ACTIONS TO PREVENT RECURRENCE
95 Met Tower	8/10/2020	Air sampler lost 136 hours of run time due to a power outage from Tropical Storm Isaias. CR-IP3-2020-01928 (also see CR-IP3-2020-01849 & 01857)
95 Met Tower	8/17/2020	Air sampler lost 172 hours of run time due to a power outage from Tropical Storm Isaias. CR-IP3-2020-02004
04 Algonquin	8/31/2020	Air sampler lost 169 hours of run time due to a tripped GFCI. CR-IP3-2020-02140
04 Algonquin	9/9/2020	Air sampler lost 94 hours of run time due to a defective GFCI. CR-IP3-2020-02272
23 Roseton	11/30/2020	Air sampler lost 95.5 hours of run time due to a defective GFCI. CR-IP3-2020-03054
23 Roseton	12/7/2020	Air sampler lost 28 hours of run time due to a defective GFCI & Hour-meter. CR-IP3-2020-03125

TABLE B-1b
2020 Other Media Deviations

LOCATION	DATE	PROBLEM / ACTIONS TO PREVENT RECURRENCE
09 Hudson River Intake	1/22/2020	Sample line and bucket found frozen due to no power. Grab sample was collected. CR-IP2-2020-00323.
09 Hudson River Intake	3/10/2020	Sample was not able to be obtained due to loss of power. Grab sample was collected. CR-IP2-2020-00836
09 Hudson River Intake	12/23/2020	Sample was not able to be obtained due to loss of power. Grab sample was collected. IP2-2020-02093
20 Cortlandt Yacht Club	1/13/2021	During collection of 4 Quarter REMP TLDs it was discovered that the TLD was missing from the Cortlandt Yacht Club location. Technician searched the area but did not find it. TLD was replaced. CR-IP2-2021-00017

Plant: Indian Point Energy Center	Year: 2020	Page 40 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-1c
2020 Changes to the REMP Program

LOCATION	DATE	Discussion of REMP Change
Precipitation - IPEC #44 and # 23 - discontinued	1/1/2020	This media is not required by the ODCM and not listed in NUREG 1301. Routine sampling/analysis was not very useful. Therefore, it was decided to eliminate it.
Airborne - IPEC #44 Peekskill replaced by IPEC #108 Telecom Building	4/6/2020	Location # 44 has been subject to some vandalism and ownership of the property is of concern. Therefore, it was decided that location #108 would be an appropriate replacement. Both these locations are extra locations, not required per the ODCM. Concurrent sampling for several weeks (3/30/20 – 6/22/20) was performed at these locations.
Hudson River Water - IPEC #9 (Wa1) Plant Inlet (Hudson River Intake) replaced by Roseton	10/30/2020	Plant Inlet water samples can be affected by the IPEC liquid discharges. The ODCM was revised (Rev. 5) with a location that better meets the criteria for a Control Location. Ten months of concurrent sampling was performed for these locations.
Groundwater - IPEC #106 (GW) - discontinued	10/30/2020	The ODCM was revised (Rev. 5) to delete this location. Groundwater flow from IPEC has been verified to not be towards this location. IPEC maintains a detailed on-site Groundwater Monitoring Program which continues to verify the groundwater plume direction. Results of this onsite program are listed in the annual Radioactive Effluent Release Report.

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY

INDIAN POINT ENERGY CENTER - 2020

Dockets 50-003, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean** (Range)	Mean** (Range)	
Direct Radiation (mR/Standard Quarter)	TLD-Quarterly	163		14.0 (159/159) (10.5/17.0)	DR-31	4.65 Mi. NW	16.3 (4/4) (15.2/17.0)	15.4 (4/4) (14.7/16.2)	0
Air Particulate (pCi/m ³)	Gr-B	428	0.01	.013 (374/376) (.005/.032)	108	0.36 Mi. ESE	.013 (39/39) (.006/.031)	.013 (52/52) (.006/.028)	0
Air Iodine (pCi/m ³)	GAMMA I-131	428	0.07	<LLD			-	<LLD	0
Air Particulate (10 ⁻³ pCi/m ³)	GAMMA Be-7	33	NA	112.5 (29/29) (81.6/163.8)	4	0.28 Mi. SW	119 (4/4) (90.2/163.8)	104.8 (4/4) (85.1/121.8)	0
	K-40		NA	<LLD			-	<LLD	0
	Cs-134		0.05	<LLD			-	<LLD	0
	Cs-137		0.06	<LLD			-	<LLD	0
	Th-228		NA	<LLD			-	<LLD	0
Rainwater* (pCi/L)	H-3	0	200	NA			-	NA	0
	GAMMA Co-60	0	15	NA			-	NA	0
	Cs-134		15	NA			-	NA	0
	Cs-137		18	NA			-	NA	0
*Rainwater collection was discontinued in 2019.									
Drinking Water (pCi/L)	Gr-B	24	4	3.09 (15/24) (2.14/4.07)	07	3.4 Mi. NE	3.35 (5/12) (2.97/4.07)	NA	0
	H-3	8	200	<LLD			-	NA	0
	GAMMA Mn-54	24	15	<LLD			-	NA	0
	Co-58		15	<LLD			-	NA	0
	Fe-59		30	<LLD			-	NA	0

Plant: Indian Point Energy Center	Year: 2020	Page 42 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
INDIAN POINT ENERGY CENTER - 2020
Dockets 50-003, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean** (Range)	Mean** (Range)	
Drinking Water (cont'd) (pCi/L)	Co-60		15	<LLD			-	NA	0
	Zn-65		30	<LLD			-	NA	0
	Nb-95		15	<LLD			-	NA	0
	Zr-95		30	<LLD			-	NA	0
	I-131		15	<LLD			-	NA	0
	Cs-134		15	<LLD			-	NA	0
	Cs-137		18	<LLD			-	NA	0
	Ba-140		60	<LLD			-	NA	0
	La-140		15	<LLD			-	NA	0
Groundwater (pCi/L)	H-3	1	200	<LLD			-	NA	0
	Ni-63	1	30	<LLD			-	NA	0
	Sr-90	1	1	<LLD			-	NA	0
	GAMMA Mn-54	1	15	<LLD			-	NA	0
	CO-58		15	<LLD			-	NA	0
	Fe-59		30	<LLD			-	NA	0
	Co-60		15	<LLD			-	NA	0
	Zn-65		30	<LLD			-	NA	0
	Nb-95		15	<LLD			-	NA	0

Plant: Indian Point Energy Center	Year: 2020	Page 43 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
INDIAN POINT ENERGY CENTER - 2020
Dockets 50-003, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean** (Range)	Mean** (Range)	
Groundwater (cont'd) (pCi/L)	Zr-95		30	<LLD			-	NA	0
	I-131		15	<LLD			-	NA	0
	Cs-134		15	<LLD			-	NA	0
	Cs-137		18	<LLD			-	NA	0
	Ba-140		60	<LLD			-	NA	0
	La-140		15	<LLD			-	NA	0
Soil (pCi/kg dry)	GAMMA Be-7	3	NA	<LLD			-	<LLD	0
	K-40		NA	11231 (2/2) (9632/12830)	23	20.7 Mi. N	15520 (1/1)	15520 (1/1)	0
	Co-60		NA	<LLD			-	<LLD	0
	Cs-134		150	<LLD			-	<LLD	0
	Cs-137		180	106.8 (1/2)	94	0.39 Mi. S	106.8 (1/1)	<LLD	0
	Ra-226		NA	<LLD	23	20.7 Mi. N	2632 (1/1)	2632 (1/1)	0
	Th-228		NA	538.1 (2/2) (508.1/568.1)	23	20.7 Mi. N	930.7 (1/1)	930.7 (1/1)	0
Broadleaf Vegetation (pCi/kg wet)	GAMMA Be-7	45	NA	1758.3 (27/30) (508.3/2948)	94	0.39 Mi. S	1901.7 (13/15) (1079/2948)	1102.7 (14/15) (443.4/1936)	0
	K-40		NA	5131.8 (30/30) (1762/8846)	95	0.46 Mi. SSW	5250.7 (15/15) (2597/8177)	4288.8 (15/15) (2073/6550)	0
	Co-60		NA	<LLD			-	<LLD	0
	I-131		60	<LLD			-	<LLD	0
	Cs-134		60	<LLD			-	<LLD	0

Plant: Indian Point Energy Center	Year: 2020	Page 44 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
INDIAN POINT ENERGY CENTER - 2020
Dockets 50-003, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean** (Range)	Mean** (Range)	
Broadleaf Vegetation (cont'd) (pCi/kg wet)	Cs-137		80	<LLD			-	<LLD	0
	Th-228		NA	<LLD			-	<LLD	0
River Water (pCi/L)	H-3	12	200	288 (2/4) (229/347)	10	0.3 Mi. WSW	288 (2/4) (229/347)	<LLD	0
	GAMMA Mn-54	34	15	<LLD			-	<LLD	0
	Co-58		15	<LLD			-	<LLD	0
	Fe-59		30	<LLD			-	<LLD	0
	Co-60		15	<LLD			-	<LLD	0
	Zn-65		30	<LLD			-	<LLD	0
	Nb-95		15	<LLD			-	<LLD	0
	Zr-95		30	<LLD			-	<LLD	0
	Cs-134		15	<LLD			-	<LLD	0
	I-131		15	<LLD			-	<LLD	0
	Cs-137		18	<LLD			-	<LLD	0
	Ba-140		60	<LLD			-	<LLD	0
	La-140		15	<LLD			-	<LLD	0
	Th-228		NA	<LLD			-	<LLD	0
Bottom Sediment (pCi/kg dry)	GAMMA K-40	8	NA	16288.3 (6/6) (13420/19800)	84	10.88 Mi. N	20445 (2/2) (19850/21040)	20445 (2/2) (19850/21040)	0
	Co-60		NA	<LLD			-	<LLD	0

Plant: Indian Point Energy Center	Year: 2020	Page 45 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
INDIAN POINT ENERGY CENTER - 2020
Dockets 50-003, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean** (Range)	Mean** (Range)	
Bottom Sediment (cont'd) (pCi/kg dry)	Cs-134		150	<LLD			-	<LLD	0
	Cs-137		180	167 (5/6) (85.5/210.7)	84	10.88 Mi. N	206.9 (1/2)	206.9 (1/2)	0
	Ra-226		NA	<LLD			-	<LLD	0
	Th-228		NA	729.6 (6/6) (330.3/1184)	84	10.88 Mi. N	1196 (2/2) (1098/1294)	1196 (2/2) (1098/1294)	0
Shoreline Soil (pCi/kg dry)	Sr-90	10	5000	<LLD			-	<LLD	0
	GAMMA K-40	10	NA	11397 (6/6) (8787/15530)	84	10.88 Mi. N	30555 (2/2) (29000/32110)	21448 (4/4) (11650/32110)	0
	Cs-134		150	<LLD			-	<LLD	0
	Cs-137		180	96.5 (1/6)	17	1.5 Mi. SSW	96.5 (1/2)	<LLD	0
	Ra-226		NA	<LLD	50	4.48 Mi. NNW	3306 (1/2)	3306 (1/4)	0
	Ac-228		NA	511.8 (2/6) (498.9-524.6)	84	10.88 Mi. N	607.8 (1/2)	597.8 (2/4) (587.8/607.8)	0
	Th-228		NA	317.2 (5/6) (171.2/431.2)	84	10.88 Mi. N	665.3 (2/2) (582.8/747.7)	620.3 (4/4) (520.6/747.7)	0
Aquatic Vegetation (pCi/kg wet)	GAMMA Be-7	4	NA	561.4 (1/3)	17	1.5 Mi. SSW	561.4 (1/2)	<LLD	0
	K-40		NA	2737.7 (3/3) (2405/3167)	84	10.88 Mi. N	3234 (1/1)	3234 (1/1)	0
	Co-60		NA	<LLD			-	NA	0
	I-131		60	<LLD			-	NA	0
	Cs-134		60	<LLD			-	NA	0
	Cs-137		80	<LLD			-	NA	0
	Ra-226		NA	<LLD			-	NA	0
	Ac-228		NA	<LLD			-	<LLD	0

Plant: Indian Point Energy Center	Year: 2020	Page 46 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-2 RADIOLOGICAL ENVIRONMENT MONITORING PROGRAM SUMMARY
INDIAN POINT ENERGY CENTER - 2020
Dockets 50-003, 50-247 & 50-286

Medium or Pathway Sampled (Units)	Analysis Type	Total Number	LLD*	Indicator Locations	Location with Highest Mean			Control Locations	Non-Routine Reported Measurements
				Mean ** (Range)	Location Number	Distance Direction	Mean** (Range)	Mean** (Range)	
Aquatic Vegetation (cont'd) (pCi/kg wet)	Th-228		NA	143.1 (1/2)	17	1.5 Mi. SSW	143.1 (1/2)	<LLD	0
Fish (pCi/kg wet)	Ni-63	35	100	<LLD			-	<LLD	0
	Sr-90	35	5	<LLD			-	<LLD	0
	GAMMA K-40	35	NA	2484 (22/22) (1568/3322)	23	20.7 Mi. N	2577 (13/13) (1366/3464)	2577 (13/13) (1366/3464)	0
	Mn-54		130	<LLD			-	<LLD	0
	Co-58		130	<LLD			-	<LLD	0
	Fe-59		260	<LLD			-	<LLD	0
	Co-60		130	<LLD			-	<LLD	0
	Zn-65		260	<LLD			-	<LLD	0
	Cs-134		130	<LLD			-	<LLD	0
	Cs-137		150	<LLD			-	<LLD	0
	Th-228		NA	<LLD			-	<LLD	0

Environment Samples 1183
Analysis 1343

* LLD IS THE LOWER LIMIT OF DETECTION

** THE MEAN VALUES ARE CALCULATED USING THE POSITIVE VALUES

Plant: Indian Point Energy Center	Year: 2020	Page 47 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-3
DIRECT RADIATION, QUARTERLY DATA - 2020

mR/Quarter \pm 1 sigma

Sample Nuclide	Station Number	First Quarter 01/01-03/31	Second Quarter 04/01-06/30	Third Quarter 07/01-09/30	Fourth Quarter 10/01-01/01	Annual Average	Annual Total
TLD	DR-01	14.5 \pm 0.7	14.7 \pm 0.9	16.6 \pm 0.9	15.8 \pm 1.2	15.4 \pm 1.0	61.6
	DR-02	14.1 \pm 0.8	15.0 \pm 0.7	15.5 \pm 0.9	14.4 \pm 0.8	14.7 \pm 0.6	59.0
	DR-03	12.7 \pm 0.8	12.2 \pm 0.7	13.2 \pm 0.8	12.8 \pm 0.8	12.7 \pm 0.4	50.9
	DR-04	13.0 \pm 0.6	13.2 \pm 0.5	14.4 \pm 0.8	13.0 \pm 0.9	13.4 \pm 0.7	53.7
	DR-05	13.1 \pm 0.6	13.8 \pm 0.7	14.6 \pm 0.9	13.7 \pm 0.9	13.8 \pm 0.6	55.3
	DR-06	13.9 \pm 0.7	14.2 \pm 0.5	15.5 \pm 1.2	14.0 \pm 1.0	14.4 \pm 0.7	57.6
	DR-07	15.7 \pm 0.7	15.7 \pm 0.7	16.9 \pm 1.4	15.0 \pm 0.9	15.8 \pm 0.8	63.3
	DR-08	12.0 \pm 0.6	12.7 \pm 0.9	12.7 \pm 0.6	12.1 \pm 0.7	12.4 \pm 0.4	49.5
	DR-09	13.5 \pm 0.7	13.9 \pm 0.6	14.4 \pm 0.9	13.8 \pm 0.9	13.9 \pm 0.4	55.7
	DR-10	13.7 \pm 0.7	14.1 \pm 0.8	14.2 \pm 0.6	13.4 \pm 0.8	13.8 \pm 0.4	55.4
	DR-11	10.5 \pm 0.8	10.8 \pm 0.6	11.3 \pm 0.6	11.0 \pm 0.7	10.9 \pm 0.4	43.7
	DR-12	14.8 \pm 0.8	16.1 \pm 1.0	15.9 \pm 0.8	15.4 \pm 0.8	15.6 \pm 0.6	62.2
	DR-13	15.8 \pm 0.7	16.2 \pm 0.5	16.3 \pm 0.7	15.7 \pm 1.1	16.0 \pm 0.3	64.0
	DR-14	12.1 \pm 0.7	13.5 \pm 0.8	13.2 \pm 0.9	13.0 \pm 0.7	13.0 \pm 0.6	51.8
	DR-15	11.9 \pm 0.6	13.6 \pm 0.8	13.1 \pm 0.6	13.5 \pm 0.7	13.0 \pm 0.8	52.1
	DR-16	13.9 \pm 0.8	15.0 \pm 1.0	15.1 \pm 1.0	14.8 \pm 0.8	14.7 \pm 0.6	58.7
	DR-17	13.1 \pm 0.9	14.7 \pm 0.8	14.5 \pm 1.0	14.7 \pm 1.2	14.2 \pm 0.7	56.9
	DR-18	14.0 \pm 0.6	14.5 \pm 0.5	15.5 \pm 0.7	14.3 \pm 0.9	14.6 \pm 0.6	58.2
	DR-19	14.3 \pm 0.7	15.1 \pm 0.9	15.5 \pm 0.6	14.3 \pm 0.9	14.8 \pm 0.6	59.3
	DR-20	13.8 \pm 0.6	14.2 \pm 0.7	15.0 \pm 0.9	13.7 \pm 0.8	14.2 \pm 0.6	56.6
	DR-21	14.0 \pm 0.7	14.6 \pm 0.8	15.4 \pm 0.9	13.9 \pm 0.7	14.5 \pm 0.7	57.9
	DR-22	10.9 \pm 0.8	11.7 \pm 0.4	11.8 \pm 0.5	10.9 \pm 0.6	11.3 \pm 0.5	45.3
	DR-23	13.8 \pm 0.6	14.6 \pm 0.5	14.6 \pm 0.7	13.7 \pm 0.7	14.2 \pm 0.5	56.8
	DR-24	13.9 \pm 0.7	15.4 \pm 0.7	15.3 \pm 0.8	14.4 \pm 1.0	14.8 \pm 0.7	59.1
	DR-25	10.8 \pm 0.7	12.7 \pm 0.6	12.3 \pm 0.7	12.0 \pm 0.8	11.9 \pm 0.8	47.8
	DR-26	12.5 \pm 0.7	14.7 \pm 0.5	13.8 \pm 0.6	13.6 \pm 0.9	13.7 \pm 0.9	54.6
	DR-27	12.4 \pm 0.7	13.8 \pm 0.8	13.7 \pm 0.8	13.7 \pm 0.9	13.4 \pm 0.7	53.6
	DR-28	14.6 \pm 1.1	16.4 \pm 1.0	16.0 \pm 0.8	15.2 \pm 0.8	15.5 \pm 0.8	62.2
	DR-29	12.9 \pm 0.9	14.7 \pm 0.7	14.6 \pm 0.6	14.3 \pm 1.2	14.1 \pm 0.8	56.4
	DR-30	13.2 \pm 0.5	14.6 \pm 0.9	14.7 \pm 0.8	14.2 \pm 0.8	14.1 \pm 0.7	56.5
	DR-31	15.2 \pm 0.6	16.8 \pm 0.8	17.0 \pm 0.8	16.4 \pm 0.8	16.3 \pm 0.8	65.3
	DR-32	15.1 \pm 0.9	15.9 \pm 1.0	16.2 \pm 0.7	16.2 \pm 1.2	15.8 \pm 0.5	63.3
	DR-33	12.9 \pm 0.6	13.7 \pm 0.8	14.3 \pm 0.9	12.9 \pm 0.9	13.5 \pm 0.7	53.8
	DR-34	12.6 \pm 0.6	13.8 \pm 0.5	13.7 \pm 0.7	13.0 \pm 0.8	13.3 \pm 0.6	53.2
	DR-35	12.8 \pm 0.7	13.7 \pm 0.8	14.1 \pm 0.6	13.3 \pm 0.8	13.5 \pm 0.5	53.9
	DR-36	13.8 \pm 0.6	14.7 \pm 1.0	14.9 \pm 0.8	14.2 \pm 0.7	14.4 \pm 0.5	57.6
	DR-37	13.2 \pm 0.6	14.1 \pm 0.5	15.4 \pm 0.6	13.1 \pm 0.9	14.0 \pm 1.1	55.8
	DR-38	12.0 \pm 0.5	13.3 \pm 0.7	13.2 \pm 0.6	(a)	12.8 \pm 0.7	38.5
	DR-39	14.1 \pm 0.6	15.1 \pm 0.7	15.5 \pm 0.8	14.5 \pm 0.8	14.8 \pm 0.6	59.3
	DR-40*	14.7 \pm 0.8	15.5 \pm 0.7	16.2 \pm 0.8	15.1 \pm 0.8	15.4 \pm 0.6	61.5
	DR-41	12.8 \pm 0.9	13.8 \pm 1.0	14.4 \pm 0.9	12.6 \pm 0.9	13.4 \pm 0.9	53.6
AVERAGE (Indicator Locations)		13.3 \pm 1.2	14.3 \pm 1.2	14.6 \pm 1.3	13.9 \pm 1.2	14.0 \pm 1.2	55.7

* Control location

(a) Refer deviation table B-1b

INDIAN POINT ENERGY CENTER
TABLE B-4
DIRECT RADIATION, 2011 THROUGH 2020 DATA

mR per Year

Station Number	Mean (2011-2019)	Standard Deviation (2011-2019)	Minimum Value (2011-2019)	Maximum Value (2011-2019)	2020 Annual Total
DR-01	61.6	3.3	55.6	65.6	61.6
DR-02	58.0	1.7	55.9	60.4	59.0
DR-03	46.3	4.8	35.0	50.8	50.9
DR-04	53.2	1.0	52.1	54.8	53.7
DR-05	54.7	1.6	53.3	58.2	55.3
DR-06	56.0	1.3	54.7	58.0	57.6
DR-07	62.5	1.4	60.7	64.6	63.3
DR-08	47.1	1.4	45.1	48.9	49.5
DR-09	53.0	2.0	50.0	55.8	55.7
DR-10	57.0	4.7	53.0	67.7	55.4
DR-11	43.2	1.1	41.4	44.6	43.7
DR-12	60.4	4.5	49.2	64.8	62.2
DR-13	64.9	1.9	62.3	67.6	64.0
DR-14	52.2	1.3	50.5	54.0	51.8
DR-15	52.2	1.3	50.3	53.8	52.1
DR-16	57.4	1.6	55.1	59.3	58.7
DR-17	57.8	1.7	55.6	60.1	56.9
DR-18	56.2	1.2	54.4	57.8	58.2
DR-19	58.3	1.5	55.9	60.4	59.3
DR-20	55.4	1.2	53.4	57.5	56.6
DR-21	54.8	2.3	51.9	58.4	57.9
DR-22	45.0	1.7	42.6	47.7	45.3
DR-23	55.5	1.3	53.6	57.4	56.8
DR-24	58.2	1.6	55.8	60.2	59.1
DR-25	48.5	1.5	45.7	50.5	47.8
DR-26	55.3	1.4	53.0	57.4	54.6
DR-27	54.1	1.7	51.5	56.5	53.6
DR-28	71.2	11.2	51.3	80.6	62.2
DR-29	56.3	1.2	54.8	58.3	56.4
DR-30	57.6	2.1	54.7	61.9	56.5
DR-31	64.8	1.9	61.5	67.4	65.3
DR-32	53.8	4.1	48.7	63.3	63.3
DR-33	53.8	1.2	52.3	55.6	53.8
DR-34	52.4	1.8	50.2	55.0	53.2
DR-35	52.6	2.7	49.9	56.3	53.9
DR-36	57.9	1.5	55.9	60.2	57.6
DR-37	54.7	1.2	53.3	56.8	55.8
DR-38	48.7	1.6	46.6	50.9	38.5
DR-39	57.9	2.0	54.8	60.9	59.3
DR-40*	57.8	4.3	49.3	62.4	61.5
DR-41	51.8	1.6	49.7	53.9	53.6
AVERAGE (Indicator Locations)					55.8

* Control location

Plant: Indian Point Energy Center	Year: 2020	Page 49 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-5
DIRECT RADIATION, INNER AND OUTER RINGS - 2020
(mR per Year)

Inner Ring ID	Outer Ring ID	Sector	Inner Ring Annual Total	Outer Ring Annual Total
DR-01	DR-17	N	61.59	56.91
DR-02	DR-18	NNE	58.96	58.24
DR-03	DR-19	NE	50.89	59.26
DR-04	DR-20	ENE	53.69	56.61
DR-05	DR-21	E	55.26	57.93
DR-06	DR-22	ESE	57.63	45.33
DR-07	DR-23	SE	63.25	56.77
DR-08	DR-24	SSE	49.45	59.12
DR-09	DR-25	S	55.66	47.77
DR-10	DR-26	SSW	55.35	54.64
DR-11	DR-27	SW	43.66	53.57
DR-12	DR-28	WSW	62.20	62.17
DR-13	DR-29	W	64.03	56.35
DR-14	DR-30	WNW	51.80	56.53
DR-15	DR-31	NW	52.11	65.27
DR-16	DR-32	NNW	58.72	63.34
		Average	55.89	56.86

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-6

GROSS BETA ACTIVITY IN AIRBORNE PARTICULATE SAMPLES - 2020

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Gas Holder Bldg. 44	Training Building 94	Met Tower 95	Telcom Bldg. 108
01/06/20	0.007 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	(b)
01/14/20	0.010 ± 0.002	0.012 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.012 ± 0.002	(b)
01/22/20	0.015 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	0.014 ± 0.002	0.016 ± 0.002	0.014 ± 0.002	0.014 ± 0.002	0.015 ± 0.002	(b)
01/28/20	0.010 ± 0.002	0.012 ± 0.003	0.013 ± 0.003	0.011 ± 0.002	0.015 ± 0.003	0.013 ± 0.002	0.011 ± 0.002	0.014 ± 0.003	(b)
02/03/20	0.010 ± 0.002	0.009 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	(b)
02/10/20	0.010 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.012 ± 0.002	0.009 ± 0.002	0.011 ± 0.002	(b)
02/18/20	0.012 ± 0.002	0.015 ± 0.002	0.011 ± 0.002	0.014 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.014 ± 0.002	0.012 ± 0.002	(b)
02/24/20	0.019 ± 0.003	0.018 ± 0.003	0.019 ± 0.003	0.018 ± 0.003	0.018 ± 0.003	0.016 ± 0.003	0.017 ± 0.003	0.015 ± 0.003	(b)
03/02/20	0.016 ± 0.003	0.015 ± 0.003	0.017 ± 0.003	0.015 ± 0.003	0.014 ± 0.003	0.018 ± 0.003	0.015 ± 0.002	0.012 ± 0.002	(b)
03/09/20	0.013 ± 0.002	0.013 ± 0.002	0.012 ± 0.002	0.014 ± 0.002	0.011 ± 0.002	0.015 ± 0.003	0.013 ± 0.002	0.012 ± 0.002	(b)
03/16/20	0.010 ± 0.002	0.013 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.013 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	(b)
03/24/20	0.010 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	0.011 ± 0.002	(b)
03/30/20	0.008 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.008 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.009 ± 0.002	(b)
04/06/20	0.006 ± 0.002	0.006 ± 0.002	0.007 ± 0.002	0.006 ± 0.002	0.006 ± 0.002	0.005 ± 0.002	0.007 ± 0.002	0.006 ± 0.002	0.006 ± 0.002
04/14/20	0.014 ± 0.002	0.013 ± 0.002	0.013 ± 0.002	0.014 ± 0.003	0.014 ± 0.002	0.013 ± 0.002	0.016 ± 0.002	0.013 ± 0.002	0.013 ± 0.002
04/20/20	0.013 ± 0.003	0.010 ± 0.003	0.011 ± 0.002	0.013 ± 0.003	0.012 ± 0.002	0.011 ± 0.002	0.012 ± 0.003	0.011 ± 0.002	0.008 ± 0.002
04/27/20	0.011 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.013 ± 0.003	0.011 ± 0.002	0.011 ± 0.002	0.014 ± 0.002	0.014 ± 0.003	0.010 ± 0.002
05/04/20	0.009 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.009 ± 0.002	0.010 ± 0.002
05/11/20	0.008 ± 0.002	0.009 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.009 ± 0.002	0.011 ± 0.002	0.008 ± 0.002	0.009 ± 0.002	0.009 ± 0.002
05/18/20	0.011 ± 0.003	0.012 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.013 ± 0.002
05/27/20	0.008 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.007 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	0.009 ± 0.002
06/02/20	0.007 ± 0.002	0.008 ± 0.002	0.006 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	0.006 ± 0.002	0.008 ± 0.002	0.008 ± 0.002	0.009 ± 0.002
06/08/20	0.016 ± 0.003	0.014 ± 0.003	0.016 ± 0.003	0.014 ± 0.003	0.015 ± 0.002	0.014 ± 0.002	0.014 ± 0.003	0.014 ± 0.003	0.013 ± 0.003
06/15/20	0.010 ± 0.002	0.010 ± 0.002	0.009 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.010 ± 0.002	0.009 ± 0.002
06/22/20	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	0.008 ± 0.002	0.010 ± 0.002	0.010 ± 0.002
06/29/20	0.016 ± 0.002	0.014 ± 0.002	0.015 ± 0.003	0.016 ± 0.003	0.016 ± 0.003	(b)	0.015 ± 0.003	0.016 ± 0.003	0.017 ± 0.003

*Control Location

(a) Refer deviation table B-1b

(b) Refer deviation table B-1c

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-6

GROSS BETA ACTIVITY IN AIRBORNE PARTICULATE SAMPLES - 2020

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Gas Holder Bldg. 44	Training Building 94	Met Tower 95	Telcom Bldg. 108
07/06/20	0.013 ± 0.002	0.012 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	(b)	0.012 ± 0.002	0.011 ± 0.002	0.011 ± 0.002
07/13/20	0.010 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	0.012 ± 0.002	0.011 ± 0.002	(b)	0.011 ± 0.002	0.009 ± 0.002	0.009 ± 0.002
07/20/20	0.014 ± 0.002	0.013 ± 0.002	0.014 ± 0.003	0.018 ± 0.003	0.016 ± 0.003	(b)	0.014 ± 0.003	0.013 ± 0.002	0.014 ± 0.003
07/27/20	0.017 ± 0.002	0.015 ± 0.002	0.017 ± 0.003	0.019 ± 0.003	0.018 ± 0.003	(b)	0.016 ± 0.002	0.019 ± 0.003	0.018 ± 0.003
08/03/20	0.017 ± 0.002	0.017 ± 0.002	0.016 ± 0.002	0.019 ± 0.003	0.007 ± 0.002	(b)	0.017 ± 0.002	0.019 ± 0.003	0.017 ± 0.003
08/10/20	0.016 ± 0.002	0.015 ± 0.002	0.015 ± 0.002	0.018 ± 0.003	0.015 ± 0.002	(b)	0.014 ± 0.002	0.015 ± 0.008 (a)	0.016 ± 0.002
08/17/20	0.020 ± 0.003	0.023 ± 0.003	0.020 ± 0.003	0.020 ± 0.003	0.022 ± 0.003	(b)	0.022 ± 0.003	< 1.070 (a)	0.018 ± 0.003
08/24/20	0.019 ± 0.003	0.016 ± 0.002	0.015 ± 0.002	0.016 ± 0.002	0.017 ± 0.003	(b)	0.018 ± 0.003	0.019 ± 0.003	0.017 ± 0.003
08/31/20	< 0.114 (a)	0.013 ± 0.002	0.011 ± 0.002	0.012 ± 0.002	0.017 ± 0.003	(b)	0.016 ± 0.002	0.013 ± 0.002	0.014 ± 0.003
09/09/20	0.017 ± 0.003 (a)	0.012 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	0.014 ± 0.002	(b)	0.013 ± 0.002	0.013 ± 0.002	0.013 ± 0.002
09/14/20	0.009 ± 0.002	0.008 ± 0.002	0.012 ± 0.002	0.011 ± 0.003	0.012 ± 0.002	(b)	0.010 ± 0.002	0.011 ± 0.003	0.010 ± 0.002
09/22/20	0.011 ± 0.002	0.010 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	(b)	0.010 ± 0.002	0.014 ± 0.002	0.012 ± 0.002
09/28/20	0.032 ± 0.004	0.032 ± 0.004	0.028 ± 0.003	0.027 ± 0.003	0.031 ± 0.003	(b)	0.028 ± 0.003	0.030 ± 0.004	0.031 ± 0.003
10/05/20	0.008 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	0.010 ± 0.002	0.009 ± 0.002	(b)	0.011 ± 0.002	0.010 ± 0.002	0.010 ± 0.002
10/13/20	0.018 ± 0.002	0.015 ± 0.002	0.016 ± 0.002	0.015 ± 0.002	0.016 ± 0.002	(b)	0.017 ± 0.002	0.014 ± 0.002	0.016 ± 0.002
10/19/20	0.011 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	(b)	0.012 ± 0.002	0.012 ± 0.002	0.009 ± 0.002
10/26/20	0.011 ± 0.002	0.014 ± 0.002	0.013 ± 0.002	0.011 ± 0.002	0.013 ± 0.002	(b)	0.010 ± 0.002	0.012 ± 0.002	0.011 ± 0.002
11/02/20	0.010 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	(b)	0.010 ± 0.002	0.013 ± 0.002	0.012 ± 0.002
11/09/20	0.027 ± 0.003	0.024 ± 0.003	0.027 ± 0.003	0.026 ± 0.003	0.024 ± 0.003	(b)	0.027 ± 0.003	0.025 ± 0.003	0.024 ± 0.003
11/16/20	0.017 ± 0.003	0.016 ± 0.003	0.014 ± 0.002	0.015 ± 0.002	0.018 ± 0.003	(b)	0.017 ± 0.002	0.018 ± 0.003	0.015 ± 0.002
11/23/20	0.015 ± 0.002	0.017 ± 0.003	0.015 ± 0.002	0.016 ± 0.002	0.017 ± 0.002	(b)	0.013 ± 0.002	0.016 ± 0.003	0.015 ± 0.003
11/30/20	0.017 ± 0.002	0.016 ± 0.002	0.020 ± 0.004 (a)	0.016 ± 0.002	0.018 ± 0.003	(b)	0.018 ± 0.003	0.016 ± 0.002	0.016 ± 0.002
12/07/20	0.009 ± 0.002	0.009 ± 0.002	0.010 ± 0.002 (a)	0.008 ± 0.002	0.010 ± 0.002	(b)	0.009 ± 0.002	0.009 ± 0.002	0.008 ± 0.002
12/14/20	0.018 ± 0.003	0.019 ± 0.003	0.017 ± 0.002	0.017 ± 0.002	0.018 ± 0.003	(b)	0.016 ± 0.002	0.018 ± 0.003	0.019 ± 0.003
12/22/20	0.009 ± 0.002	0.011 ± 0.002	0.009 ± 0.002	0.009 ± 0.002	0.012 ± 0.002	(b)	0.009 ± 0.002	0.010 ± 0.002	0.011 ± 0.002
12/29/20	0.012 ± 0.002	0.011 ± 0.002	0.010 ± 0.002	0.011 ± 0.002	0.011 ± 0.002	(b)	0.009 ± 0.002	0.010 ± 0.002	0.015 ± 0.002

(a) Refer deviation table B-1b

*Control Location

(b) Refer deviation table B-1c

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-7

IODINE-131 ACTIVITY IN AIRBORNE CHARCOAL SAMPLES - 2020

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Gas Holder Bldg. 44	Training Building 94	Met Tower 95	Telcom Bldg. 108
01/06/20	< 0.033	< 0.033	< 0.015	< 0.014	< 0.017	< 0.017	< 0.033	< 0.031	(b)
01/14/20	< 0.023	< 0.023	< 0.018	< 0.023	< 0.018	< 0.018	< 0.022	< 0.013	(b)
01/22/20	< 0.013	< 0.015	< 0.014	< 0.013	< 0.014	< 0.014	< 0.015	< 0.013	(b)
01/28/20	< 0.024	< 0.026	< 0.031	< 0.023	< 0.035	< 0.033	< 0.027	< 0.032	(b)
02/03/20	< 0.016	< 0.016	< 0.016	< 0.016	< 0.008	< 0.016	< 0.016	< 0.018	(b)
02/10/20	< 0.018	< 0.018	< 0.018	< 0.019	< 0.018	< 0.018	< 0.018	< 0.018	(b)
02/18/20	< 0.030	< 0.029	< 0.012	< 0.030	< 0.012	< 0.012	< 0.029	< 0.012	(b)
02/24/20	< 0.021	< 0.020	< 0.022	< 0.022	< 0.022	< 0.022	< 0.011	< 0.022	(b)
03/02/20	< 0.019	< 0.018	< 0.021	< 0.019	< 0.022	< 0.022	< 0.018	< 0.022	(b)
03/09/20	< 0.031	< 0.030	< 0.016	< 0.032	< 0.016	< 0.017	< 0.030	< 0.016	(b)
03/16/20	< 0.020	< 0.019	< 0.030	< 0.021	< 0.012	< 0.031	< 0.013	< 0.031	(b)
03/24/20	< 0.033	< 0.031	< 0.025	< 0.033	< 0.021	< 0.017	< 0.030	< 0.020	(b)
03/30/20	< 0.024	< 0.022	< 0.026	< 0.024	< 0.021	< 0.026	< 0.023	< 0.027	(b)
04/06/20	< 0.031	< 0.029	< 0.030	< 0.031	< 0.030	< 0.032	< 0.030	< 0.030	< 0.024
04/14/20	< 0.017	< 0.016	< 0.026	< 0.020	< 0.025	< 0.025	< 0.016	< 0.028	< 0.008
04/20/20	< 0.025	< 0.022	< 0.019	< 0.021	< 0.018	< 0.018	< 0.023	< 0.021	< 0.012
04/27/20	< 0.027	< 0.024	< 0.009	< 0.026	< 0.013	< 0.012	< 0.023	< 0.014	< 0.012
05/04/20	< 0.033	< 0.031	< 0.019	< 0.031	< 0.021	< 0.020	< 0.028	< 0.020	< 0.011
05/11/20	< 0.025	< 0.022	< 0.022	< 0.024	< 0.021	< 0.023	< 0.021	< 0.021	< 0.014
05/18/20	< 0.028	< 0.024	< 0.032	< 0.025	< 0.013	< 0.033	< 0.023	< 0.036	< 0.013
05/27/20	< 0.044	< 0.043	< 0.018	< 0.037	< 0.017	< 0.016	< 0.035	< 0.015	< 0.014
06/02/20	< 0.044	< 0.046	< 0.035	< 0.039	< 0.033	< 0.013	< 0.037	< 0.031	< 0.031
06/08/20	< 0.036	< 0.038	< 0.015	< 0.030	< 0.014	< 0.013	< 0.029	< 0.016	< 0.016
06/15/20	< 0.025	< 0.028	< 0.012	< 0.028	< 0.012	< 0.006	< 0.026	< 0.012	< 0.011
06/22/20	< 0.021	< 0.019	< 0.013	< 0.023	< 0.012	< 0.011	< 0.022	< 0.012	< 0.018
06/29/20	< 0.039	< 0.036	< 0.028	< 0.045	< 0.026	(b)	< 0.042	< 0.026	< 0.026

*Control Location

(a) Refer deviation table B-1b

(b) Refer deviation table B-1c

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-7

IODINE-131 ACTIVITY IN AIRBORNE CHARCOAL SAMPLES - 2020

pCi/m³ ± 2 Sigma

PERIOD ENDING	Algonquin 4	NYU Tower 5	Roseton 23*	Croton Point 27	Grassy Point 29	Gas Holder Bldg. 44	Training Building 94	Met Tower 95	Telcom Bldg. 108
07/06/20	< 0.018	< 0.016	< 0.015	< 0.018	< 0.015	(b)	< 0.018	< 0.015	< 0.015
07/13/20	< 0.030	< 0.012	< 0.031	< 0.031	< 0.029	(b)	< 0.031	< 0.031	< 0.031
07/20/20	< 0.022	< 0.021	< 0.038	< 0.025	< 0.015	(b)	< 0.024	< 0.036	< 0.037
07/27/20	< 0.024	< 0.022	< 0.032	< 0.027	< 0.031	(b)	< 0.024	< 0.032	< 0.032
08/03/20	< 0.026	< 0.025	< 0.019	< 0.027	< 0.027	(b)	< 0.026	< 0.020	< 0.020
08/10/20	< 0.036	< 0.014	< 0.035	< 0.035	< 0.036	(b)	< 0.034	< 0.069 (a)	< 0.039
08/17/20	< 0.019	< 0.018	< 0.022	< 0.020	< 0.023	(b)	< 0.019	< 5.007 (a)	< 0.023
08/24/20	< 0.038	< 0.035	< 0.018	< 0.038	< 0.018	(b)	< 0.038	< 0.012	< 0.019
08/31/20	< 0.434 (a)	< 0.014	< 0.010	< 0.016	< 0.022	(b)	< 0.015	< 0.022	< 0.023
09/09/20	< 0.056 (a)	< 0.029	< 0.024	< 0.030	< 0.024	(b)	< 0.030	< 0.021	< 0.025
09/14/20	< 0.021	< 0.020	< 0.010	< 0.022	< 0.011	(b)	< 0.020	< 0.012	< 0.011
09/22/20	< 0.034	< 0.030	< 0.039	< 0.033	< 0.040	(b)	< 0.032	< 0.034	< 0.041
09/28/20	< 0.020	< 0.018	< 0.019	< 0.020	< 0.019	(b)	< 0.019	< 0.022	< 0.020
10/05/20	< 0.022	< 0.020	< 0.016	< 0.022	< 0.016	(b)	< 0.021	< 0.016	< 0.018
10/13/20	< 0.025	< 0.023	< 0.023	< 0.024	< 0.024	(b)	< 0.024	< 0.024	< 0.025
10/19/20	< 0.017	< 0.014	< 0.009	< 0.016	< 0.010	(b)	< 0.016	< 0.010	< 0.010
10/26/20	< 0.016	< 0.015	< 0.023	< 0.016	< 0.024	(b)	< 0.016	< 0.024	< 0.025
11/02/20	< 0.029	< 0.031	< 0.021	< 0.028	< 0.022	(b)	< 0.028	< 0.023	< 0.024
11/09/20	< 0.021	< 0.023	< 0.010	< 0.020	< 0.010	(b)	< 0.020	< 0.010	< 0.011
11/16/20	< 0.018	< 0.019	< 0.026	< 0.018	< 0.027	(b)	< 0.009	< 0.019	< 0.029
11/23/20	< 0.029	< 0.031	< 0.011	< 0.028	< 0.024	(b)	< 0.028	< 0.026	< 0.026
11/30/20	< 0.024	< 0.023	< 0.022 (a)	< 0.022	< 0.020	(b)	< 0.024	< 0.022	< 0.022
12/07/20	< 0.024	< 0.023	< 0.024 (a)	< 0.010	< 0.021	(b)	< 0.024	< 0.022	< 0.022
12/14/20	< 0.017	< 0.017	< 0.016	< 0.007	< 0.017	(b)	< 0.017	< 0.018	< 0.018
12/22/20	< 0.035	< 0.035	< 0.025	< 0.032	< 0.026	(b)	< 0.034	< 0.024	< 0.029
12/29/20	< 0.028	< 0.029	< 0.024	< 0.027	< 0.025	(b)	< 0.026	< 0.025	< 0.028

*Control Location

(a) Refer deviation table B-1b

(b) Refer deviation table B-1c

Plant: Indian Point Energy Center	Year: 2020	Page 54 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2020

10^{-3} pCi/m³ ± 2 Sigma

DATE	Algonquin 4				NYU Tower 5			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	92 ± 22	130 ± 26	164 ± 29	90 ± 17	109 ± 23	115 ± 23	101 ± 23	84 ± 19
K-40	< 24	< 16	< 23	< 11	< 25	< 21	< 18	< 18
Mn-54	< 1	< 1	< 1	< 1	< 2	< 1	< 1	< 1
Co-58	< 2	< 2	< 1	< 2	< 4	< 2	< 2	< 2
Fe-59	< 5	< 5	< 10	< 5	< 8	< 5	< 4	< 5
Co-60	< 2	< 1	< 1	< 1	< 2	< 1	< 1	< 1
Zn-65	< 4	< 3	< 5	< 3	< 4	< 4	< 3	< 2
Nb-95	< 2	< 2	< 3	< 2	< 3	< 2	< 2	< 2
Zr-95	< 4	< 3	< 4	< 3	< 4	< 3	< 4	< 4
Ru-103	< 3	< 3	< 4	< 2	< 5	< 3	< 3	< 2
Ru-106	< 10	< 11	< 8	< 9	< 19	< 7	< 7	< 9
I-131	< 192	< 174	< 696	< 136	< 211	< 202	< 531	< 149
Cs-134	< 1	< 1	< 2	< 1	< 2	< 1	< 1	< 1
Cs-137	< 1	< 1	< 1	< 1	< 2	< 1	< 1	< 1
Ba-140	< 112	< 80	< 221	< 90	< 127	< 82	< 179	< 79
La-140	< 36	< 41	< 113	< 28	< 45	< 38	< 96	< 29
Ce-141	< 4	< 4	< 6	< 3	< 5	< 4	< 4	< 3
Ce-144	< 5	< 5	< 5	< 4	< 8	< 5	< 4	< 4
Ra-226	< 20	< 21	< 21	< 14	< 27	< 19	< 13	< 16
Ac-228	< 5	< 5	< 5	< 4	< 7	< 3	< 4	< 3
Th-228	< 2	< 2	< 2	< 1	< 2	< 2	< 1	< 1

Plant: Indian Point Energy Center	Year: 2020	Page 55 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2020

10^{-3} pCi/m³ \pm 2 Sigma

DATE	Roseton 23*				Croton Point 27			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	85 \pm 19	112 \pm 24	122 \pm 24	101 \pm 18	106 \pm 20	127 \pm 21	120 \pm 25	100 \pm 21
K-40	< 24	< 12	< 16	< 17	< 13	< 11	< 13	< 18
Mn-54	< 2	< 1	< 1	< 1	< 1	< 1	< 1	< 1
Co-58	< 2	< 2	< 2	< 2	< 1	< 2	< 1	< 2
Fe-59	< 6	< 6	< 6	< 6	< 5	< 5	< 9	< 6
Co-60	< 1	< 2	< 1	< 1	< 1	< 1	< 1	< 1
Zn-65	< 4	< 3	< 2	< 3	< 2	< 3	< 3	< 4
Nb-95	< 2	< 2	< 2	< 2	< 2	< 2	< 2	< 2
Zr-95	< 4	< 4	< 3	< 3	< 3	< 4	< 3	< 4
Ru-103	< 3	< 3	< 3	< 2	< 2	< 3	< 3	< 3
Ru-106	< 12	< 9	< 11	< 11	< 10	< 10	< 9	< 11
I-131	< 178	< 241	< 492	< 151	< 157	< 143	< 541	< 195
Cs-134	< 1	< 2	< 1	< 1	< 1	< 1	< 1	< 1
Cs-137	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1
Ba-140	< 97	< 117	< 165	< 92	< 53	< 84	< 168	< 93
La-140	< 33	< 21	< 89	< 45	< 38	< 55	< 99	< 35
Ce-141	< 5	< 7	< 4	< 3	< 2	< 3	< 5	< 4
Ce-144	< 6	< 11	< 4	< 4	< 4	< 4	< 4	< 6
Ra-226	< 21	< 31	< 12	< 15	< 15	< 16	< 15	< 18
Ac-228	< 5	< 4	< 4	< 4	< 5	< 3	< 5	< 4
Th-228	< 2	< 3	< 1	< 1	< 2	< 2	< 2	< 2

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 56 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2020

$10^{-3} \text{ pCi/m}^3 \pm 2 \text{ Sigma}$

DATE	Grassy Point 29				Gas Holder Bldg. 44			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	95 ± 18	137 ± 21	132 ± 23	92 ± 21	102 ± 20	134 ± 31	(a)	(a)
K-40	< 18	< 12	< 22	< 18	< 18	< 15		
Mn-54	< 1	< 1	< 1	< 1	< 1	< 1		
Co-58	< 2	< 1	< 2	< 1	< 2	< 2		
Fe-59	< 4	< 5	< 7	< 5	< 4	< 7		
Co-60	< 1	< 1	< 1	< 1	< 1	< 1		
Zn-65	< 2	< 2	< 3	< 3	< 1	< 5		
Nb-95	< 2	< 2	< 2	< 2	< 2	< 2		
Zr-95	< 2	< 3	< 4	< 3	< 3	< 3		
Ru-103	< 2	< 2	< 3	< 2	< 3	< 4		
Ru-106	< 10	< 9	< 9	< 5	< 8	< 11		
I-131	< 127	< 150	< 711	< 155	< 129	< 330		
Cs-134	< 1	< 1	< 1	< 1	< 1	< 2		
Cs-137	< 1	< 1	< 1	< 1	< 1	< 1		
Ba-140	< 69	< 84	< 178	< 68	< 62	< 133		
La-140	< 38	< 33	< 111	< 24	< 37	< 53		
Ce-141	< 3	< 3	< 5	< 2	< 3	< 5		
Ce-144	< 4	< 5	< 5	< 4	< 4	< 6		
Ra-226	< 15	< 17	< 18	< 15	< 14	< 23		
Ac-228	< 3	< 3	< 4	< 3	< 3	< 5		
Th-228	< 1	< 1	< 1	< 1	< 1	< 2		

(a) Refer deviation table B-1c

Plant: Indian Point Energy Center	Year: 2020	Page 57 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2020

$10^{-3} \text{ pCi/m}^3 \pm 2 \text{ Sigma}$

DATE	Training Building 94				Met Tower 95			
	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	89 ± 25	138 ± 28	133 ± 28	93 ± 22	93 ± 22	129 ± 34	120 ± 27	82 ± 19
K-40	< 21	< 24	< 28	< 22	< 20	< 26	< 23	< 22
Mn-54	< 2	< 1	< 2	< 2	< 1	< 2	< 1	< 1
Co-58	< 3	< 2	< 3	< 3	< 1	< 3	< 3	< 2
Fe-59	< 6	< 4	< 12	< 8	< 4	< 9	< 7	< 7
Co-60	< 2	< 2	< 2	< 2	< 1	< 2	< 2	< 1
Zn-65	< 5	< 4	< 5	< 5	< 2	< 4	< 5	< 5
Nb-95	< 3	< 3	< 3	< 2	< 2	< 3	< 2	< 2
Zr-95	< 6	< 4	< 6	< 6	< 4	< 7	< 5	< 3
Ru-103	< 4	< 3	< 5	< 4	< 2	< 4	< 4	< 3
Ru-106	< 17	< 12	< 18	< 13	< 9	< 15	< 12	< 15
I-131	< 255	< 241	< 925	< 292	< 128	< 324	< 705	< 180
Cs-134	< 2	< 1	< 2	< 2	< 1	< 3	< 1	< 1
Cs-137	< 2	< 1	< 2	< 1	< 1	< 2	< 1	< 1
Ba-140	< 155	< 114	< 257	< 140	< 73	< 162	< 190	< 123
La-140	< 57	< 50	< 116	< 60	< 35	< 72	< 93	< 46
Ce-141	< 5	< 5	< 8	< 5	< 3	< 6	< 6	< 5
Ce-144	< 7	< 6	< 7	< 6	< 4	< 7	< 5	< 6
Ra-226	< 28	< 21	< 25	< 27	< 16	< 28	< 17	< 21
Ac-228	< 8	< 5	< 6	< 6	< 4	< 7	< 5	< 5
Th-228	< 3	< 2	< 2	< 2	< 1	< 2	< 2	< 2

Plant: Indian Point Energy Center	Year: 2020	Page 58 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-8
GAMMA EMITTERS IN AIRBORNE PARTICULATE SAMPLES - 2020

10^{-3} pCi/m³ \pm 2 Sigma

Telecomm Bldg 108				
DATE	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Be-7	(a)	115 \pm 21	144 \pm 30	97 \pm 28
K-40		< 18	< 29	< 33
Mn-54		< 1	< 2	< 2
Co-58		< 1	< 4	< 3
Fe-59		< 5	< 11	< 9
Co-60		< 1	< 2	< 2
Zn-65		< 3	< 3	< 5
Nb-95		< 2	< 4	< 3
Zr-95		< 3	< 6	< 4
Ru-103		< 2	< 7	< 4
Ru-106		< 10	< 19	< 21
I-131		< 136	< 1001	< 320
Cs-134		< 1	< 2	< 2
Cs-137		< 1	< 2	< 1
Ba-140		< 66	< 279	< 165
La-140		< 37	< 116	< 52
Ce-141		< 3	< 8	< 6
Ce-144		< 4	< 9	< 8
Ra-226		< 16	< 32	< 27
Ac-228		< 3	< 8	< 7
Th-228		< 1	< 3	< 3

(a) Refer deviation table B-1c

Plant: Indian Point Energy Center	Year: 2020	Page 59 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-9
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Camp Field
7

DATE	01/14/20	02/12/20	03/17/20	04/15/20	5/12/2020	06/08/20
RADIOCHEMICAL						
Gr-B	< 2	4 \pm 2	< 3	< 2	3 \pm 2	3 \pm 1
H-3 (a)			< 193			< 186
GAMMA						
Be-7	< 57	< 34	< 74	< 49	< 57	< 66
K-40	< 127	< 83	< 138	< 113	< 148	< 130
Mn-54	< 7	< 5	< 6	< 7	< 5	< 7
Co-58	< 6	< 5	< 7	< 6	< 5	< 7
Fe-59	< 13	< 11	< 12	< 13	< 12	< 13
Co-60	< 7	< 5	< 7	< 7	< 7	< 7
Zn-65	< 15	< 10	< 12	< 15	< 14	< 14
Nb-95	< 7	< 5	< 7	< 8	< 7	< 7
Zr-95	< 11	< 10	< 14	< 11	< 9	< 11
Ru-103	< 8	< 6	< 8	< 6	< 6	< 8
Ru-106	< 59	< 42	< 58	< 61	< 67	< 66
I-131	< 9	< 8	< 7	< 8	< 7	< 9
Cs-134	< 8	< 5	< 9	< 7	< 7	< 11
Cs-137	< 9	< 6	< 7	< 7	< 7	< 7
Ba-140	< 25	< 22	< 24	< 24	< 26	< 27
La-140	< 11	< 9	< 11	< 8	< 6	< 8
Ce-141	< 11	< 9	< 11	< 12	< 10	< 11
Ce-144	< 39	< 38	< 50	< 51	< 44	< 53
Ra-226	< 174	< 134	< 175	< 187	< 187	< 181
Ac-228	< 23	< 18	< 37	< 28	< 22	< 30
Th-228	< 13	< 10	< 14	< 13	< 14	< 15

(a) Quarterly Composite

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-9

RADIONUCLIDES IN DRINKING WATER SAMPLES - 2020

pCi/L \pm 2 SigmaCamp Field
7

DATE	07/14/20	08/11/20	09/02/20	10/06/20	11/04/20	12/07/20
RADIOCHEMICAL						
Gr-B	< 2	< 2	3 \pm 2	3 \pm 2	< 2	< 2
H-3 (a)			< 179			< 194
GAMMA						
Be-7	< 64	< 61	< 57	< 50	< 53	< 58
K-40	< 146	< 145	< 132	< 100	< 125	< 137
Mn-54	< 7	< 6	< 5	< 7	< 6	< 6
Co-58	< 7	< 6	< 7	< 7	< 8	< 8
Fe-59	< 10	< 12	< 10	< 8	< 15	< 14
Co-60	< 5	< 9	< 6	< 6	< 9	< 7
Zn-65	< 12	< 12	< 12	< 15	< 15	< 13
Nb-95	< 7	< 8	< 6	< 8	< 7	< 8
Zr-95	< 13	< 10	< 8	< 13	< 7	< 13
Ru-103	< 6	< 8	< 8	< 6	< 6	< 6
Ru-106	< 64	< 63	< 54	< 49	< 66	< 66
I-131	< 9	< 8	< 8	< 9	< 8	< 10
Cs-134	< 7	< 8	< 8	< 7	< 7	< 7
Cs-137	< 7	< 7	< 9	< 7	< 8	< 8
Ba-140	< 25	< 23	< 25	< 21	< 25	< 27
La-140	< 9	< 7	< 6	< 8	< 10	< 9
Ce-141	< 11	< 11	< 11	< 8	< 10	< 10
Ce-144	< 51	< 48	< 52	< 45	< 42	< 50
Ra-226	< 174	< 160	< 179	< 167	< 168	< 176
Ac-228	< 22	< 25	< 28	< 31	< 29	< 35
Th-228	< 14	< 13	< 14	< 11	< 14	< 13

(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 61 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-9
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

DATE	Croton					
	8					
	01/14/20	02/12/20	03/17/20	04/15/20	05/12/20	06/08/20
RADIOCHEMICAL						
Gr-B	2 \pm 1	3 \pm 1	< 2	3 \pm 2	3 \pm 2	4 \pm 2
H-3 (a)			< 190			< 185
GAMMA						
Be-7	< 49	< 53	< 46	< 52	< 66	< 59
K-40	< 37	< 95	< 158	< 126	< 152	< 94
Mn-54	< 5	< 5	< 7	< 6	< 6	< 7
Co-58	< 5	< 6	< 5	< 5	< 6	< 6
Fe-59	< 9	< 11	< 14	< 13	< 14	< 15
Co-60	< 5	< 7	< 8	< 7	< 9	< 7
Zn-65	< 10	< 13	< 14	< 14	< 11	< 13
Nb-95	< 5	< 6	< 7	< 6	< 8	< 7
Zr-95	< 10	< 8	< 13	< 13	< 14	< 13
Ru-103	< 5	< 6	< 7	< 6	< 8	< 6
Ru-106	< 43	< 76	< 69	< 54	< 62	< 69
I-131	< 6	< 10	< 8	< 7	< 9	< 9
Cs-134	< 6	< 7	< 6	< 7	< 9	< 7
Cs-137	< 6	< 6	< 7	< 7	< 9	< 6
Ba-140	< 19	< 27	< 29	< 25	< 30	< 22
La-140	< 7	< 11	< 8	< 6	< 11	< 12
Ce-141	< 8	< 9	< 10	< 10	< 13	< 10
Ce-144	< 37	< 35	< 48	< 43	< 52	< 47
Ra-226	< 141	< 137	< 169	< 144	< 190	< 155
Ac-228	< 24	< 23	< 27	< 24	< 32	< 33
Th-228	< 10	< 10	< 12	< 12	< 14	< 12

(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 62 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-9
RADIONUCLIDES IN DRINKING WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

DATE	Croton					
	8					
	07/14/20	08/11/20	09/02/20	10/06/20	11/04/20	12/07/20
RADIOCHEMICAL						
Gr-B	3 \pm 2	3 \pm 2	3 \pm 1	3 \pm 2	< 2	3 \pm 2
H-3 (a)			< 180			< 189
GAMMA						
Be-7	64	67	58	48	44	60
K-40	153	136	143	103	79	78
Mn-54	7	7	7	5	4	5
Co-58	7	7	6	4	5	6
Fe-59	14	16	12	9	9	11
Co-60	6	7	7	5	7	6
Zn-65	14	18	13	11	9	14
Nb-95	7	8	7	5	6	6
Zr-95	14	13	10	9	9	12
Ru-103	7	6	6	6	5	6
Ru-106	73	55	60	56	54	55
I-131	11	9	7	7	6	7
Cs-134	10	6	8	6	6	6
Cs-137	8	7	8	6	5	7
Ba-140	36	33	32	20	17	31
La-140	6	11	9	7	5	10
Ce-141	12	10	11	9	9	10
Ce-144	53	46	45	41	40	42
Ra-226	174	164	167	150	130	161
Ac-228	33	29	29	21	21	28
Th-228	15	14	14	11	10	10

(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 63 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-10
RADIONUCLIDES IN GROUNDWATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Lafarge Monitoring Well
106

DATE	05/21/20	(a)
RADIOCHEMICAL		
H-3	< 180	
Ni-63	< 19	
Sr-90	< 1	
GAMMA		
Be-7	< 70	
K-40	< 61	
Mn-54	< 8	
Co-58	< 7	
Fe-59	< 17	
Co-60	< 9	
Zn-65	< 15	
Nb-95	< 9	
Zr-95	< 12	
Ru-103	< 9	
Ru-106	< 73	
Cs-134	< 9	
Cs-137	< 8	
Ba-140	< 33	
La-140	< 12	
Ce-141	< 12	
Ce-144	< 51	
Ac-228	< 32	

(a) Refer deviation table B-1b

Plant: Indian Point Energy Center	Year: 2020	Page 64 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-11
GAMMA EMITTERS IN SOIL SAMPLES - 2020

pCi/kg dry \pm 2 Sigma

	Roseton 23*	Training Building 94	Met Tower 95
DATE	09/14/20	09/14/20	09/14/20
Be-7	< 657	< 447	< 607
K-40	15520 \pm 1877	9632 \pm 1552	12830 \pm 1540
Mn-54	< 88	< 64	< 72
Co-58	< 69	< 53	< 64
Fe-59	< 157	< 118	< 109
Co-60	< 71	< 61	< 48
Zn-65	< 181	< 136	< 186
Nb-95	< 82	< 66	< 80
Zr-95	< 171	< 118	< 123
Ru-103	< 79	< 51	< 66
Ru-106	< 712	< 535	< 642
I-131	< 104	< 72	< 91
Cs-134	< 109	< 73	< 90
Cs-137	< 85	107 \pm 64	< 77
Ba-140	< 321	< 244	< 257
La-140	< 104	< 70	< 101
Ce-141	< 114	< 67	< 99
Ce-144	< 465	< 273	< 363
Ra-226	2632 \pm 1698	< 1304	< 1621
Th-228	931 \pm 167	568 \pm 89	508 \pm 149

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 65 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

DATE	Roseton 23*					
	05/18/20	05/18/20	05/18/20	06/15/20	06/15/20	06/15/20
GAMMA						
Be-7	1936 \pm 314	1152 \pm 226	< 366	897 \pm 212	666 \pm 255	443 \pm 207
K-40	5843 \pm 616	4596 \pm 516	3615 \pm 664	6550 \pm 688	5290 \pm 668	5681 \pm 655
Mn-54	< 23	< 20	< 24	< 25	< 29	< 29
Co-58	< 28	< 17	< 23	< 22	< 27	< 25
Fe-59	< 59	< 46	< 71	< 52	< 50	< 68
Co-60	< 27	< 19	< 41	< 27	< 35	< 33
Zn-65	< 64	< 39	< 74	< 63	< 66	< 68
Nb-95	< 23	< 21	< 29	< 21	< 27	< 28
Zr-95	< 34	< 29	< 57	< 45	< 48	< 50
Ru-103	< 22	< 20	< 31	< 22	< 24	< 29
Ru-106	< 190	< 158	< 202	< 193	< 245	< 243
I-131	< 45	< 33	< 51	< 26	< 31	< 35
Cs-134	< 29	< 20	< 24	< 29	< 28	< 35
Cs-137	< 24	< 20	< 27	< 21	< 25	< 37
Ba-140	< 125	< 92	< 165	< 101	< 90	< 122
La-140	< 34	< 30	< 48	< 28	< 32	< 30
Ce-141	< 43	< 27	< 41	< 33	< 38	< 43
Ce-144	< 154	< 110	< 164	< 122	< 146	< 158
Ra-226	< 555	< 467	< 622	< 411	< 470	< 730
Th-228	< 42	< 31	< 43	< 35	< 43	< 49

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 66 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

DATE	Roseton 23*					
	07/20/20	07/20/20	07/20/20	08/17/20	08/17/20	08/17/20
GAMMA						
Be-7	904 \pm 332	765 \pm 226	1796 \pm 349	1078 \pm 209	910 \pm 189	997 \pm 253
K-40	4135 \pm 619	3128 \pm 503	4224 \pm 657	3306 \pm 426	4067 \pm 514	2073 \pm 398
Mn-54	< 25	< 24	< 31	< 20	< 20	< 28
Co-58	< 22	< 22	< 33	< 17	< 18	< 30
Fe-59	< 57	< 41	< 69	< 42	< 40	< 55
Co-60	< 24	< 14	< 22	< 18	< 27	< 23
Zn-65	< 57	< 49	< 55	< 35	< 57	< 55
Nb-95	< 29	< 20	< 28	< 19	< 23	< 33
Zr-95	< 44	< 34	< 53	< 36	< 36	< 47
Ru-103	< 21	< 21	< 33	< 22	< 20	< 30
Ru-106	< 228	< 236	< 242	< 191	< 200	< 245
I-131	< 37	< 26	< 24	< 27	< 26	< 33
Cs-134	< 28	< 24	< 24	< 22	< 22	< 31
Cs-137	< 30	< 27	< 33	< 21	< 21	< 30
Ba-140	< 102	< 79	< 121	< 84	< 84	< 105
La-140	< 29	< 28	< 39	< 25	< 22	< 31
Ce-141	< 46	< 32	< 45	< 32	< 29	< 44
Ce-144	< 175	< 140	< 180	< 128	< 118	< 196
Ra-226	< 727	< 548	< 710	< 487	< 474	< 664
Th-228	< 47	< 41	< 58	< 42	< 42	< 55

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 67 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

DATE	Roseton 23*		
	09/14/20	09/14/20	09/14/20
GAMMA			
Be-7	1726 \pm 379	1359 \pm 356	809 \pm 293
K-40	3238 \pm 632	2545 \pm 667	6041 \pm 811
Mn-54	< 25	< 27	< 28
Co-58	< 30	< 32	< 31
Fe-59	< 57	< 46	< 59
Co-60	< 37	< 22	< 36
Zn-65	< 66	< 53	< 65
Nb-95	< 30	< 30	< 28
Zr-95	< 51	< 48	< 39
Ru-103	< 27	< 27	< 30
Ru-106	< 262	< 269	< 286
I-131	< 35	< 38	< 33
Cs-134	< 27	< 38	< 39
Cs-137	< 30	< 22	< 34
Ba-140	< 113	< 121	< 99
La-140	< 35	< 42	< 22
Ce-141	< 41	< 45	< 39
Ce-144	< 167	< 163	< 170
Ra-226	< 660	< 618	< 727
Th-228	< 49	< 57	< 50

* Control Location

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-12

GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

Training Center

94

DATE	05/19/20	05/19/20	05/19/20	06/16/20	06/16/20	06/16/20
GAMMA						
Be-7	< 285	2344 \pm 198	1079 \pm 303	< 247	1121 \pm 285	1081 \pm 308
K-40	3394 \pm 642	6574 \pm 369	6450 \pm 743	3420 \pm 498	4659 \pm 617	8846 \pm 797
Mn-54	< 26	< 17	< 32	< 22	< 29	< 23
Co-58	< 29	< 15	< 27	< 22	< 24	< 23
Fe-59	< 64	< 34	< 66	< 59	< 54	< 61
Co-60	< 16	< 16	< 30	< 27	< 29	< 29
Zn-65	< 66	< 34	< 77	< 50	< 68	< 68
Nb-95	< 34	< 16	< 34	< 26	< 26	< 30
Zr-95	< 55	< 31	< 52	< 43	< 45	< 45
Ru-103	< 34	< 17	< 32	< 20	< 25	< 24
Ru-106	< 281	< 155	< 315	< 240	< 220	< 210
I-131	< 56	< 32	< 58	< 27	< 33	< 31
Cs-134	< 34	< 18	< 32	< 25	< 32	< 33
Cs-137	< 28	< 18	< 28	< 25	< 25	< 30
Ba-140	< 161	< 87	< 135	< 101	< 93	< 93
La-140	< 51	< 23	< 44	< 28	< 29	< 26
Ce-141	< 50	< 27	< 49	< 32	< 34	< 45
Ce-144	< 204	< 102	< 185	< 137	< 155	< 183
Ra-226	< 705	< 361	< 719	< 534	< 545	< 658
Th-228	< 53	< 31	< 57	< 43	< 51	< 59

Plant: Indian Point Energy Center	Year: 2020	Page 69 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

Training Center
94

DATE	07/21/20	07/21/20	07/21/20	08/18/20	08/18/20	08/18/20
GAMMA						
Be-7	2033 \pm 474	2543 \pm 350	1414 \pm 317	1501 \pm 288	2430 \pm 398	2199 \pm 451
K-40	4399 \pm 642	7587 \pm 784	6088 \pm 814	2080 \pm 467	6849 \pm 859	4591 \pm 795
Mn-54	< 32	< 36	< 30	< 26	< 38	< 31
Co-58	< 29	< 22	< 30	< 27	< 39	< 31
Fe-59	< 65	< 66	< 81	< 48	< 87	< 49
Co-60	< 32	< 31	< 27	< 28	< 44	< 32
Zn-65	< 60	< 67	< 94	< 51	< 70	< 67
Nb-95	< 33	< 29	< 36	< 31	< 40	< 33
Zr-95	< 44	< 42	< 68	< 32	< 61	< 59
Ru-103	< 27	< 29	< 32	< 26	< 32	< 33
Ru-106	< 286	< 262	< 297	< 231	< 349	< 333
I-131	< 39	< 33	< 36	< 37	< 41	< 25
Cs-134	< 40	< 27	< 41	< 28	< 38	< 37
Cs-137	< 27	< 33	< 34	< 30	< 34	< 35
Ba-140	< 102	< 122	< 111	< 102	< 113	< 108
La-140	< 39	< 20	< 23	< 31	< 36	< 31
Ce-141	< 47	< 46	< 44	< 41	< 45	< 45
Ce-144	< 201	< 196	< 176	< 170	< 189	< 170
Ra-226	< 792	< 704	< 715	< 751	< 735	< 714
Th-228	< 58	< 53	< 56	< 57	< 62	< 58

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

Training Center
94

DATE	09/15/20	09/15/20	09/15/20
GAMMA			
Be-7	1502 \pm 384	2527 \pm 401	2948 \pm 364
K-40	2660 \pm 613	5836 \pm 776	1762 \pm 464
Mn-54	< 31	< 32	< 26
Co-58	< 33	< 32	< 32
Fe-59	< 58	< 56	< 55
Co-60	< 28	< 29	< 31
Zn-65	< 50	< 81	< 61
Nb-95	< 34	< 29	< 26
Zr-95	< 54	< 64	< 50
Ru-103	< 28	< 31	< 28
Ru-106	< 239	< 311	< 320
I-131	< 35	< 41	< 35
Cs-134	< 37	< 36	< 30
Cs-137	< 32	< 41	< 33
Ba-140	< 127	< 136	< 118
La-140	< 38	< 35	< 22
Ce-141	< 47	< 48	< 39
Ce-144	< 188	< 209	< 166
Ra-226	< 716	< 716	< 696
Th-228	< 65	< 76	< 59

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-12

GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 SigmaMet Tower
95

DATE	05/19/20	05/19/20	05/19/20	06/16/20	06/16/20	06/16/20
GAMMA						
Be-7	1484 \pm 310	< 321	2582 \pm 407	954 \pm 265	1032 \pm 259	508 \pm 178
K-40	4795 \pm 622	2597 \pm 484	5986 \pm 749	8177 \pm 729	4615 \pm 788	4670 \pm 623
Mn-54	< 28	< 25	< 35	< 20	< 28	< 29
Co-58	< 29	< 30	< 33	< 24	< 29	< 25
Fe-59	< 60	< 48	< 62	< 56	< 68	< 55
Co-60	< 30	< 28	< 37	< 27	< 35	< 33
Zn-65	< 59	< 45	< 82	< 60	< 63	< 70
Nb-95	< 33	< 29	< 34	< 24	< 31	< 26
Zr-95	< 58	< 48	< 60	< 34	< 50	< 45
Ru-103	< 34	< 31	< 34	< 22	< 24	< 26
Ru-106	< 290	< 203	< 303	< 214	< 240	< 175
I-131	< 56	< 47	< 56	< 27	< 37	< 29
Cs-134	< 29	< 31	< 42	< 31	< 32	< 18
Cs-137	< 35	< 24	< 37	< 28	< 42	< 29
Ba-140	< 175	< 143	< 168	< 78	< 117	< 89
La-140	< 42	< 44	< 46	< 18	< 26	< 29
Ce-141	< 53	< 39	< 63	< 34	< 42	< 39
Ce-144	< 198	< 180	< 232	< 133	< 162	< 148
Ra-226	< 763	< 603	< 791	< 545	< 599	< 511
Th-228	< 63	< 50	< 69	< 46	< 44	< 41

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-12

GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 SigmaMet Tower
95

DATE	07/21/20	07/21/20	07/22/20	08/18/20	08/18/20	08/18/20
GAMMA						
Be-7	1813 \pm 306	963 \pm 393	1986 \pm 399	2280 \pm 310	1639 \pm 313	2098 \pm 317
K-40	3846 \pm 583	6039 \pm 852	7085 \pm 847	6593 \pm 676	3690 \pm 676	5331 \pm 723
Mn-54	< 32	< 25	< 32	< 31	< 31	< 24
Co-58	< 26	< 36	< 44	< 27	< 27	< 34
Fe-59	< 61	< 68	< 84	< 72	< 64	< 54
Co-60	< 33	< 30	< 41	< 37	< 23	< 37
Zn-65	< 74	< 64	< 86	< 75	< 45	< 66
Nb-95	< 33	< 29	< 42	< 30	< 26	< 33
Zr-95	< 48	< 60	< 48	< 56	< 53	< 39
Ru-103	< 26	< 32	< 37	< 26	< 27	< 27
Ru-106	< 297	< 301	< 296	< 236	< 206	< 254
I-131	< 36	< 36	< 38	< 34	< 34	< 34
Cs-134	< 38	< 39	< 46	< 31	< 32	< 36
Cs-137	< 33	< 34	< 38	< 36	< 27	< 34
Ba-140	< 109	< 111	< 127	< 116	< 94	< 127
La-140	< 41	< 29	< 33	< 38	< 45	< 30
Ce-141	< 40	< 41	< 51	< 41	< 38	< 42
Ce-144	< 166	< 180	< 225	< 158	< 149	< 187
Ra-226	< 720	< 597	< 822	< 649	< 644	< 768
Th-228	< 54	< 56	< 71	< 54	< 54	< 62

Plant: Indian Point Energy Center	Year: 2020	Page 73 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-12
GAMMA EMITTERS IN BROAD LEAF VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

DATE	Met Tower 95		
	09/15/20	09/15/20	09/15/20
GAMMA			
Be-7	2597 \pm 443	1328 \pm 328	1488 \pm 392
K-40	5946 \pm 842	5190 \pm 656	4200 \pm 703
Mn-54	< 37	< 31	< 30
Co-58	< 30	< 31	< 27
Fe-59	< 68	< 62	< 65
Co-60	< 34	< 28	< 25
Zn-65	< 71	< 73	< 80
Nb-95	< 32	< 23	< 38
Zr-95	< 52	< 40	< 59
Ru-103	< 32	< 26	< 29
Ru-106	< 278	< 226	< 323
I-131	< 28	< 31	< 40
Cs-134	< 26	< 34	< 37
Cs-137	< 38	< 28	< 23
Ba-140	< 122	< 107	< 113
La-140	< 32	< 29	< 34
Ce-141	< 51	< 40	< 47
Ce-144	< 200	< 157	< 215
Ra-226	< 777	< 650	< 818
Th-228	< 62	< 56	< 67

Plant: Indian Point Energy Center	Year: 2020	Page 74 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-13
RADIONUCLIDES IN RIVER WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Plant Inlet Hudson River Intake

9 (b)

DATE	01/29/20	02/25/20	03/31/20	04/28/20	05/28/20	06/30/20
RADIOCHEMICAL						
H-3 (a)			< 192			< 180
GAMMA						
K-40	< 31	< 14	< 31	< 55	< 25	47 \pm 23
Mn-54	< 1	< 1	< 2	< 3	< 1	< 2
Co-58	< 2	< 2	< 2	< 4	< 2	< 2
Fe-59	< 4	< 4	< 4	< 8	< 4	< 4
Co-60	< 2	< 1	< 2	< 4	< 2	< 2
Zn-65	< 3	< 3	< 3	< 6	< 3	< 3
Nb-95	< 2	< 2	< 2	< 4	< 2	< 2
Zr-95	< 3	< 3	< 3	< 6	< 3	< 4
Ru-103	< 2	< 2	< 2	< 4	< 2	< 2
Ru-106	< 14	< 14	< 15	< 31	< 14	< 15
I-131	< 8	< 8	< 12	< 13	< 8	< 13
Cs-134	< 2	< 2	< 2	< 3	< 2	< 2
Cs-137	< 2	< 1	< 2	< 4	< 2	< 2
Ba-140	< 15	< 14	< 19	< 27	< 15	< 20
La-140	< 5	< 5	< 6	< 8	< 5	< 6
Ce-141	< 4	< 3	< 4	< 7	< 4	< 4
Ce-144	< 11	< 11	< 13	< 26	< 11	< 13
Ra-226	< 34	< 31	< 43	< 90	< 33	< 44
Ac-228	< 6	< 5	< 6	< 13	< 6	< 7
Th-228	< 3	< 3	< 3	< 7	< 3	< 4

(a) Quarterly Composite

(b) Refer REMP changes table B-1c

Plant: Indian Point Energy Center	Year: 2020	Page 75 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-13
RADIONUCLIDES IN RIVER WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Plant Inlet Hudson River Intake

9

DATE	07/28/20	08/25/20	09/29/20	10/27/20	11/24/20	12/30/20
RADIOCHEMICAL						
H-3 (a)			< 181			< 190
GAMMA						
K-40	59 \pm 31	51 \pm 27	51 \pm 27	< 19	41 \pm 27	< 19
Mn-54	< 2	< 2	< 2	< 2	< 2	< 2
Co-58	< 2	< 2	< 2	< 2	< 2	< 2
Fe-59	< 5	< 4	< 4	< 6	< 4	< 5
Co-60	< 2	< 2	< 2	< 3	< 2	< 2
Zn-65	< 4	< 4	< 3	< 4	< 4	< 4
Nb-95	< 2	< 2	< 2	< 3	< 2	< 2
Zr-95	< 4	< 3	< 3	< 5	< 4	< 4
Ru-103	< 3	< 2	< 2	< 3	< 2	< 3
Ru-106	< 18	< 17	< 14	< 22	< 17	< 16
I-131	< 12	< 7	< 9	< 9	< 10	< 12
Cs-134	< 2	< 2	< 2	< 3	< 2	< 2
Cs-137	< 2	< 2	< 2	< 2	< 2	< 2
Ba-140	< 21	< 13	< 15	< 20	< 17	< 21
La-140	< 7	< 5	< 5	< 6	< 6	< 7
Ce-141	< 5	< 3	< 4	< 5	< 4	< 4
Ce-144	< 14	< 11	< 12	< 17	< 12	< 12
Ra-226	< 46	< 41	< 42	< 63	< 40	< 35
Ac-228	< 8	< 8	< 6	< 10	< 7	< 7
Th-228	< 3	< 3	< 3	< 5	< 3	< 3

(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 76 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-13
RADIONUCLIDES IN RIVER WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Discharge Canal

10

DATE	01/29/20	02/25/20	03/31/20	04/28/20	05/28/20	06/30/20
RADIOCHEMICAL						
H-3 (a)			347 \pm 135			< 176
GAMMA						
K-40	< 29	< 30	< 42	< 69	< 15	50 \pm 27
Mn-54	< 1	< 2	< 2	< 3	< 2	< 2
Co-58	< 2	< 2	< 2	< 4	< 2	< 2
Fe-59	< 4	< 5	< 5	< 8	< 4	< 4
Co-60	< 2	< 2	< 2	< 4	< 2	< 2
Zn-65	< 3	< 3	< 5	< 8	< 3	< 4
Nb-95	< 2	< 2	< 3	< 4	< 2	< 2
Zr-95	< 3	< 3	< 5	< 7	< 3	< 4
Ru-103	< 2	< 2	< 3	< 4	< 2	< 2
Ru-106	< 14	< 16	< 21	< 26	< 16	< 16
I-131	< 8	< 8	< 13	< 14	< 9	< 12
Cs-134	< 2	< 2	< 2	< 4	< 2	< 2
Cs-137	< 2	< 2	< 2	< 3	< 2	< 2
Ba-140	< 16	< 17	< 23	< 28	< 16	< 21
La-140	< 5	< 6	< 8	< 9	< 6	< 6
Ce-141	< 3	< 4	< 6	< 8	< 4	< 4
Ce-144	< 10	< 11	< 17	< 26	< 12	< 12
Ra-226	< 37	< 41	< 58	< 82	< 44	< 44
Ac-228	< 6	< 6	< 9	< 14	< 7	< 7
Th-228	< 3	< 3	< 5	< 7	< 3	< 3

(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 77 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-13
RADIONUCLIDES IN RIVER WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Discharge Canal

10

DATE	07/28/20	08/25/20	09/29/20	10/27/20	11/24/20	12/30/20
RADIOCHEMICAL						
H-3 (a)			< 177			229 \pm 125
GAMMA						
K-40	45 \pm 28	< 18	37 \pm 22	< 23	58 \pm 24	< 16
Mn-54	< 2	< 2	< 1	< 3	< 2	< 2
Co-58	< 2	< 2	< 2	< 3	< 2	< 2
Fe-59	< 5	< 5	< 4	< 6	< 4	< 5
Co-60	< 2	< 2	< 2	< 3	< 2	< 2
Zn-65	< 4	< 4	< 3	< 5	< 3	< 4
Nb-95	< 2	< 2	< 2	< 3	< 2	< 2
Zr-95	< 4	< 3	< 3	< 5	< 3	< 3
Ru-103	< 2	< 2	< 2	< 3	< 2	< 2
Ru-106	< 16	< 16	< 14	< 24	< 16	< 15
I-131	< 11	< 7	< 8	< 9	< 9	< 12
Cs-134	< 2	< 2	< 2	< 3	< 2	< 2
Cs-137	< 2	< 2	< 2	< 3	< 2	< 2
Ba-140	< 18	< 15	< 15	< 20	< 17	< 20
La-140	< 6	< 5	< 5	< 7	< 6	< 7
Ce-141	< 4	< 4	< 4	< 6	< 4	< 5
Ce-144	< 11	< 11	< 12	< 18	< 11	< 13
Ra-226	< 41	< 41	< 33	< 69	< 40	< 43
Ac-228	< 7	< 7	< 6	< 11	< 6	< 7
Th-228	< 3	< 3	< 3	< 5	< 3	< 3

(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 78 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-13
RADIONUCLIDES IN RIVER WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Roseton
23*

DATE	03/30/20	04/27/20	05/26/20	06/29/20	07/27/20	08/24/20
RADIOCHEMICAL						
H-3 (a)	< 187			< 183		
GAMMA						
K-40	< 50	< 40	< 37	< 25	< 25	< 26
Mn-54	< 2	< 3	< 2	< 2	< 2	< 2
Co-58	< 3	< 3	< 2	< 2	< 2	< 2
Fe-59	< 6	< 7	< 4	< 4	< 4	< 4
Co-60	< 3	< 3	< 2	< 2	< 2	< 2
Zn-65	< 5	< 6	< 3	< 3	< 3	< 3
Nb-95	< 3	< 3	< 2	< 2	< 2	< 2
Zr-95	< 5	< 6	< 3	< 3	< 3	< 3
Ru-103	< 3	< 4	< 2	< 2	< 2	< 2
Ru-106	< 24	< 25	< 15	< 13	< 13	< 14
I-131	< 11	< 11	< 10	< 13	< 10	< 7
Cs-134	< 3	< 3	< 2	< 2	< 2	< 2
Cs-137	< 2	< 3	< 2	< 2	< 2	< 2
Ba-140	< 22	< 25	< 17	< 20	< 16	< 14
La-140	< 7	< 10	< 5	< 7	< 6	< 4
Ce-141	< 6	< 6	< 4	< 4	< 4	< 3
Ce-144	< 19	< 18	< 11	< 12	< 11	< 11
Ra-226	< 60	< 55	< 34	< 33	< 32	< 42
Ac-228	< 11	< 11	< 7	< 6	< 6	< 6
Th-228	< 4	< 5	< 3	< 3	< 3	< 3

* Control Location
(a) Quarterly Composite

Plant: Indian Point Energy Center	Year: 2020	Page 79 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-13
RADIONUCLIDES IN RIVER WATER SAMPLES - 2020

pCi/L \pm 2 Sigma

Roseton
23*

DATE	09/28/20	10/27/20	11/23/20	12/28/20
RADIOCHEMICAL				
H-3 (a)	< 176			< 193
GAMMA				
K-40	< 37	< 28	< 32	< 14
Mn-54	< 2	< 2	< 2	< 2
Co-58	< 2	< 3	< 2	< 2
Fe-59	< 4	< 6	< 4	< 4
Co-60	< 2	< 3	< 2	< 2
Zn-65	< 3	< 5	< 3	< 3
Nb-95	< 2	< 3	< 2	< 2
Zr-95	< 3	< 5	< 3	< 3
Ru-103	< 2	< 3	< 2	< 2
Ru-106	< 14	< 21	< 15	< 12
I-131	< 9	< 10	< 10	< 12
Cs-134	< 2	< 3	< 2	< 2
Cs-137	< 2	< 2	< 2	< 2
Ba-140	< 16	< 19	< 17	< 18
La-140	< 5	< 7	< 5	< 7
Ce-141	< 4	< 5	< 4	< 4
Ce-144	< 12	< 15	< 13	< 11
Ra-226	< 43	< 55	< 44	< 33
Ac-228	< 7	< 10	< 7	< 6
Th-228	< 3	< 4	< 4	< 3

*Control Location

(a) Quarterly Composite

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-14

GAMMA EMITTERS IN BOTTOM SEDIMENT SAMPLES - 2020

pCi/kg dry \pm 2 Sigma

DATE	Discharge Canal 10		Off Verplanck 17	
	06/12/20	09/21/20	06/12/20	09/21/20
GAMMA				
Be-7	< 521	< 488	< 777	< 834
K-40	15650 \pm 1597	13760 \pm 1484	16410 \pm 2114	18690 \pm 1956
Mn-54	< 61	< 45	< 92	< 94
Co-58	< 72	< 40	< 70	< 95
Fe-59	< 130	< 126	< 189	< 238
Co-60	< 66	< 51	< 119	< 108
Zn-65	< 152	< 113	< 218	< 242
Nb-95	< 56	< 44	< 105	< 117
Zr-95	< 92	< 92	< 152	< 187
Ru-103	< 51	< 45	< 90	< 97
Ru-106	< 583	< 442	< 743	< 843
I-131	< 80	< 77	< 122	< 176
Cs-134	< 72	< 57	< 113	< 120
Cs-137	154 \pm 53	86 \pm 46	198 \pm 93	211 \pm 100
Ba-140	< 270	< 247	< 459	< 511
Ce-141	< 74	< 65	< 116	< 137
Ce-144	< 309	< 241	< 465	< 498
Ra-226	< 1234	< 1008	< 1528	< 2129
Th-228	406 \pm 85	330 \pm 89	1184 \pm 137	929 \pm 137

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER

TABLE B-14

GAMMA EMITTERS IN BOTTOM SEDIMENT SAMPLES - 2020

pCi/kg dry \pm 2 Sigma

DATE	Lent's Cove 28		Cold Spring 84*	
	06/10/20	09/22/20	06/10/20	09/22/20
GAMMA				
Be-7	< 773	< 413	< 782	< 699
K-40	19800 \pm 2149	13420 \pm 1284	21040 \pm 2218	19850 \pm 2126
Mn-54	< 116	< 51	< 98	< 89
Co-58	< 96	< 41	< 73	< 79
Fe-59	< 220	< 100	< 273	< 191
Co-60	< 124	< 62	< 91	< 105
Zn-65	< 221	< 123	< 254	< 214
Nb-95	< 120	< 52	< 115	< 101
Zr-95	< 200	< 100	< 169	< 168
Ru-103	< 107	< 40	< 107	< 70
Ru-106	< 682	< 318	< 739	< 664
I-131	< 222	< 71	< 227	< 145
Cs-134	< 119	< 54	< 116	< 119
Cs-137	187 \pm 105	< 67	207 \pm 109	< 124
Ba-140	< 665	< 196	< 665	< 434
Ce-141	< 142	< 65	< 139	< 103
Ce-144	< 426	< 221	< 460	< 425
Ra-226	< 2012	< 787	< 2061	< 1797
Th-228	1141 \pm 174	388 \pm 83	1098 \pm 157	1294 \pm 140

* Control Location

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-15
RADIONUCLIDES IN SHORELINE SOIL SAMPLES - 2020

pCi/kg dry \pm 2 Sigma

DATE	Off Verplanck 17		Lent's Cove 28	
	06/10/20	09/10/20	06/10/20	09/10/20
RADIOCHEMICAL				
Sr-90	< 46	< 40	< 45	< 43
GAMMA				
Be-7	< 327	< 432	1091 \pm 498	< 694
K-40	10520 \pm 1033	15530 \pm 1610	11960 \pm 1314	12650 \pm 1619
Mn-54	< 37	< 51	< 50	< 73
Co-58	< 37	< 58	< 55	< 50
Fe-59	< 83	< 152	< 84	< 141
Co-60	< 37	< 72	< 36	< 68
Zn-65	< 71	< 140	< 117	< 161
Nb-95	< 42	< 71	< 48	< 71
Zr-95	< 67	< 124	< 67	< 139
Ru-103	< 36	< 56	< 51	< 64
Ru-106	< 311	< 398	< 477	< 512
I-131	< 68	< 93	< 104	< 123
Cs-134	< 49	< 70	< 60	< 81
Cs-137	96 \pm 57	< 57	< 60	< 81
Ba-140	< 174	< 273	< 190	< 364
La-140	< 35	< 89	< 44	< 111
Ce-141	< 74	< 80	< 112	< 89
Ce-144	< 299	< 281	< 402	< 316
Ra-226	< 1104	< 1148	< 1733	< 1132
Ac-228	499 \pm 130	< 406	< 392	525 \pm 179
Th-228	338 \pm 100	331 \pm 90	431 \pm 170	315 \pm 126

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-15
RADIONUCLIDES IN SHORELINE SOIL SAMPLES - 2020

pCi/kg dry \pm 2 Sigma

DATE	Manitou Inlet 50*		White Beach 53	
	06/10/20	09/10/20	06/10/20	09/10/20
RADIOCHEMICAL				
Sr-90	< 34	< 44	< 47	< 43
GAMMA				
Be-7	< 476	< 575	< 462	< 337
K-40	11650 \pm 1272	13030 \pm 1486	8787 \pm 1110	8935 \pm 1195
Mn-54	< 56	< 71	< 53	< 42
Co-58	< 59	< 67	< 51	< 39
Fe-59	< 114	< 136	< 148	< 93
Co-60	< 40	< 76	< 52	< 30
Zn-65	< 126	< 145	< 132	< 97
Nb-95	< 68	< 82	< 63	< 43
Zr-95	< 91	< 138	< 96	< 81
Ru-103	< 53	< 64	< 53	< 43
Ru-106	< 514	< 571	< 527	< 307
I-131	< 103	< 126	< 104	< 75
Cs-134	< 70	< 78	< 71	< 49
Cs-137	< 59	< 79	< 57	< 45
Ba-140	< 345	< 338	< 325	< 200
La-140	< 109	< 72	< 101	< 41
Ce-141	< 80	< 112	< 77	< 68
Ce-144	< 307	< 420	< 264	< 237
Ra-226	3306 \pm 1071	< 1447	< 1230	< 1050
Ac-228	588 \pm 362	< 404	< 233	< 223
Th-228	630 \pm 157	521 \pm 101	< 100	171 \pm 104

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 84 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-15
RADIONUCLIDES IN SHORELINE SOIL SAMPLES - 2020

pCi/kg dry \pm 2 Sigma

DATE	Cold Spring 84*	
	06/10/20	09/10/20
RADIOCHEMICAL		
Sr-90	< 41	< 50
GAMMA		
Be-7	< 433	< 493
K-40	32110 \pm 2077	29000 \pm 2227
Mn-54	< 71	< 57
Co-58	< 72	< 66
Fe-59	< 162	< 161
Co-60	< 84	< 60
Zn-65	< 180	< 176
Nb-95	< 70	< 67
Zr-95	< 116	< 111
Ru-103	< 58	< 63
Ru-106	< 464	< 480
I-131	< 100	< 98
Cs-134	< 80	< 88
Cs-137	< 63	< 67
Ba-140	< 293	< 315
La-140	< 97	< 74
Ce-141	< 85	< 76
Ce-144	< 303	< 301
Ra-226	< 1089	< 1309
Ac-228	608 \pm 201	< 412
Th-228	748 \pm 84	583 \pm 101

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 85 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-16
GAMMA EMITTERS IN AQUATIC VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

Lent's Cove
28

DATE	06/12/20 Myriophyllum	09/22/20 Myriophyllum
Be-7	(a)	< 183
K-40		2641 \pm 470
Mn-54		< 18
Co-58		< 21
Fe-59		< 56
Co-60		< 16
Zn-65		< 51
Nb-95		< 20
Zr-95		< 37
Ru-103		< 21
Ru-106		< 185
I-131		< 26
Cs-134		< 24
Cs-137		< 28
Ba-140		< 86
La-140		< 25
Ce-141		< 29
Ce-144		< 126
Ra-226		< 463
Ac-228		< 122
Th-228		< 34

(a) Unable to locate and collect samples at this location

Plant: Indian Point Energy Center	Year: 2020	Page 86 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-16
GAMMA EMITTERS IN AQUATIC VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

Off Verplanck
17

DATE	06/12/20 Myriophyllum	09/21/20 Myriophyllum
Be-7	561 \pm 224	< 251
K-40	3167 \pm 448	2405 \pm 492
Mn-54	< 26	< 28
Co-58	< 22	< 31
Fe-59	< 48	< 67
Co-60	< 21	< 28
Zn-65	< 51	< 73
Nb-95	< 29	< 31
Zr-95	< 35	< 48
Ru-103	< 23	< 27
Ru-106	< 180	< 233
I-131	< 35	< 46
Cs-134	< 26	< 33
Cs-137	< 28	< 33
Ba-140	< 102	< 125
La-140	< 24	< 40
Ce-141	< 34	< 45
Ce-144	< 145	< 174
Ra-226	< 564	< 738
Ac-228	< 116	< 133
Th-228	143 \pm 46	< 62

Plant: Indian Point Energy Center	Year: 2020	Page 87 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-16
GAMMA EMITTERS IN AQUATIC VEGETATION SAMPLES - 2020

pCi/kg wet \pm 2 Sigma

Cold Spring
84*

DATE	06/10/20 Myriophyllum	09/21/20
Be-7	< 259	(a)
K-40	3234 \pm 445	
Mn-54	< 24	
Co-58	< 19	
Fe-59	< 49	
Co-60	< 18	
Zn-65	< 49	
Nb-95	< 27	
Zr-95	< 36	
Ru-103	< 24	
Ru-106	< 164	
I-131	< 53	
Cs-134	< 28	
Cs-137	< 27	
Ba-140	< 132	
La-140	< 47	
Ce-141	< 38	
Ce-144	< 137	
Ra-226	< 536	
Ac-228	< 127	
Th-228	< 57	

* Control Location

(a) Unable to locate and collect samples at this location

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Downstream
107

DATE	04/29/20 Eel	05/06/20 Sunfish	05/06/20 Perch	05/07/20 Cattfish	05/20/20 Striped Bass	06/03/20 Blue Crab
RADIOCHEMICAL						
Ni-63	< 51	< 50	< 78	< 86	< 87	< 95
Sr-90	< 4	< 4	< 5	< 3	< 4	< 5
GAMMA						
Be-7	< 275	< 443	< 474	< 622	< 549	< 333
K-40	1798 \pm 534	2294 \pm 721	2433 \pm 890	3322 \pm 1027	2724 \pm 1248	2761 \pm 702
Mn-54	< 35	< 43	< 61	< 69	< 65	< 44
Co-58	< 35	< 36	< 68	< 75	< 71	< 22
Fe-59	< 70	< 94	< 118	< 152	< 145	< 77
Co-60	< 30	< 35	< 41	< 46	< 58	< 32
Zn-65	< 67	< 103	< 141	< 140	< 173	< 62
Nb-95	< 35	< 47	< 57	< 59	< 71	< 32
Zr-95	< 55	< 69	< 104	< 132	< 81	< 75
Ru-103	< 34	< 52	< 46	< 71	< 77	< 41
Ru-106	< 283	< 381	< 479	< 637	< 760	< 312
I-131	< 57	< 88	< 91	< 137	< 172	< 94
Cs-134	< 37	< 48	< 73	< 71	< 73	< 44
Cs-137	< 35	< 50	< 44	< 75	< 60	< 45
Ba-140	< 167	< 266	< 271	< 400	< 337	< 246
La-140	< 41	< 87	< 108	< 120	< 167	< 55
Ce-141	< 46	< 61	< 60	< 104	< 92	< 90
Ce-144	< 169	< 214	< 237	< 338	< 350	< 308
Ra-226	< 599	< 1013	< 844	< 1543	< 1672	< 1199
Th-228	< 61	< 83	< 76	< 130	< 117	< 106

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Downstream

107

DATE	08/18/20 Sunfish	08/23/20 Catfish	08/23/20 Blue Crab	08/23/20 Perch	09/11/20 Eel
RADIOCHEMICAL					
Ni-63	< 74	< 62	< 75	< 92	< 90
Sr-90	< 5	< 4	< 3	< 5	< 4
GAMMA					
Be-7	< 643	< 427	< 481	< 608	< 342
K-40	2639 \pm 793	2134 \pm 900	2130 \pm 804	2576 \pm 996	2360 \pm 764
Mn-54	< 59	< 60	< 55	< 74	< 63
Co-58	< 75	< 45	< 59	< 63	< 38
Fe-59	< 145	< 126	< 138	< 148	< 98
Co-60	< 65	< 42	< 51	< 58	< 49
Zn-65	< 107	< 149	< 128	< 102	< 81
Nb-95	< 61	< 56	< 60	< 84	< 48
Zr-95	< 114	< 100	< 98	< 142	< 93
Ru-103	< 75	< 66	< 60	< 55	< 52
Ru-106	< 595	< 460	< 520	< 661	< 475
I-131	< 194	< 97	< 113	< 120	< 74
Cs-134	< 73	< 69	< 54	< 62	< 55
Cs-137	< 73	< 58	< 56	< 67	< 54
Ba-140	< 457	< 293	< 264	< 335	< 239
La-140	< 141	< 83	< 61	< 123	< 57
Ce-141	< 104	< 61	< 74	< 95	< 72
Ce-144	< 289	< 226	< 279	< 353	< 271
Ra-226	< 1311	< 895	< 1101	< 1312	< 1043
Th-228	< 103	< 77	< 94	< 122	< 88

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Roseton
23*

DATE	04/28/20 Eel	05/07/20 Perch	05/07/20 Striped Bass	05/20/20 Catfish	05/27/20 Perch	06/18/20 Blue Crab
RADIOCHEMICAL						
Ni-63	< 95	< 93	< 98	< 50	< 97	< 68
Sr-90	< 4	< 5	< 4	< 4	< 3	< 5
GAMMA						
Be-7	< 184	< 434	< 725	< 468	< 352	< 405
K-40	2121 \pm 420	2459 \pm 745	3063 \pm 919	3091 \pm 713	2386 \pm 790	3116 \pm 1002
Mn-54	< 21	< 38	< 64	< 43	< 38	< 48
Co-58	< 23	< 49	< 78	< 34	< 40	< 48
Fe-59	< 48	< 93	< 175	< 98	< 81	< 119
Co-60	< 26	< 30	< 75	< 52	< 44	< 63
Zn-65	< 46	< 74	< 116	< 85	< 103	< 123
Nb-95	< 24	< 41	< 62	< 47	< 43	< 52
Zr-95	< 46	< 74	< 148	< 105	< 60	< 109
Ru-103	< 24	< 55	< 78	< 57	< 50	< 51
Ru-106	< 195	< 361	< 510	< 503	< 409	< 447
I-131	< 44	< 89	< 437	< 124	< 81	< 83
Cs-134	< 27	< 37	< 66	< 49	< 40	< 62
Cs-137	< 25	< 56	< 58	< 52	< 38	< 55
Ba-140	< 121	< 223	< 687	< 324	< 230	< 285
La-140	< 22	< 62	< 171	< 111	< 88	< 72
Ce-141	< 32	< 105	< 112	< 119	< 58	< 62
Ce-144	< 109	< 395	< 268	< 382	< 209	< 211
Ra-226	< 413	< 1504	< 1107	< 1294	< 931	< 989
Th-228	< 37	< 102	< 85	< 102	< 75	< 72

* Control Location

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Roseton
23*

DATE	08/19/20 Sunfish	08/23/20 Eel	09/01/20 Perch	09/01/20 Blue Crab	09/11/20 Striped Bass	09/11/20 Catfish
RADIOCHEMICAL						
Ni-63	< 100	< 97	< 91	< 98	< 79	< 90
Sr-90	< 5	< 5	< 5	< 4	< 4	< 4
GAMMA						
Be-7	< 435	< 366	< 460	< 377	< 421	< 615
K-40	2215 \pm 820	1366 \pm 660	2799 \pm 938	2589 \pm 893	2581 \pm 1051	3464 \pm 1065
Mn-54	< 55	< 60	< 57	< 67	< 46	< 79
Co-58	< 41	< 60	< 53	< 55	< 58	< 74
Fe-59	< 136	< 116	< 106	< 107	< 87	< 178
Co-60	< 37	< 64	< 59	< 39	< 55	< 81
Zn-65	< 102	< 108	< 119	< 117	< 104	< 126
Nb-95	< 52	< 60	< 57	< 54	< 46	< 86
Zr-95	< 103	< 120	< 83	< 71	< 79	< 130
Ru-103	< 50	< 59	< 42	< 42	< 60	< 76
Ru-106	< 481	< 504	< 408	< 393	< 507	< 746
I-131	< 130	< 104	< 76	< 64	< 91	< 122
Cs-134	< 68	< 73	< 52	< 59	< 51	< 81
Cs-137	< 47	< 68	< 42	< 50	< 46	< 86
Ba-140	< 305	< 238	< 257	< 183	< 199	< 297
La-140	< 105	< 118	< 71	< 57	< 94	< 107
Ce-141	< 69	< 67	< 67	< 57	< 66	< 97
Ce-144	< 249	< 257	< 216	< 222	< 263	< 324
Ra-226	< 1053	< 1070	< 945	< 1052	< 1235	< 1557
Th-228	< 77	< 70	< 81	< 73	< 82	< 127

* Control Location

Plant: Indian Point Energy Center	Year: 2020	Page 92 of 128
Annual Radiological Environmental Operating Report		

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Roseton
23*

DATE 09/11/20
 Eel

RADIOCHEMICAL

Ni-63 < 85
Sr-90 < 4

GAMMA

Be-7 < 462
K-40 2257 \pm 1027
Mn-54 < 59
Co-58 < 56
Fe-59 < 77
Co-60 < 76
Zn-65 < 102
Nb-95 < 52
Zr-95 < 57
Ru-103 < 53
Ru-106 < 420
I-131 < 71
Cs-134 < 60
Cs-137 < 72
Ba-140 < 240
La-140 < 75
Ce-141 < 60
Ce-144 < 236
Ra-226 < 1011
Th-228 < 80

* Control Location

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Downstream

25

DATE	04/30/20 Eel	05/06/20 Sunfish	05/06/20 Perch	05/06/20 Catfish	05/14/20 Striped Bass	06/09/20 Blue Crab
RADIOCHEMICAL						
Ni-63	< 92	< 86	< 79	< 55	< 75	< 96
Sr-90	< 4	< 4	< 4	< 4	< 4	< 5
GAMMA						
Be-7	< 229	< 490	< 721	< 556	< 787	< 382
K-40	2594 \pm 473	2883 \pm 1012	2189 \pm 1279	1568 \pm 910	3159 \pm 969	2486 \pm 753
Mn-54	< 27	< 68	< 68	< 55	< 59	< 40
Co-58	< 27	< 57	< 79	< 61	< 75	< 45
Fe-59	< 55	< 132	< 163	< 129	< 152	< 81
Co-60	< 29	< 57	< 91	< 66	< 58	< 37
Zn-65	< 62	< 141	< 178	< 87	< 145	< 80
Nb-95	< 30	< 94	< 86	< 63	< 67	< 42
Zr-95	< 45	< 110	< 130	< 98	< 144	< 73
Ru-103	< 28	< 68	< 69	< 62	< 91	< 41
Ru-106	< 275	< 678	< 670	< 586	< 487	< 404
I-131	< 45	< 131	< 156	< 121	< 214	< 85
Cs-134	< 28	< 76	< 94	< 88	< 60	< 46
Cs-137	< 29	< 67	< 94	< 66	< 63	< 46
Ba-140	< 138	< 376	< 401	< 311	< 588	< 224
La-140	< 39	< 132	< 116	< 106	< 174	< 49
Ce-141	< 39	< 103	< 100	< 95	< 124	< 63
Ce-144	< 137	< 286	< 318	< 359	< 380	< 181
Ra-226	< 572	< 1435	< 1508	< 1245	< 1401	< 873
Th-228	< 46	< 115	< 132	< 112	< 117	< 71

Annual Radiological Environmental Operating Report

INDIAN POINT ENERGY CENTER
TABLE B-17
RADIONUCLIDES IN FISH / INVERTEBRATES - 2020

pCi/kg wet \pm 2 Sigma

Downstream

25

DATE	08/19/20 Sunfish	08/23/20 Catfish	08/23/20 Blue Crab	09/01/20 Perch	09/11/20 Striped Bass
RADIOCHEMICAL					
Ni-63	< 83	< 42	< 88	< 88	< 89
Sr-90	< 5	< 3	< 3	< 4	< 4
GAMMA					
Be-7	< 634	< 416	< 451	< 610	< 320
K-40	2488 \pm 962	2564 \pm 879	3202 \pm 761	2278 \pm 780	2071 \pm 971
Mn-54	< 71	< 34	< 35	< 66	< 44
Co-58	< 75	< 58	< 36	< 75	< 57
Fe-59	< 160	< 104	< 124	< 134	< 114
Co-60	< 78	< 70	< 51	< 70	< 40
Zn-65	< 133	< 88	< 117	< 172	< 99
Nb-95	< 79	< 55	< 57	< 76	< 44
Zr-95	< 115	< 95	< 73	< 106	< 61
Ru-103	< 81	< 64	< 59	< 76	< 48
Ru-106	< 549	< 427	< 465	< 619	< 477
I-131	< 171	< 95	< 106	< 120	< 70
Cs-134	< 70	< 50	< 44	< 88	< 65
Cs-137	< 69	< 63	< 49	< 83	< 47
Ba-140	< 422	< 350	< 252	< 446	< 222
La-140	< 120	< 87	< 62	< 104	< 88
Ce-141	< 96	< 80	< 65	< 95	< 48
Ce-144	< 332	< 305	< 258	< 319	< 203
Ra-226	< 1171	< 1228	< 1147	< 1551	< 895
Th-228	< 126	< 98	< 79	< 104	< 75

Plant: Indian Point Energy Center	Year: 2020	Page 95 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

TABLE B-18
LAND USE CENSUS - RESIDENCE AND MILCH ANIMAL RESULTS 2020

The 2020 land use census indicated there were no new residences that were closer in proximity to IPEC.

IPEC maintains a complete nearest residence survey with updated distances.

No milch animals were observed during this reporting period within the 5-mile zone. There are no animals producing milk for human consumption within five miles of Indian Point.

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

TABLE B-19
LAND USE CENSUS
2020

UNRESTRICTED AREA BOUNDARY
AND NEAREST RESIDENCES

Sector	Compass Point	Distance to site Boundary from Unit 2 Plant Vent (meters)	Distance to site Boundary from Unit 3 Plant Vent (meters)	Distance to nearest resident, from Unit 1 superheater (meters)	Address of nearest resident, Last Census
1	N	RIVER	RIVER	1788	41 River Road Tomkins Cove
2	NNE	RIVER	RIVER	3111	Chateau Rive Apts. John St. Peekskill
3	NE	550	636	1907	211 Viewpoint Terrace, Peekskill
4	ENE	600	775	1478	1018 Lower South St. Peekskill
5	E	662	785	1371	1103 Lower South St. Peekskill
6	ESE	569	622	715	461 Broadway Buchanan
7	SE	553	564	1168	223 First St. Buchanan
8	SSE	569	551	1240	5 Pheasant's Run Buchanan
9	S	700	566	1133	320 Broadway Verplanck
10	SSW	755	480	1574	240 Eleventh St. Verplanck
11	SW	544	350	3016	8 Spring St. Tomkins Cove
12	WSW	RIVER	RIVER	2170	9 West Shore Dr. Tomkins Cove
13	W	RIVER	RIVER	1919	712 Rt. 9W Tomkins Cove
14	WNW	RIVER	RIVER	1752	770 Rt. 9W Tomkins Cove
15	NW	RIVER	RIVER	1693	807 Rt. 9W Tomkins Cove
16	NNW	RIVER	RIVER	1609	4 River Rd. Tomkins Cove

Plant: Indian Point Energy Center	Year: 2020	Page 97 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 6.0

HISTORICAL TRENDS

Plant: Indian Point Energy Center	Year: 2020	Page 98 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

HISTORICAL TRENDS

The past ten years of historical data for various radionuclides and media are presented both in tabular form and graphical form to facilitate the comparison of 2020 data with historical values. Although other samples were taken and analyzed, values were only tabulated and plotted where positive indications were present.

Averaging the positive values in these tables can result in a biased high value, especially, when the radionuclide is detected in only one or two quarters for the year.


Annual Radiological Environmental Operating Report

TABLE C-1
DIRECT RADIATION, ANNUAL SUMMARY
2010-2020

Average Quarterly Dose (mR/Quarter)			
Year	Inner Ring	Outer Ring	Control Location
2010	14.0	14.3	13.0
2011	13.6	14.4	13.4
2012	13.2	13.5	12.5
2013	13.4	13.8	14.2
2014	13.7	13.6	14.2
2015	13.8	14.0	14.3
2016	14.3	14.2	15.6
2017	14.3	14.7	15.6
2018	14.0	14.4	15.3
2019	13.7	13.9	15.0
2020	14.0	14.2	15.4
Historical Average 2010-2019	13.8	14.1	14.3

Annual Radiological Environmental Operating Report

Figure C-1
DIRECT RADIATION, ANNUAL SUMMARY
2010-2020

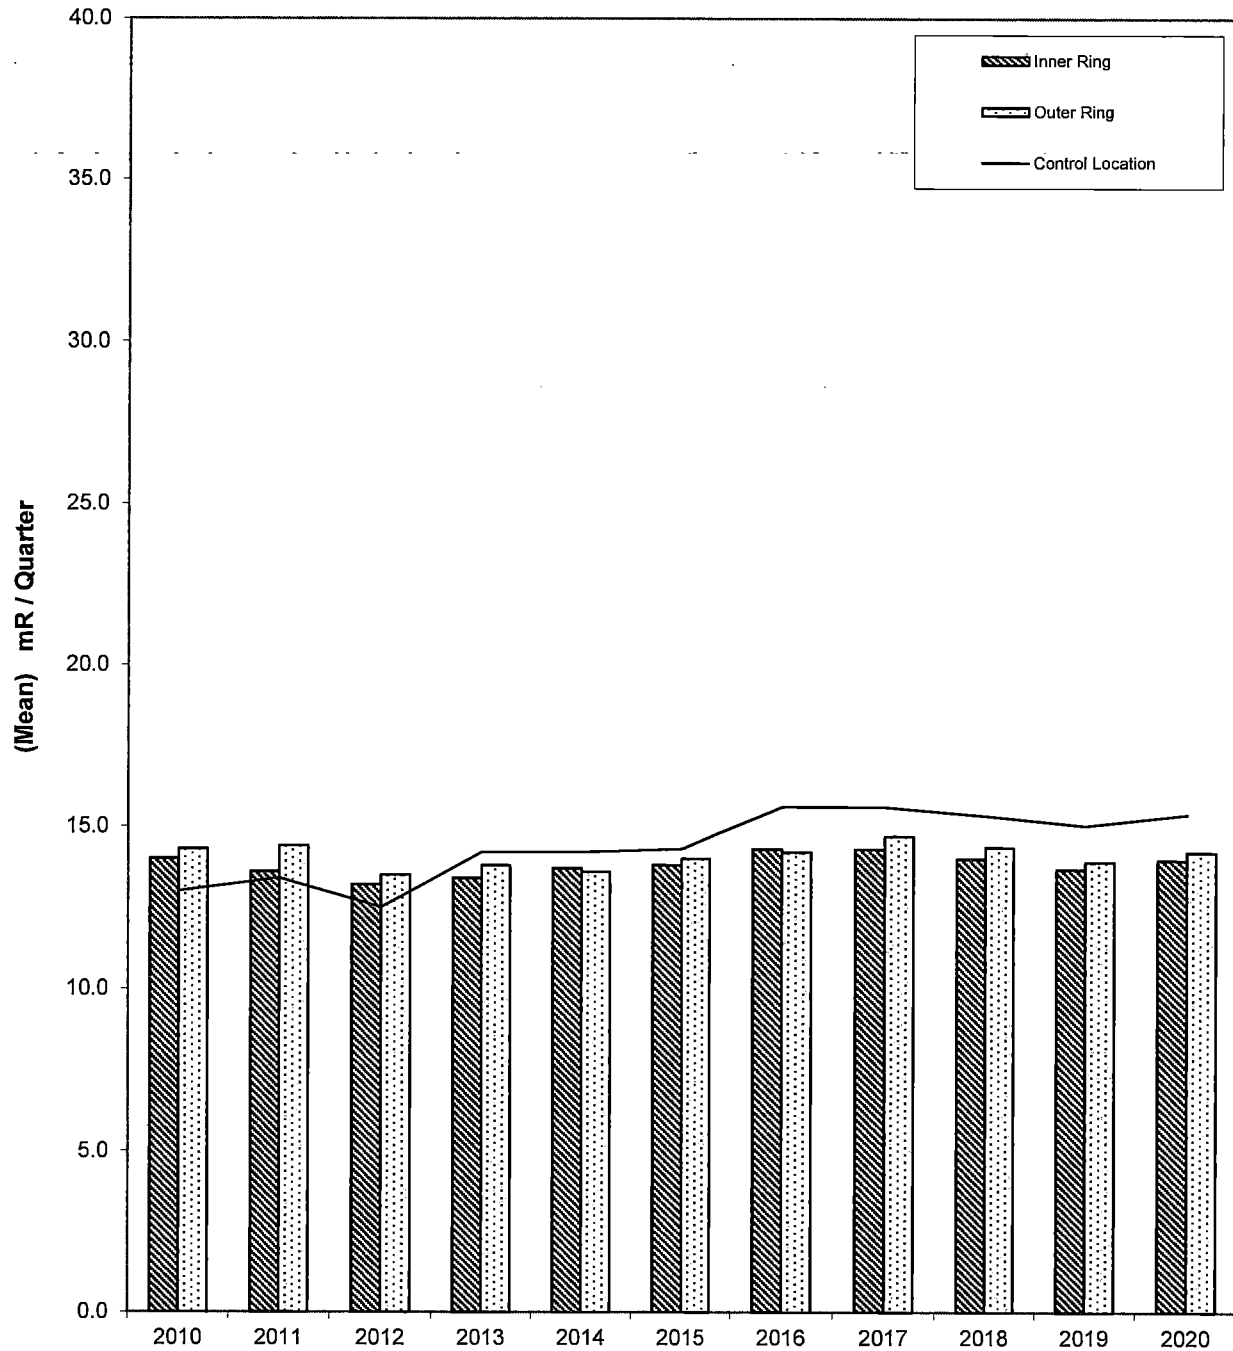

Plant: Indian Point Energy Center	Year: 2020	Page 101 of 128
Annual Radiological Environmental Operating Report		

TABLE C-2
RADIONUCLIDES IN AIR
2010-2020
(pCi/m³)


Year	Gross Beta		Cs-137	
	All Indicator Locations	Control Location	All Indicator Locations	Control Location
2010	0.01	0.01	< Lc	< Lc
2011	0.014	0.014	< Lc	< Lc
2012	0.014	0.014	< Lc	< Lc
2013	0.014	0.014	< Lc	< Lc
2014	0.013	0.013	< Lc	< Lc
2015	0.016	0.015	< Lc	< Lc
2016	0.015	0.015	< Lc	< Lc
2017	0.013	0.012	< Lc	< Lc
2018	0.013	0.012	< Lc	< Lc
2019	0.012	0.012	< Lc	< Lc
2020	0.013	0.013	< Lc	< Lc

Historical Average 2010-2019	0.01	0.01	< L _c	< L _c
---	------	------	------------------	------------------

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

Figure C-2
RADIONUCLIDES IN AIR - GROSS BETA
2010-2020

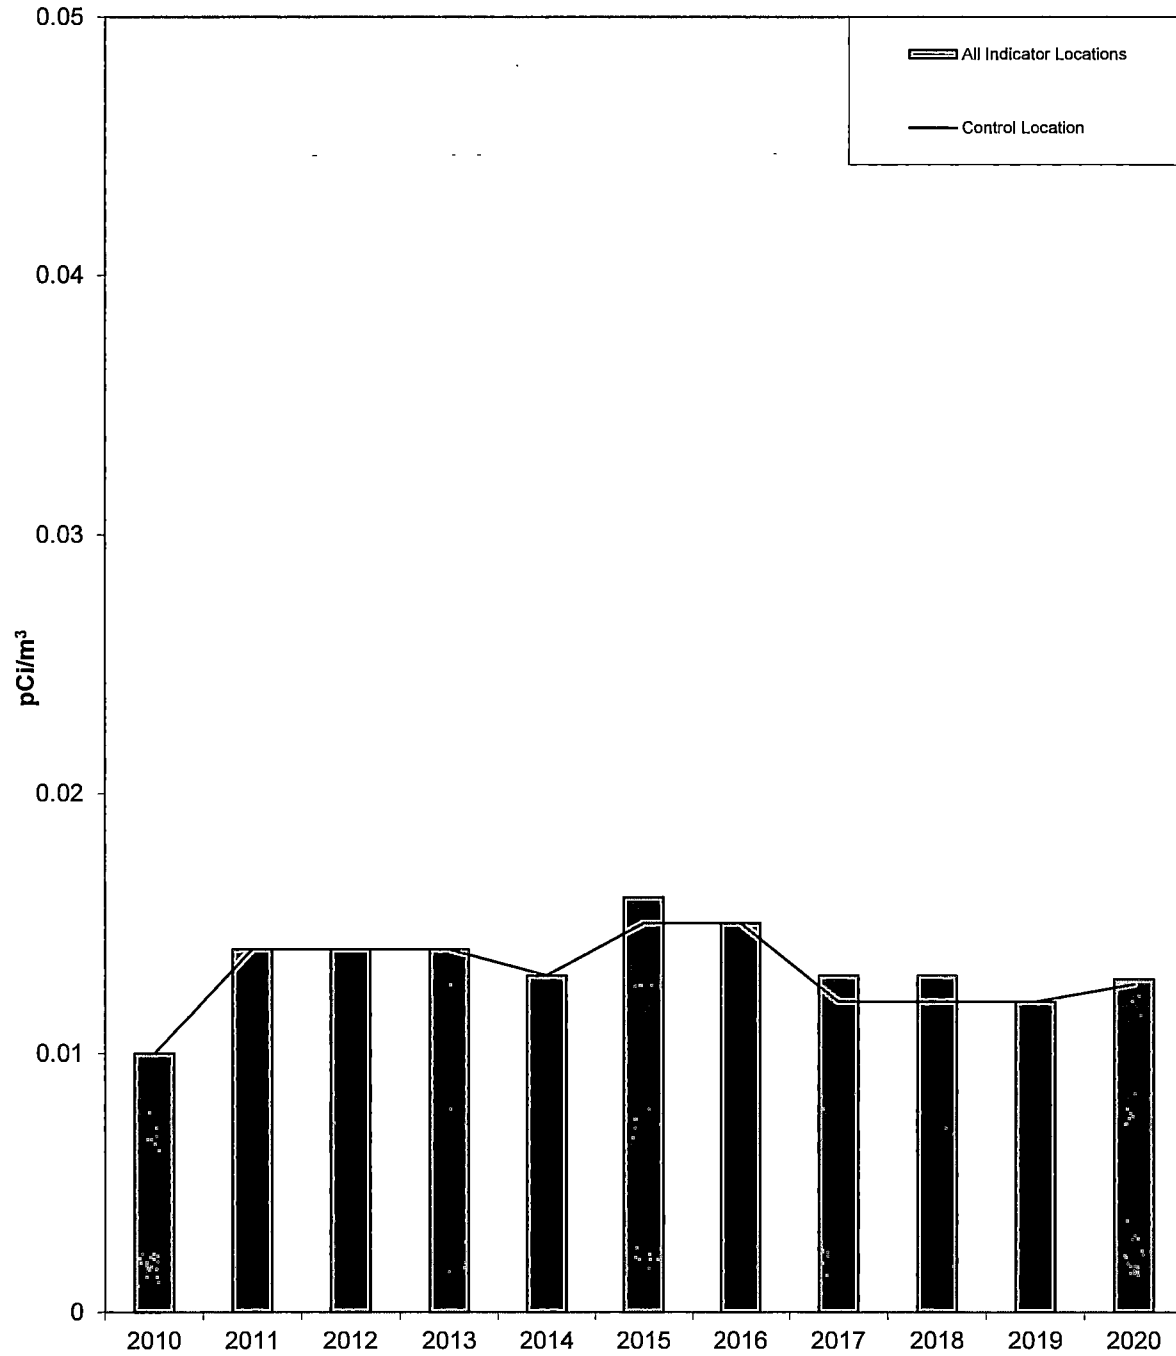

Plant: Indian Point Energy Center	Year: 2020	Page 103 of 128
Annual Radiological Environmental Operating Report		

TABLE C-3
RADIONUCLIDES IN HUDSON RIVER WATER-TRITIUM
2010-2020
(pCi/L)

Year	Tritium (H-3)		Cs-137	
	Inlet	Discharge	Inlet	Discharge
2010	428	< L _c	< L _c	< L _c
2011	< L _c	661	< L _c	< L _c
2012	< L _c	539	< L _c	< L _c
2013	241	462	< L _c	< L _c
2014	224	253	< L _c	< L _c
2015	188	341	< L _c	< L _c
2016	< L _c	415	< L _c	< L _c
2017	< L _c	299	< L _c	< L _c
2018	236	266	< L _c	< L _c
2019	273	295	< L _c	< L _c
2020 ^(b)	< L _c	288	< L _c	< L _c
Historical Average 2010-2019	265	392	< L _c	< L _c

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

(b) Refer REMP changes table B-1c

Annual Radiological Environmental Operating Report

Figure C-3
RADIONUCLIDES IN HUDSON RIVER WATER - TRITIUM
2010-2020

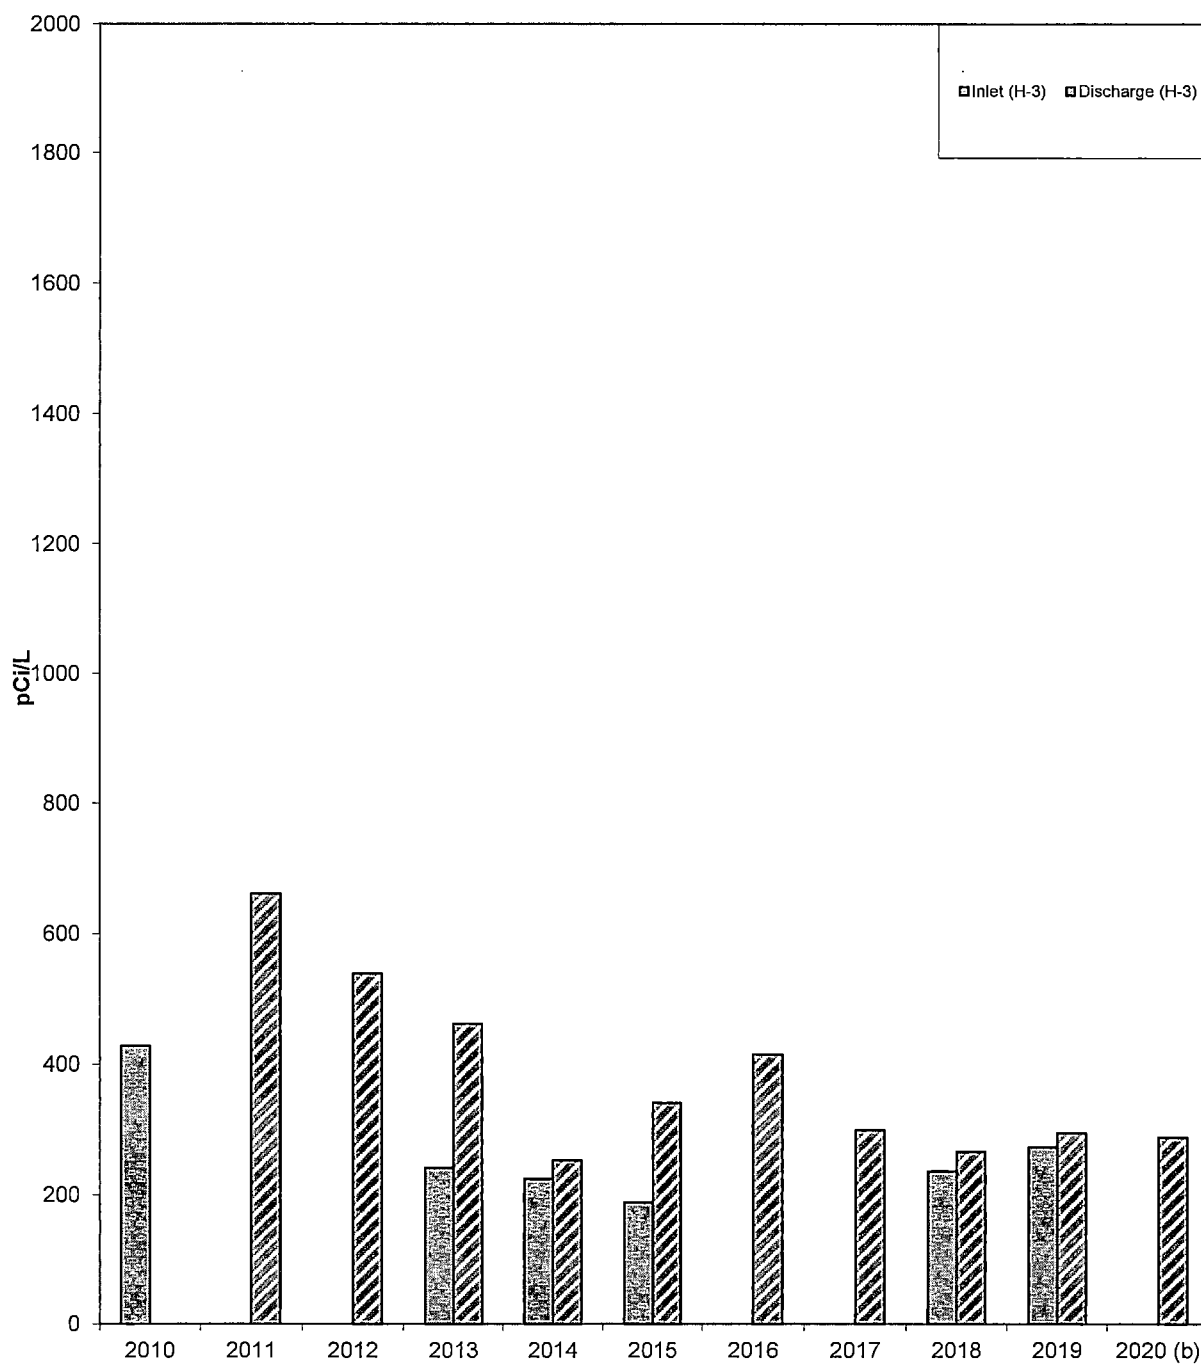



TABLE C-4
RADIONUCLIDES IN DRINKING WATER
2010-2020
(pCi/L)

Year	Tritium (H-3)	Cs-137
2010	< L _c	< L _c
2011	< L _c	< L _c
2012	< L _c	< L _c
2013	< L _c	< L _c
2014	< L _c	< L _c
2015	< L _c	< L _c
2016	< L _c	< L _c
2017	< L _c	< L _c
2018	< L _c	< L _c
2019	< L _c	< L _c
2020	< L _c	< L _c
Historical Average 2010-2019	< L _c	< L _c

Critical Level (L_c) is less than the ODCM required LLD.

<L_c indicates no positive values above sample critical level.

Figure C-4
RADIONUCLIDES IN DRINKING WATER
2010-2020

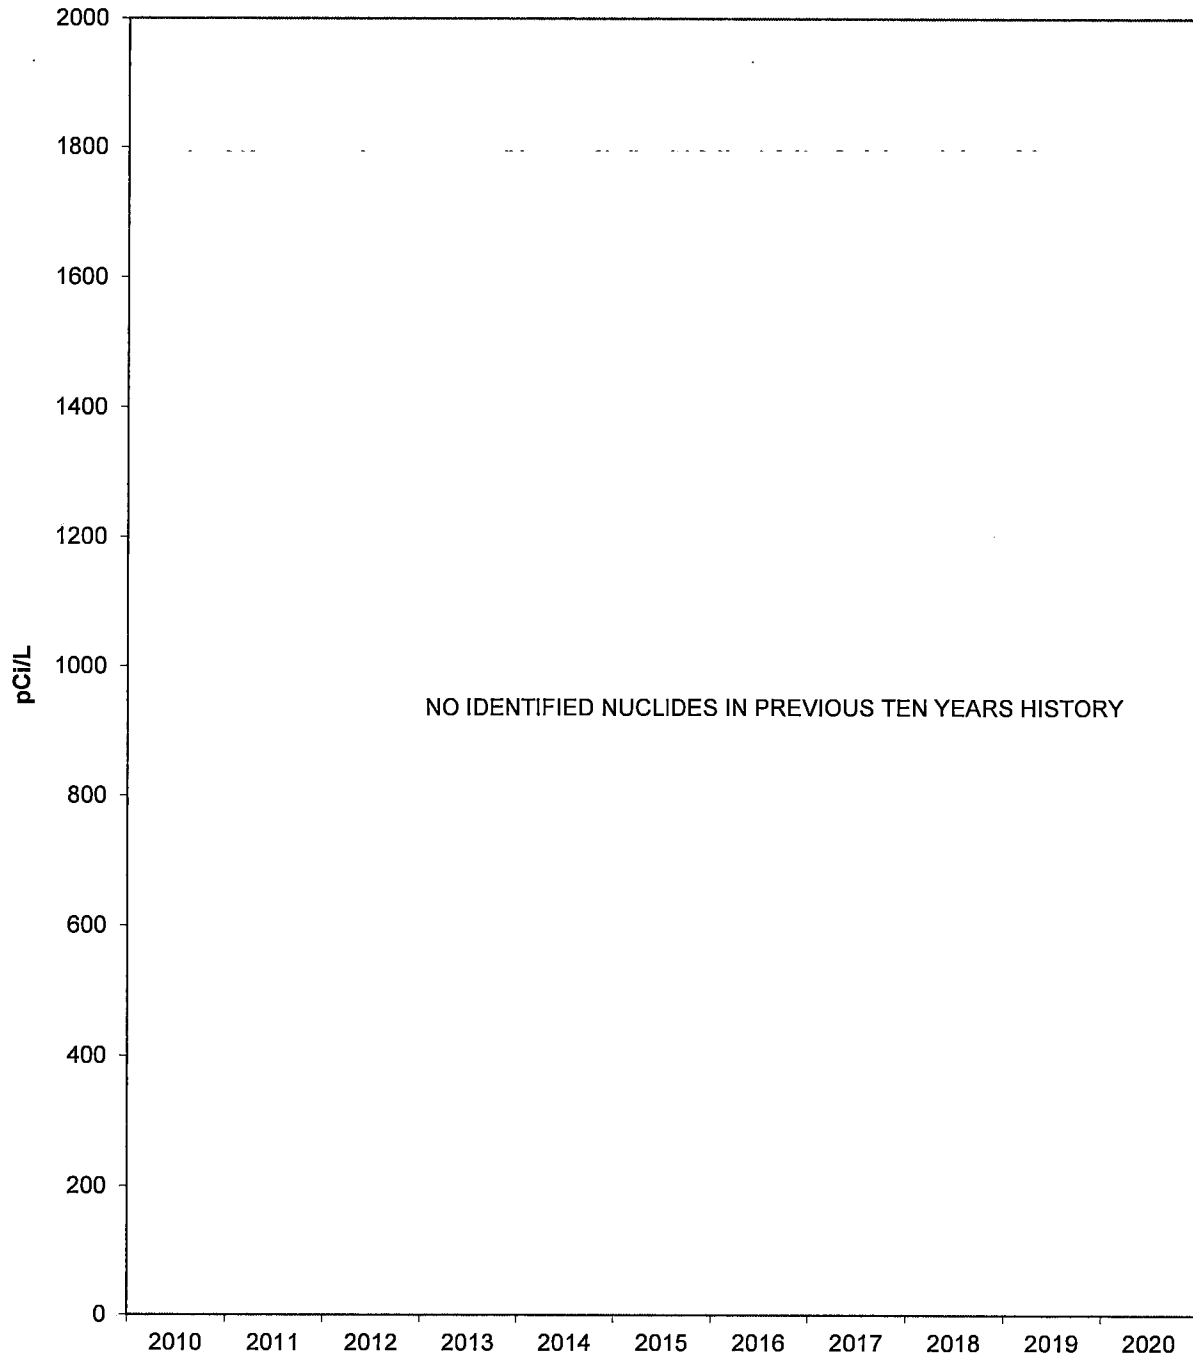


**TABLE C-5
RADIONUCLIDES IN SHORELINE SOIL
2010-2020
(pCi/Kg, dry)**

Year	Cs-134		Cs-137	
	Indicator	Control	Indicator	Control
2010	< Lc	< Lc	154	63
2011	< Lc	< Lc	108	< Lc
2012	< Lc	< Lc	141	< Lc
2013	< Lc	< Lc	133	< Lc
2014	< Lc	< Lc	327	< Lc
2015	< Lc	< Lc	110	< Lc
2016	< Lc	< Lc	< Lc	< Lc
2017	< Lc	< Lc	151	< Lc
2018	< Lc	< Lc	129	< Lc
2019	< Lc	< Lc	104	< Lc
2020	< Lc	< Lc	96	< Lc
Historical Average 2010-2019	< Lc	< Lc	151	63

Critical Level (L_c) is less than the ODCM required LLD.
<L_c indicates no positive values above sample critical level.

Annual Radiological Environmental Operating Report

Figure C-5
RADIONUCLIDES IN SHORELINE SEDIMENT
2010-2020

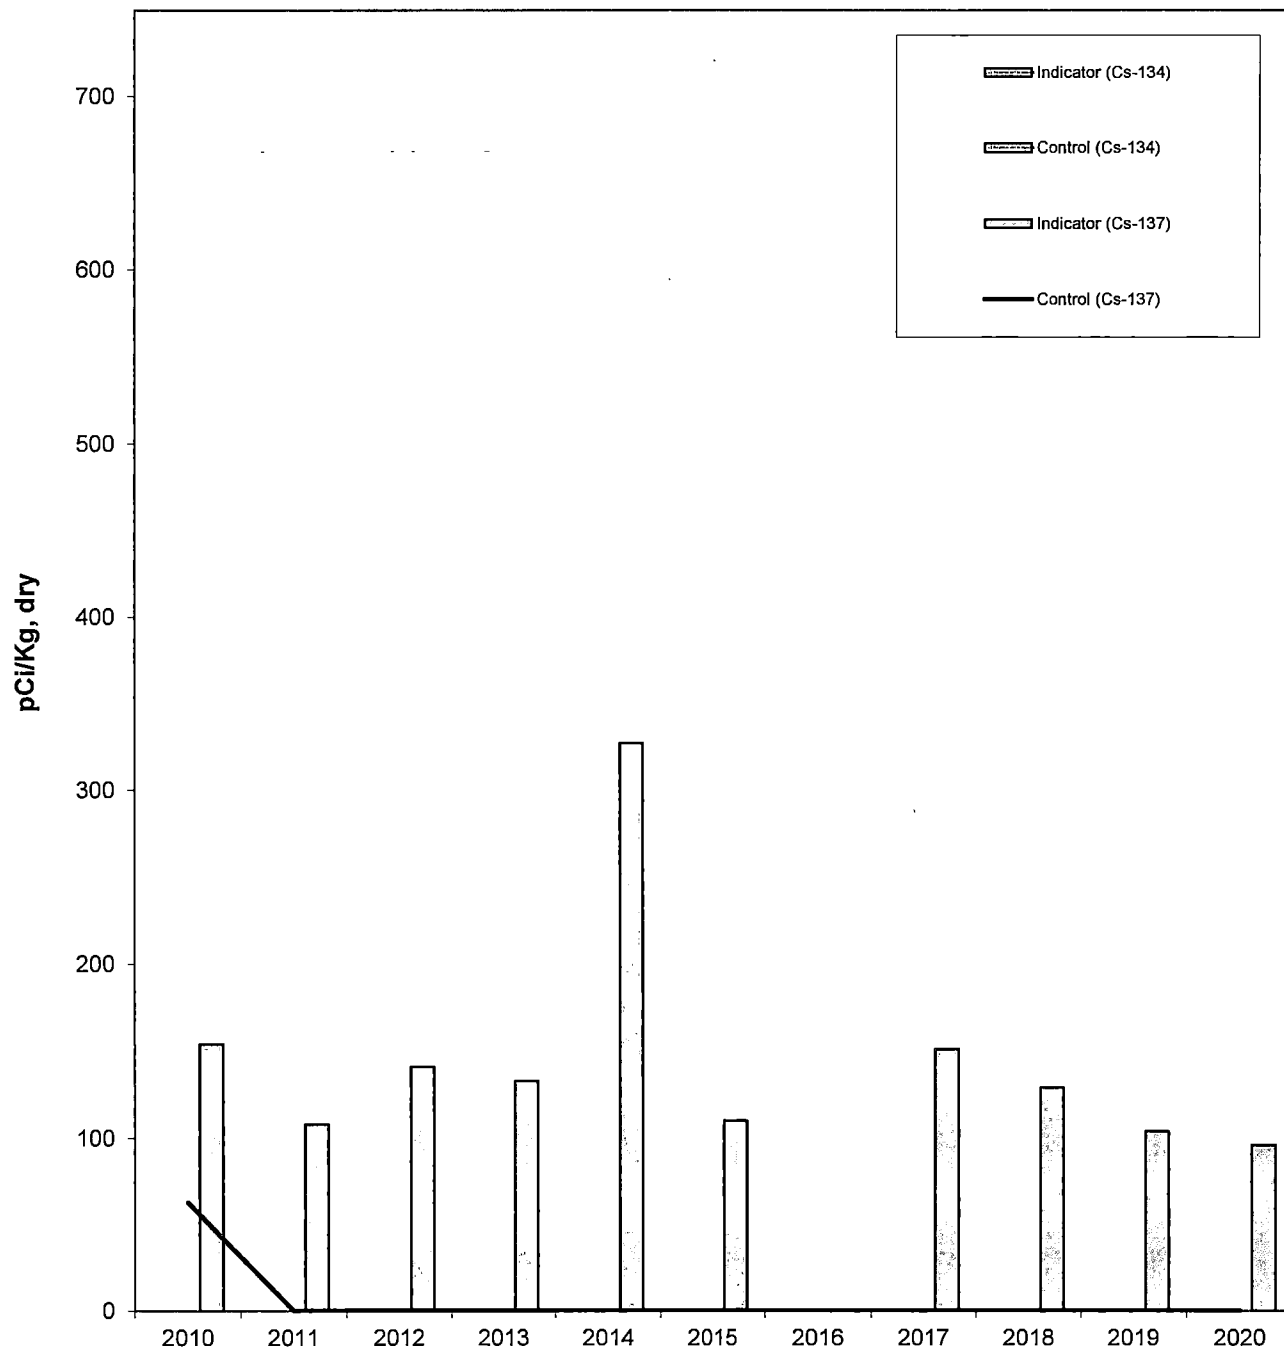

Plant: Indian Point Energy Center	Year: 2020	Page 109 of 128
Annual Radiological Environmental Operating Report		


TABLE C-6
RADIONUCLIDES IN BROAD LEAF VEGETATION
2010-2020
(pCi/Kg, wet)

Cs-137		
Year	Indicator	Control
2010	31	< Lc
2011	< Lc	< Lc
2012	44	< Lc
2013	< Lc	< Lc
2014	< Lc	< Lc
2015	< Lc	< Lc
2016	< Lc	< Lc
2017	< Lc	< Lc
2018	< Lc	< Lc
2019	< Lc	< Lc
2020	< Lc	< Lc
Historical Average 2009-2018	38	< Lc

Critical Level (L_c) is less than the ODCM required LLD.

< L_c indicates no positive values above sample critical level.

Figure C-6
RADIONUCLIDES IN BROAD LEAF VEGETATION
2010-2020

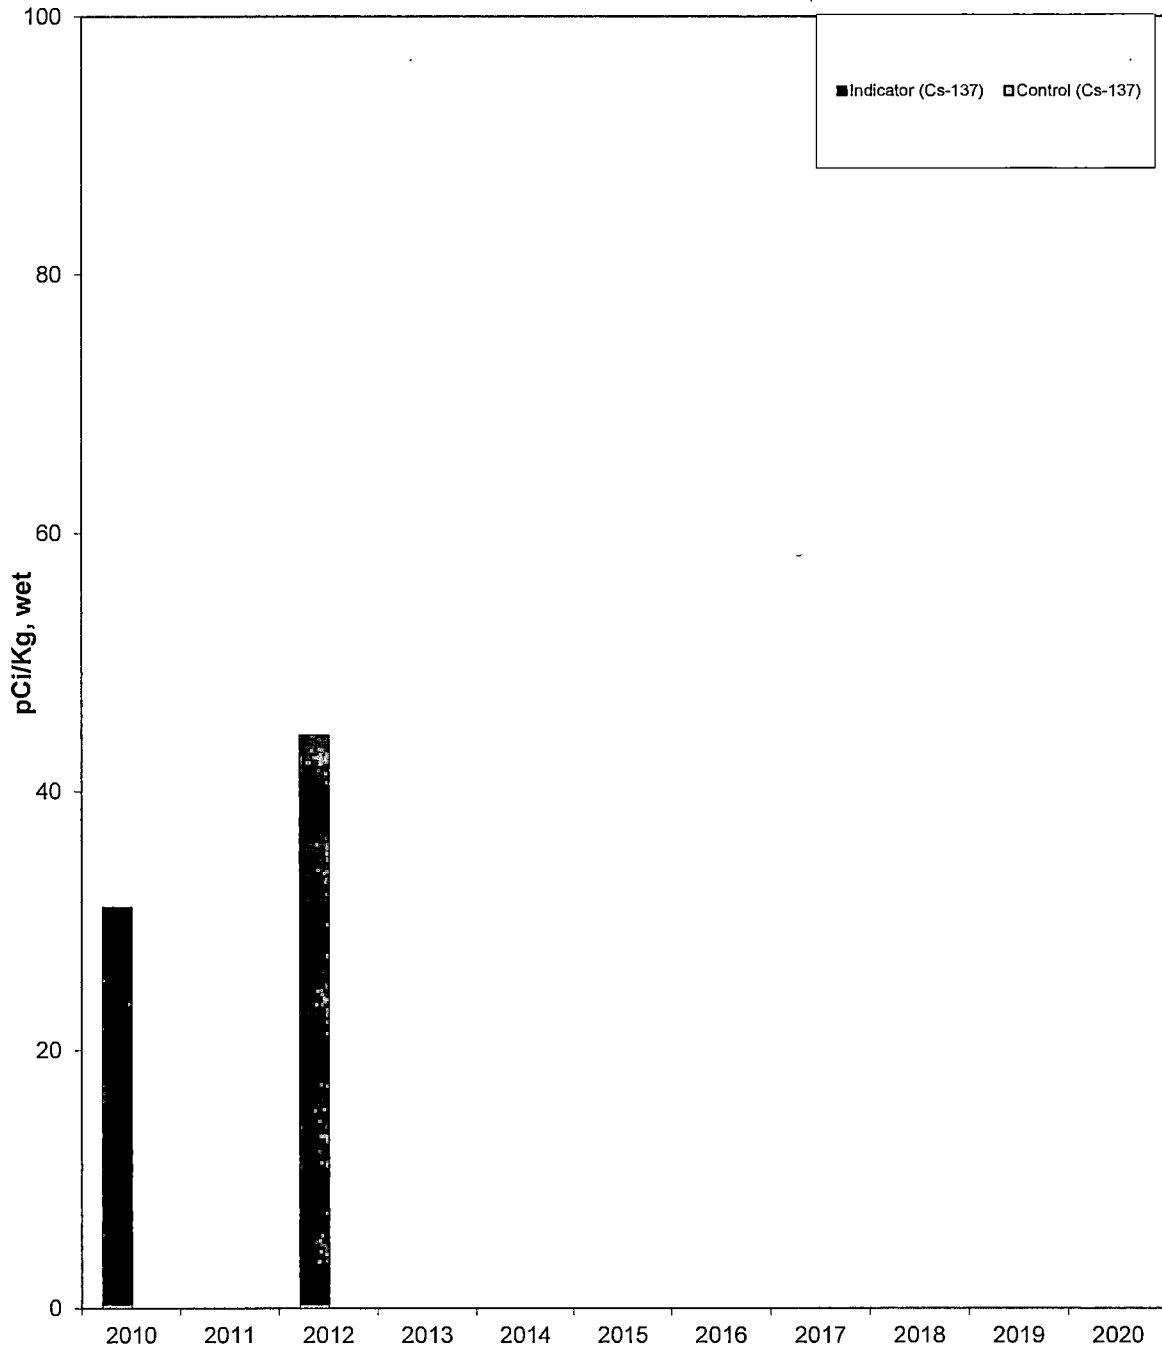

Plant: Indian Point Energy Center	Year: 2020	Page 111 of 128
Annual Radiological Environmental Operating Report		

TABLE C-7
RADIONUCLIDE IN FISH AND INVERTEBRATES
2010-2020
(pCi/Kg, dry)

Cs-137		
Year	Indicator	Control
2010	< Lc	< Lc
2011	< Lc	< Lc
2012	< Lc	< Lc
2013	< Lc	< Lc
2014	< Lc	< Lc
2015	< Lc	< Lc
2016	< Lc	< Lc
2017	< Lc	< Lc
2018	< Lc	< Lc
2019	< Lc	< Lc
2020	< Lc	< Lc
Historical Average 2010-2020	< Lc	< Lc

Critical Level (L_c) is less than the ODCM required LLD.

< L_c indicates no positive values above sample critical level.

Annual Radiological Environmental Operating Report

Figure C-7
RADIONUCLIDES IN FISH AND INVERTEBRATES
2010-2020

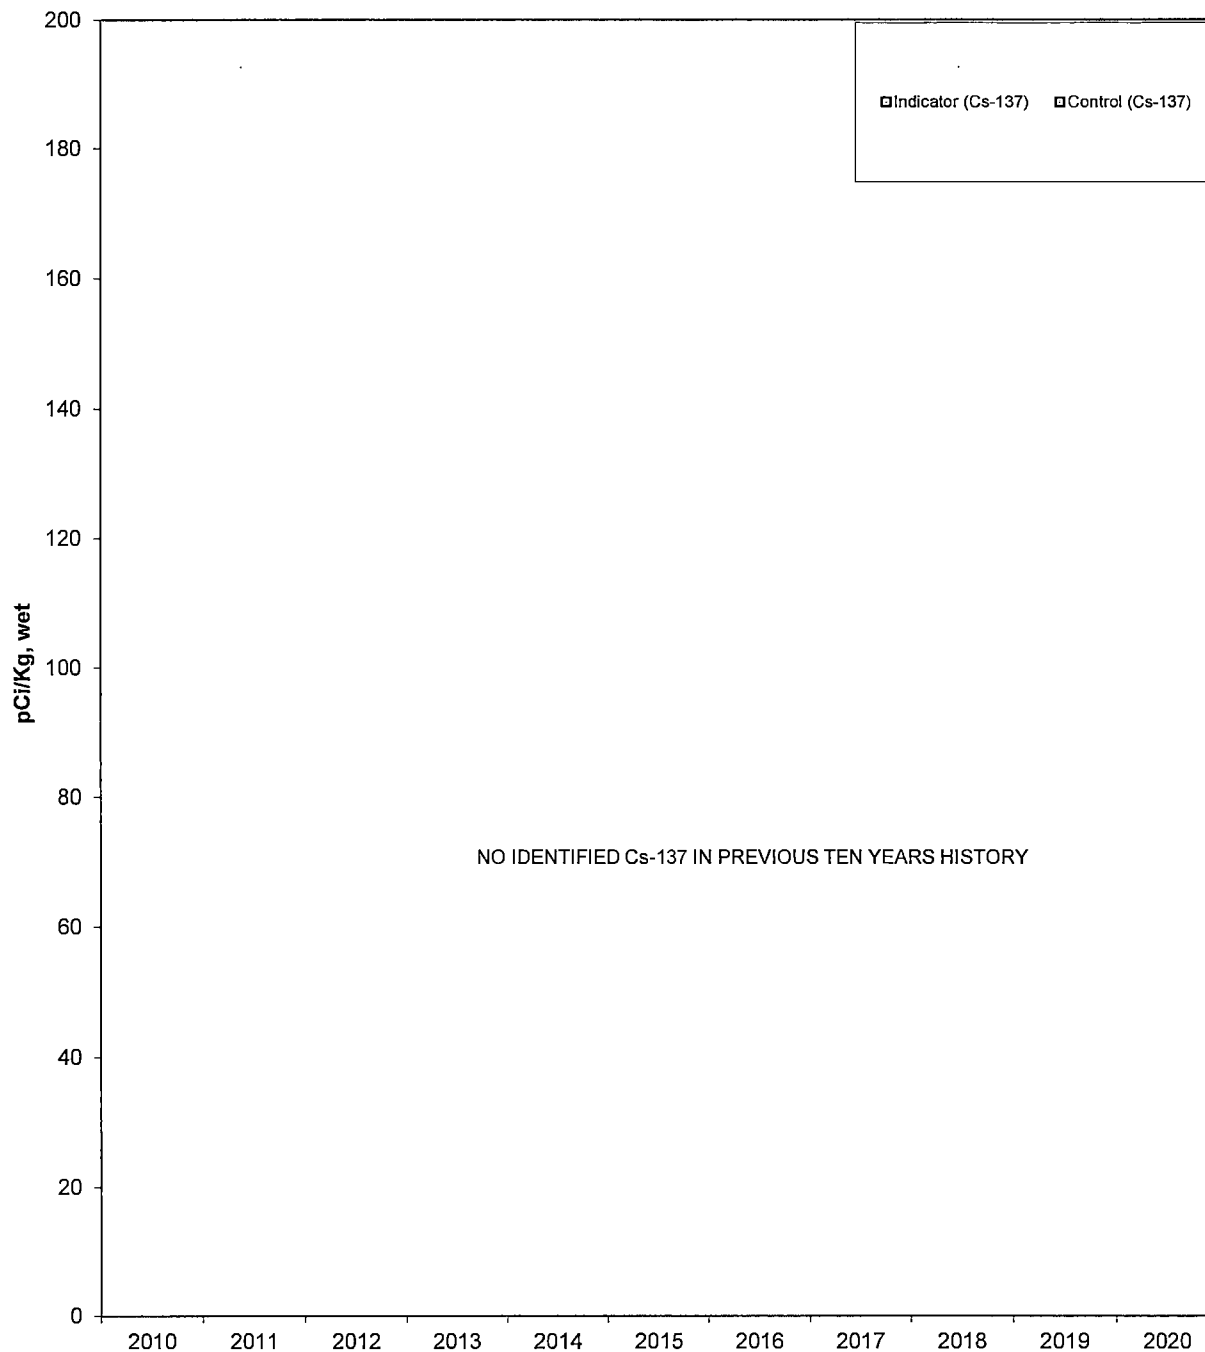


TABLE C-8
RIVER WATER - Discharge Area - Tritium
REMP vs. EFFLUENT
(pCi/L)

Year	REMP*	EFFLUENT **
1Q 2017	216	912
2Q 2017	<191	372
3Q 2017	<179	51
4Q 2017	381	665
1Q 2018	273	659
2Q 2018	326	439
3Q 2018	<197	332
4Q 2018	199	418
1Q 2019	296	484
2Q 2019	294	602
3Q 2019	<187	74
4Q 2019	<181	8
1Q 2020	347	1021
2Q 2020	<176	470
3Q 2020	<177	188
4Q 2020	229	866
Four Year Average, by Quarter, 2017 - 2020	285	473

* Sample from mixing zone, expected to be less than average activity in the discharge canal.

** Based upon Effluent Report data, average activity in the discharge canal calculated from the total H-3 discharged divided by the total dilution volume for the quarter.


TABLE C-9
RADIONUCLIDES IN BOTTOM SEDIMENT
2010-2020
(pCi/Kg, dry)

Cs-137		
Year	Indicator	Control
2010	552	< Lc
2011	287	238
2012	284	< Lc
2013	2738	264
2014	327	< Lc
2015	876	< Lc
2016	224	< Lc
2017	350	< Lc
2018	741	198
2019	190	176
2020	167	207
Historical Average 2010-2019	612	219

Critical Level (L_c) is less than the RETS required LLD.

<L_c indicates no positive values above sample critical level.

Figure C-9
RADIONUCLIDES IN BOTTOM SEDIMENT
2010-2020

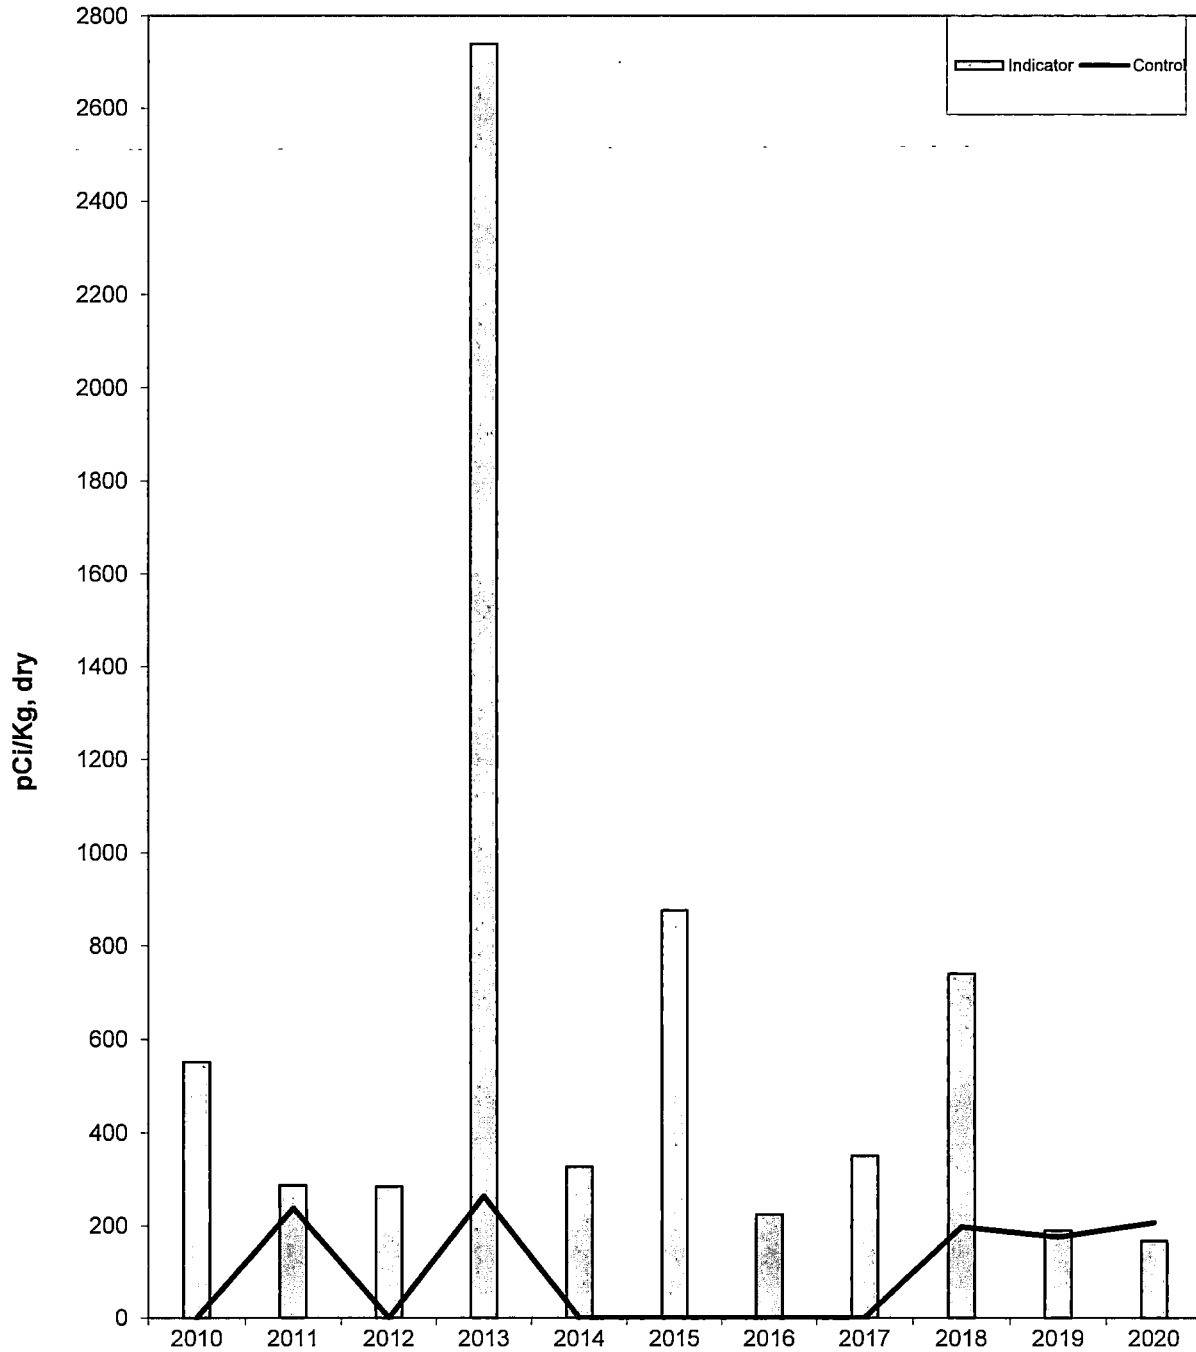

Plant: Indian Point Energy Center	Year: 2020	Page 116 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 7.0

INTERLABORATORY COMPARISON PROGRAM

Plant: Indian Point Energy Center	Year: 2020	Page 117 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

INTERLABORATORY COMPARISON PROGRAM

This section presents the results of the interlaboratory comparison program for the Teledyne Brown Engineering Environmental Services and Environmental Dosimetry Company.

7.1 Program Description – Teledyne Brown Engineering Environmental Services Comparison Programs

The Teledyne Brown Engineering Environmental Services participates in several interlaboratory comparison programs. These programs include sample media for which samples are routinely collected and for which comparison samples are commercially available. Participation in these interlaboratory comparison programs ensure that independent checks on the precision and accuracy of the measurement of radioactive material in the environmental samples are performed as part of the Quality Assurance Program for environmental monitoring. To fulfill the requirement for an Interlaboratory Comparison Program, Teledyne Brown Engineering Environmental Services has engaged the following programs:

- Eckert & Ziegler Analytics Environmental Radioactivity Cross Check Program
- Department of Energy (DOE) Mixed Analyte Performance Evaluation Program (MAPEP)
- Environmental Resource Associates (ERA) Cross Check Program

These programs supply sample media as blind samples (typically spikes), which contain certified levels of radioactivity unknown to the analysis laboratory. These samples are prepared and analyzed by the Teledyne Brown Engineering Environmental Services using standard laboratory procedures. Each program issues a statistical summary report of the results. Teledyne Brown Engineering Environmental Services uses predetermined acceptance criteria methodology for evaluating its laboratory performance.

Teledyne Brown Engineering Environmental Services also analyzes laboratory blanks. The analysis of laboratory blanks provides a means to detect and measure radioactive contamination of analytical samples. The analysis of analytical blanks also provides information on the adequacy of background subtraction. Laboratory blank results are analyzed using control charts.

7.2 Acceptance Criteria

Each sample result is evaluated to determine the accuracy and precision of the laboratory's analysis result. The sample evaluation method is discussed below.

7.2.1 Analytics Sample Results Evaluation

Samples provided by Analytics are evaluated using what is specified as the NRC method. This method is based on the calculation of the ratio of results reported by the participating laboratory (QC result) to the Vendor Laboratory Known value (reference result).

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

An Environmental Laboratory analytical result is evaluated using the following calculation:

The value for the error resolution is calculated.

$$\text{Error Resolution} = \frac{\text{Reference Result}}{\text{Reference Results Error (1 sigma)}}$$

Using the appropriate row under the Error Resolution column in Table D-2.1, a corresponding Ratio of Agreement interval is given for use in Tables D-3.1, D-3.2, and D-3.3

The value for the ratio is then calculated.

$$\text{Ratio of agreement} = \frac{\text{QC Result}}{\text{Reference Result}}$$

If the value falls within the agreement interval, the result is acceptable.

TABLE D-2.1 Ratio of Agreement

ERROR RESOLUTION	RATIO OF AGREEMENT
< 4	No Comparison
4 to 7	0.5-2.0
8 to 15	0.6-1.66
16 to 50	0.75-1.33
51 to 200	0.8-1.25
>200	0.85-1.18

This acceptance test is generally referred to as the "NRC" method. The acceptance criteria are contained in Procedure EN-CY-102. The NRC method generally results in an acceptance range of approximately $\pm 25\%$ of the Known value when applied to sample results from the Eckert & Ziegler Analytics Interlaboratory Comparison Program. This method is used as the procedurally required assessment method and requires the generation of a deviation from QA/QC program report when results are unacceptable.

7.2.2 ERA and MAPEP Sample Result Evaluation

Both these programs supply an acceptance range for evaluating the results.

7.3 Program Results Summary

The Interlaboratory Comparison Program numerical results are summarized in the following tables.

Plant: Indian Point Energy Center	Year: 2020	Page 119 of 128
Annual Radiological Environmental Operating Report		

TABLE D-3.1 **Analytics Environmental Radioactivity Cross Check Program**
Teledyne Brown Engineering Environmental Services

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Ratio of TBE to Known Result	Evaluation ^(b)
September 2020	E13247	Milk	Sr-89	pCi/L	62.8	95.4	0.66	N ⁽¹⁾
			Sr-90	pCi/L	12.0	12.8	0.94	A
	E13248	Milk	Ce-141	pCi/L	156	150	1.04	A
			Co-58	pCi/L	172	180	0.96	A
			Co-60	pCi/L	369	379	0.97	A
			Cr-51	pCi/L	372	372	1.00	A
			Cs-134	pCi/L	171	200	0.85	A
			Cs-137	pCi/L	241	250	0.96	A
			Fe-59	pCi/L	217	200	1.08	A
			I-131	pCi/L	84.6	95.0	0.89	A
			Mn-54	pCi/L	175	180	0.97	A
			Zn-65	pCi/L	252	270	0.93	A
	E13249	Charcoal	I-131	pCi	70.2	75.8	0.93	A
	E13250	AP	Ce-141	pCi	101	101	1.00	A
			Co-58	pCi	111	120	0.92	A
			Co-60	pCi	249	254	0.98	A
			Cr-51	pCi	287	249	1.15	A
			Cs-134	pCi	114	134	0.85	A
			Cs-137	pCi	159	168	0.95	A
			Fe-59	pCi	127	134	0.95	A
			Mn-54	pCi	114	121	0.94	A
			Zn-65	pCi	168	181	0.93	A
	E13251	Soil	Ce-141	pCi/g	0.241	0.191	1.26	W
			Co-58	pCi/g	0.211	0.228	0.93	A
			Co-60	pCi/g	0.466	0.481	0.97	A
			Cr-51	pCi/g	0.450	0.472	0.95	A
			Cs-134	pCi/g	0.273	0.254	1.07	A
			Cs-137	pCi/g	0.370	0.390	0.95	A
			Fe-59	pCi/g	0.233	0.254	0.92	A
			Mn-54	pCi/g	0.217	0.229	0.95	A
			Zn-65	pCi/g	0.368	0.343	1.07	A
	E13252	AP	Sr-89	pCi	79.9	100.0	0.80	A
			Sr-90	pCi	12.1	13.4	0.90	A

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) See **NCR 20-19**

Plant: Indian Point Energy Center	Year: 2020	Page 120 of 128
Annual Radiological Environmental Operating Report		

TABLE D-3.1 Analytics Environmental Radioactivity Cross Check Program
Teledyne Brown Engineering Environmental Services

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Ratio of TBE to Known Result	Evaluation ^(b)
December 2020	E13254	Milk	Sr-89	pCi/L	82.2	89.7	0.92	A
			Sr-90	pCi/L	12.4	13.0	0.96	A
	E13255	Milk	Ce-141	pCi/L	91.1	100	0.91	A
			Co-58	pCi/L	77.5	84.3	0.92	A
			Co-60	pCi/L	147	152	0.97	A
			Cr-51	pCi/L	259	253	1.02	A
			Cs-134	pCi/L	97.1	108	0.90	A
			Cs-137	pCi/L	117	127	0.92	A
			Fe-59	pCi/L	114	112	1.02	A
			I-131	pCi/L	84.3	91.9	0.92	A
			Mn-54	pCi/L	137	143	0.96	A
			Zn-65	pCi/L	175	190	0.92	A
	E13256	Charcoal	I-131	pCi	70.2	78.2	0.90	A
	E13257A	AP	Ce-141	pCi	67.4	74.6	0.90	A
			Co-58	pCi	57.9	62.9	0.92	A
			Co-60	pCi	108	113	0.95	A
			Cr-51	pCi	162	189	0.86	A
			Cs-134	pCi	68.1	80.4	0.85	A
			Cs-137	pCi	82.4	95.0	0.87	A
			Fe-59	pCi	80.5	83.7	0.96	A
			Mn-54	pCi	102	107	0.95	A
			Zn-65	pCi	115	142	0.81	A
	E13258	Soil	Ce-141	pCi/g	0.167	0.170	0.98	A
			Co-58	pCi/g	0.125	0.143	0.87	A
			Co-60	pCi/g	0.245	0.257	0.95	A
			Cr-51	pCi/g	0.393	0.429	0.92	A
			Cs-134	pCi/g	0.147	0.183	0.80	A
			Cs-137	pCi/g	0.260	0.288	0.90	A
			Fe-59	pCi/g	0.199	0.190	1.05	A
			Mn-54	pCi/g	0.229	0.243	0.94	A
			Zn-65	pCi/g	0.320	0.322	0.99	A
	E13259	AP	Sr-89	pCi	85.0	78.6	1.08	A
			Sr-90	pCi	13.1	11.4	1.15	A

(a) The Analytics known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) Analytics evaluation based on TBE internal QC limits:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

Plant: Indian Point Energy Center	Year: 2020	Page 121 of 128
Annual Radiological Environmental Operating Report		

TABLE D-3.2 DOE's Mixed Analyte Performance Evaluation Program (MAPEP)
Teledyne Brown Engineering Environmental Services

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Acceptance Range	Evaluation ^(b)
February 2020	20-GrF42	AP	Gross Alpha	Bq/sample	0.676	1.24	0.37 - 2.11	A
			Gross Beta	Bq/sample	2.03	2.00	1.00 - 3.00	A
	20-MaS42	Soil	Ni-63	Bq/kg	0.01		(1)	A
			Sr-90	Bq/kg	348	340	238 - 442	A
	20-MaW42	Water	Ni-63	Bq/L	11.6	11.1	7.8 - 14.4	A
			Pu-238	Bq/L	0.926	0.94	0.66 - 1.22	A
			Pu-239/240	Bq/L	0.712	0.737	0.516 - 0.958	A
	20-RdF42	AP	U-234/233	Bq/sample	0.0416	0.075	0.053 - 0.098	N ⁽³⁾
			U-238	Bq/sample	0.0388	0.078	0.055 - 0.101	N ⁽³⁾
	20-RdV42	Vegetation	Cs-134	Bq/sample	3.23	3.82	2.67 - 4.97	A
			Cs-137	Bq/sample	2.64	2.77	1.94 - 3.60	A
			Co-57	Bq/sample	0.0281		(1)	A
			Co-60	Bq/sample	2.62	2.79	1.95 - 3.63	A
			Mn-54	Bq/sample	4.3	4.58	3.21 - 5.95	A
			Sr-90	Bq/sample	0.396	0.492	0.344 - 0.640	A
			Zn-65	Bq/sample	3.93	3.79	2.65 - 4.93	A
August 2020	20-GrF43	AP	Gross Alpha	Bq/sample	0.267	0.528	0.158 - 0.989	A
			Gross Beta	Bq/sample	0.939	0.915	0.458 - 1.373	A
	20-MaS43	Soil	Ni-63	Bq/kg	438	980	686 - 1274	N ⁽⁴⁾
			Tc-99	Bq/kg	1.11		(1)	A
	20-MaW43	Water	Ni-63	Bq/L	0.175		(1)	A
			Tc-99	Bq/L	8.8	9.4	6.6 - 12.2	A
	20-RdV43	Vegetation	Cs-134	Bq/sample	3.635	4.94	3.46 - 6.42	W
			Cs-137	Bq/sample	0.0341		(1)	A
			Co-57	Bq/sample	5.855	6.67	4.67 - 8.67	W
			Co-60	Bq/sample	3.122	4.13	2.89 - 5.37	W
			Mn-54	Bq/sample	4.524	5.84	4.09 - 7.59	A
			Sr-90	Bq/sample	1.01	1.39	0.97 - 1.81	W
			Zn-65	Bq/sample	4.706	6.38	4.47 - 8.29	W

(a) The MAPEP known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation

(b) DOE/MAPEP evaluation:

A = Acceptable - reported result falls within ratio limits of 0.80-1.20

W = Acceptable with warning - reported result falls within 0.70-0.80 or 1.20-1.30

N = Not Acceptable - reported result falls outside the ratio limits of < 0.70 and > 1.30

(1) False positive test

(2) Sensitivity evaluation

(3) See **NCR 20-13**

(4) See **NCR 20-20**

Plant: Indian Point Energy Center	Year: 2020	Page 122 of 128
Annual Radiological Environmental Operating Report		

TABLE D-3.3 **ERA Environmental Radioactivity Cross Check Program**
Teledyne Brown Engineering Environmental Services

Month/Year	Identification Number	Matrix	Nuclide	Units	TBE Value	Known Value ^(a)	Acceptance Limits	Evaluation ^(b)	
March 2020	MRAD-32	Water	Am-241	pCi/L	52.5	45.3	31.1 - 57.9	A	
			Fe-55	pCi/L	155	152	89.3 - 221	A	
			Pu-238	pCi/L	34.0	36.4	21.9 - 47.2	A	
			Pu-239	pCi/L	30.9	33.6	20.8 - 41.4	A	
April 2020	RAD-121	Water	Ba-133	pCi/L	41.8	41.8	34.0- 46.7	A	
			Cs-134	pCi/L	42.9	46.3	37.1 - 50.9	A	
			Cs-137	pCi/L	226	234	211 - 259	A	
			Co-60	pCi/L	52.4	50.3	45.3 - 57.9	A	
			Zn-65	pCi/L	83.3	86.8	78.1 - 104	A	
			GR-A	pCi/L	20.1	23.6	11.9 - 31.6	A	
			GR-B	pCi/L	45.6	60.5	41.7 - 67.2	A	
			U-Nat	pCi/L	18.45	18.6	14.9 - 20.9	A	
			H-3	pCi/L	14200	14100	12300 - 15500	A	
			Sr-89	pCi/L	58.0	60.1	48.3 - 67.9	A	
			Sr-90	pCi/L	34.1	44.7	33.0 - 51.2	A	
			I-131	pCi/L	27.4	28.9	24.1 - 33.8	A	
September 2020	MRAD-33	Soil	Sr-90	pCi/Kg	4360	4980	1550 - 7760	A	
			AP	Fe-55	pCi/Filter	189	407	149 - 649	A
				U-234	pCi/Filter	17.9	18.3	13.6 - 21.4	A
				U-238	pCi/Filter	19.1	18.1	13.7 - 21.6	A
		Water		Am-241	pCi/L	160	176	121 - 225	A
			Fe-55	pCi/L	299	298	175 - 433	A	
			Pu-238	pCi/L	200	191	115 - 247	A	
			Pu-239	pCi/L	105	100	61.9 - 123	A	
October 2020	RAD-123	Water	Ba-133	pCi/L	37.1	37.0	29.8 - 41.6	A	
			Cs-134	pCi/L	50.6	52.7	42.5 - 58.0	A	
			Cs-137	pCi/L	131	131	118 - 146	A	
			Co-60	pCi/L	62.9	60.5	54.4 - 69.1	A	
			Zn-65	pCi/L	167	162	146 - 191	A	
			GR-A	pCi/L	40.0	26.2	13.3 - 34.7	N ⁽¹⁾	
			GR-B	pCi/L	47.5	69.1	48.0 - 76.0	N ⁽¹⁾	
			U-Nat	pCi/L	17.2	20.3	16.3 - 22.7	A	
			H-3	pCi/L	23800	23200	20,300 - 25,500	A	
			Sr-89	pCi/L	41.1	43.3	33.4 - 50.5	A	
			Sr-90	pCi/L	28.5	30.2	22.0 - 35.0	A	
			I-131	pCi/L	22.9	28.2	23.5 - 33.1	N ⁽²⁾	
November 2020	QR111920K	Water	GR-A	pCi/L	50.7	52.4	27.3 - 65.6	A	
			GR-B	pCi/L	24.9	24.3	15.0 - 32.3	A	

(a) The ERA known value is equal to 100% of the parameter present in the standard as determined by gravimetric and/or volumetric measurements made during standard preparation.

(b) ERA evaluation:

A = Acceptable - Reported value falls within the Acceptance Limits

N = Not Acceptable - Reported value falls outside of the Acceptance Limits

(1) See **NCR 20-18**

(2) See **NCR 20-17**

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT**7.4 Environmental TLD Quality Assurance**

Environmental dosimetry services for the reporting period of January – December, 2020 were provided by the Environmental Dosimetry Company (EDC), Sterling, Massachusetts. The TLD systems at the Environmental Dosimetry Company (EDC) are calibrated and operated to ensure consistent and accurate evaluation of TLDs. The quality of the dosimetric results reported to EDC clients is ensured by in house performance testing and independent performance testing by EDC clients.

The purpose of the dosimetry quality assurance program is to provide performance documentation of the routine processing of EDC dosimeters. Performance testing provides a statistical measure of the bias and precision of dosimetry processing against a reliable standard, which in turn points out any trends or performance changes. Dosimetry quality control tests are performed on EDC Panasonic 814 Environmental dosimeters. These tests include: (1) the in house testing program conducted by the EDC QA Officer and (2) independent test perform by EDC clients.

Excluded from this report are instrumentation checks. Although instrumentation checks represent an important aspect of the quality assurance program, they are not included as process checks in this report. Instrumentation checks represent between 5-10% of the TLDs processed.

Table D-4.1 provides a summary of individual dosimeter results evaluated against the EDC internal acceptance criteria for high-energy photons (Cs-137) only. The internal acceptance (tolerance) criteria for the Panasonic Environmental dosimeters are: $\pm 15\%$ for bias and $\pm 12.8\%$ for precision. During this period, 100% (72/72) of the individual dosimeters, evaluated against these criteria met the tolerance limits for accuracy and 100% (72/72) met the criterion for precision.

Table D-4.2 provides the Bias + Standard deviation results for each group (N=6) of dosimeters evaluated against the internal tolerance criteria. Overall, 100% (12/12) of the dosimeter sets evaluated against the internal tolerance performance criteria met these criteria.

Table D-4.3 presents the independent blind spike results for irradiated dosimeters provided by client utilities during this annual period. All results passed the performance acceptance criterion.

TABLE D-4.1

**PERCENTAGE OF INDIVIDUAL DOSIMETERS THAT PASSED EDC INTERNAL CRITERIA
JANUARY – DECEMBER 2020 ^{(1), (2)}**

Dosimeter Type	Number Tested	% Passed Bias Criteria	% Passed Precision Criteria
Panasonic Environmental	72	100	100

⁽¹⁾This table summarizes results of tests conducted by EDC.

⁽²⁾Environmental dosimeter results are free in air.

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

TABLE D-4.2

MEAN DOSIMETER ANALYSES (N=6)
JANUARY – DECEMBER 2020 ^{(1), (2)}

Process Date	Mean Bias %	Standard Deviation %	Tolerance Limit +/-15%
4/28/2020	1.8	1.2	Pass
5/02/2020	2.9	1.4	Pass
5/20/2020	-0.5	1.4	Pass
7/28/2020	4.1	0.6	Pass
8/07/2020	4.0	1.3	Pass
9/24/2020	-4.6	1.2	Pass
10/24/2020	5.2	1.6	Pass
10/28/2020	1.6	0.7	Pass
11/18/2020	0.5	1.6	Pass
01/21/2021	3.8	1.7	Pass
02/09/2021	0.3	0.8	Pass
02/16/2021	5.3	1.5	Pass

⁽¹⁾This table summarizes results of tests conducted by EDC for TLDs issued in 2020.

⁽²⁾Environmental dosimeter results are free in air.

TABLE D-4.3

SUMMARY OF INDEPENDENT DOSIMETER TESTING
JANUARY – DECEMBER 2020 ^{(1), (2)}

Issuance Period	Client	Mean Bias %	Standard Deviation %	Pass / Fail
1 st Qtr. 2020	Millstone	-3.8	3.0	Pass
2 nd Qtr.2020	Seabrook	0.5	1.4	Pass
2 nd Qtr.2020	Millstone	-3.0	1.6	Pass
3 rd Qtr. 2020	Millstone	0.4	2.6	Pass
4 th Qtr.2020	PSEG(PNNL)	-3.2	0.9	Pass
4 th Qtr.2020	Seabrook	6.9	1.9	Pass
4 th Qtr.2020	SONGS	-8.4	1.3	Pass
4 th Qtr.2020	Millstone	3.0	1.9	Pass

⁽¹⁾Performance criteria are +/- 30%.

⁽²⁾Blind spike irradiations using Cs-137

Plant: Indian Point Energy Center	Year: 2020	Page 125 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

SECTION 8.0

REFERENCES

Plant: Indian Point Energy Center	Year: 2020	Page 126 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

8.0 REFERENCES

1. United States of America, Code of Federal Regulations, Title 10, Part 50, Appendix A Criteria 64.
2. Currie, L.A., "Limits for Qualitative Detection of Quantitative Determination", Analytical Chemistry, 40:586-593, 1968.
3. Mayer, Dauer, "Application of Systematic Error Bounds to Detection Limits for Practical Counting", Health Physics Journal, 65(1): 89-91, 1993.
4. U.S. Nuclear Regulatory Commission, Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program," Revision 1, November 1979.
5. Wetherbee, Gregory A., et.al., Wet Deposition of Fission-Product Isotopes to North America from the Fukushima Dai-ichi Incident, March 2012, Environmental Science and Technology.
6. IPEC Offsite Dose Calculation Manual, Units 1, 2 and 3.
7. United States of America, Code of Federal Regulations, Title 10.
8. United States of America, Code of Federal Regulations, Title 40.
9. U.S. Nuclear Regulatory Commission, Regulatory Guide 4.1, "Program for Monitoring Radioactivity in the Environs of Nuclear Power Plants," Revision 1, April 1975.
10. U.S. Nuclear Regulatory Commission, Regulatory Guide 4.1, Radiological Environmental Monitoring for Nuclear Power Plants, Revision 2, June 2009.
11. Entergy Nuclear Indian Point, Radiological Environmental Monitoring Chemistry Procedures.
12. U.S. Nuclear Regulatory Commission, Regulatory Guide 4.8, Environmental Technical Specifications for Nuclear Power Plants, December 1975.
13. Eisenbud, M., Environmental Radioactivity, Academic Press, New York, 1987.
14. Glasstone, S., and W. H. Jordan, Nuclear Power and Its Environmental Effects, American Nuclear Society, La Grange Park, IL, 1980.
15. Cohen N., and Eisenbud M., Radiological Studies of the Hudson River, Progress Report Institute of Environmental Medicine, New York University Medical Center, December 1983.
16. U.S. Nuclear Regulatory Commission. Regulatory Guide 4.15, Revision 1, Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment February 1979.

Plant: Indian Point Energy Center	Year: 2020	Page 127 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

17. J. W. Poston, Cesium-137 and Other Man-Made Radionuclides in the Hudson River: A Review of the Available Literature, Applied Physical Technology, Inc., report to NYPA, September 1977.
18. U.S. Environmental Protection Agency Report EPC-520/1 80-012, Upgrading Environmental Radiation Data, August 1980.
19. Andrews, Howard L. and Lapp, Ralph E. Nuclear Radiation Physics, Prentice-Hall, Inc., Englewood Cliffs, New Jersey, 1972.
20. U.S. Nuclear Regulatory Commission, Branch Technical Position to Regulatory Guide 4.8, An Acceptable Radiological Environmental Monitoring Program, November 1979.
21. Eichholz, Geoffrey G., Environmental Aspects of Nuclear Power, Lewis Publishers, Inc., Chelsea, Michigan, 1985.
22. Kelly, J. J. (Ed.), Effluent and Environmental Radiation Surveillance, ASTM STP #698, Philadelphia, PA, 1978.
23. Knoll, Glenn F., Radiation Detection and Measurement, first edition, John Wiley and Sons, New York, 1979.
24. Dixon, Wilfred J., Introduction to Statistical Analysis, third edition, McGraw-Hill Inc., 1969.
25. National Council on Radiation Protection. NCRP Report No. 94, Exposure of the Population in the United States and Canada from Natural Background Radiation December 1987.
26. National Council on Radiation Protection. NCRP Report No. 62, Tritium in the Environment, March 1979.
27. Kuhn, W., et al., The Influence of Soil Parameters on Cs-137 Uptake by Plants from Long-Term Fallout on Forest Clearings and Grasslands, Health Physics Journal, 46(5), p. 1083, May 1984.
28. Garner, J., et al., High Radiocesium Levels in Granite Outcrop Vegetation and Reductions Through Time, Health Physics Journal, 60(4), p. 533, April 1991.
29. McGee, E., et al., The Variability in Fallout Content of Soils and Plants and the Design of Optimum Field Sampling Strategies, Health Physics Journal, 68(3), March 1995.
30. Consolidated Edison Company of New York, Safety Evaluation for Amendment #45 to Unit 1 Provisional Operating License, January 1996.
31. U.S Nuclear Regulatory Commission, Regulatory Guide 4.13, Performance, Testing, and Procedural Specifications for Thermoluminescence Dosimetry: Environmental Applications, November 1979.

Plant: Indian Point Energy Center	Year: 2020	Page 128 of 128
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT		

32. Office of Environmental Management, Semi-Annual Report of the Department of Energy, Quality Assessment Program, EML 617, June 2003.
33. Office of Environmental Management, Semi-Annual Report of the Department of Energy, Quality Assessment Program, EML 618, December 2003.
34. McFarland, R.C., et al., The Counting Room: Special Edition, Radioactivity and Radiochemistry, Caretaker Publications, Atlanta, Georgia, 1994.
35. Bevington, P.R., Data Reduction and Error Analysis for the Physical Sciences, McGraw Hill, 1969.
36. ENN-LI-102, Corrective Action Process
37. Technical Information Document 2003-011 "Justification for the Removal of the Radiological Environmental Monitoring Blind Spike Program at IPEC"
38. National Council on Radiation Protection and Measurements, Report No. 169, "Design of Effective Radiological Effluent Monitoring and Environmental Surveillance Programs", December 2010.
39. Donald T. Oakley, "Natural Radiation Exposure in the United States." U. S. Environmental Protection Agency, ORP/SID 72-1, June 1972.
40. National Council on Radiation Protection and Measurements, Report No. 160, "Ionizing Radiation Exposures of the Population of the United States," March 2009.
41. National Council on Radiation Protection and Measurements, Report No. 94, "Exposure of the Population of the United States and Canada from Natural Background Radiation," December 1987.
42. U.S. Nuclear Regulatory Commission, Regulatory Guide 8.29, "Instructions Concerning Risks from Occupational Radiation Exposure," Revision 0, July 1981.
43. U.S. Nuclear Regulatory Commission, NUREG-1301, "Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors," April 1991.
44. NYS Department of Environmental Conservation, "Measurement of Strontium and Other Radionuclides in Edible Tissue and Bone/carapace of Fish and Blue Crabs from the Lower Hudson River, New York", November 2009.