


BALTIMORE
GAS & ELECTRIC CO.
Calvert Cliffs
Nuclear Power Plant

REACTOR COOLANT PUMP FLOW
TEST INSTRUMENTATION

Figure A
Rev. 18

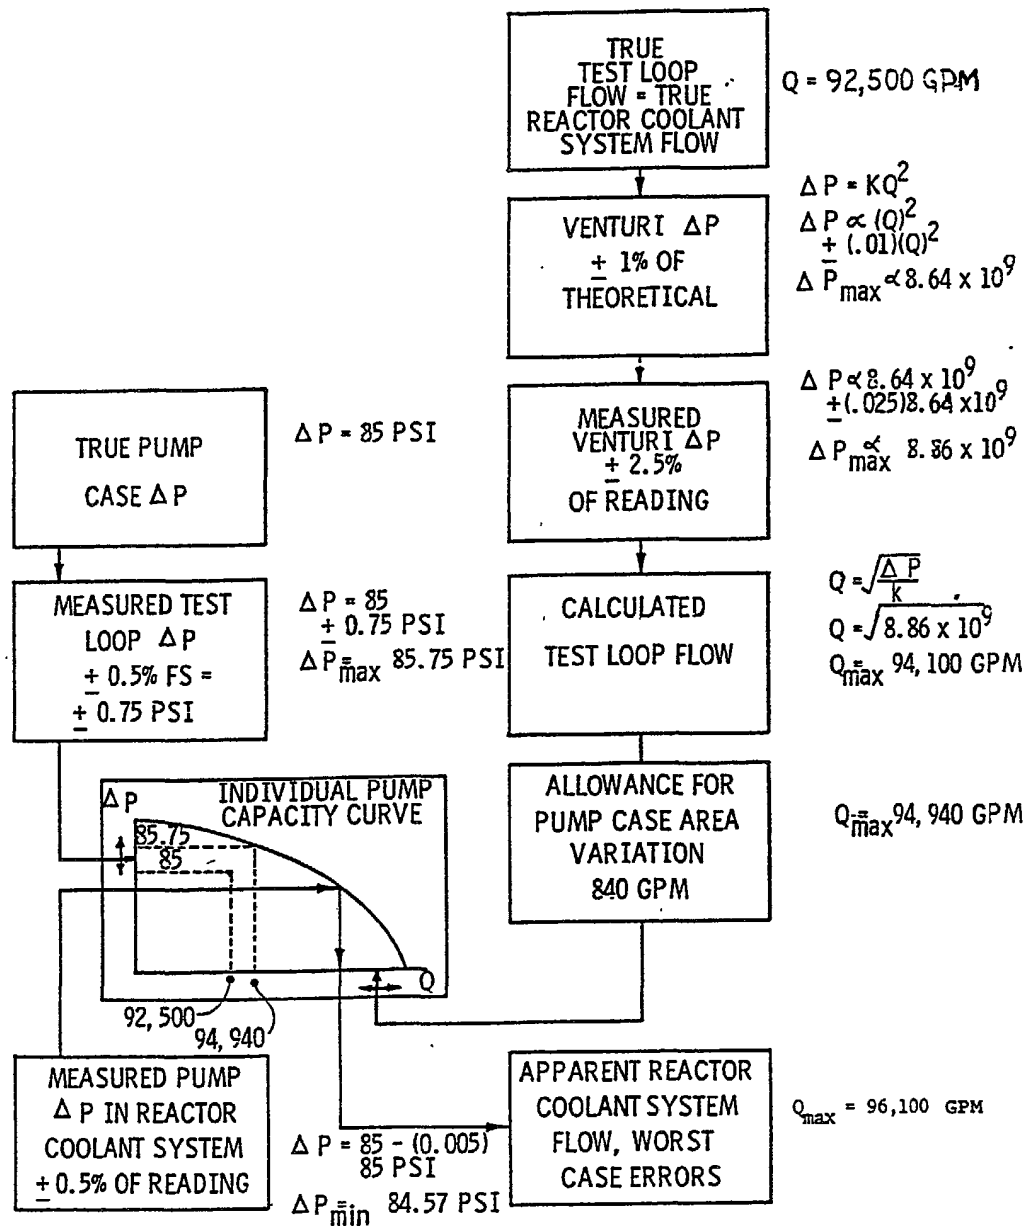

BALTIMORE
GAS & ELECTRIC CO.
Calvert Cliffs
Nuclear Power Plant

ERROR IN ESTABLISHMENT OF FLOW

Figure B
Rev. 18