



BFN-19

Figure 7.3-1

(Deleted by Amendment 17)

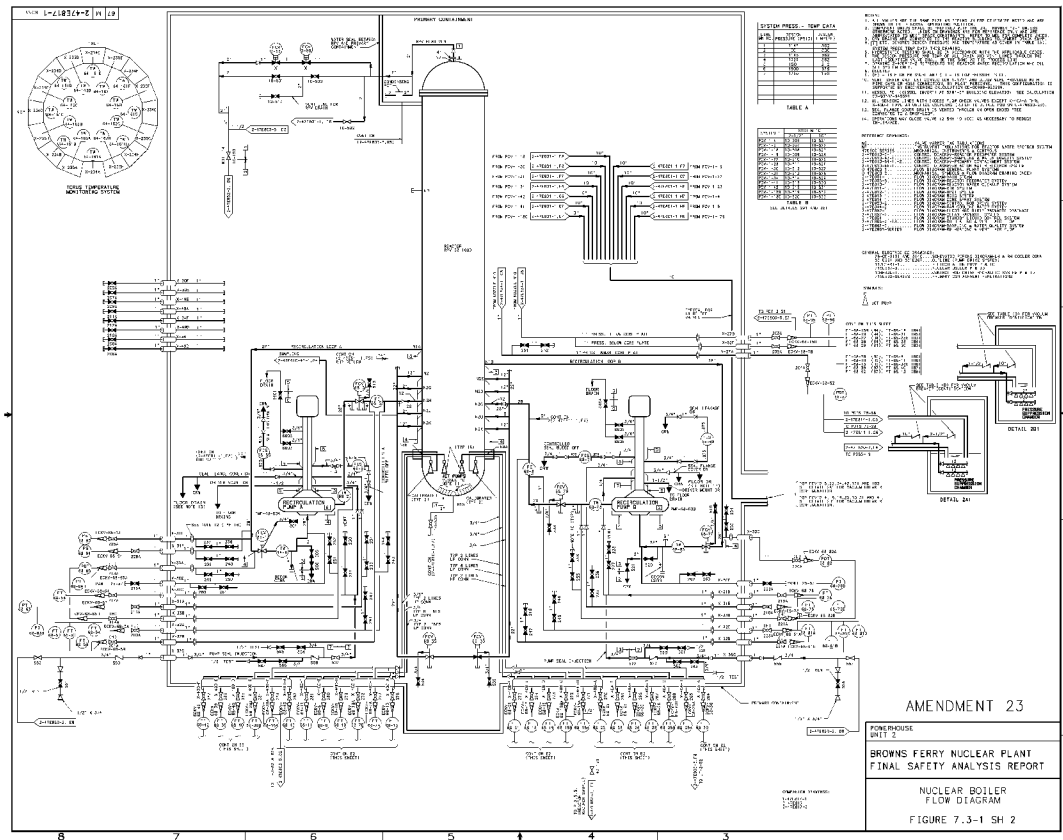

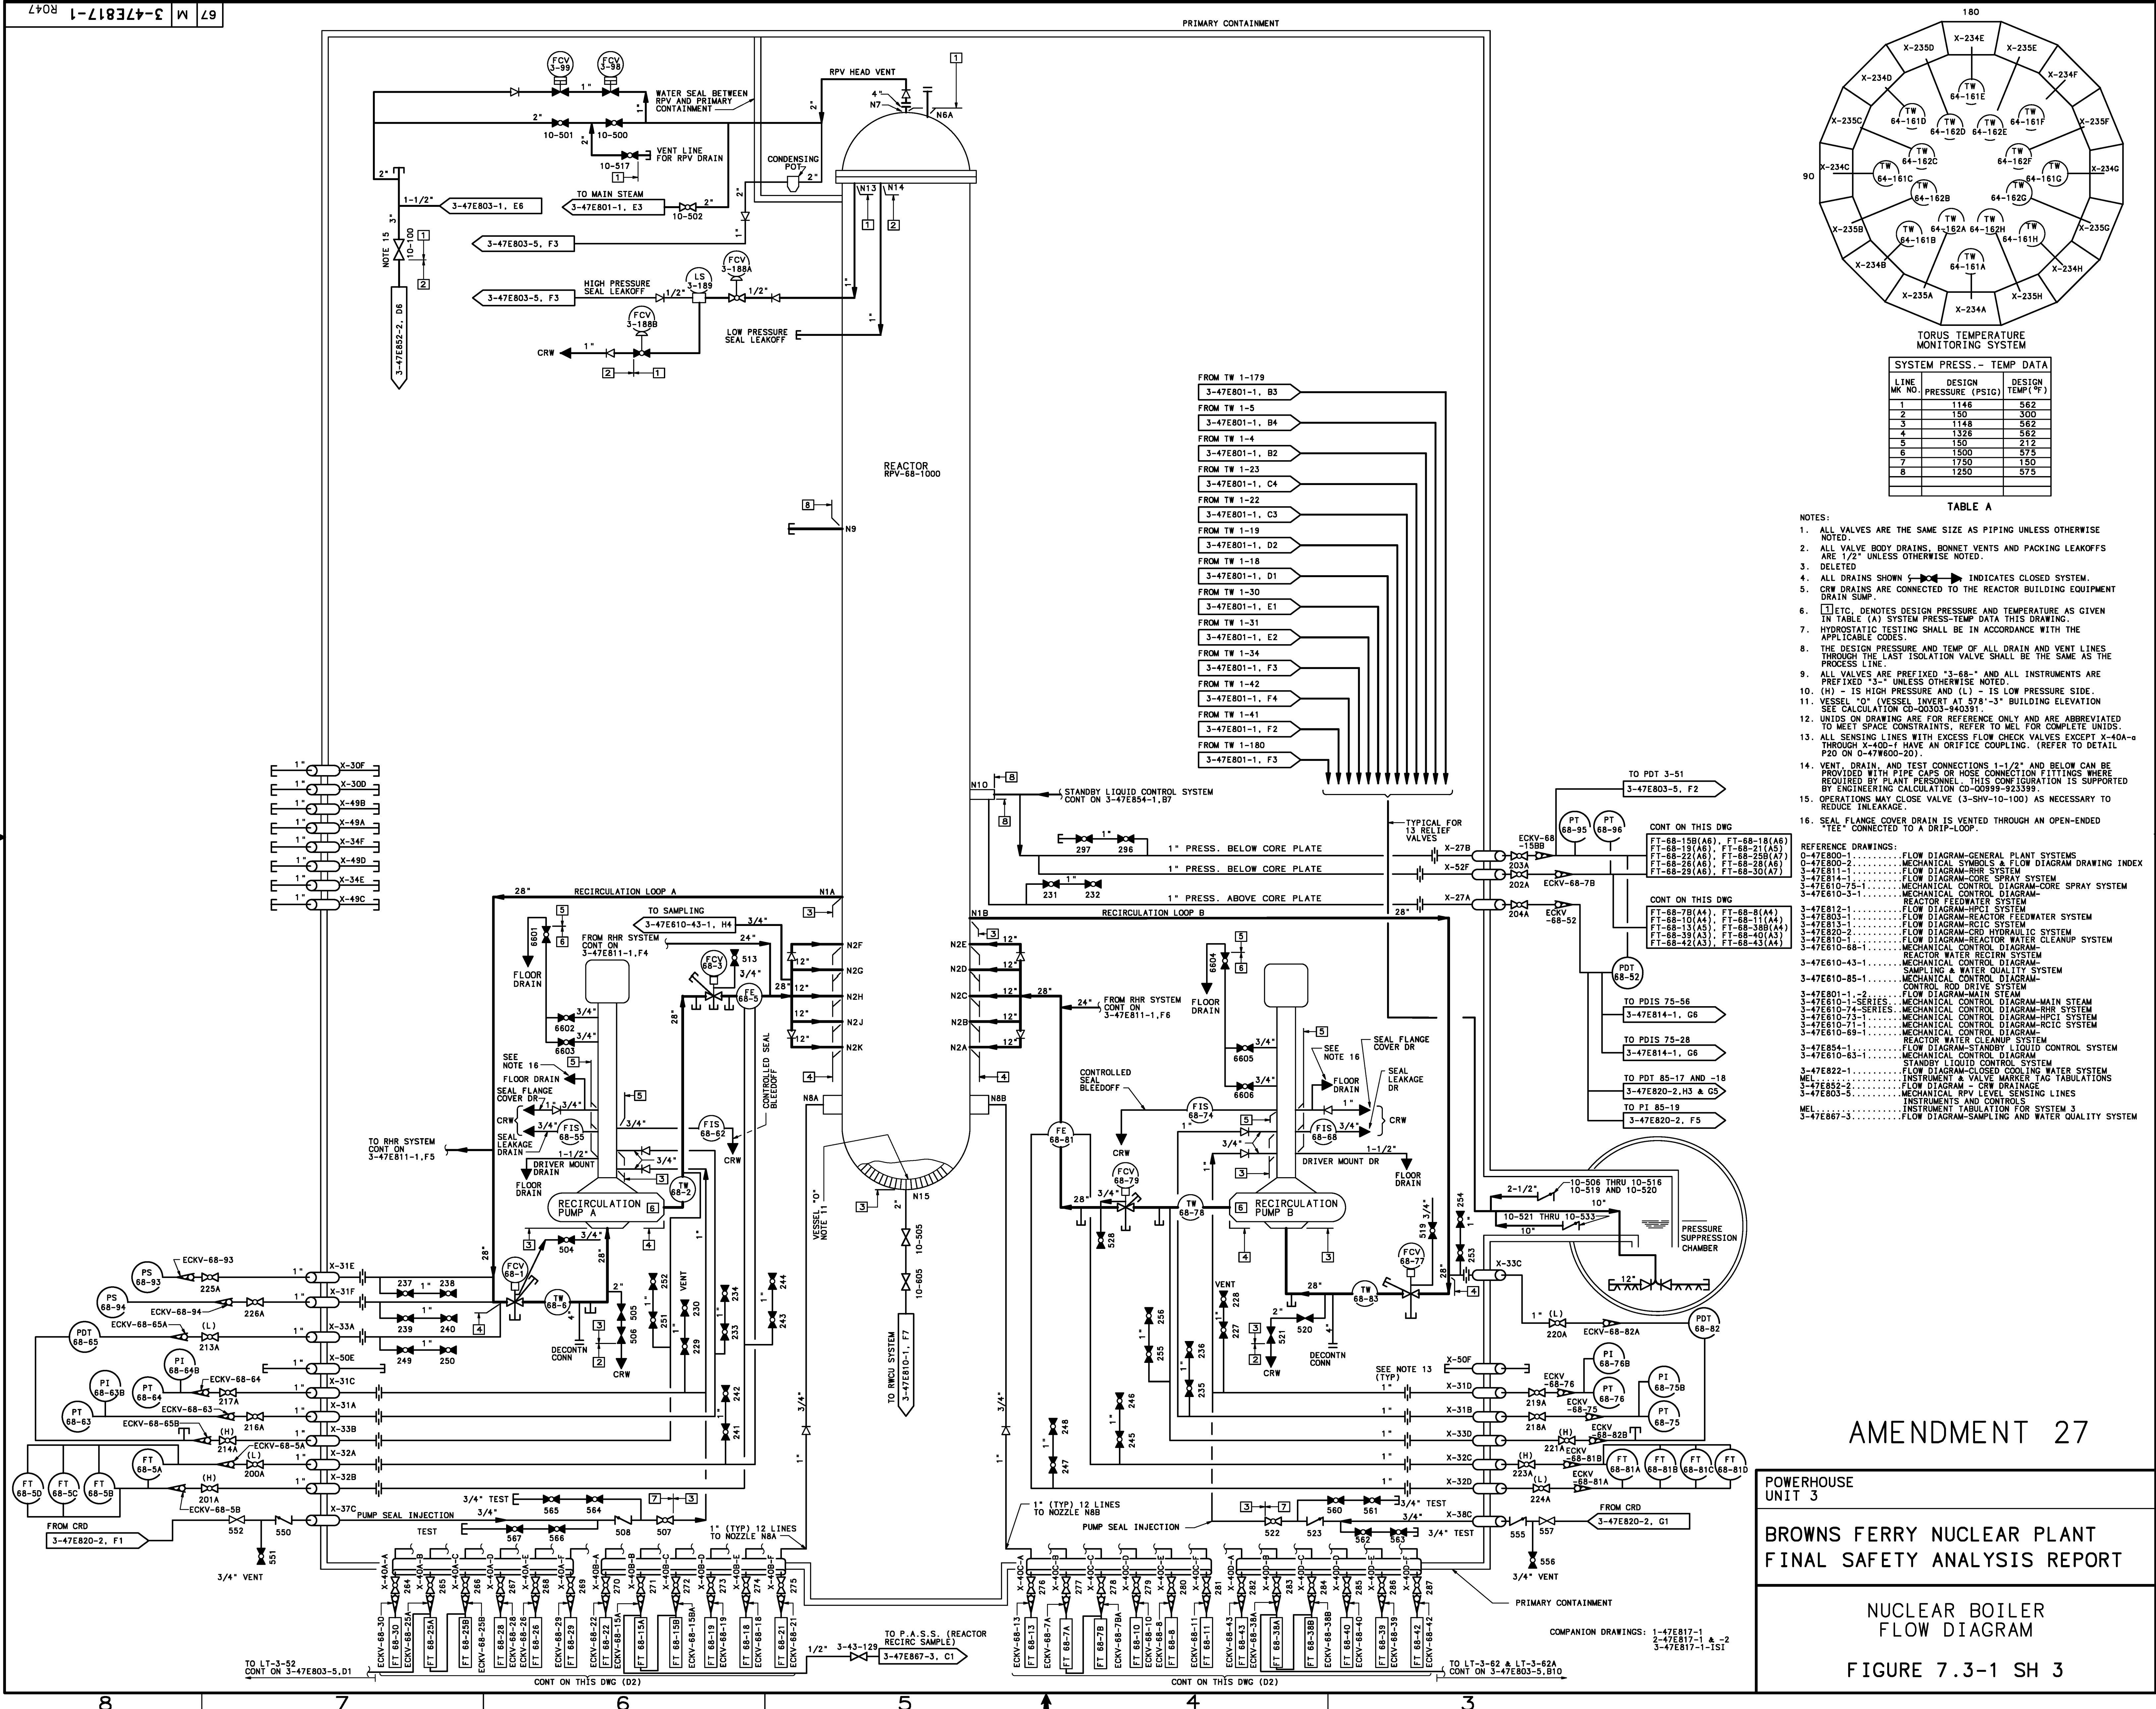

AMENDMENT 27

POWERHOUSE
UNIT 3

BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY ANALYSIS REPORT

NUCLEAR BOILER
FLOW DIAGRAM

FIGURE 7.3-1 SH 3

BFN-22

Figure 7.3-2a through 7.3-2l

(Deleted by Amendment 22)