




AMENDMENT 29

POWERHOUSE
UNIT 2
BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY ANALYSIS REPORT

REACTOR FEEDWATER SYSTEM
MECHANICAL CONTROL DIAGRAM
FIGURE 7.8-1 SH 1

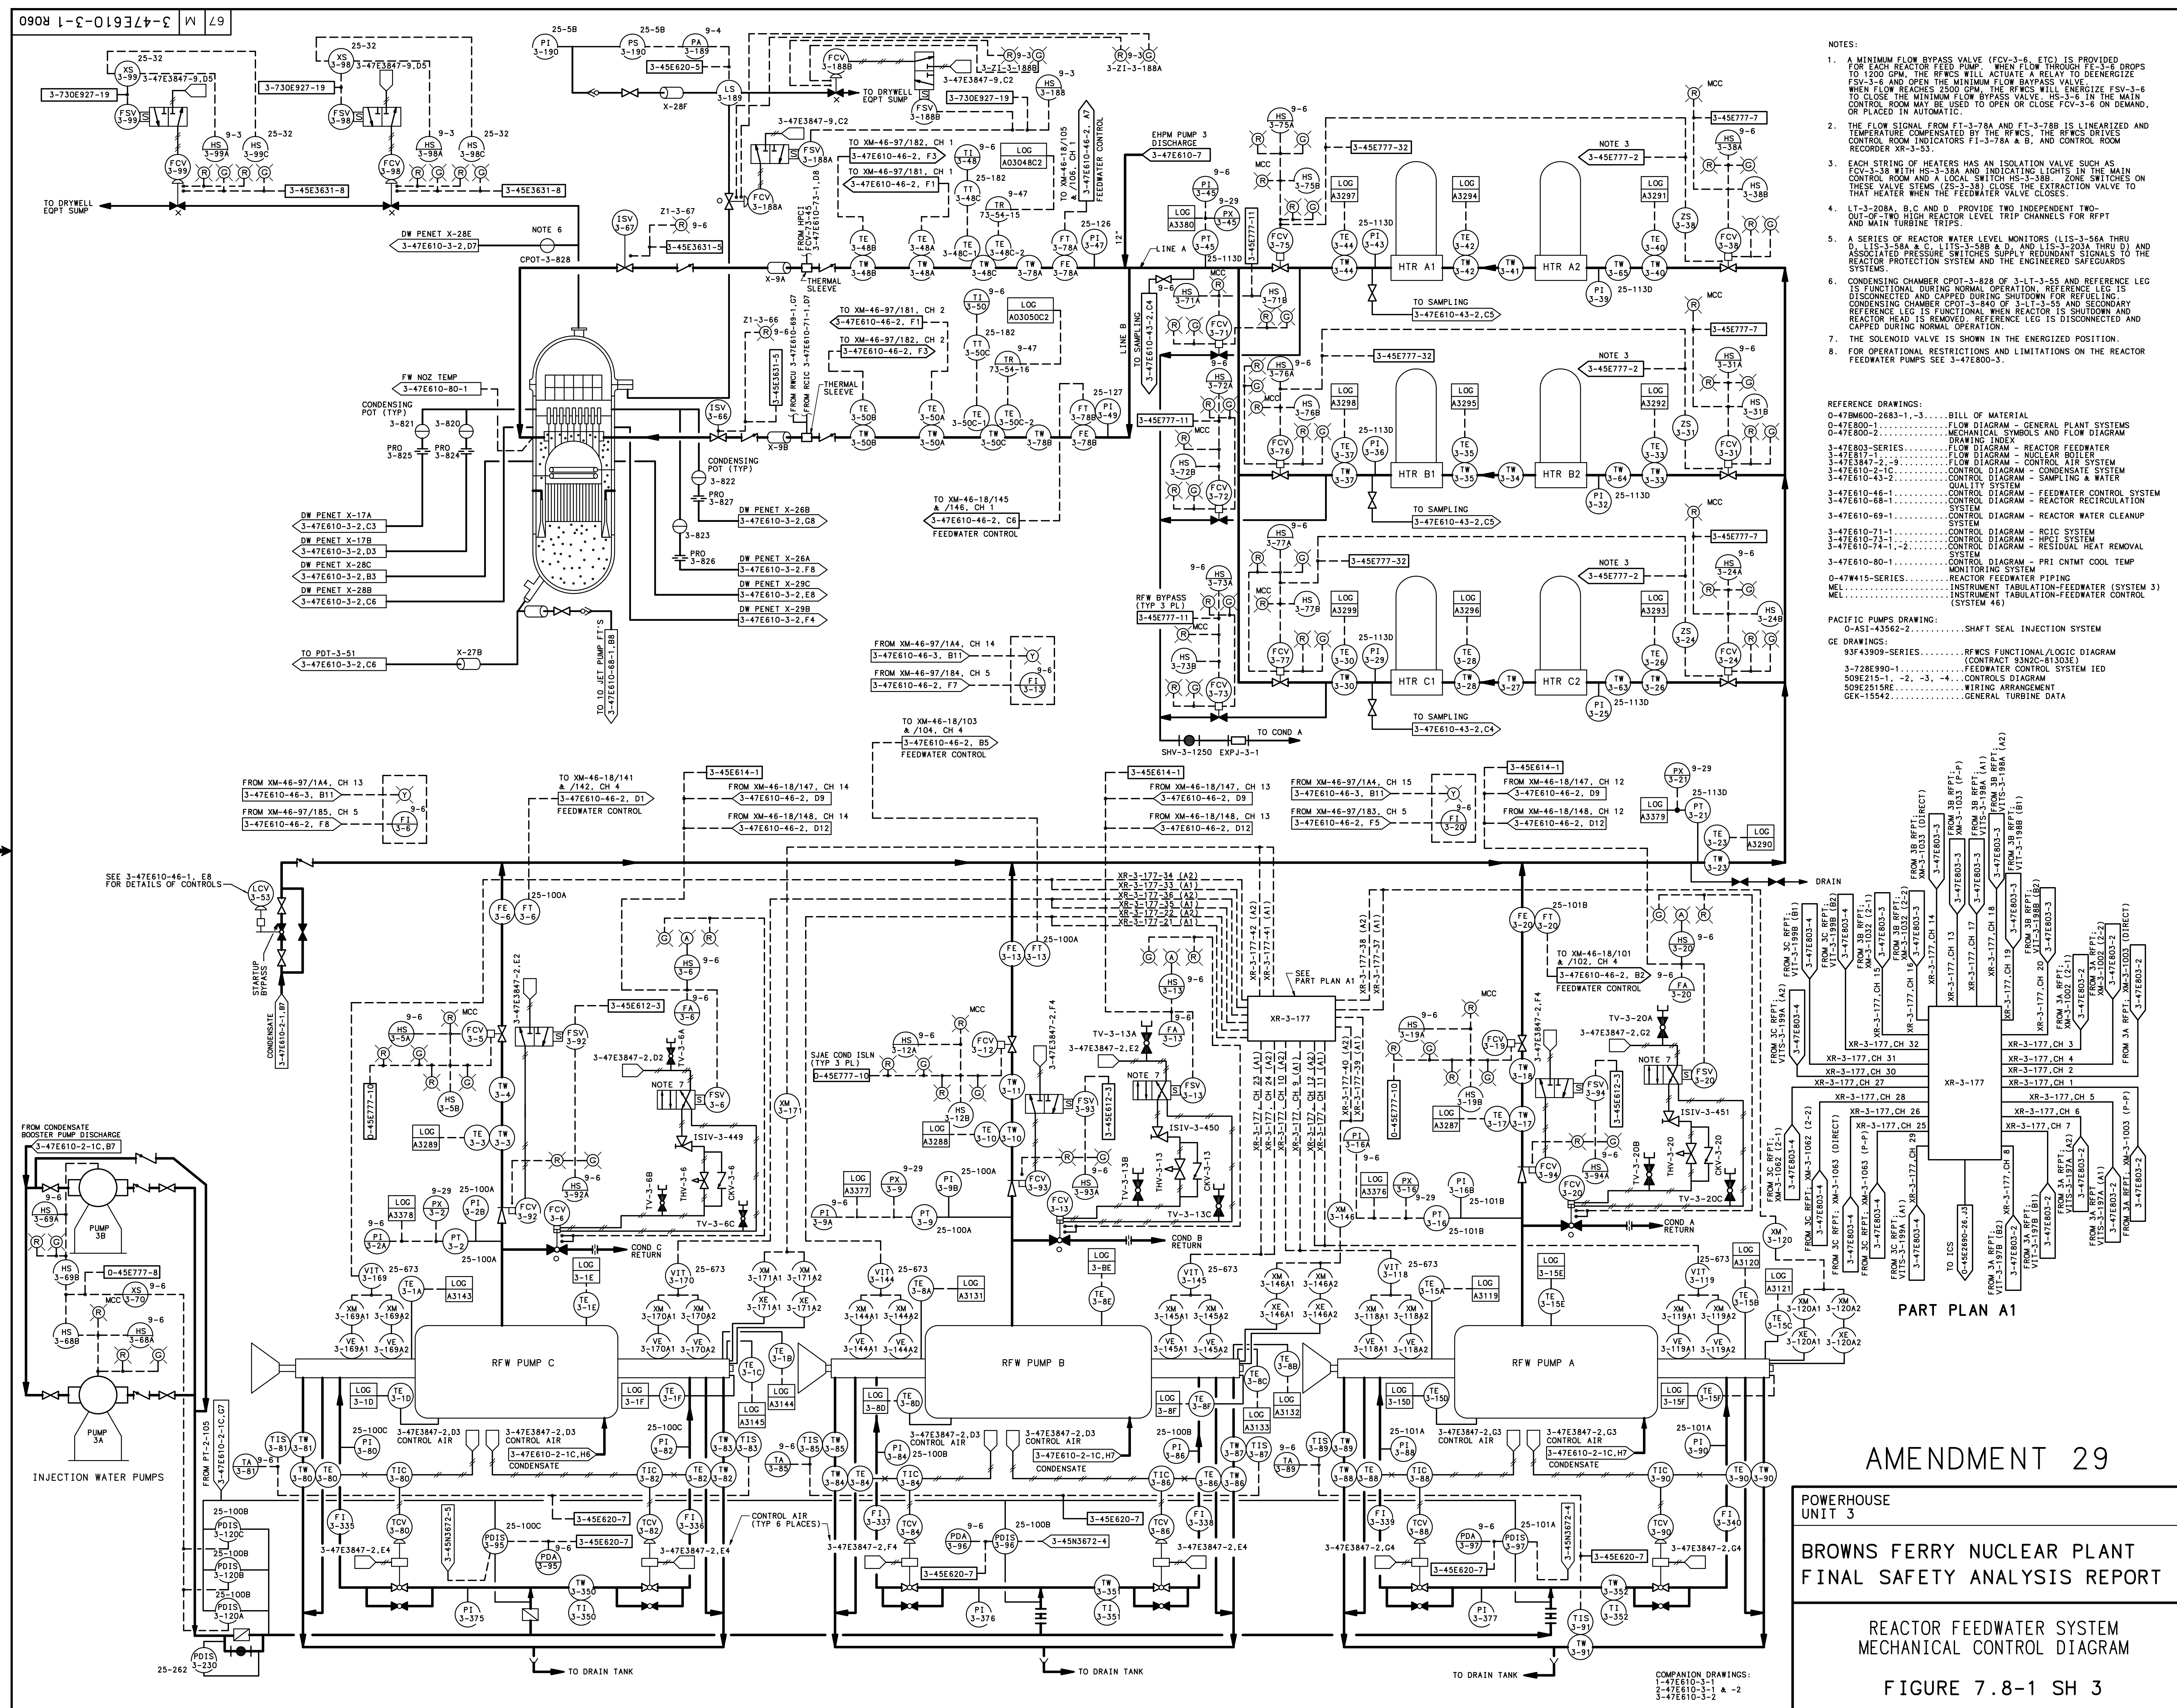

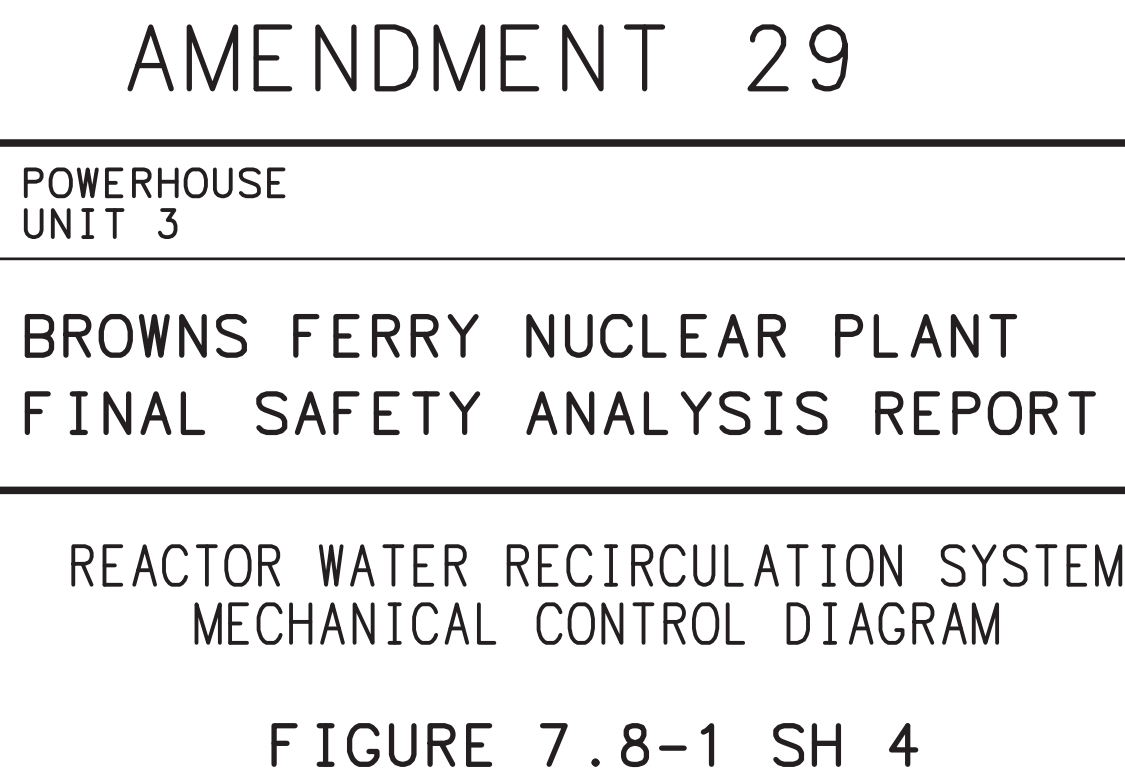


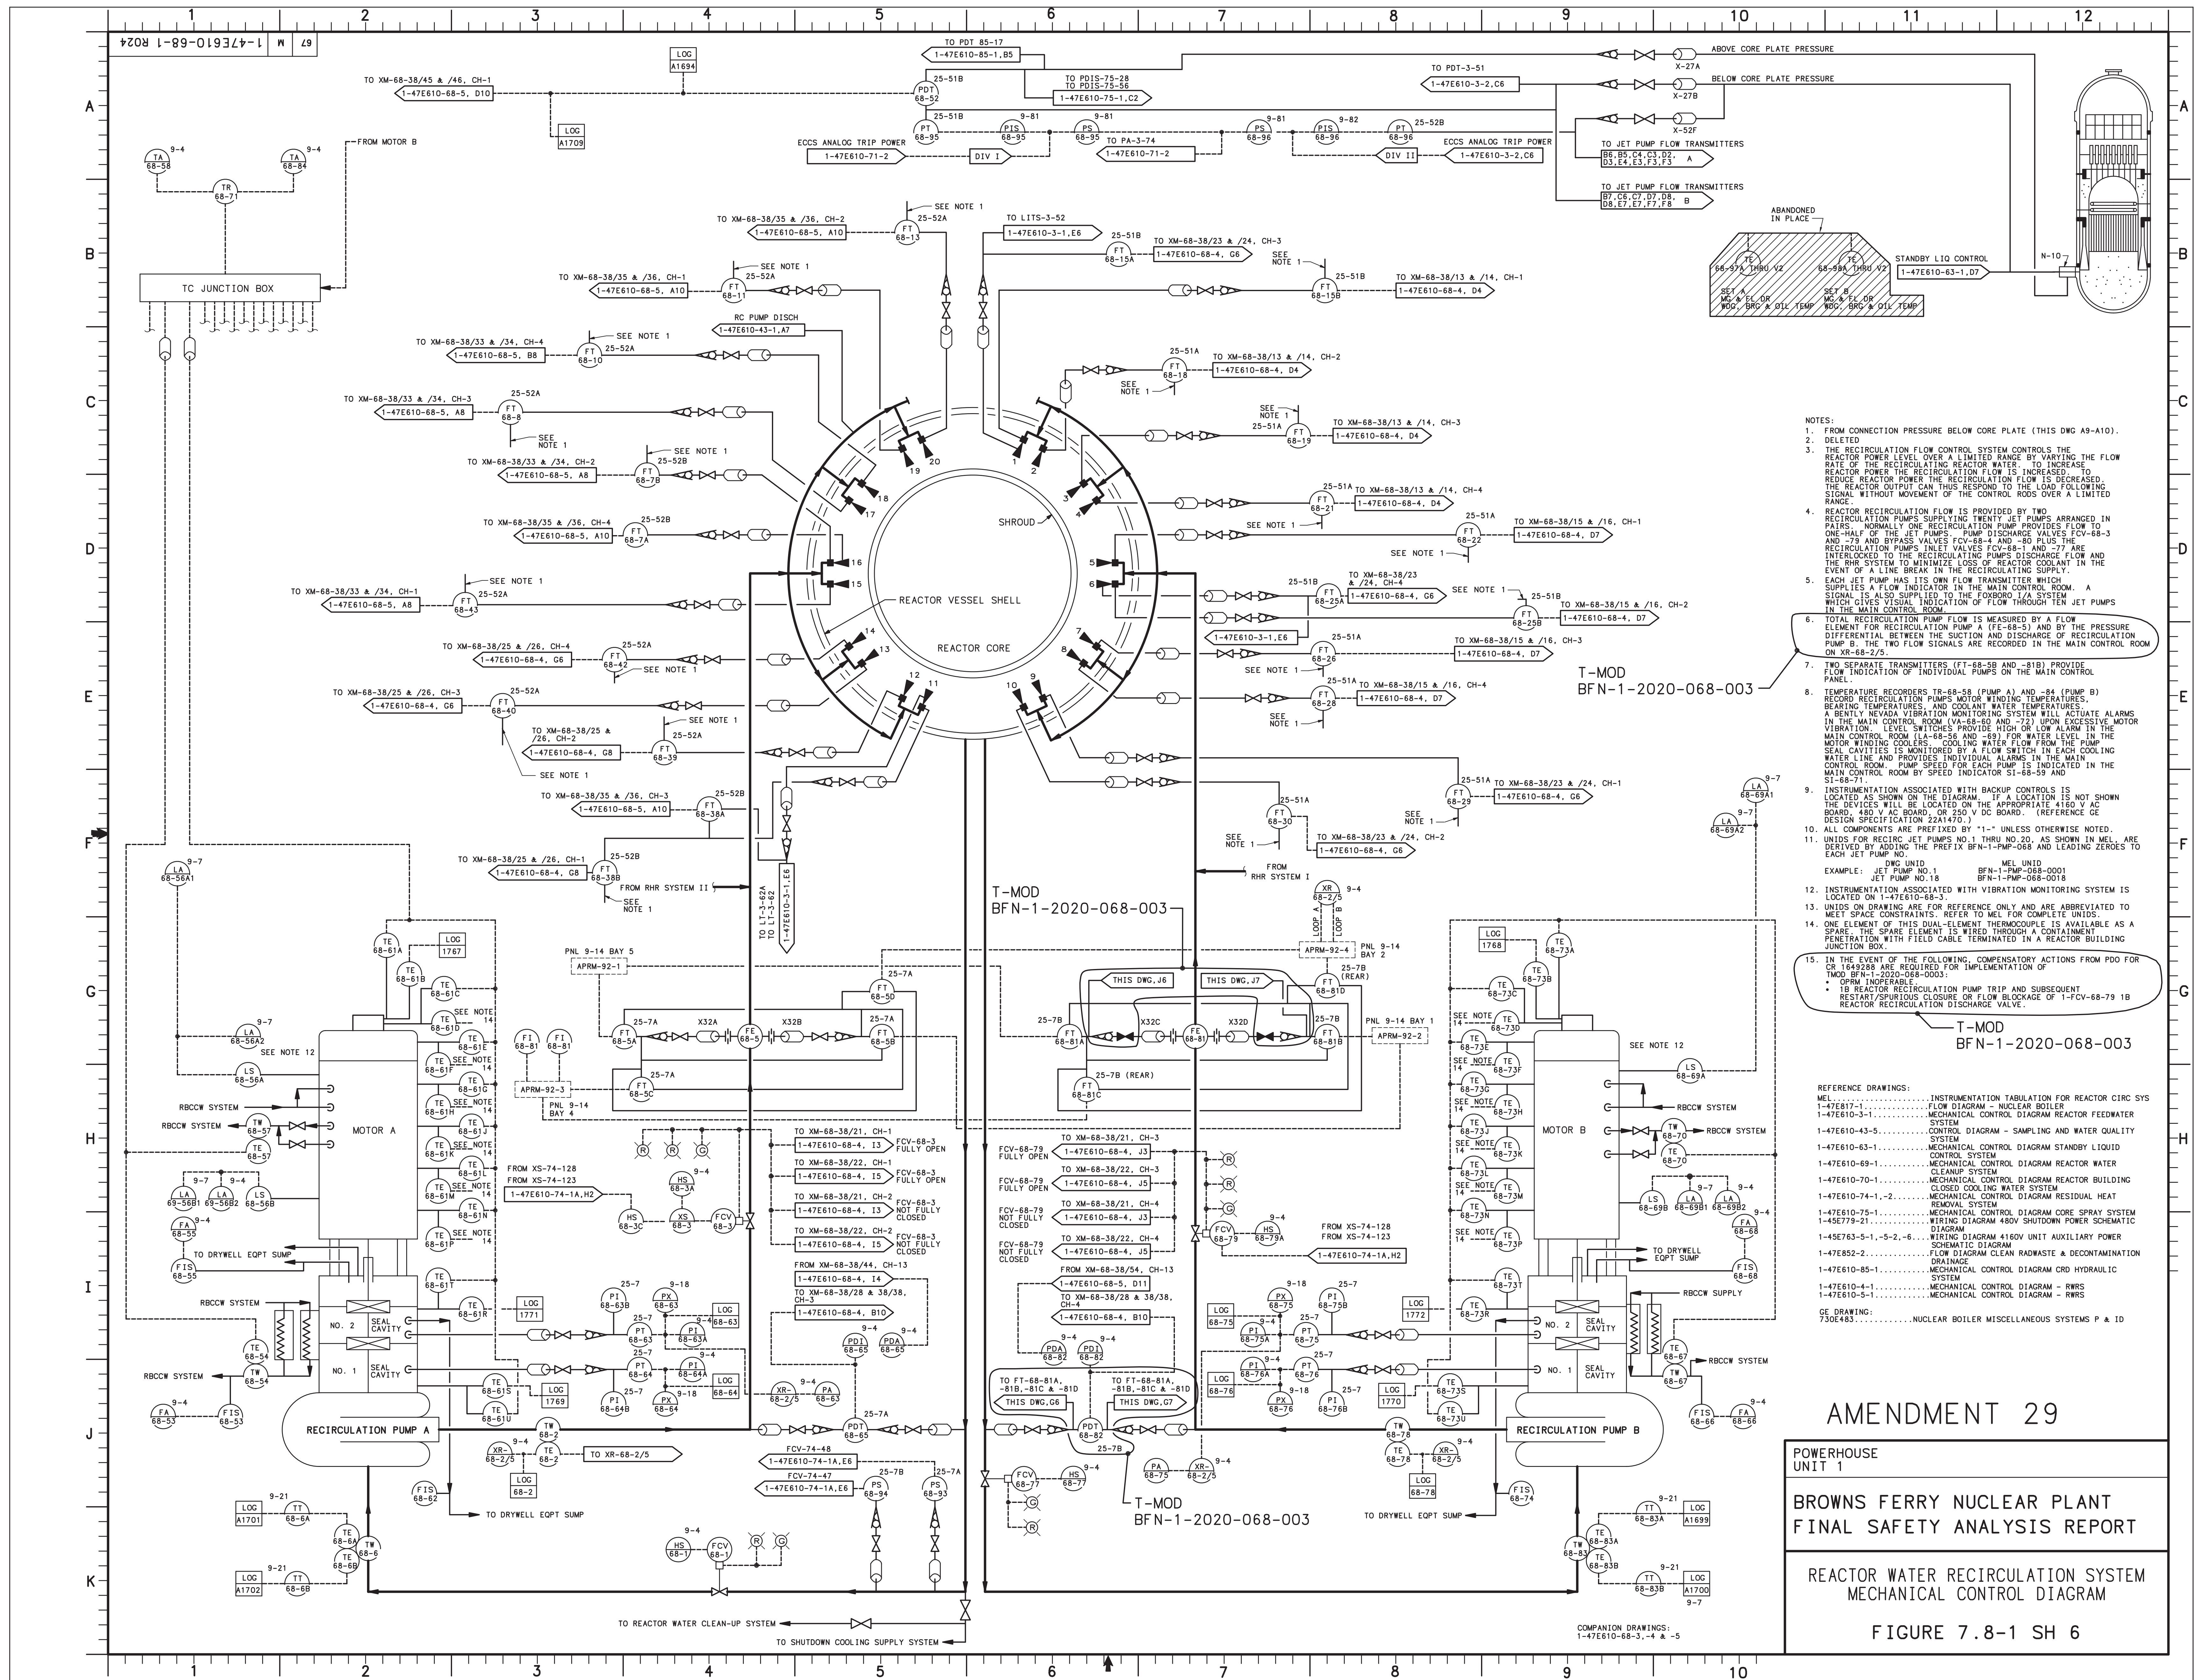

BFN-17

Figure 7.8-2

(Deleted by Amendment 17)

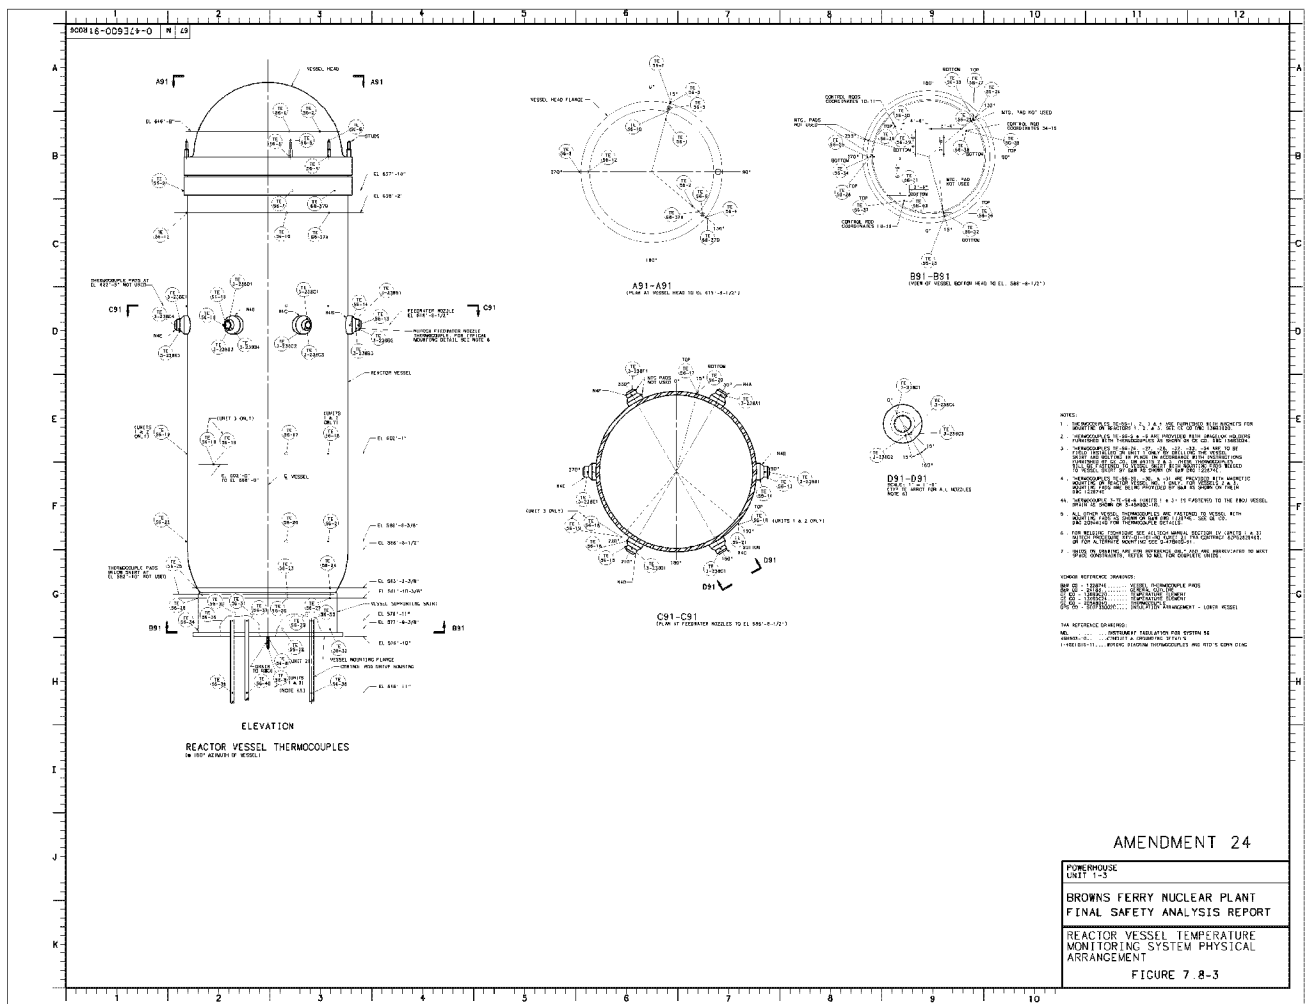

AMENDMENT 24