
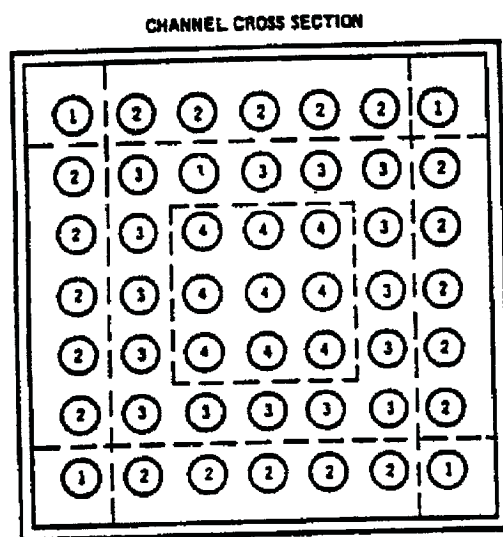


TABLE OF RADIATION HEAT TRANSFER COEFFICIENTS
RECEPTOR

		FUEL ROD TYPE				CHANNEL SIDE WALL
		1	2	3	4	
FUEL ROD TYPE	1	-	0.205	0.0649	0.007	0.2914
	2	0.041	-	0.177	0.0287	0.1788
	3	0.0212	0.221	-	0.150	0.0235
	4	0.003	0.0637	0.268	-	NIL
CHANNEL SIDE WALL		0.0975	0.299	0.031	NIL	-



FUEL BUNDLE DETAIL

CHANNEL		
ROD TYPE	No. OF RODS	ROD POWER FACTOR
1	4	1.24
2	20	1.09
3	16	0.91
4	9	0.85

AMENDMENT 16

BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY ANALYSIS REPORT

Fuel Rod and Fuel Bundle Details
FIGURE 14.8-1