



BFN-16


FIGURE 8.6-1.c


(This figure consists of a safeguard drawing which contains proprietary information. May be available upon request.)

<p>BROWNS FERRY NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>Security Related Information - Withheld in accordance with 10 CFR 2.390</p> <p>Figure 8.6-1.c 0-45W710-3</p>

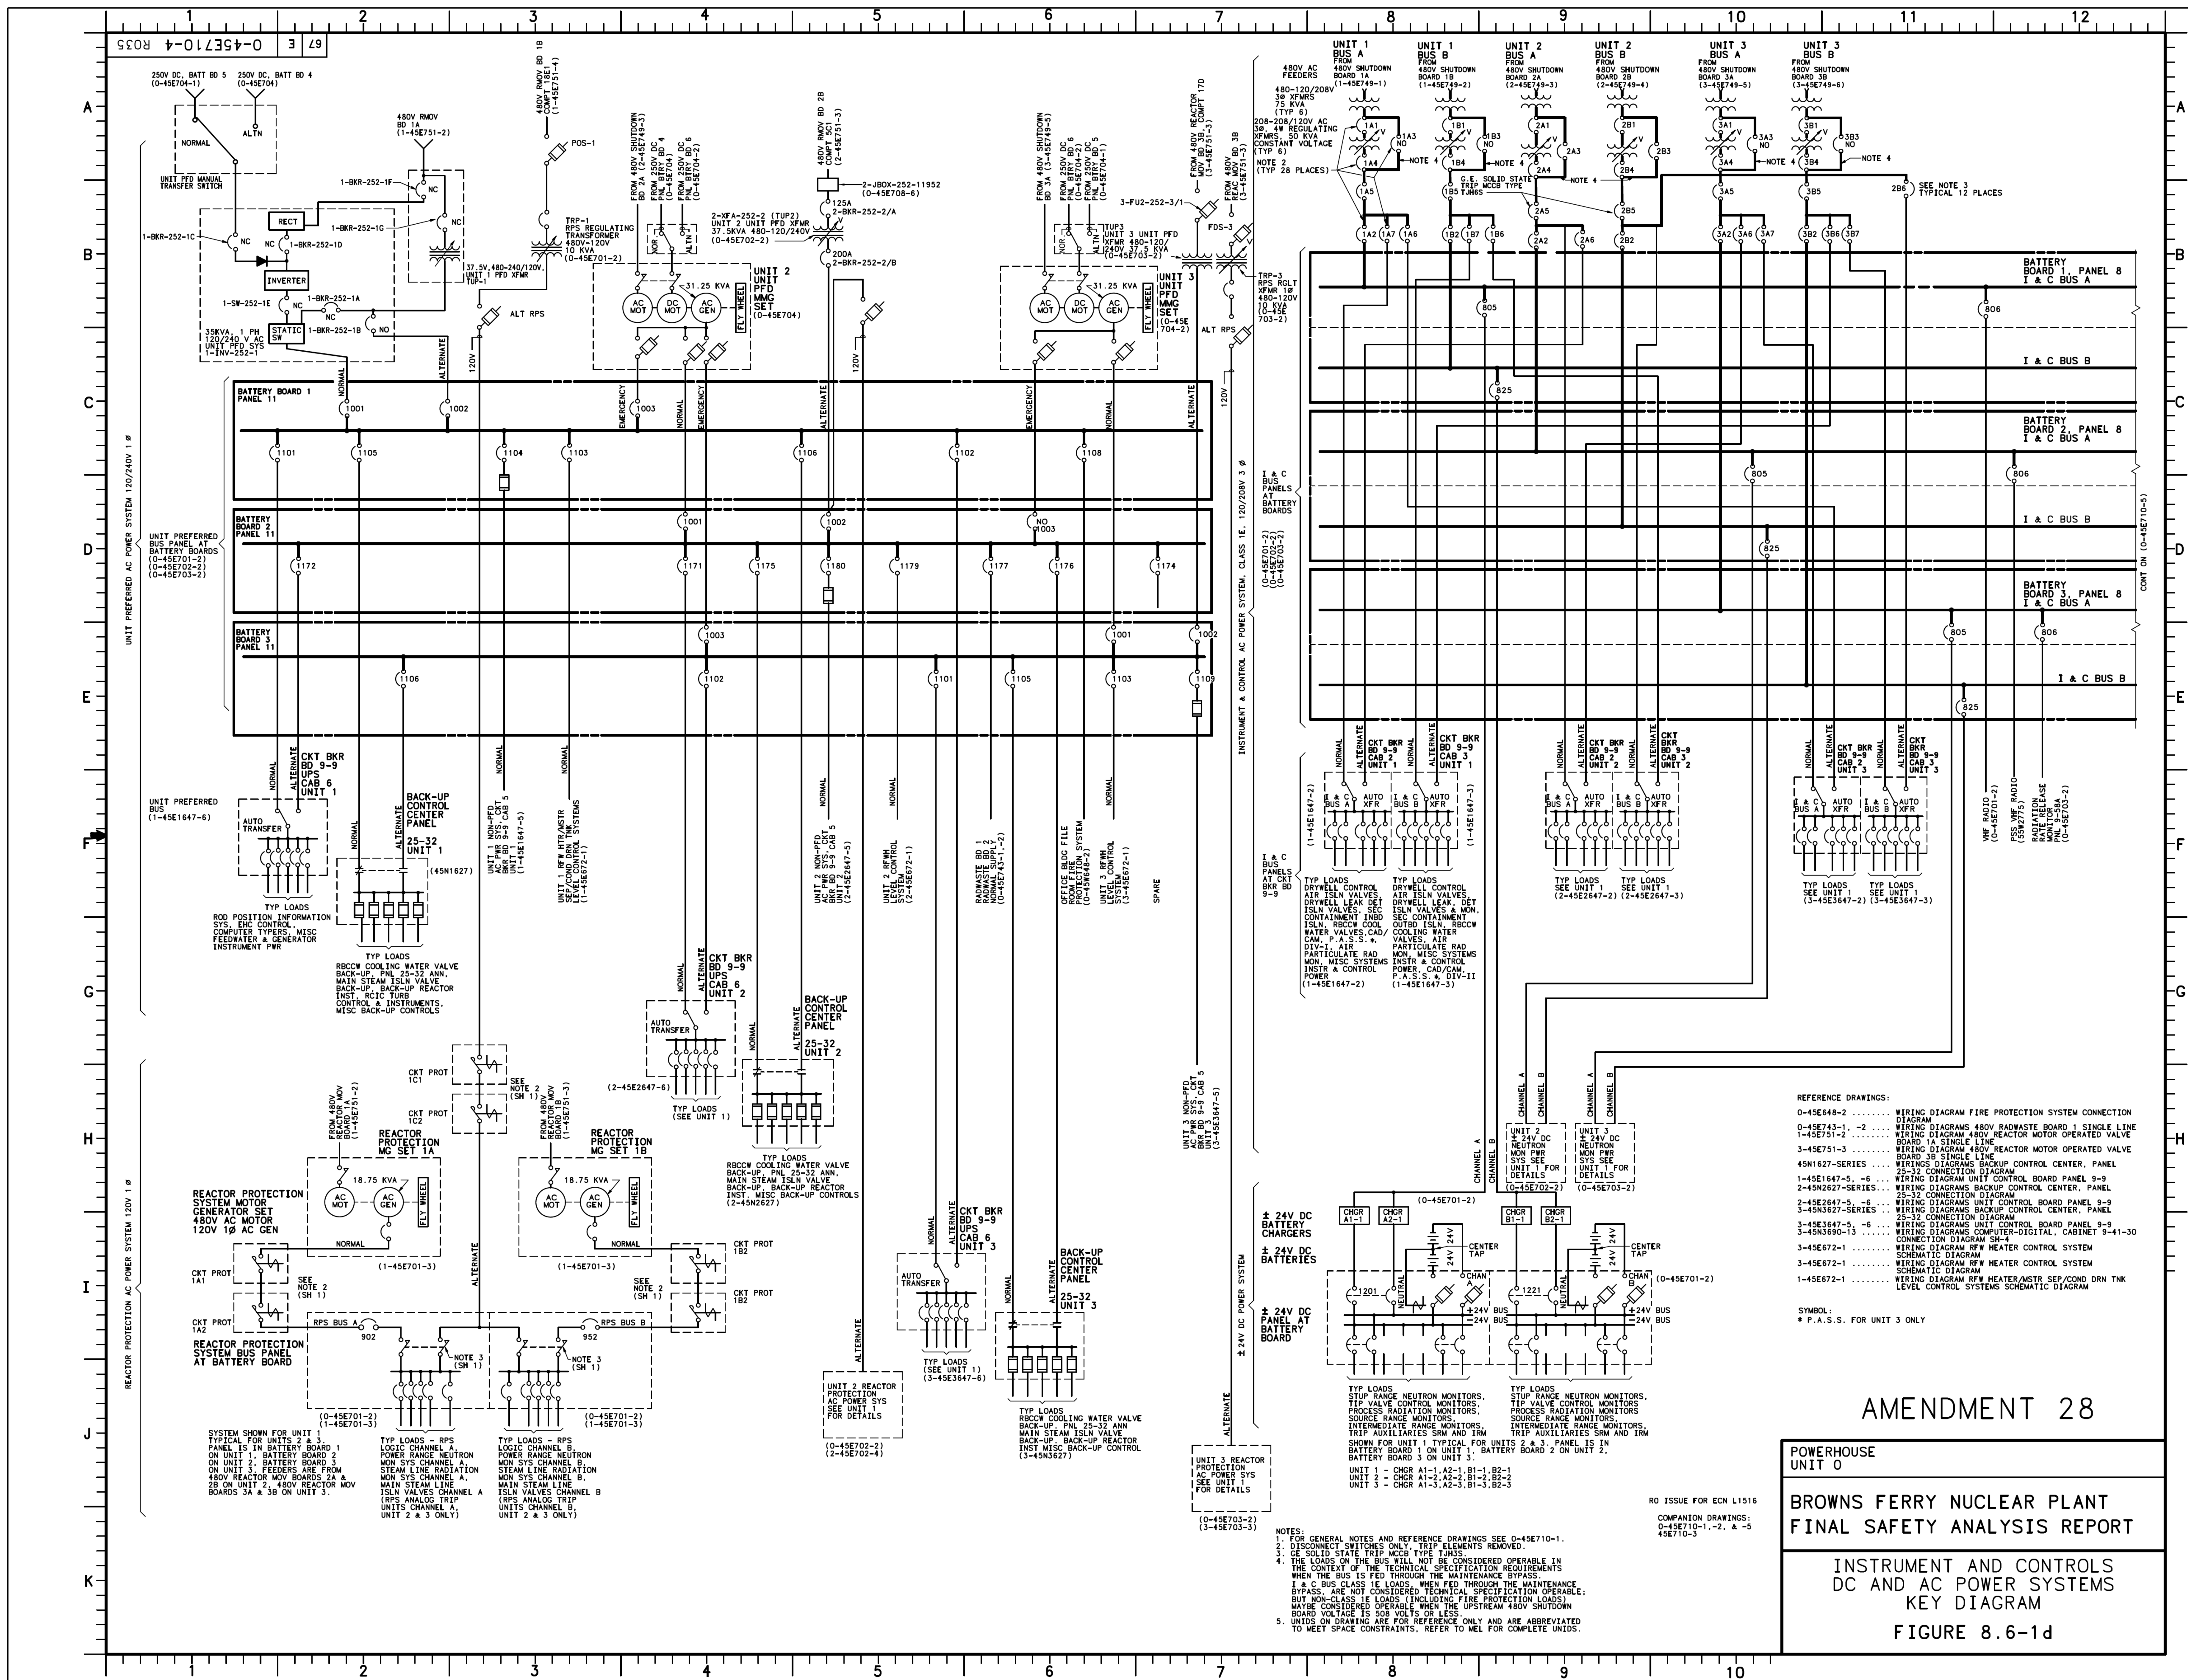

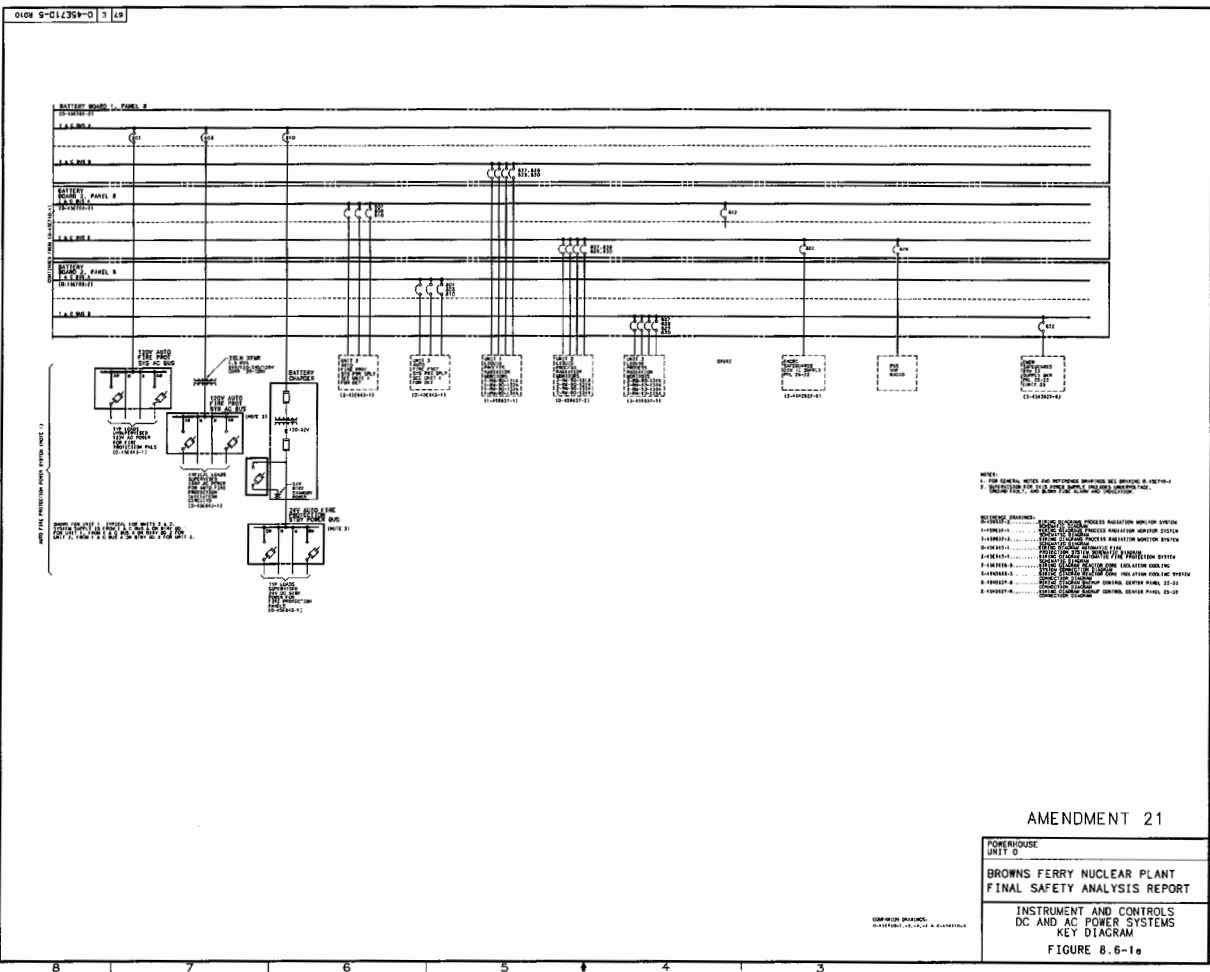

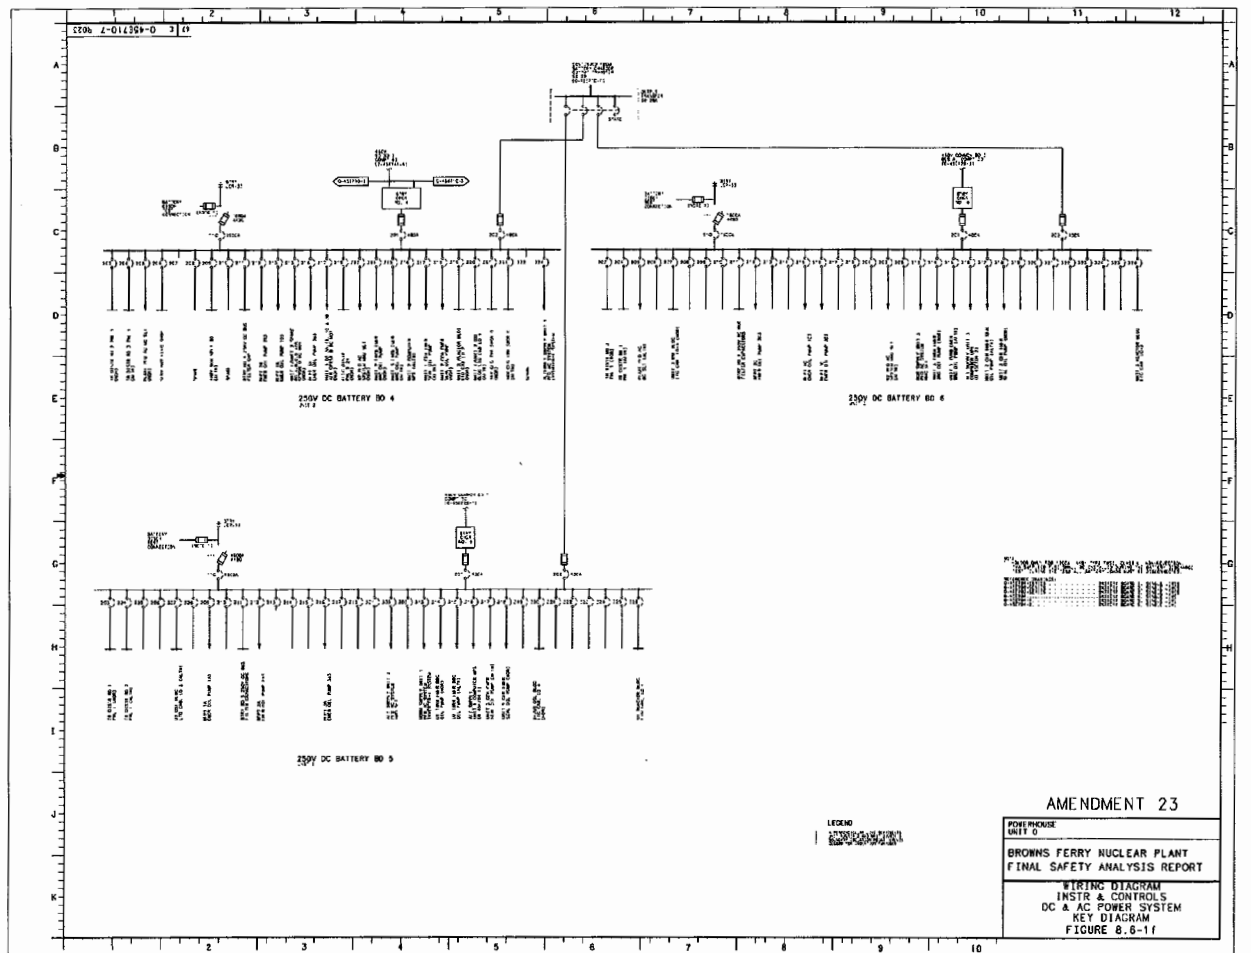

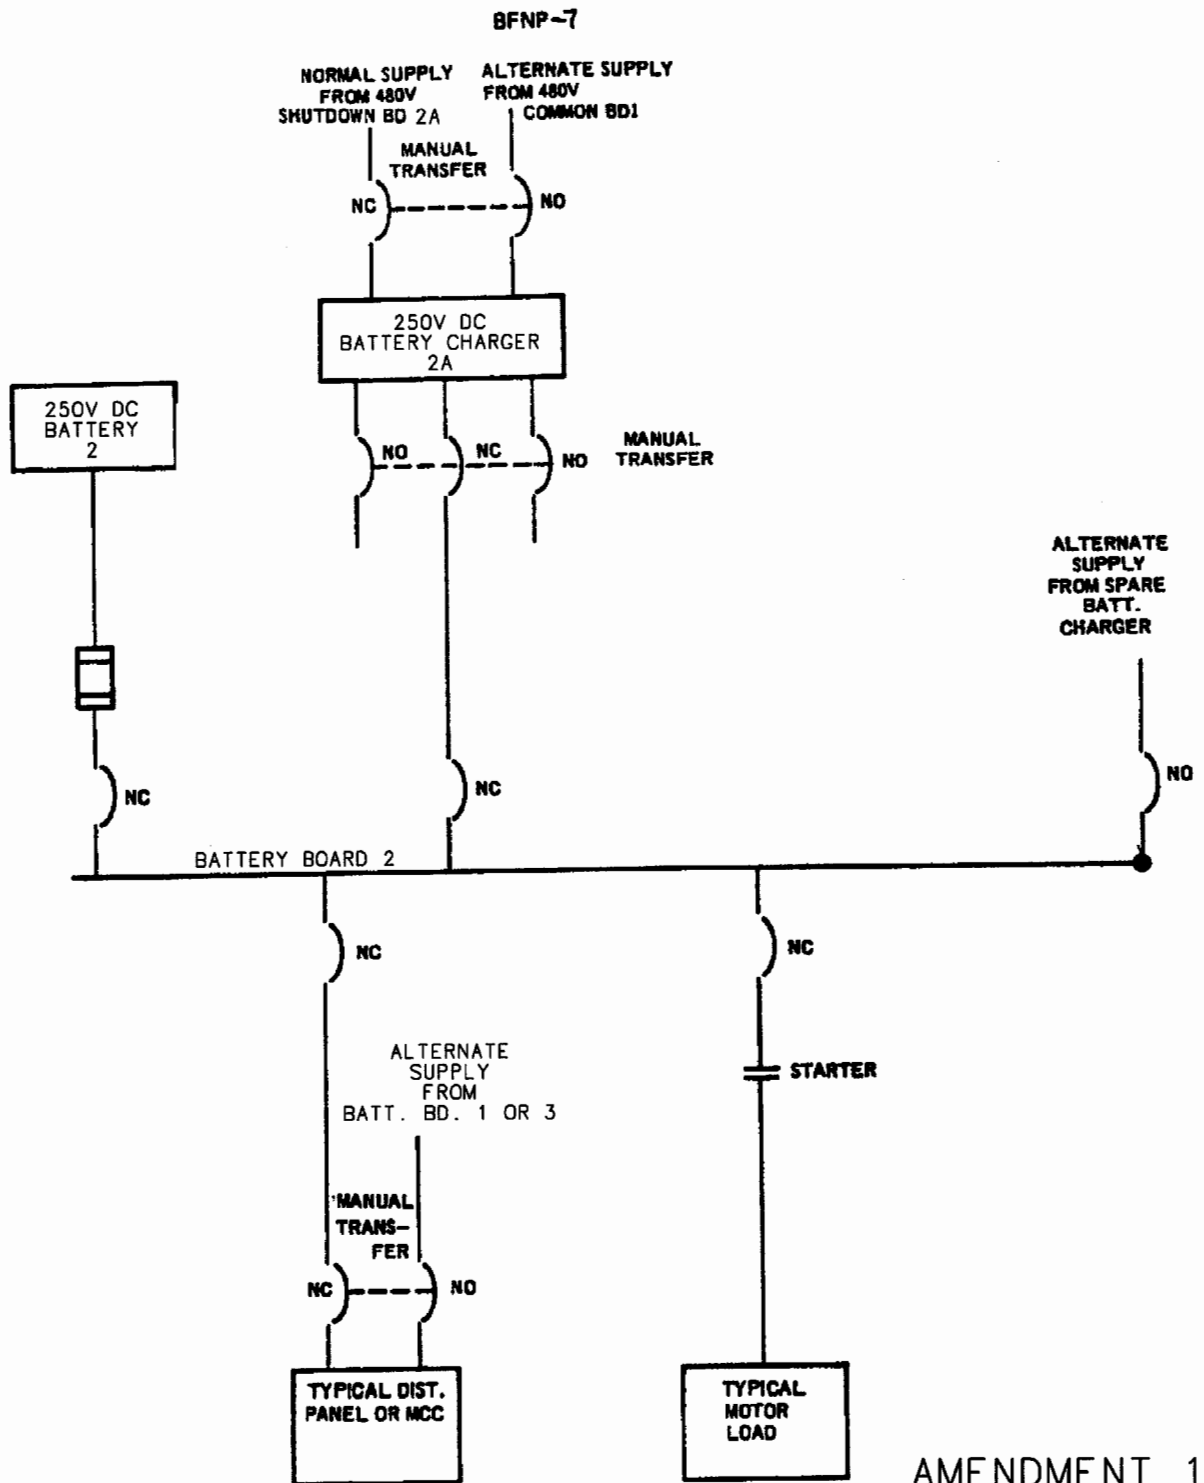



AMENDMENT 17

BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

250-Volt d-c Power System
Typical Unit Arrangement

FIGURE 8.6-2a

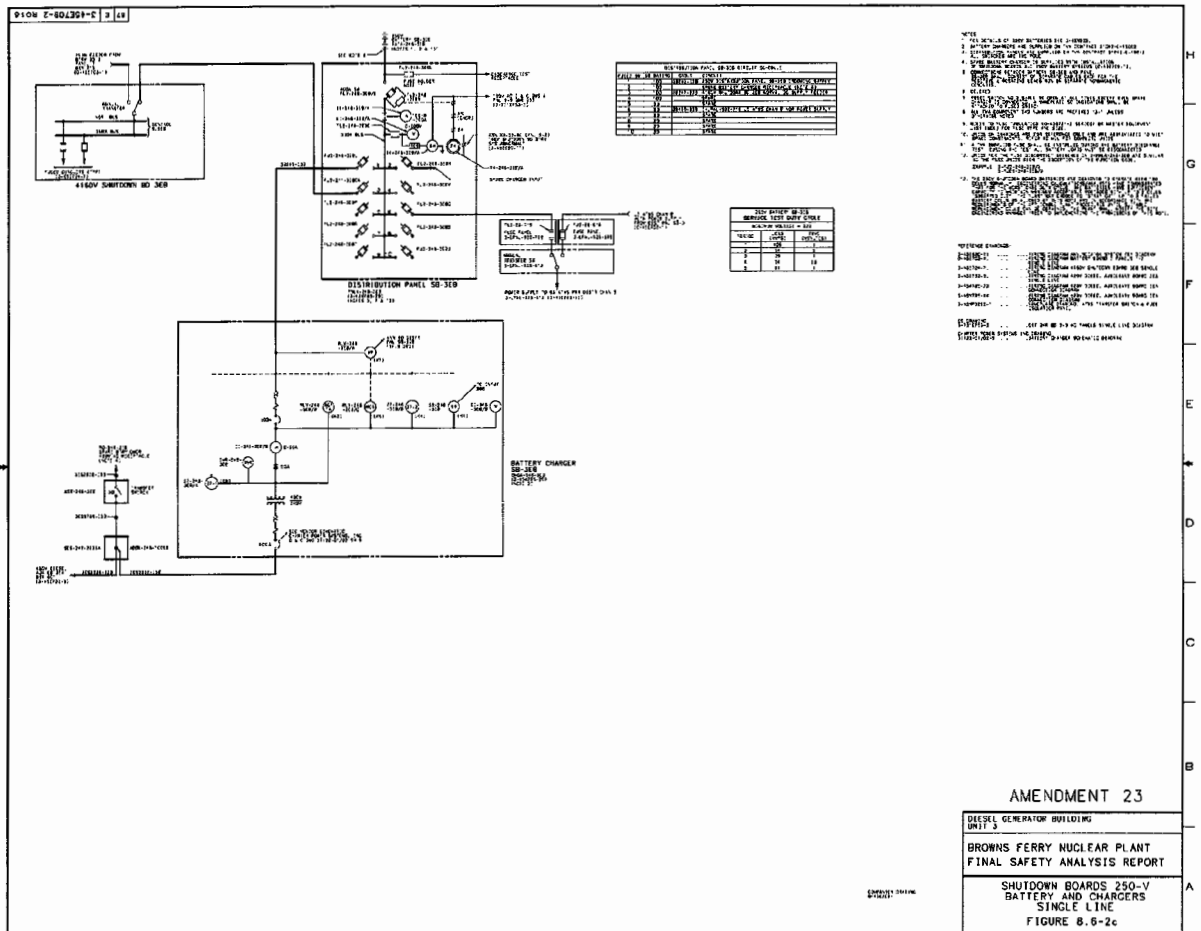


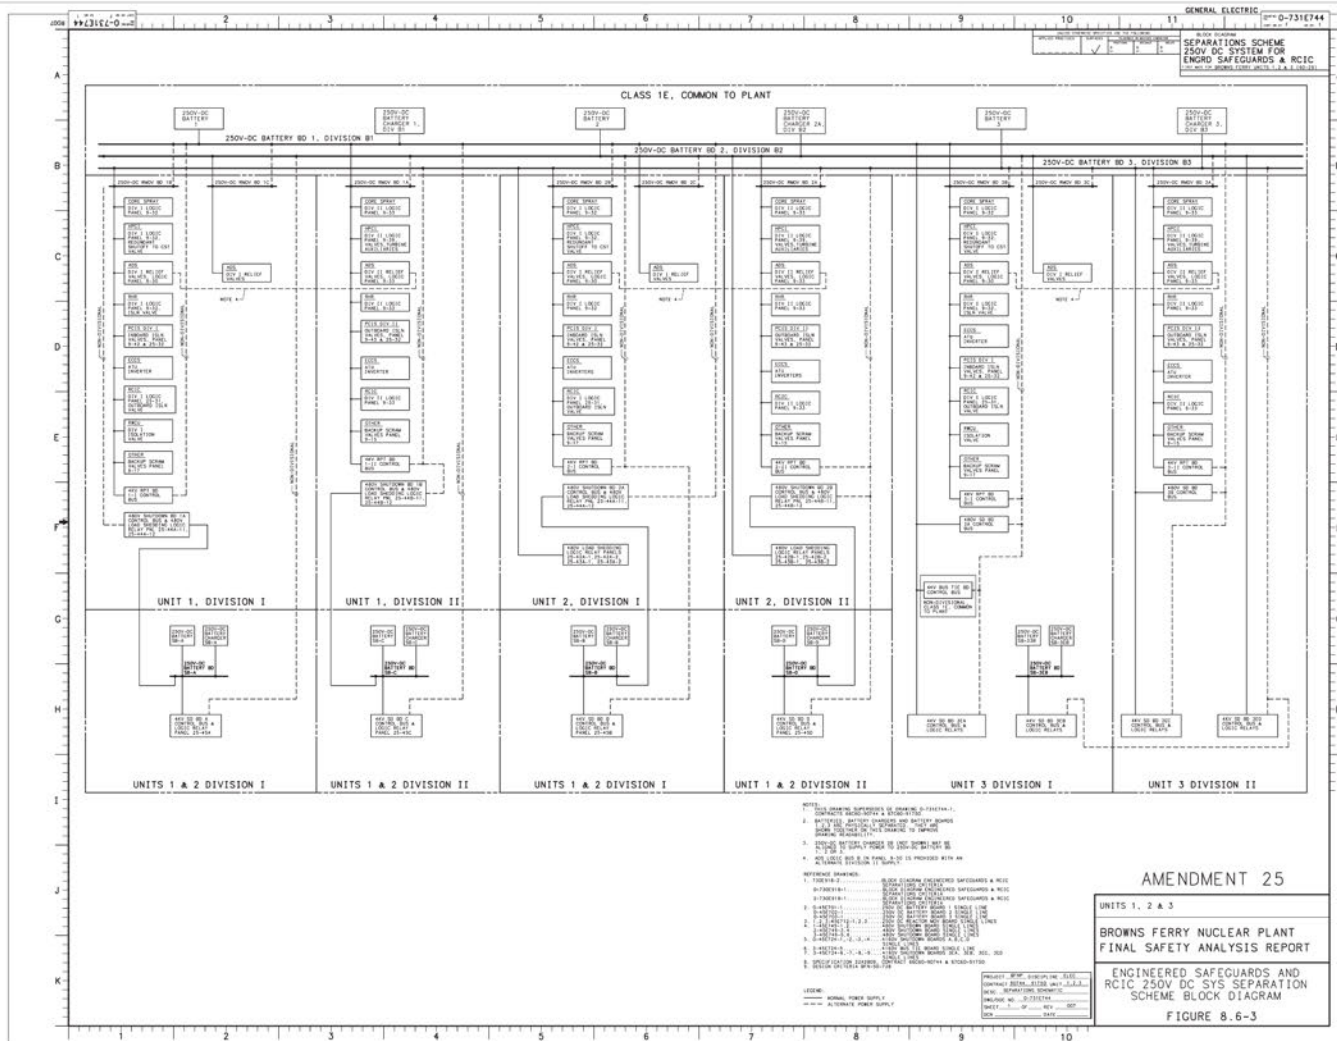


BFN-16

Figure 8.6-4

Deleted by Amendment 7.



UNIT 1 CRT BKR BD 9-9 250 V DC CONTROL SYSTEM SUPPLY PANEL

BROWNS FERRY NUCLEAR PLANT
FINAL SAFETY ANALYSIS REPORT

DC BOARD 9-9
ONE LINE DIAGRAM
FIGURE 8.6-5

