

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE OF CONTENTS**

**CHAPTER 10 STEAM AND POWER CONVERSION SYSTEM**

<b>10.1</b>	<b>SUMMARY DESCRIPTION .....</b>	<b>10.1-1</b>
<b>10.2</b>	<b>TURBINE GENERATOR .....</b>	<b>10.2-1</b>
10.2.1	Design Bases .....	10.2-1
10.2.2	System Description .....	10.2-2
10.2.2.1	Turbine Generator .....	10.2-2
10.2.2.2	Generator Exciter System .....	10.2-2
10.2.2.3	Cycle Description .....	10.2-2
10.2.2.4	Tests and Inspections .....	10.2-3
10.2.2.5	Instrumentation Application .....	10.2-4
10.2.3	Turbine Disk Integrity .....	10.2-11
10.2.3.1	Materials Selection .....	10.2-11
10.2.3.2	Fracture Toughness .....	10.2-12
10.2.3.3	High Temperature Properties .....	10.2-12
10.2.3.4	Turbine Disk Design .....	10.2-12
10.2.3.5	Preservice Inspection .....	10.2-13
10.2.3.6	Inservice Inspection .....	10.2-14
10.2.3.7	Design Standards .....	10.2-15
10.2.3.8	References .....	10.2-16
10.2.4	Evaluation .....	10.2-17
10.2.5	Hydrogen and Carbon Dioxide Systems .....	10.2-18
10.2.5.1	Power Generation Design Bases .....	10.2-18
10.2.5.2	System Description .....	10.2-19
10.2.5.3	System Evaluation .....	10.2-19
10.2.5.4	Tests and Inspections .....	10.2-21
10.2.5.5	Instrumentation Application .....	10.2-21
<b>10.3</b>	<b>MAIN AND REHEAT STEAM SYSTEM .....</b>	<b>10.3-1</b>
10.3.1	Power Generation Design Bases .....	10.3-1
10.3.2	System Description .....	10.3-1
10.3.3	System Evaluation .....	10.3-2
10.3.4	Tests and Inspections .....	10.3-2

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE OF CONTENTS**

10.3.5	Instrumentation Application .....	10.3-2
10.3.6	Steam and Feedwater System Materials .....	10.3-3
<b>10.4</b>	<b>OTHER FEATURES OF STEAM AND POWER CONVERSION SYSTEM .....</b>	<b>10.4-1</b>
10.4.1	Main Condensers .....	10.4-1
10.4.1.1	Power Generation Design Bases .....	10.4-1
10.4.1.2	System Description .....	10.4-3
10.4.1.3	System Evaluation .....	10.4-5
10.4.1.4	Tests and Inspections .....	10.4-6
10.4.1.5	Instrumentation Application .....	10.4-7
10.4.2	Condenser Air Removal System .....	10.4-8
10.4.2.1	Power Generation Design Bases .....	10.4-8
10.4.2.2	System Description .....	10.4-8
10.4.2.3	System Evaluation .....	10.4-9
10.4.2.4	Tests and Inspections .....	10.4-9
10.4.2.5	Instrumentation Application .....	10.4-10
10.4.3	Turbine Gland Sealing System .....	10.4-10
10.4.3.1	Power Generation Design Bases .....	10.4-10
10.4.3.2	System Description .....	10.4-10
10.4.3.3	System Evaluation .....	10.4-12
10.4.3.4	Tests and Inspections .....	10.4-12
10.4.3.5	Instrumentation Application .....	10.4-13
10.4.4	Turbine Bypass System .....	10.4-13
10.4.4.1	Power Generation Design Bases .....	10.4-13
10.4.4.2	System Description .....	10.4-14
10.4.4.3	System Evaluation .....	10.4-19
10.4.4.4	Tests and Inspections .....	10.4-20
10.4.4.5	Instrumentation Application .....	10.4-20
10.4.5	Circulating Water System .....	10.4-21
10.4.5.1	Power Generation Design Bases .....	10.4-21
10.4.5.2	System Description .....	10.4-21
10.4.5.3	System Evaluation .....	10.4-25

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE OF CONTENTS**

10.4.5.4	Tests and Inspections .....	10.4-31
10.4.5.5	Instrumentation Application .....	10.4-31
10.4.6	Condensate Cleanup System .....	10.4-32
10.4.6.1	Power Generation Design Bases .....	10.4-32
10.4.6.2	System Description .....	10.4-34
10.4.6.3	System Evaluation .....	10.4-35
10.4.6.4	Tests and Inspections .....	10.4-35
10.4.6.5	Instrumentation Application .....	10.4-36
10.4.7	Condensate and Feedwater System .....	10.4-38
10.4.7.1	Power Generation Design Bases .....	10.4-38
10.4.7.2	System Description .....	10.4-39
10.4.7.3	System Evaluation .....	10.4-45
10.4.7.4	Tests and Inspections .....	10.4-46
10.4.7.5	Instrumentation Application .....	10.4-46
10.4.8	Deleted .....	10.4-47
10.4.9	References .....	10.4-47

APPENDIX 10A

(Proprietary information of Siemens Power Corporation)

|

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**LIST OF TABLES**

Table 10.1-1	Summary of Important Design and Performance Characteristics of Power Conversion System
Table 10.4-1	Circulating Water System Components



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**LIST OF FIGURES**

Figure 10.1-1	Deleted
Figure 10.1-2	Turbine Cycle Heat Balance
Figure 10.2-1	Deleted
Figure 10.2-1-1	Hydrogen and Carbon Dioxide System
Figure 10.2-1-2	Hydrogen and Carbon Dioxide System
Figure 10.2-2	Yard Piping Hydrogen Storage and Distribution
Figure 10.2-3	Yard Piping Hydrogen Distribution
Figure 10.3-1	Main and Reheat Steam System (2 Sheets)
Figure 10.3-2	Main and Reheat Steam System
Figure 10.3-3	Main and Reheat Steam System
Figure 10.3-4	Extraction Steam System
Figure 10.3-5	Heater Vents and Drains Systems (3 Sheets)
Figure 10.3-6	Heater Vents and Drains
Figure 10.3-7	Heater Vents and Drains
Figure 10.3-8	Moisture Separator-Reheater Vents and Drains (2 Sheets)
Figure 10.4-1	Condenser Air Removal System
Figure 10.4-2	Condenser Air Removal System
Figure 10.4-3	Main and RFP Turbine Steam Seal and Drain System
Figure 10.4-4	Main and RFP Turbine Steam Seal and Drain System
Figure 10.4-5	Circulating Water System
Figure 10.4-6	Circulating Water System
Figure 10.4-7	Circulating Water System
Figure 10.4-8	Deleted
Figure 10.4-9	Deleted
Figure 10.4-9A	Condensate Cleanup System (Condensate Demineralizers)
Figure 10.4-9b	Condensate Cleanup System
Figure 10.4-9c	Condensate Cleanup System
Figure 10.4-9d	Condensate Cleanup System
Figure 10.4-9e	Condensate Cleanup System

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**LIST OF FIGURES**

Figure 10.4-9F	Condensate Cleanup System (Precoat Filters)	
Figure 10.4-9g	Condensate Cleanup System	
Figure 10.4-10	Condensate System (2 Sheets)	
Figure 10.4-11	Condensate System	
Figure 10.4-12	Condensate System	
Figure 10.4-13	Feedwater System	
Figure 10.4-13a	Figure Number Not Used	
Figure 10.4-13B	GGNS RFPT EHC System Hydraulic Power Unit (HPU)	
Figure 10.4-14	Bypass Stop and Control Valve	
Figure 10.4-15	Bypass Stop Valve Actuator	
Figure 10.4-16	Bypass Control Valve Actuator	

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**CHAPTER 10.0 STEAM AND POWER CONVERSION SYSTEM**

**10.1 SUMMARY DESCRIPTION**

The components of the power conversion system are designed to produce electrical power from the steam coming from the reactor, condense the steam into water, and return the water to the reactor as heated feedwater, with a major portion of its gaseous, dissolved, and particulate impurities removed.

The power conversion system includes the turbine generator, main condensers, main condenser evacuation system, turbine gland sealing system, main steam system, turbine bypass system, condensate cleanup system, and the condensate and feedwater pumping and heating system. The heat rejected to the main condenser is removed by a closed circulating water system.

Steam, generated in the reactor, is supplied to the high pressure turbine. Steam leaving the high-pressure turbine passes through a combined moisture separator/reheater prior to entering the low-pressure turbines. A portion of the turbine steam is extracted for steam reheating and feedwater heating. The moisture separator drains, first stage steam reheater drains, and the drains from the fifth and sixth stage feedwater heaters go to the heater drain tank and are pumped forward into the feedwater stream. The second stage steam reheater drains go to the sixth stage feedwater heater. The drains from the fourth and third stage feedwater heaters cascade to the second stage feedwater heater. The second and first stage feedwater heaters drain independently to the main condenser.

Steam exhausted from the low-pressure turbines is condensed and deaerated in the main condenser. The condensate pumps take suction from the intermediate pressure condenser shell hotwell, delivering the condensate through the condensate demineralizers to the condensate booster pumps, which discharge through four stages of low-pressure feedwater heaters to the reactor feed pumps. The reactor feed pumps are steam-turbine driven and discharge through two stages of high-pressure feedwater heaters to the reactor.

The seal steam condenser and the steam-jet air ejectors are cooled by the turbine building cooling water system and the plant service water system, respectively.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Normally, the turbine utilizes all the steam being generated by the reactor; however, an automatic pressure-controlled turbine bypass system is provided to discharge excess steam directly to the condenser.

The steam and power conversion system is designed to utilize the rated 4412.2 MWt available from the reactor coolant system for long-term loading conditions. Of the above thermal energy, 4408 MWt represents rated core thermal power, and 4.2 MWt represents the net addition of accessory equipment. The steam and power conversion system is designed with the capability of accepting 105 percent of the normal rated thermal input for transients and short-term loading conditions.

The necessary biological shielding for the main turbines, reactor feed pump turbines, moisture separator and reheaters, and condenser has been provided for operator protection.

A summary of important design and performance characteristics of the power conversion system is given in Table 10.1-1.

The principal guaranteed reactor rating flow quantities and fluid energy levels are shown on the turbine cycle heat balance, Figure 10.1-2.

The majority of the steam and power conversion system is located in the turbine building. Since the turbine building is a nonseismic, nonsafety-related building, turbine building piping failures are not analyzed.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE 10.1-1: SUMMARY OF IMPORTANT DESIGN AND PERFORMANCE  
CHARACTERISTICS OF POWER CONVERSION SYSTEM**

a. Turbine data:

Manufacturer	A-CPSI/SPC/kwu
Type/LSB length, in.	TC6F-46
No. of turbines	1-HP, 3-LP

b. Net generator output, MW 1498.9

c. Turbine cycle heat rate, Btu/kW-hr 10,042

d. Exhaust pressures, in. Hg abs 3.62/2.91/2.37

e. Final feedwater temperature, F 419.5

f. Steam conditions at throttle valve:

Flow, 10 <sup>6</sup> lb/hr	19.005
Pressure, psia	951.0
Temperature, F	538.5
Enthalpy, Btu/lb	1190.4
Moisture content - %	0.60

g. Turbine cycle arrangement

Steam reheat, stages	2
No. of feedwater heating stages	6
Heater drain system	HP pumped forward, LP No. 4 and No. 3 cascade to No. 2, and No. 2 and No. 1 drain independently to condenser

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE 10.1-1: SUMMARY OF IMPORTANT DESIGN AND PERFORMANCE  
CHARACTERISTICS OF POWER CONVERSION SYSTEM (Continued)**

Feedwater heaters in condenser neck	Nos. 1, 2, 3, and 4
h. Type of condensate demineralizer	Deep bed
i. Main steam bypass capacity, %	30.4

FIGURE 10.1-001

DELETED





**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.2     TURBINE GENERATOR**

**10.2.1     Design Bases**

The turbine generator is designed for the following conditions:

Turbine-generator output, kW	1,498,988
Steam conditions at turbine throttle valves:	
Flow, lb/hr	19,005,082
Pressure, psia	951.0
Temperature, F	538.5
Moisture content, %	0.60
Exhaust pressures, in. Hg abs	3.62/2.91/2.37
Final feedwater temperature, F	419.5
Stages of feedwater heating	6
Stages of steam reheating	2

This represents the guaranteed reactor rating (100 percent) heat-balance conditions shown in Figure 10.1.2

The unit is intended for base load operation.

Within the functional limitation imposed by the nuclear steam supply system, the turbine generator is capable of accepting a load reduction from 100 percent to 35.4 percent (utilizing 30.4-percent bypass) at a rate not to exceed one percent per second with the ability to return to rated power. The plant can be controlled manually over its entire operating range at a rate of 195 MWe per minute, provided the total load change does not exceed the thermal stress limitations. The plant will accept a step-load rejection up to 35-percent full power without reactor trip. Step load reductions between 35 percent and 86 percent  $P_n$  (rated power) for other than fault events or load rejection events are not considered to be credible. Fault events in this range will not initiate a reactor trip unless power falls below 12 percent full power during the event. Step load reductions or load rejections greater than 86 percent rated power will result in a turbine trip and a reactor trip due to actuation of the Load Rejection circuitry and subsequent fast closure of the turbine control valves.

The turbine-generator and its ancillaries are manufactured in accordance with Allis-Chalmers Power Systems, Inc./SPC/kwu standard specifications.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.2.2     System Description**

**10.2.2.1     Turbine Generator**

The turbine generator consists of the turbine, moisture separator/reheaters, generator, exciter, controls, and required subsystems. Refer to subsection 10.2.3, Turbine Disk Integrity, for drawings of turbine, LP & HP stop and control valves, and associated equipment.

The main turbine includes one double-flow, high-pressure turbine and three double-flow, low-pressure turbines. The 1800-rpm, tandem-compound, six-flow, reheat steam turbine includes three double flow advanced design eight-disc (four discs per flow) LP turbines with 46-inch last-stage blades. Also, advanced design rotor discs for LP Nos. 1 and 2 turbines are made from 3.5% NiCrMoV steel material. Exhaust steam from the high-pressure turbine passes through two combined moisture separator and two-stage reheaters before entering the three low-pressure turbines.

The generator is a direct-driven, three-phase, 60-Hz, 22,000 volt, 1800-rpm, hydrogen cooled with water cooled stator and rotor windings, synchronous generator rated at 1600 MVA at 0.9 power factor, 75 psig hydrogen pressure, and 0.58 short-circuit ratio.

**10.2.2.2     Generator Exciter System**

The generator exciter system is a brushless, rotating, rectifier type with a thyristor voltage regulator. The exciter is coupled to the outboard end of the generator and includes a permanent-magnet pilot exciter which energizes the field of the main exciter through the voltage regulator. The output of the main exciter is rectified by silicon diodes mounted on rotating wheels; dc power is delivered to the generator field winding through conductors built into a central bore in the exciter end of the generator shaft. The exciter is cooled by air circulated within its housing by a shaft-mounted blower. The heat is rejected in an air-to-water heat exchanger in the housing.

**10.2.2.3     Cycle Description**

Steam enters the power conversion system in four main steam lines and flows to the four high-pressure stop and control valves of the main turbine generator (refer to Figure 10.3-3). As shown in Figure 10.1-2, approximately 95.2 percent of the main supply is

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

admitted to the high-pressure turbine. The other 4.8 percent is used in the second-stage reheating of the steam supply to the low-pressure turbines and for the air ejectors. During a station electrical load change, a portion of the main steam flow may occasionally be bypassed directly to the condenser to maintain a constant pressure in the reactor vessel steam dome. Heating steam is supplied to the offgas preheaters via the bypass header.

There is one extraction point for steam as it passes through the high-pressure turbine. A part of this high-pressure extraction steam is used for the first-stage reheating of the steam to the low-pressure turbines (refer to Figure 10.3-1), and the remainder is used for the last (sixth) stage of feedwater heating (refer to Figure 10.3-4). Most of the exhaust flow from the high-pressure turbine is led to the two combined moisture separator and two-stage reheaters. An extraction from the high-pressure turbine exhaust is used for the next-to-last (fifth) stage of feedwater heating. The drying and reheating processes, which take place between the high-pressure turbine exhaust and low-pressure turbine inlets, improve the cycle efficiency. These processes ultimately result in the production of additional electric energy from the same heat generated in the reactor. A portion of the reheated steam is directed to the turbines which drive the reactor feed pumps (refer to Figure 10.3-2). The remainder of the reheated steam is conducted equally to the three low-pressure turbines. The water removed from the steam passing through the moisture separator is drained either to the moisture separator drain tank or moisture separator shell drain tank and then to the heater drain tank (refer to Figure 10.3-8). A portion of the HP turbine exhaust flow is used for heating of the seal steam generator.

There are four extraction points in the low-pressure turbines. Extraction steam from these four points is used as the heating supply to the first four stages of feedwater heating. In addition to the external moisture separator, there is moisture removal in the low-pressure turbines at the last two extraction points (refer to Figure 10.3-4).

#### **10.2.2.4     Tests and Inspections**

[HISTORICAL INFORMATION] [An air leakage test will be performed to determine that the gas system is tight before hydrogen is introduced into a hydrogen-cooled generator. In addition, hydrogen purity will be monitored and tested in the generator. The

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

generator windings and all motors will be megger tested. Vibration tests will be performed on selected motor-driven equipment. Hydrostatic tests were performed on all coolers.

All piping was tested in accordance with the requirements of ANSI B31.1 "Power Piping Code," except as follows:

- a. Some unisolable portions of feedwater heater vents and drains with a design pressure of 50 psig or less.
- b. Some unisolable portions of moisture separator reheater vents and drains with a design pressure of 150 psig or less.
- c. Any condenser tie-in line of nominal pipe size of 6 inches or less with maximum operating pressure of 50 psig or less.

The main stop valves will be tested for tightness. All motor operated valves will be bench tested or in-place tested.]

The following tests and inspections will be performed periodically to ensure operability and reliability of the unit:

- a. The main stop and control valves and the low-pressure turbine stop and control valves will be closed fully and reopened by sequence testing initiated and monitored at the control panel Turbine Control Protection System (TCPS) Human Machine Interface (HMI). This system will check the actual closing time of each stop valve. If the closing time exceeds a specific time, the closing time will be indicated on the control panel TCPS HMIs.
- b. The extraction check valves, which are equipped with air-operated closing mechanisms, will be tested by partially closing the valves, using the test levers.
- c. The turbine overspeed trip solenoid valves in the redundant testable trip manifolds (TDMs), including the speed detector modules for the electrical overspeed trip, are tested and monitored from the TCPS HMIs. In addition, the diverse overspeed trip system (DOPS), a subsystem of TCPS, is tested at local panel H13-P830 JC12.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.2.2.5     Instrumentation Application**

The turbine generator utilizes a digital electrohydraulic control (DEHC) turbine control and protection system (TCPS) which controls the speed, load, and main steam pressure for startup and planned operations. The turbine trip function of TCPS trips the unit when required. The TCPS, which includes the turbine trip function and the bypass control function operate the main stop and control valves, LP turbine stop and control valves, bypass stop and control valves and other protective devices. Turbine-generator supervisory instrumentation is provided for operational analysis and malfunction diagnosis.

The automatic control functions are programmed to protect the reactor coolant system with appropriate corrective actions (see Chapter 7).

The turbine generator is equipped with a redundant digital electrohydraulic control system that combines the principles of distributed control system technology and high-pressure hydraulics to control steam flow through the turbine. The control system has five major functions:

- Speed control
- Load demand process
- Valve positioning control
- Pressure control
- Bypass control

**10.2.2.5.1     Emergency Control Operations**

The turbine trip function of TPCS will close all valves, shutting down the turbine on the following signals:

- a. Turbine is approximately 10 percent above rated speed. This trip is in effect during overspeed testing as well as normal operation. For overspeed trip details see subsection 10.2.2.5.4.
- b. Vacuum decreases to less than a preselected value.
- c. Excessive thrust bearing wear measured as a change in axial position of the shaft. Under Temporary Modification EC 89874, excessive thrust bearing is replaced with an alarm and operator action to monitor and manual trip the turbine if thrust wear is determined actual, when reactor power is above 20.8%.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

- d. A predetermined decrement of generator stator and rotor coolant flow rate; high coolant temperature; low water level in coolant tank; liquid in generator terminal box
- e. External trip signals, representing various electrical system malfunctions as well as remote manual trip on the control panel
- f. Loss of hydraulic fluid supply pressure. In case of a pressure loss in the control fluid supply, the turbine will remain tripped until the fluid system has been restored to normal operating pressure and the turbine is in reset.
- g. Low lubrication oil pressure
- h. Operation of the manual mechanical trip handle at the turbine front standard
- i. High level in moisture separator drain system or high level in moisture separator shell drain system
- j. High reactor water level
- k. GENERATOR PROTECTIVE RELAY actuation

The turbine generator will not trip as a direct result of a seismic event. It may, however, be tripped indirectly by one or more of its protective devices. The turbine is designed to accept the equivalent of 0.2g horizontally in any direction at the shaft centerline without tripping.

#### **10.2.2.5.2 Turbine-Generator Supervisory Instruments**

Although the turbine is not readily accessible during operation, the turbine supervisory instrumentation is sufficient to detect potential malfunctions. The turbine supervisory instrumentation includes monitoring of the following:

- a. Vibration
- b. Thrust bearing wear, measured as a change in axial shaft position
- c. Exhaust hood temperature and low spray water pressure
- d. Oil system pressures, levels, and temperatures

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

- e. Bearing metal and lube oil cooler inlet and outlet temperatures
- f. Turbine casing and other important metal temperatures
- g. Valve positions
- h. Casing and rotor differential expansion
- i. Shaft speed, electrical load, and control valve inlet pressure indication
- j. Hydrogen temperature, dew point, pressure, and purity in the generator
- k. Stator and rotor winding coolant temperature, pressure, conductivity, and flow
- l. Stator and rotor winding coolant outlet temperatures, conductivity, oxygen content of the shaft pump leakage water, coolant flow rate
- m. Exciter air temperatures
- n. Seal steam pressure and regulating valve position
- o. Seal steam condenser vacuum
- p. Seal oil pressure and temperature

**10.2.2.5.3 Testing Provisions**

Provisions are made for testing each of the following devices while the unit is operating:

- a. Main stop and control valves
- b. Bypass stop and control valves
- c. Low-pressure turbine stop and control valves
- d. Overspeed trip
- e. Turbine extraction nonreturn valves
- f. Deleted
- g. Deleted

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

- h. Remote trip solenoids of both testable dump manifolds
- i. Lubricating oil pump
- j. Hydraulic fluid pump

**10.2.2.5.4      Overspeed Protection**

The turbine overspeed protection system is not a safety-related system. Since the turbine overspeed control system equipment, electrical cables, and hydraulic lines are not required to safely shutdown the reactor, no protection is provided for the overspeed protection system from the effects of high or moderate energy pipe failure. Refer to Section 3.6 for further discussion of pipe break criteria. Nevertheless, the turbine is provided with a highly reliable and redundant control system to trip the turbine in the event of a turbine overspeed condition. Details of the overspeed protection system and the related turbine valving are discussed below.

The Ovation Turbine Control and Protection System (TCPS) provides the following overspeed protection features:

- a. Normal speed control that closes the high pressure control valve and low pressure control valves at 105%.
- b. Primary electronic overspeed protection system (DOPS), 110% set point, 3 passive speed probes, 2-out-of-3 logic channel trip and single failure proof, and on-line testable. DOPS is diverse and independent of the normal speed control system.
- c. Backup overspeed trip, 110% set point, 3 active sensors, 2-out-of-3 hardware channel trip independent of software and on-line testable.
- d. Backup overspeed trip, 110% set point, trip logic in software.
- e. Two redundant testable dump manifolds (TDM) to trip the turbine, each arranged in 2-out-of-3 logic, and either TDM trip will depressurize the emergency trip system fluid pressure which will result in fast closure of the high pressure stop and control valves, and the low pressure stop and control valves. TDM trip solenoids are testable on-line from the main control room console. Furthermore, tripping of one TDM will result in a cross trip of the other TDM to trip the turbine.



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Overspeed of the turbine is limited by rapid closure of the turbine control valves whenever generator output is dropped to less than a preset value, as would exist immediately after a load rejection. Load rejection detected by the 2002. GENERATOR PROTECTIVE RELAY. The TCPS which includes the backup overspeed trip and DOPS subsystems and GENERATOR PROTECTIVE RELAY are of proven design and are made of reliable components. The TCPS has redundant channels for functions critical to closure of the HP and the LP control valves in a speed-controlled mode.

The TCPS controls the unit in a speed-controlled mode during startup and in a main steam pressure control mode during power operation. The speed measuring transducers and redundant control improve the reliability for its function critical to closure of the HP and LP control valves in a speed controlled mode. In addition, the GENERATOR PROTECTIVE RELAY system provides trip signals to the ETS controllers of TCPS to protect the turbine from over speed during a load rejection event. Redundant power supplies are provided to the TCPS. If any of these fail, automatic transfer is made to the backup and an alarm is given.

The extraction valves close whenever the turbine trips. This protects the unit against excessive overspeed due to reverse flow of steam from the extraction system through the turbine.

Redundant turbine trip signals from TCPS are provided to the turbine protection logic to de-energize the feedwater heater bleeder trip valve solenoids resulting in closure of the feedwater heater steam extraction valves.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

In each pipe from the MSRs to the LP turbines, there is an LP stop and an LP control valve arranged to avoid excessive overspeed due to stored energy in the MSRs after a load rejection or turbine trip. One of these valves functions as a stop valve, the other as a control valve. [This sentence is for HISTORICAL INFORMATION ONLY: The design of the hydraulic valve actuators of the LP valves is as described in Report ER-601.] The first valve in each pipe, which acts as a stop valve, has an actuator piston which is controlled by a test solenoid valve in its fully open or fully closed position. The second valve functions as a control valve, and its actuator is designed with a feedback system, giving the LP control valves a proportional control function. Both the LP stop valves and the LP control valves are tripped closed when turbine the trips.

The stop and control valves are independent of each other, each valve having its own separate hydraulic actuator. The HP stop and control valves are physically combined in a single casing, but this in no way affects their independent function. All four HP stop and control valves of the turbine are identical and are of proven design based on extensive experience. Loss of passive speed signals to DOPS will result in a turbine trip. Loss of redundant electrical power or failure of trip solenoids in the TDMs will result in a trip because the trip solenoids de-energize to trip. Rupture of hydraulic piping will result in loss of hydraulic supply or trip header pressure which will cause a turbine trip. Loss of hydraulic pressure will also result in closure of the turbine stop and control valves, thereby preventing the possibility of turbine overspeed. High hydraulic piping rupture or loss of redundant power to the TDM trip solenoids will result in safe turbine shutdown.

In the event of a high- or moderate-energy piping failure, it may be possible that the turbine could lose both electrical speed control systems.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

A failure of the connection from the low pressure turbine to the condenser would result in air entering the condenser through the connection and this would result in a loss of condenser vacuum which would trip the turbine.

For further details of the overspeed trip system, see drawings of the control system in Allis-Chalmers' Engineering Report Nos. ER-504 and ER-601. [This paragraph is for HISTORICAL INFORMATION ONLY.]

### **10.2.3     Turbine Disk Integrity**

The use of suitable materials, adequate design, and preservice and inservice inspections can minimize the probability of failure of a turbine disk or rotor. NRC's Standard Review Plan 10.2.3, Turbine Disk Integrity, provides guidelines for choosing materials, designs, and inspections which minimize the probability of these failures. Grand Gulf's compliance with this SRP is demonstrated in the following subsections.

References referred to in the following sections are listed in subsection 10.2.3.8.

#### **10.2.3.1     Materials Selection**

"The turbine disk or rotor should be made from a material and by a process that tends to minimize flaw occurrence and maximize fracture toughness properties, such as a NiCrMoV alloy processed by vacuum melting or vacuum degassing."

For compliance with the above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- a.     "Chemical analysis should be made for each forging."

For compliance with the above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- b.     "The fracture appearance transition temperature (50% FATT) as obtained from Charpy tests performed in accordance with specification ASTM A-370 should be no higher than 0°F for low pressure disks and 50°F for high pressure rotors. Nil-ductility transition (NDT) temperature obtained in accordance with specification ASTM E-208 may be used in lieu of FATT. NDT temperatures should be no higher than -30° and 20°F, respectively."

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- c. "The Charpy V-notch (Cv) energy at the minimum operating temperature of each low pressure disk in the tangentialx direction should be at least 60 ft-lbs. The Cv energy of high pressure rotor materials at minimum operating temperature should be at least 50 ft-lbs. A minimum of three Cv specimens should be tested in accordance with specification ASTM A-370."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

#### **10.2.3.2     Fracture Toughness**

"The ratio of the fracture toughness (K<sub>Ic</sub>) of the disk and rotor materials to the maximum tangential stress at speeds from normal to design overspeed should be at least two in. at minimum operating temperature. Bore stress calculations should include components due to centrifugal loads, interference fit, and thermal gradients. Sufficient warmup time should be specified in the turbine operating instructions to assure that toughness will be adequate to prevent brittle fracture during startup."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

##### **10.2.3.2.1     Fracture Toughness Properties**

These are obtained as described in Ref. 1, Question 120.2 (Pg. 14) of Ref. 2, and Part 3 of Ref. 4.

#### **10.2.3.3     High Temperature Properties**

High pressure rotor integrity is described in Ref. 1, Part 1.2 of Ref. 3, and Question 120.1 (Pg. 7) of Ref. 2.

#### **10.2.3.4     Turbine Disk Design**

- a. For a discussion of the design overspeed of the turbine, see Ref. 1, Part 2 of Ref. 3, and Part 3 of Ref. 4.
- b. "The combined stresses of low pressure disks or high pressure rotor at design overspeed due to centrifugal forces, interference fit, and thermal gradients should not

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

exceed 0.75 of the minimum specified yield strength of the material, or 0.75 of the measured yield strength in the weak direction of the materials if appropriate tensile tests have been performed on the actual disk material."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- c. "The turbine shaft bearings should be able to withstand any combination of the normal operating loads, anticipated transients, and accidents resulting in turbine trip."

Compliance with above statement from SRP 10.2.3 is demonstrated in References 1, 2, 3 and 4.

- d. "The natural critical frequencies of the turbine shaft assemblies existing between zero speed and 20% overspeed should be controlled in the design and operation so as to cause no distress to the unit during operation."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- e. "The turbine rotor and disk design should facilitate inservice inspection of all high stress regions, including bores and keyways, with the need for removing the disks from the shaft."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

#### **10.2.3.5     Preservice Inspection**

- a. "Disk forgings should be rough machined prior to heat treatment."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- b. "Each finished disk should be subjected to 100% volumetric (ultrasonic), surface, and visual examinations using procedures and acceptance criteria equivalent to those specified for Class 1 components in the ASME Boiler and Pressure Vessel Code, Sections III and V."

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- c. "Finish machined bores, keyways, and drilled holes should be subjected to magnetic particle or liquid penetrant examination."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3 of Ref. 4.

- d. "Each turbine rotor assembly should be spin tested at the maximum speed anticipated during a turbine trip following loss of full load."

For compliance with above statement from SRP 10.2.3, see Ref. 1 and Part 3.5 of Ref. 4.

#### **10.2.3.6     Inservice Inspection**

Major components, such as HP and LP turbines, are to be inspected at periodic intervals.

The LP turbine discs are to be inspected at periodic intervals. The methodology used to determine the inspection intervals for the LP turbines and the acceptable levels of disc failure are given in References 6, 7 and 11 of Section 10.2.3.8. LP disc inspections are set to not exceed the limits given in Reference 11. Actual LP turbine rotor disc test data and actual operating hours are used to establish the appropriate operating hours between disc inspections.

A representative main stop and control valve, a representative low pressure stop and control valve, and a representative bypass stop and control valve are to be inspected at least once per 48 months. Depending upon what is found in the valves actually inspected will determine whether or not other valves will require inspection and repair during this same outage.

Generator bearings shaft seals are to be inspected on a periodic basis and the rotor should be removed for a thorough inspection of the generator internals at periodic intervals.

The main steam stop and control valves, the LP stop and control valves, and the turbine protective devices are to be exercised using the main control panel TCPS HMIs at periodic intervals. The testing intervals for the main steam stop and control valves, the LP stop

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

and control valves, and the turbine protective devices are in accordance with turbine generator vendor recommendations, as described on page 18 of Section 9 in Reference 5 of Section 10.2.3.8 and as discussed in References 9, 10 and 13 of Section 10.2.3.8.

The frequency of testing for all turbine extraction nonreturn valves will be the same intervals as those for the turbine stop and control valves.

For additional information, see page 6, section 8, part 6.C of Ref. 1.

**10.2.3.7     Design Standards**

The turbine generator is designed in accordance with ACPSI/KWU design standards which have evolved from years of design and operating experience. These design standards, in general, meet or exceed the intent of codes such as DIN, VDE, ANSI, and IEEE where applicable.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.2.3.8      References**

1.      Engineering Statement ES-43      Comments on the "Branch Technical Position MTEB 10.-1 (Rev. 2) Turbine Disk Integrity" for 1800 rpm Nuclear Steam Turbine-Generators with 46 inch Last Stage Blades.
2.      Engineering Statement ES-63      Comments on Questions from the Mechanical and Materials Engineering Branches of the NRC Pertaining to the A-CPSI Missile Reports ER-503 and ER-504.
3.      Engineering Report No. ER-503      Turbine Missile Analysis for 1800 rpm Nuclear Steam Turbine-Generators with 46 inch Last Stage Blades.
4.      Engineering Report No. ER-504      Probability of Turbine Missiles from 1800 rpm Nuclear Steam Turbine-Generators with 46 inch Last Stage Blades.
5.      Engineering Report No. ER-601      Speed Control of 1800 rpm Steam Turbine-Generators for Light Water Reactor Application
6.      Engineering Report No. ER-8503      Probability of disk cracking due to stress corrosion.
7.      Letter from C. R. Hutchinson to NRC Document Control Desk, GNRO-94/00114, dated October 12, 1994, "Closure and Deletion of License Condition 2.C.(26), Turbine Disc Integrity (PCOL 94/01)"
8.      Design Report No. FS4/1018/1995      Engineering Analysis in the Hypothetical Case of a Wheel Disk Bursting in the LP Sections 1 to 3 of the New Design Series



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

1.     Engineering Statement ES-43     Comments on the "Branch Technical Position MTEB 10.-1 (Rev. 2) Turbine Disk Integrity" for 1800 rpm Nuclear Steam Turbine-Generators with 46 inch Last Stage Blades.
9.     Letter from Siemens Power Corporation to W. R. Patterson, Turbine Project Manager, GEXI-95/00625, dated June 21, 1994, "Theoretical Basis and Calculations for Extending the Interval Between Testing of the Turbine Valves".
10.    Letter from Siemens Power Corporation to W. R. Patterson, Turbine Project Manager, GEXI-97/00102, dated March 6, 1997, "ATT Valve Testing".
11.    Missile Analysis with LP Upgrade, 98044j, November 19, 1998.
12.    GNRI-95/00083, "Issuance of Amendment No. 121 to Operating License No. NPF-29 - Grand Gulf Nuclear Station, Unit 1 (TAC No. M90673)", P. W. O'Connor, NRC, to C. R. Hutchinson, Entergy, April 17, 1995.
13.    Letter from Siemens Power Corporation to W. R. Patterson, GEXI-98/00233, dated August 17, 1998, "MAIN Turbine-Generator ATT Valve Test Interval".

Notes: Items 1-5 above were originated by Allis-Chalmers and revised by Siemens Power Corporation as part of turbine upgrade.

Item 6 above was performed by Utility Power Corporation and submitted to the NRC by MP&L via AECM-85/0333, dated November 1, 1985. This item was revised by Siemens Power Corporation as part of turbine upgrade.

#### **10.2.4     Evaluation**

The primary source of radioactivity in the steam and power conversion system is radiation from nitrogen-16, formed by activation in the reactor. This activity is carried with the steam to the turbine. Other gaseous sources of radioactivity are fission product noble gases and other activation gases, such as oxygen-19, nitrogen-17, and nitrogen-13, which are also carried with the steam to the turbine. Nongaseous fission and activation products are present in the turbine due to moisture carryover in

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

the steam from the NSSS. The maximum anticipated operating concentration of radioactivity in the high-pressure turbine will be the same as that indicated in the tables in Chapter 11 multiplied by the following appropriate carryover factors:

Noble gas	1 (100% carryover)
Halogens	0.02
Other fission products	0.001

The activity entering the low-pressure turbine is further reduced due to the presence of moisture separation, etc., between the high- and low-pressure turbines.

Most of the gaseous activity in the condenser will be removed by the air ejectors to the offgas system (see Section 11.3). The amount that is not removed will be reduced significantly by the approximate three minutes of holdup time in the condenser hotwells. Therefore, the activity entering the condensate and the feedwater line will be significantly reduced.

Shielding requirements are discussed in Section 12.3. The turbine will be in a controlled access area with a locked door.

#### **10.2.5     Main Generator Hydrogen and Carbon Dioxide Systems**

##### **10.2.5.1    Power Generation Design Bases**

- a.   The hydrogen and carbon dioxide system is designed to provide the necessary flow and pressure at the main turbine generator:
  1.   During startup when air is purged from the generator by carbon dioxide
  2.   During startup when carbon dioxide is purged from the generator by hydrogen
  3.   During shutdown when hydrogen is purged from the generator by carbon dioxide
  4.   During shutdown when carbon dioxide is purged from the generator by air

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

5. During normal operation where hydrogen is continuously supplied to the generator to make up for generator hydrogen leakage
  - b. A dry hydrogen environment is maintained within the generator during normal operation by means of a hydrogen gas dryer unit.
  - c. Should the carbon dioxide portion of the subject system fail, the plant could continue in normal operation. Should the hydrogen portion of the subject system fail, the plant could continue in normal operation until the generator hydrogen pressure began to fall below 75 psi after which the generator should be operated in accordance with the turbine generator manufacturer's requirements.

**10.2.5.2     System Description**

The hydrogen and carbon dioxide system consists of hydrogen supply piping with all necessary valves, instrumentation, gas purity measuring equipment, hydrogen gas dryers, and carbon dioxide supply piping with all necessary valves and instrumentation. The hydrogen and carbon dioxide system components, piping, valves, and instrumentation are shown in Figures 10.2-1 through 10.2-3.

The carbon dioxide bulk storage units are located outdoors. The hydrogen and carbon dioxide gas filling unit (generator gas rack) is located inside the turbine building at El 129'-0" in an area classified as radiation zone B.

Hydrogen makeup to the generator is supplied from the Hydrogen Water Chemistry (HWC) system (P73) via a ¾" supply line from hydrogen isolation/regulation panel 1H22-P732. The hydrogen bulk storage area for the HWC system is described in Section 9.5.10.2.1.

**10.2.5.3     System Evaluation**

The hydrogen and carbon dioxide system serves no safety function. Systems analysis has shown that failure of the hydrogen and carbon dioxide system will not compromise any safety-related systems or prevent safe shutdown.

The safety evaluation for the hydrogen bulk storage area for the HWC system is included in Section 9.5.10.3.1.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The hydrogen distribution headers inside the turbine building are routed as follows:

1. Headers are located to prevent physical damage to pipe.
2. Headers are located away from equipment that present a fire hazard to hydrogen.
3. Headers are routed through ventilated areas.

The protective measures taken to prevent fires and explosions include the strict observance of the turbine vendor's operating instructions. These protective measures include the following during operation and maintenance:

- a. During normal operation, hydrogen is used to cool the generator. To prevent hydrogen from leaking through the generator shaft seal glands into the turbine building, a shaft oil sealing system is provided.

To avoid having an explosive hydrogen-air mixture in the generator at any time, such as when the generator is being filled with hydrogen prior to being placed in service or when hydrogen is being removed from the generator for maintenance or inspection, a carbon dioxide purge is used. Hydrogen concentrations are controlled with the aid of a gas analyzer.

Before filling or purging the generator, the carbon dioxide analyzer will be calibrated with air, carbon dioxide, and hydrogen.

- b. Hydrogen removal from the generator before it is opened for maintenance

While the generator is at standstill or on turning-gear operation and the shaft-sealing system is in operation, carbon dioxide is admitted into the generator, maintaining a pressure between specified limits in the generator casing, until the carbon dioxide concentration in the discharge is in excess of 95 percent measured by a gas tester on the control board of the hydrogen and carbon dioxide gas system. The carbon dioxide will be purged from the casing with dry air.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

- c. Air removal from the generator before hydrogen fill following maintenance

While the generator is at a standstill or on turning-gear operation and the shaft-sealing system is in operation, carbon dioxide will be admitted to the bottom of the generator through carbon dioxide distribution piping, and air in the generator will be discharged to atmosphere through the hydrogen feed pipe.

While the generator is being filled with carbon dioxide, the percentage of carbon dioxide in the gas mixture being discharged from the generator to the atmosphere should be measured by the carbon dioxide-air scale of the carbon dioxide analyzer. Carbon dioxide will be admitted to the generator until air has been displaced by carbon dioxide.

- d. Filling generator with hydrogen

When the air has been displaced by carbon dioxide as determined by the gas analyzer, hydrogen is admitted to the top of the generator through the sparger and carbon dioxide is vented to atmosphere through the lower sparger, where it was originally admitted. When hydrogen concentration in the vented gas is above 98 percent hydrogen in air, the vent to atmosphere may be closed and the hydrogen pressure raised to the required operating pressure.

#### **10.2.5.4     Tests and Inspections**

The hydrogen and carbon dioxide system is proved operable by its use. [HISTORICAL INFORMATION] [System piping and components were pneumatically tested prior to initial startup.]


#### **10.2.5.5     Instrumentation Application**

The primary operating station for the hydrogen and carbon dioxide system is at the generator gas rack. Hydrogen pressure and gas purity are monitored both at the generator gas rack and in the control room. In addition, a mechanical hydrogen purity meter system which monitors generator fan differential pressure provides a redundant hydrogen purity indication at the generator gas rack. Hydrogen dew point is monitored to provide generator moisture detection.

Figure 10.2-001:  
Superceded by FSAR Figures 10.2-001-1 and 10.2-001-2


# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

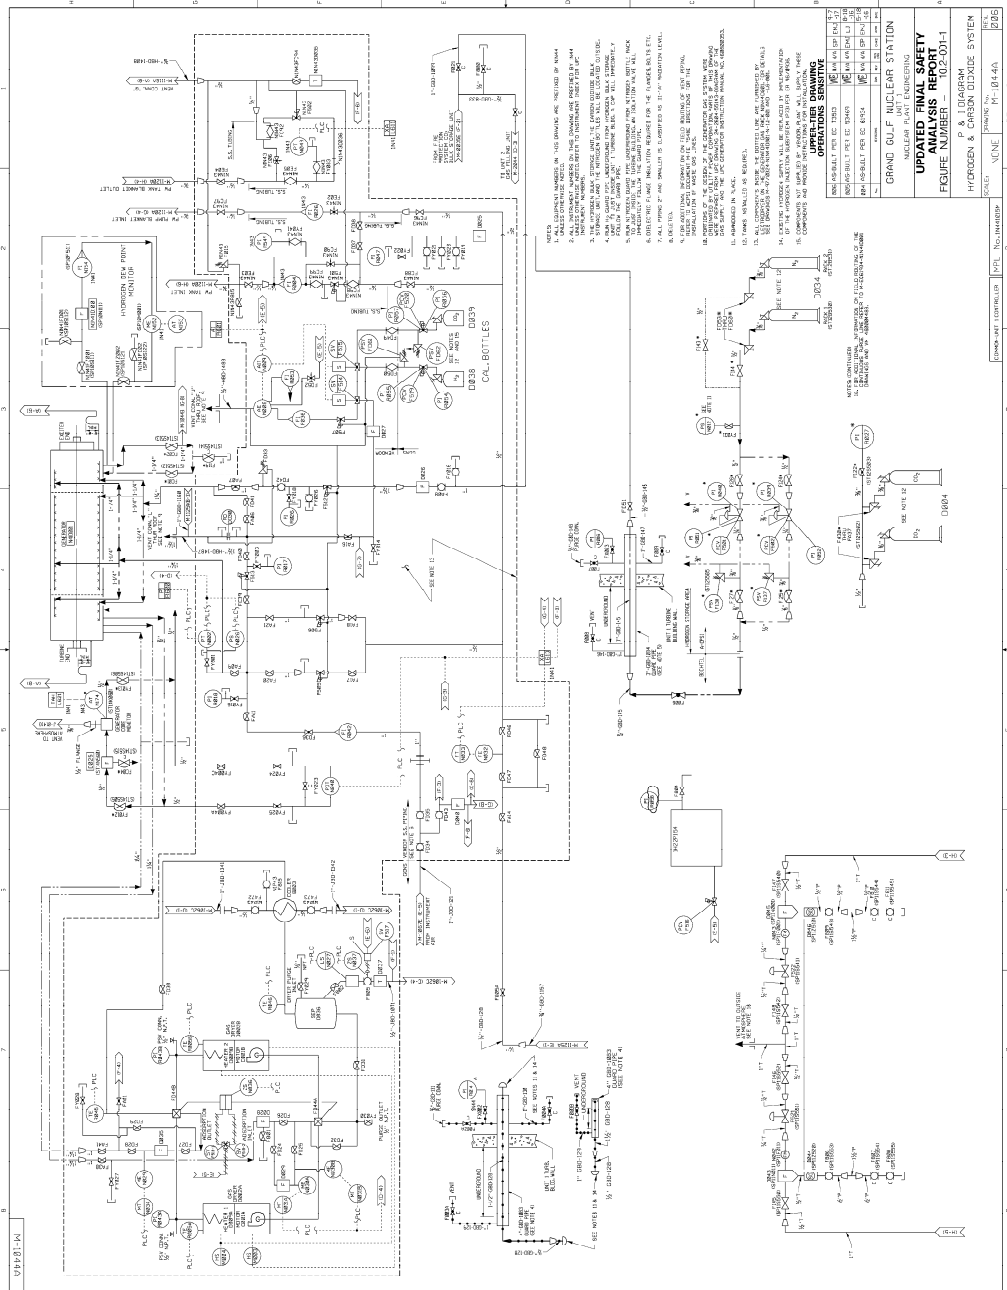

# GRAND GULF NUCLEAR GENERATING STATION


## Updated Final Safety Analysis Report (UFSAR)

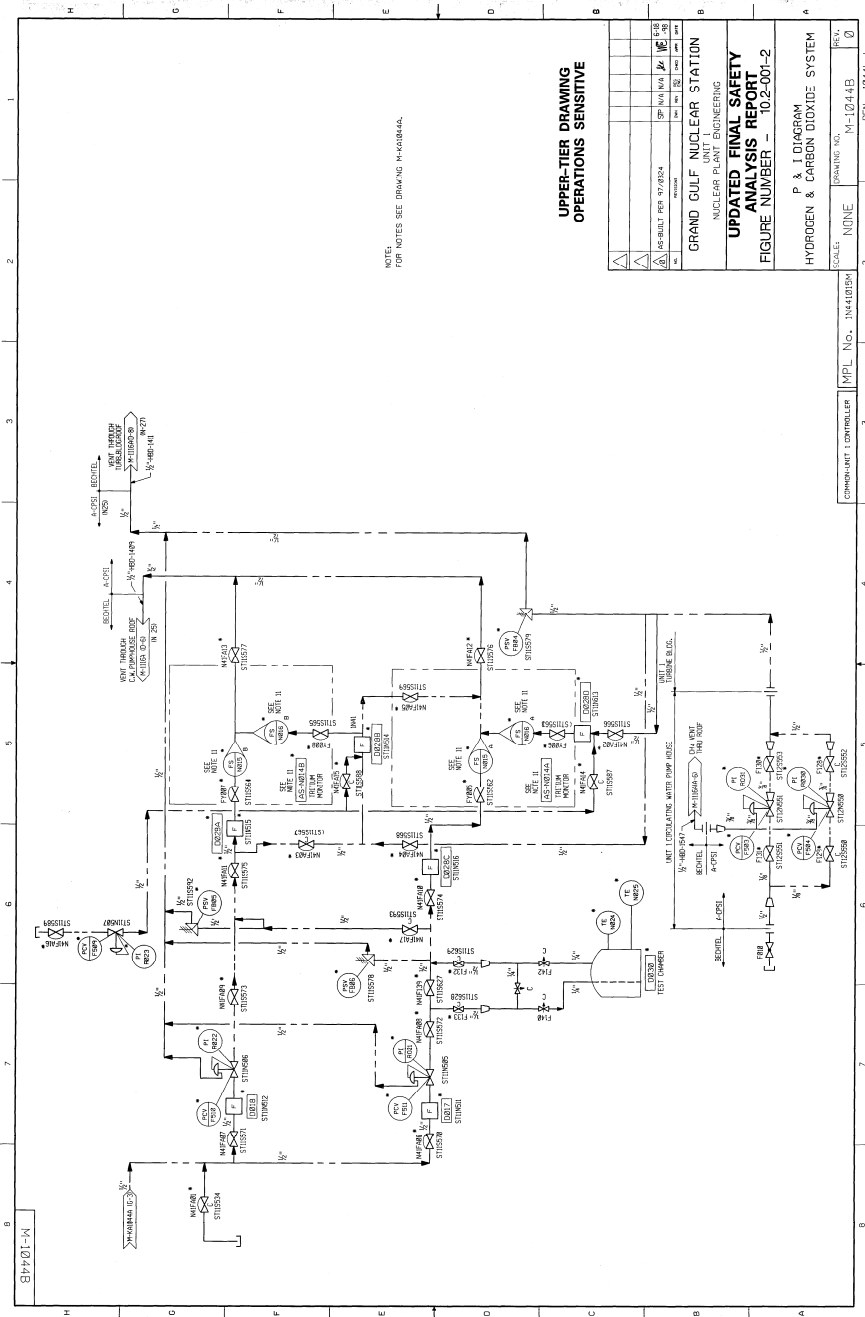




# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

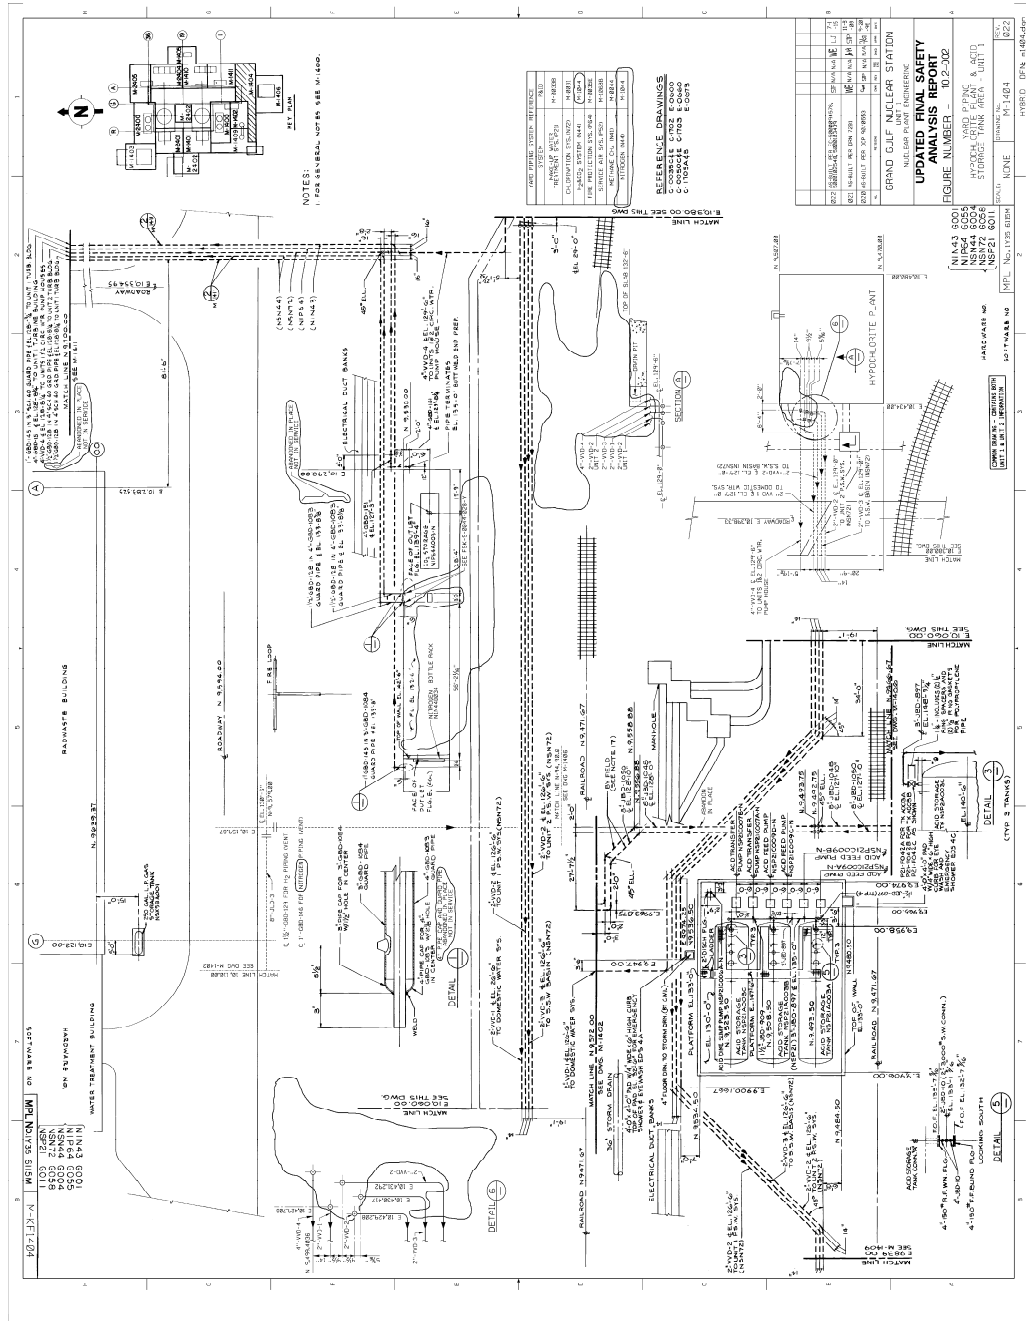

# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

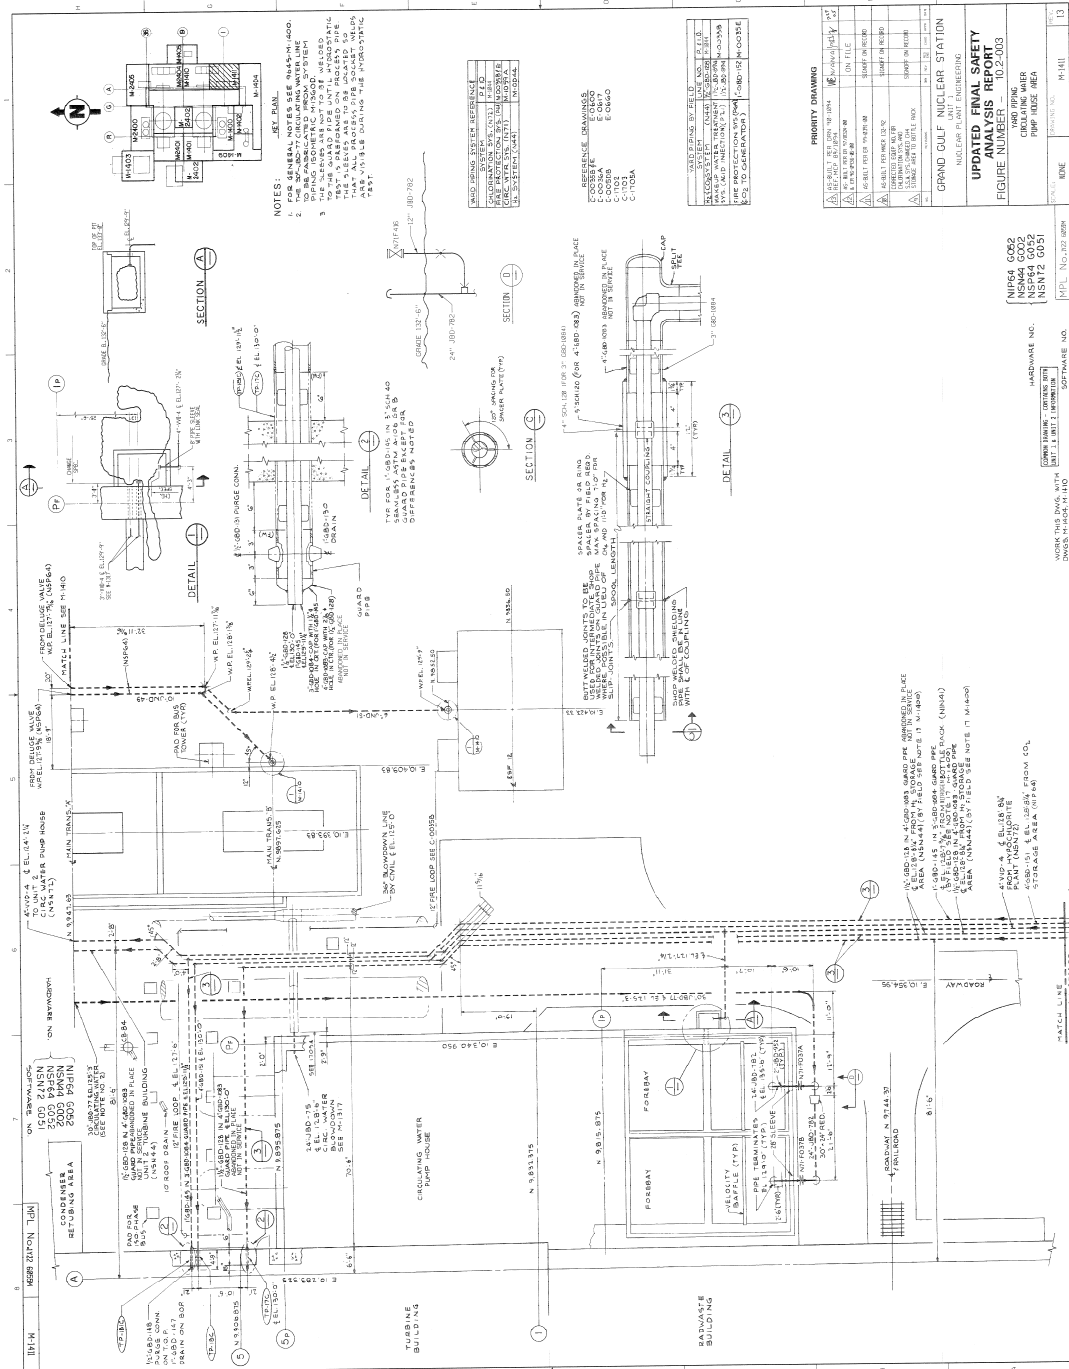

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.3     MAIN AND REHEAT STEAM SYSTEM**

**10.3.1     Power Generation Design Bases**

The main and reheat steam system performs the following:

- a.    Delivers main steam from the reactor to the turbine generator from warmup to valves-wide-open flow
- b.    Delivers main steam to the second stage reheaters, steam jet air ejector, and offgas preheaters
- c.    Delivers main steam to the reactor feed pump turbines during startup and low-load operation and to the seal steam generator (during low loads)
- d.    Delivers reheat steam to the reactor feed pump turbines during normal operation
- e.    Bypasses main steam past the turbine directly to the main condenser during startup and in the event the steam required by the turbine is less than that produced by the NSSS.

**10.3.2     System Description**

The main and reheat steam system is shown in Figures 10.3-1 to 10.3-3. The main steam piping consists of four 28-inch outside diameter lines downstream of the main steam line shutoff valves up to the main turbine stop valves. The extraction steam lines used for the feedwater heaters are shown in Figure 10.3-4. The feedwater heater vents and drains are shown in Figures 10.3-5 through 10.3-7. The moisture separator/reheater vents and drains are shown in Figure 10.3-8. The remaining portion of the main steam lines between the reactor pressure vessel and the shutoff valves is described in Section 5.4. Section 5.2 discusses inservice inspection, materials, and environmental conditions for the safety-related portions of the system piping. A discussion of the measures provided to limit blowdown of the system in the event of a steam line break is presented in subsection 5.4.4. The use of four main steam lines permits tests of the turbine stop valves and main steam line isolation valves during plant operation, with only a minimum of load reduction.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

All equipment, piping, and valves described in this section are located in the turbine building. Major components such as combined main stop and control valves, combined bypass stop and control valves, moisture separator/reheaters, reactor feed pump turbines, and main turbines are located in high radiation areas.

All main steam line piping between the main steam line shutoff valve and the turbine main stop valve, turbine bypass piping from the main steam line to the turbine bypass stop valve, and the main steam branch lines have been designed, fabricated, and tested in accordance with the requirements of Table 3.2-1. The turbine bypass system is discussed in subsection 10.4.4.

The design pressure-temperature rating of the main steam piping is 1250 psig, 575 F, the same as the design pressure-temperature of the reactor. The main steam line has been analyzed for the dynamic loadings due to fast closure of the turbine stop valves.

The branch lines from the four main steam lines to the turbine bypass system are headered. This header placement ensures that the turbine bypass system is connected to the operating steam lines.

#### **10.3.3     System Evaluation**

The portion of the main and reheat steam system described in this section has no safety-related function as discussed in Section 3.2, and therefore is not classified as seismic Category I.

#### **10.3.4     Tests and Inspections**

Inspection and testing were carried out in accordance with the requirements of the codes and standards listed in Table 3.2-1. The main steam lines were hydrostatically tested to confirm leak tightness. Visual inspection of the pipe weld joints in the main steam lines confirmed the exterior condition of the weld.

#### **10.3.5     Instrumentation Application**

Steam-flow measurement and its application to reactor coolant control are discussed in subsection 7.7.1.4. Steam pressure measurement and its application to turbine generator control are discussed in subsection 7.7.1.5. Leakage detection in the event of a main steam line break is discussed in subsection 7.6.1.4.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.3.6      Steam and Feedwater System Materials**

Section 5.4 discusses the Class 2 and 3 portion of the main steam and feedwater piping and contains a discussion of materials as required in Regulatory Guide 1.70, Revision 2.

**TABLE 1: COMPONENT SPECIFICATIONS**

ITEM NO.	DESCRIPTION	MANUFACTURER	DATE
1	REACTOR CORE	WESTINGHOUSE	1975
2	STEAM GENERATOR	WESTINGHOUSE	1975
3	CONDENSER	WESTINGHOUSE	1975
4	COOLING TOWER	WESTINGHOUSE	1975
5	BOILER	WESTINGHOUSE	1975
6	HEATER	WESTINGHOUSE	1975
7	VALVE	WESTINGHOUSE	1975
8	PUMP	WESTINGHOUSE	1975
9	CONTROLLER	WESTINGHOUSE	1975
10	WIRE	WESTINGHOUSE	1975

**NOTES:**

1. This drawing is a schematic diagram of the Grand Gulf Nuclear Station.
2. The drawing shows the reactor core, steam generator, condenser, cooling tower, boiler, heater, valve, pump, controller, and wire.
3. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
4. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
5. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
6. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
7. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
8. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
9. The drawing is a technical drawing of the Grand Gulf Nuclear Station.
10. The drawing is a technical drawing of the Grand Gulf Nuclear Station.









# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

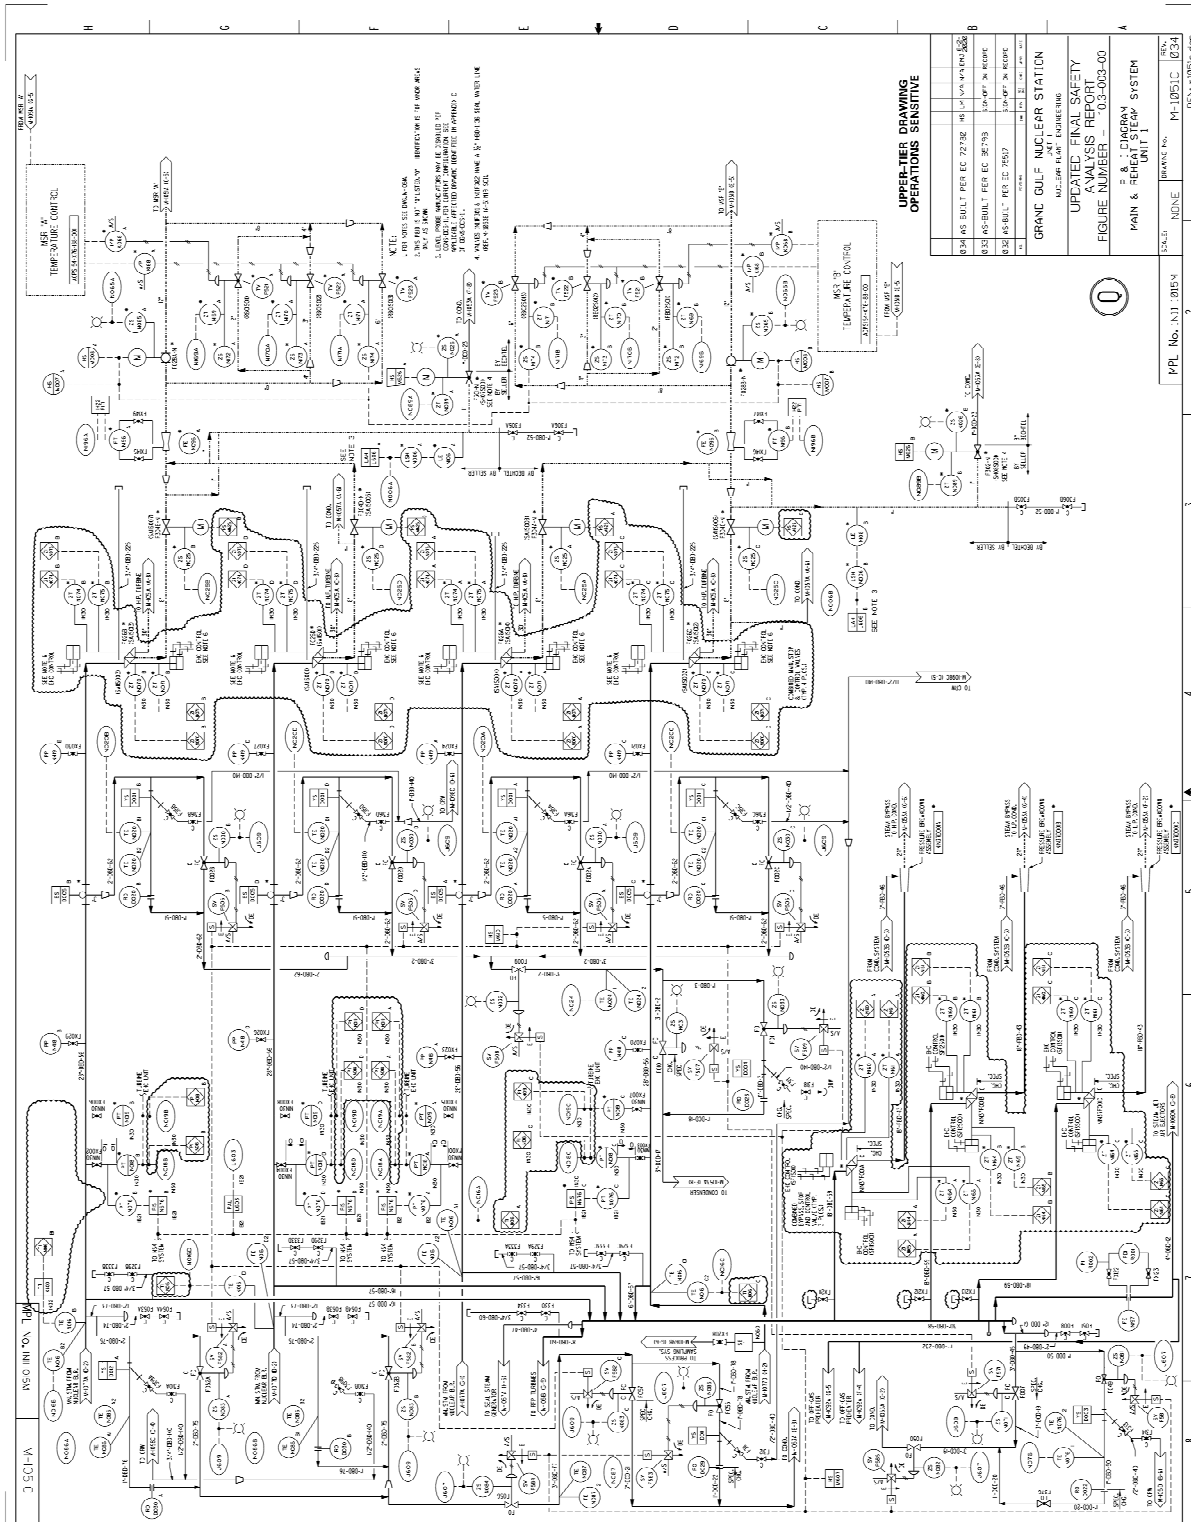

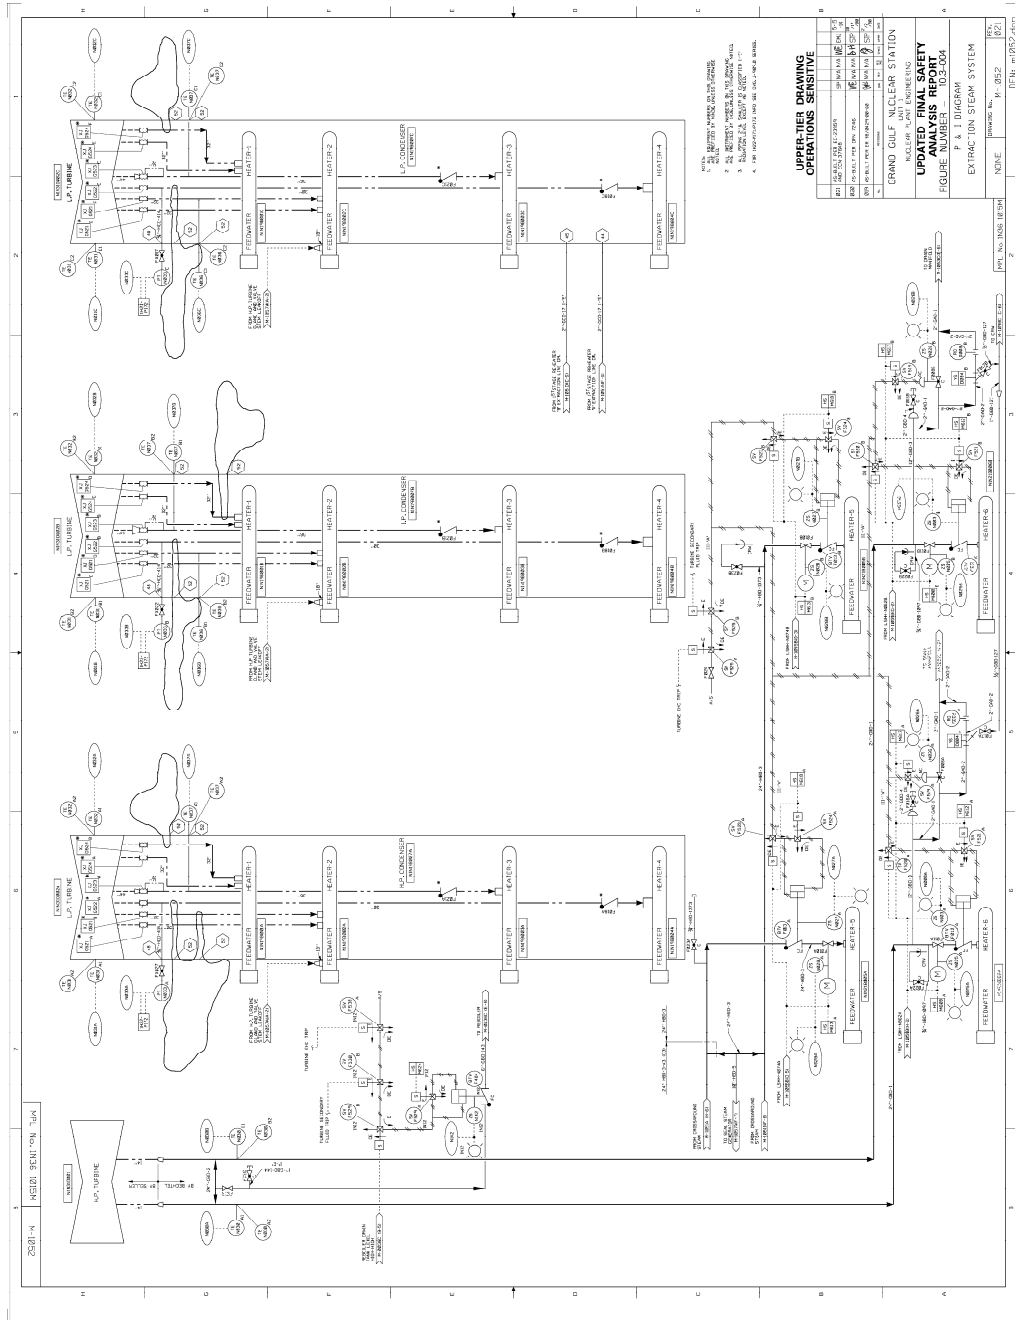

**UPPER-TIER DRAWING OPERATIONS SENSITIVE**

**Grand Gulf Nuclear Station**  
 Unit 1  
 Nuclear Engineering  
 Updated Final Safety Analysis Report  
 Figure Number - 10.3-005-1  
 P & I Diagram  
 Heater Vents & Drains Systems  
 Unit 1

**Legend:**

- 1. ALL EQUIPMENT NUMBERS ON THIS DRAWING ARE TO BE IDENTICAL TO THE EQUIPMENT NUMBERS ON THE DRAWING SHEET.
- 2. ALL INSTRUMENT NUMBERS ON THIS DRAWING ARE TO BE IDENTICAL TO THE INSTRUMENT NUMBERS ON THE DRAWING SHEET.
- 3. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 4. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 5. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 6. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 7. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 8. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 9. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
- 10. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.

**Notes:**


1. ALL EQUIPMENT NUMBERS ON THIS DRAWING ARE TO BE IDENTICAL TO THE EQUIPMENT NUMBERS ON THE DRAWING SHEET.
2. ALL INSTRUMENT NUMBERS ON THIS DRAWING ARE TO BE IDENTICAL TO THE INSTRUMENT NUMBERS ON THE DRAWING SHEET.
3. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
4. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
5. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
6. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
7. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
8. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
9. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.
10. THE DRAWING NUMBER IS TO BE IDENTICAL TO THE DRAWING NUMBER ON THE DRAWING SHEET.




[illegible]

# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

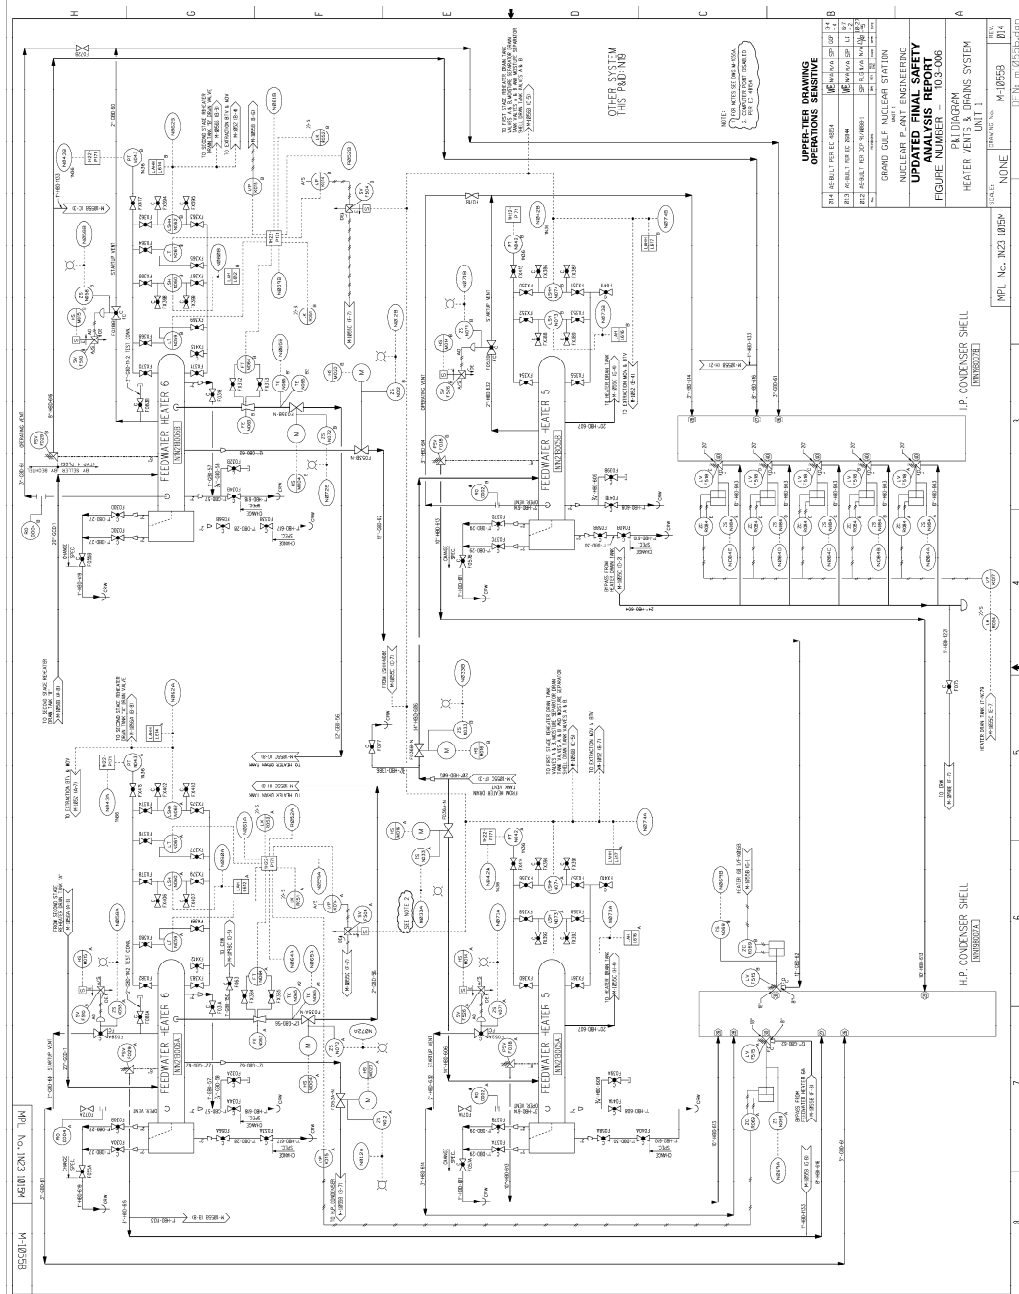

GRAND GULF NUCLEAR GENERATING STATION  
Updated Final Safety Analysis Report (UFSAR)

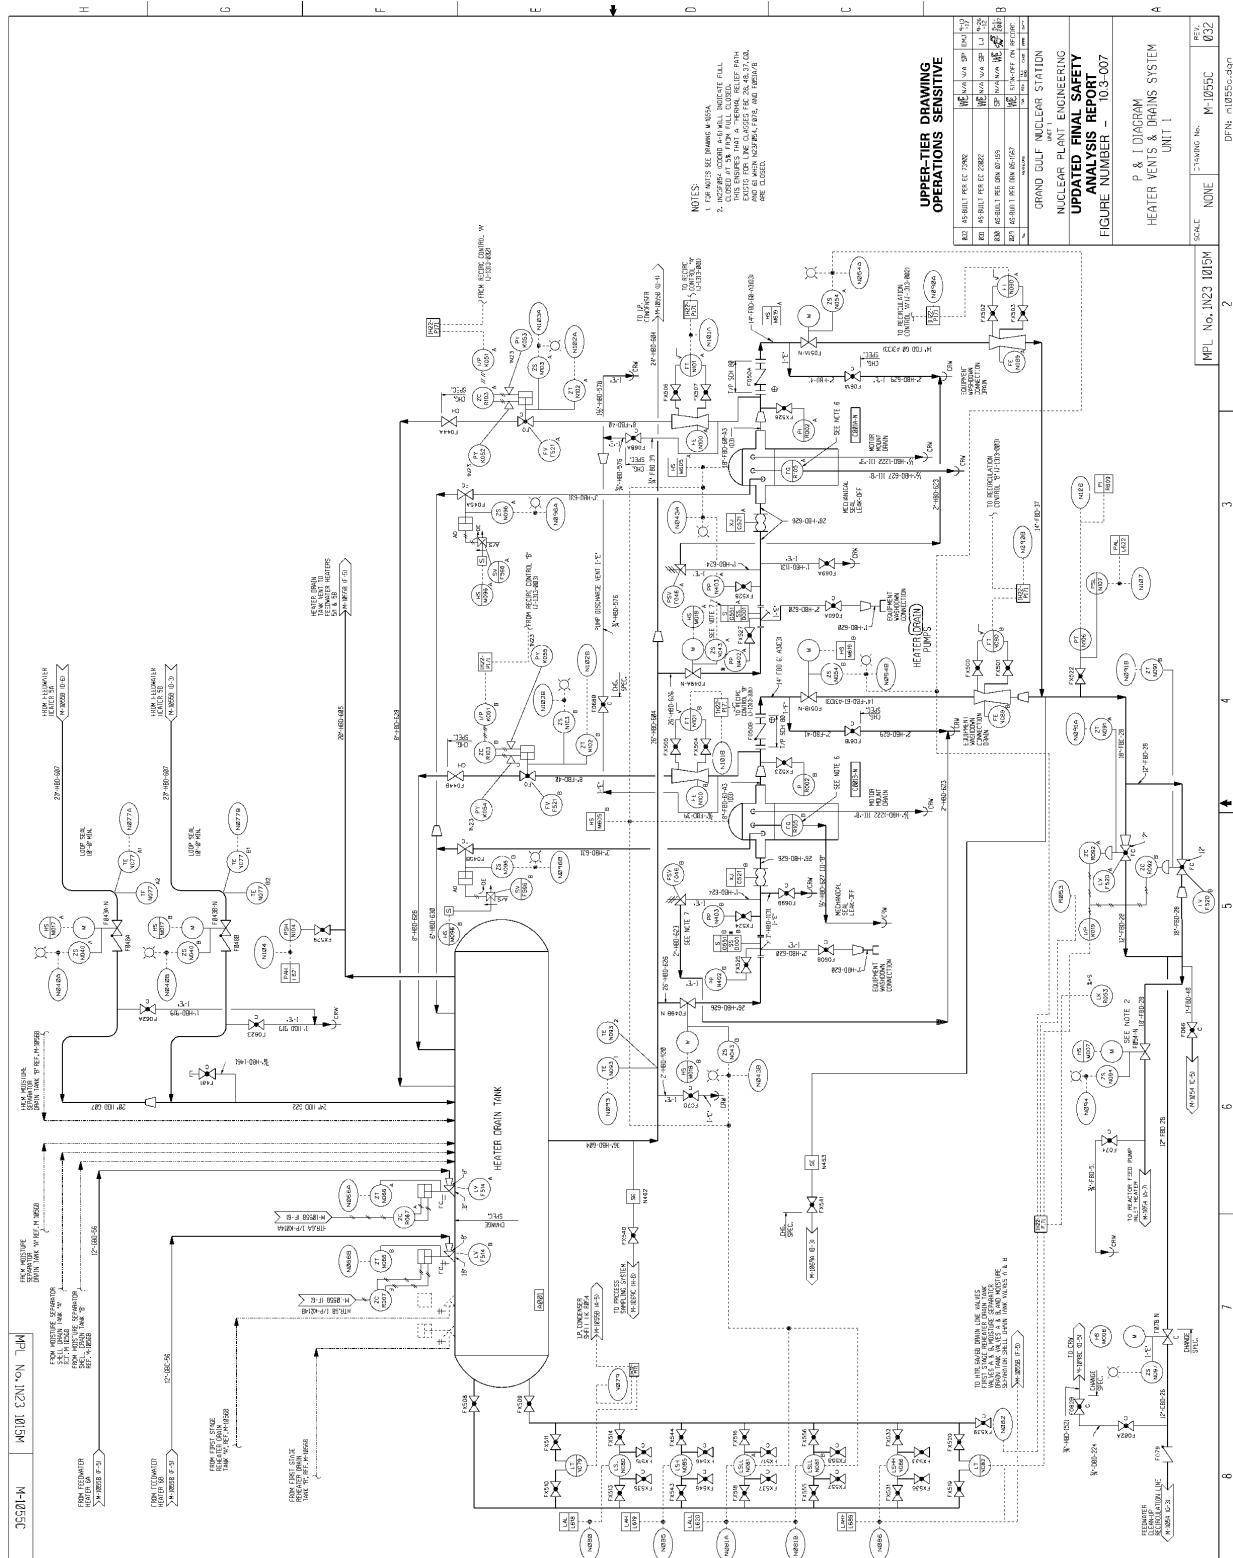

[illegible]



[illegible]

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.4     OTHER FEATURES OF STEAM AND POWER CONVERSION SYSTEM**

**10.4.1     Main Condensers**

**10.4.1.1     Power Generation Design Bases**

a.     Performance Requirements

The objective of the main condenser is to provide the heat sink for the turbine exhaust steam, turbine bypass steam, and other turbine cycle flows, and to receive and collect flows for return to the reactor.

The main condenser is designed for the following conditions at normal full load:

Total main turbine exhaust steam, lb/hr	894 x 10 <sup>6</sup>
Total condensate outflow, lb/hr	10.658 x 10 <sup>6</sup>
Total condenser duty, Btu/hr	8.568 x 10 <sup>9</sup>
No. of condenser shells	3
Condenser pressure, in. Hg abs	2.26/2.86/3.68
Circulating water:	
Flow, gpm	572,000
No. of tube passes per shell	1
Inlet temperature, F	85
Outlet temperature, F	115

b.     Turbine Bypass Steam

The main condenser is designed to accept up to 30.4 percent of the guaranteed reactor steam flow from the turbine bypass system described in subsection 10.4.4. This condition is accommodated without increasing the condenser back pressure to the turbine trip set point or exceeding the allowable turbine exhaust temperature.

c.     Condensate Deaeration

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The main condenser is designed to deaerate the condensate and provide the required water quality. The dissolved oxygen in the condenser hotwell effluent will be in accordance with Heat Exchange Institute standards or less under normal full-load operation.

d. Air Leakage

The main condenser is designed to minimize air leakage. Welded construction has been used for the condenser shells and, wherever practicable, for condenser shell connections and penetrations. Equipment and piping connected to the condenser shells are also designed to minimize air leakage to the main condenser.

The design capacity of the evacuation system described in subsection 10.4.2 has been determined in accordance with the recommendations of the Heat Exchange Institute, Standards for Steam Surface Condensers.

Performance of a Hydrogen Water Chemistry (HWC) program will have an effect on the amount of non-condensables in the condenser. At a design 102 scfm injection rate for hydrogen, the hydrogen concentration in the steam reduces slightly. Both radiolytic oxygen and radiolytic hydrogen, the products of the radiolytic decomposition of the primary coolant, are reduced to near zero at the design injection rate. Because of the reduced radiolytic gas flows, the total non-condensable gas flow rate in the offgas system will reduce slightly from normal water chemistry (NWC) to HWC conditions, as shown in the Table below, and assuming a 40 scfm in-leakage into the condenser:

	NWC (scfm)	HWC (scfm)
Radiolytic Hydrogen	105	0
Injected Hydrogen	0	102
Total Hydrogen	105	102
<hr/>		
Radiolytic Oxygen	53	0
In Leakage Oxygen	8	8
Total Oxygen	61	8

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Total Hydrogen	105	102
Total Oxygen	61	8
In-Leakage Nitrogen	32	32
Total Non-condensables	198	142
Oxygen Added to Offgas	0	51
Total Offgas Flow	198	193

e.     Condensate Detention

The condenser hotwells are designed to store a sufficient volume of condensate to provide at least a 1.5-min. effective detention of the condensate for radioactive decay.

f.     Design Codes

The condenser has been designed in accordance with the requirements of the Heat Exchange Institute, Standards for Steam Surface Condensers.

**10.4.1.2     System Description**

During plant operation, steam from the low-pressure turbine is exhausted directly downward into the condenser shells through exhaust openings in the bottom of the turbine casings and is condensed. The condenser consists of three shells, each serving one double-flow, low-pressure turbine section. The condenser also serves as a heat sink for several other flows, such as exhaust steam from the feed pump turbines, cascading heater drains, air ejector condenser drains, and seal steam condenser drains.

Other flows occurring periodically or continuously originate from the startup vents of the condensate pumps, condensate booster pumps and reactor feed pumps, minimum recirculation flows of the reactor feed pumps, condensate booster pumps and condensate pumps, feedwater line startup flushing, turbine drains, low-point drains, deaerating steam, and condensate makeup.

During transient conditions, the condenser is designed to receive turbine bypass steam and feedwater heater and drain tank high-level dumps. These drain tanks include the moisture separator, reheater, and feedwater heater drain tanks. The condenser is also

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

designed to receive relief valve discharges from moisture separator/reheater shells, feedwater heater shells, seal steam header, and various steam supply lines.

To prevent tube failure during operation of the turbine bypass, direct steam impingement on the tubes is prohibited by use of spargers to distribute the flow inside the condenser.

The condenser is cooled by the circulating water system described in subsection 10.4.5 which removes the heat rejected to the condenser.

The condensate is pumped from the intermediate pressure condenser shell hotwell by the condensate pumps described in subsection 10.4.7 and is thereby returned to the steam cycle.

The main condenser is a multipressure, three-shell, single pass, deaerating-type condenser with divided water boxes. All condenser tubes are made of stainless steel. The condenser shells are supported on the turbine foundation mat, with expansion joints provided between each turbine exhaust opening and the steam inlet connections of the condenser shells.

The condenser hotwells have baffles to ensure a minimum detention of 1.5 min. for all condensate from the time it enters the hotwells until it is removed by the condensate pumps.

Valves are provided in the circulating water system to permit either half of the condenser to be removed from service.

Air leakage and noncondensable gases, including hydrogen and oxygen gases contained in the turbine exhaust steam due to dissociation of water in the reactor, are collected in the condenser and passed through the air-cooling section of the condenser. They are removed by the main condenser evacuation system described in subsection 10.4.2.

Before leaving the condenser, the condensate is deaerated to reduce the level of dissolved oxygen to the required quality.

Since the main condenser operates at a vacuum, any leakage is into the shell side of the main condenser and radioactive leakage to the atmosphere cannot occur. Provision is made for detection of circulating water leakage into the shell side of the main condenser.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

At startup, steam is admitted to each condenser shell to assist in condensate deaeration.

**10.4.1.3     System Evaluation**

During operation, radioactive steam, gases, and condensate are present in the shells of the main condenser. The anticipated inventory of radioactive contaminants during operation and shutdown is discussed in Sections 11.1 and 11.3. Necessary shielding and controlled access for the main condenser are provided (see Sections 12.1 and 12.3).

Condensate is detained in the main condenser for a minimum of 1.5 min. to permit radioactive decay before the condensate enters the condensate system.

Hydrogen buildup during operation is not expected to occur due to provisions for continuous evacuation of the noncondensibles from the main condenser. The air cooling sections of the main condenser are centrally located in each tube field and are designed to provide for free admission of the noncondensibles. The noncondensibles are removed from each condenser shell via two lines. Each line originates at the air cooling section inside each condenser shell and is routed through the condenser shell for welding to the adjacent shell and then finally to the steam jet air ejector suction piping. The condenser air removal ejector system exhausts the noncondensibles to the offgas system by means of a steam jet air ejector unit. During shutdown, significant hydrogen buildup in the main condenser will not occur as the main condenser will then be isolated from potential sources of hydrogen.

Main condenser tubeside water quality is maintained within limits that prevent long-term corrosion of the tubes and components. The construction materials used for the main condenser tubes and components are equal in the electromotive force of materials, thereby preventing galvanic corrosion. For example, condenser tubes are stainless steel material; tube sheets and waterboxes are carbon steel material.

The main condensers are not required to effect or support the safe shutdown of the reactor or to perform in the operation of reactor safety features.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Exhaust hood overheating protection is provided by desuperheating sprays located just downstream of the last stage blades of the turbine.

The loss of main condenser vacuum will cause the turbine to be tripped.

The turbine cross-around piping and moisture separator/ reheaters are protected from overpressure by safety relief valves which discharge to the main condenser. The minimum setting of the relief valves is 10 percent above the pressure existing at the high-pressure turbine exhaust when the high-pressure section of the turbine is passing maximum calculated flow with 105 percent rated pressure and normal operating conditions.

Each low-pressure turbine receives steam from the high-pressure turbine through the moisture separators, steam reheaters, and the low-pressure turbine stop and control valves. The possible types of conditions that could lead to transient conditions requiring the operation of the safety relief valves involve the sudden closing of the low-pressure turbine stop and control valves. This sudden closing may occur in the event of a sudden generator load rejection, emergency turbine trip, or malfunction of the low-pressure turbine stop and control valves. During discharge of the safety relief valves to the main condenser, there is a corresponding reduction in the low-pressure turbine exhaust flow to the main condenser. Therefore, the total heat load on the main condenser is not increased appreciably as a result of the operation of the safety relief valves.

Should the turbine stop, control, or bypass valves fail to close on loss of condenser vacuum, four rupture diaphragms on each low-pressure turbine section protect the condenser and turbine exhaust hoods against overpressure.

#### **10.4.1.4     Tests and Inspections**

[HISTORICAL INFORMATION] [Each condenser shell is to receive a field hydrostatic test before initial operation. This test will consist of filling the condenser shell with water and, at the resulting static head, inspecting all tube joints, accessible welds, and surfaces for visible leakage and/or excessive deflection. As an alternative to testing with water, a low-pressure air and soap bubble test may be used.]

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Each condenser waterbox is to receive a field hydrostatic test with all joints and external surfaces inspected for leakage.] |

The condenser is provided with access manways to permit entry into the waterboxes (for inspection of tubes and tube joints), into the hotwells, and into the condenser shells to permit internal inspection of the condenser. Inspection can be undertaken in the event there are indications of condenser operating abnormalities (such as tube leaks), or for general inspection purposes. Each condenser will be inspected during refueling outages. This inspection will consist of draining the condenser, removing the inspection covers, and inspecting accessible areas for waterbox fouling, impingement erosion, internal structural damage, and cleanliness. Additionally, a detailed inspection will be conducted periodically based on general industry practices.

**10.4.1.5     Instrumentation Application**

Each condenser shell is provided with hotwell level and condenser pressure indicators and alarms in the control room.

The condensate level in the condenser hotwell will be maintained within proper limits by automatic controls which provide for transfer of condensate to and from the condensate storage tank, as needed, to satisfy the requirements of the steam system.

Condensate temperature is monitored in the outlet lines to the condensate pumps.

Turbine exhaust hood temperature is monitored and controlled with water sprays to provide protection from exhaust hood overheating.

A high condenser back-pressure alarm is provided at approximately 6 in. Hg absolute.

Turbine trip is activated on loss of main condenser vacuum, with condenser back pressure reaching or exceeding a set point of approximately 9 in. Hg absolute.

Water box pressure and temperature measurements are provided.

Conductivity elements detect leakage of circulating water into the condenser steam space.



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.4.2     Condenser Air Removal System**

**10.4.2.1     Power Generation Design Bases**

- a.    The condenser air removal system is designed to achieve and maintain a vacuum in the main condenser to permit plant startup and power generation.
- b.    The condenser air removal system is designed to remove the noncondensable gases from the main condenser, including air inleakage and dissociation products originating in the reactor and to exhaust them to the gaseous radwaste system.

**10.4.2.2     System Description**

The condenser air removal system consists of two 100-percent capacity, single element, two stage, steam-jet air ejector units, complete with inter-condenser. The two stages of the steam jet air ejector units are used for normal plant operation. Three one-third capacity mechanical vacuum pumps are for use during startup. The system is shown schematically in Figures 10.4-1 and 10.4-2.

During startup, when the desired rate of air and gas removal exceeds the capacity of the steam jet air ejectors or when the steam pressure is not adequate to operate the air ejector units, the mechanical vacuum pumps are used to remove the main condenser air inleakage and offgases. The discharge from the vacuum pumps is routed to the turbine building ventilation system. The offgases from the vacuum pumps are discharged directly to the environment since the pumps are in service only during startups when there is little or no radioactive gas present.

The turbine building ventilation exhaust stack is monitored for radioactivity to stop the vacuum pumps and alert the control room operator if safe release limits are being reached.

The steam-jet air ejector may be placed into service to remove the gases from the main condenser after a pressure of 5- to 10-inch Hg abs. is established in the main condenser by the mechanical vacuum pumps. Main steam, reduced in pressure by an automatic steam-pressure reducing valve, is supplied as the driving medium to the two-stage air ejectors. The first stage takes suction from the main condenser and exhausts the gas vapor mixture to the inter-condenser. The second stage takes suction from the inter-

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

condenser and exhausts the gas vapor mixture to the gaseous radwaste system. The inter-condenser is cooled by the plant service water system. The resulting condensate from the air ejector condenser is drained back to the main condenser.

**10.4.2.3     System Evaluation**

The system has no safety-related function as discussed in Section 3.2. Failure of the system will not compromise any safety-related system or component and will not prevent safe reactor shutdown.

As long as the condenser air removal system operates normally and main condenser vacuum is maintained, there is no effect on the reactor coolant system. If the main condenser pressure increases to a predetermined value, a turbine trip is initiated. Refer to Chapter 15 for the effect of a turbine trip on reactor operation.

The offgas from the main condenser is one source of radioactive gas in the plant. It will normally include the following activation gases: nitrogen-16, oxygen-19, and nitrogen-13, plus the radioactive noble gas parents of strontium-89, strontium-90, and cesium-137. The largest contribution to the main condenser off-gas activity will come from the nitrogen-16 source. An inventory of radioactive contaminants in the effluent from the steam-jet air ejector has been evaluated in Section 11.3, Gaseous Radwaste System.

The condenser air removal system is not designed to withstand the effects of an explosion. The normal operation of the steam jet air ejectors will prevent the process stream from attaining flammable limits. In the event of inadequate steam flow necessary to prevent flammable concentrations of hydrogen, redundant instrumentation is being provided that will automatically isolate the condenser air removal system. The instrumentation and its operation is described in subsection 10.4.2.5.

**10.4.2.4     Tests and Inspections**

[HISTORICAL INFORMATION] [Testing and inspecting of the system were performed prior to initial plant operation. Components of the system are continuously monitored during operation to ensure satisfactory operation.] Periodic tests and inspections of the system are performed in conjunction with maintenance outages.

#### **10.4.2.5     Instrumentation Application**

Sufficient steam is available to maintain a nonexplosive concentration of less than four percent by volume. Redundant flow measuring instrumentation is provided to measure the steam flow. If the steam flow falls below the specified value, the system will automatically isolate to prevent a buildup of hydrogen. Automatic isolation of the condenser air removal system from the main condenser is alarmed in the control room. Once sufficient steam is again available, the isolation valve can be reopened.

Gas samples taken between the inter-condenser and the second stage steam jet air ejector can be routed to the offgas sampling panels for hydrogen concentration chemical analysis.

The mechanical vacuum pump inlet isolation valve will close upon a main steam line high-radiation signal. The mechanical pump will continue to run in dryout mode for fifteen minutes and then stop.

#### **10.4.3     Turbine Gland Sealing System**

##### **10.4.3.1     Power Generation Design Bases**

- a. The objective of the turbine gland sealing system is to prevent air leakage into and radioactive steam leakage out of the main and reactor feedpump (RFP) turbines, combined main and RFP stop and control valves, LP stop and control valves, and combined bypass stop and control valves.
- b. The turbine gland sealing system is designed to provide the means of sealing with nonradioactive steam the main and RFP turbine shaft glands and valve stems (main stop and control, LP turbine stop and control, and bypass valves). The condensed steam from the sealing system will be returned to the main condenser, and the noncondensable gases entrained with the condensed steam will be exhausted to the turbine building vent stack.

##### **10.4.3.2     System Description**

The turbine gland sealing system consists of a nonradioactive auxiliary steam source, a separate seal steam generator, seal steam pressure regulators, seal steam header, one full capacity seal steam condenser, two full capacity seal steam condenser

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

exhausters, and the associated piping, valves, controls, and instrumentation. Figures 10.4-3 and 10.4-4 include a piping and instrumentation diagram of the system.

Nonradioactive sealing steam for the RFP turbine shaft glands, RFP turbine stop and control valves and the main turbine shaft glands and valve stem glands (stop, control, and bypass valves) is supplied from the seal steam header. The source of nonradioactive sealing steam is a separate seal steam generator during normal plant operation. The unit auxiliary boiler is no longer in service.

The outer ends of all glands and valve stems are routed to the seal steam condenser which is maintained at a slight vacuum by the exhauster. During plant operation, the seal steam condenser and one motor-driven exhauster will be in operation. The exhauster discharges gland air in-leakage to the atmosphere. The seal steam condenser is cooled by the turbine building cooling water system.

The seal steam generator is a shell-and-tube heat exchanger designed to provide a continuous supply of clean sealing steam at approximately 79 psig to the seal steam pressure regulators. The heating steam is supplied at light loads by the main steam line and at high loads from turbine extraction. The regulators deliver steam to the clean steam header at a constant pressure of approximately 6 in. water gauge.

The seal steam condenser consists of a single heat exchanger that recovers condensate from the mixture of air and steam which is drawn from the outermost sections of the turbine and valve seals and exhausts the air to the atmosphere by means of the motor-driven exhauster mounted on top of the seal steam condenser. The turbine building cooling water system is used as the cooling medium. The seal steam condenser is designed for cooling water of 250 F and 150 psig.

The motor-driven exhauster is designed to discharge the air in-leakage to the atmosphere via the turbine building ventilation system. The exhauster is designed to pass the maximum flow with no more than 0.5-inch Hg gauge discharge pressure. The exhauster also maintains approximately a 12-inch water vacuum on the outlet of the shaft and valve seals.

#### **10.4.3.3     System Evaluation**

The turbine gland sealing system is designed to provide a continuous supply of clean, nonradioactive steam at approximately 6 in. water gauge to the main turbine shaft glands and the valve stems. The high-pressure turbine shaft seal must accommodate a range of turbine shell pressures from full vacuum to approximately 120 psia. The low-pressure turbine shaft seals operate against a vacuum at all times. The sealing steam enters the high- and low-pressure turbine shaft seals and the valve stem seals through an annulus. The steam is exhausted to the seal steam condenser via the vent annulus, which is maintained at a slight vacuum (about 12 inches water) or is piped to the No. 2 low-pressure feedwater heater or main condenser.

Since a supply of clean, nonradioactive steam is available from the seal steam generator, the turbine gland sealing system should always have a supply of clean, nonradioactive sealing steam. In addition, should the seal steam condenser fail to function, the sealing steam would continue to flow into the turbine, and it would be the only steam (nonradioactive) which could flow out of the glands and into the turbine building. Therefore, radioactive steam release to the environment is unlikely. (See Sections 11.3 and 15.7 for further details on the radiological evaluation of the seal system.)

A failed seal steam condenser tube can be plugged during operation by isolating the condenser water side. The exhauster will continue to operate during this time.

Relief valves on the seal steam header prevent excessive seal steam pressure. The valves are vented to the high pressure turbine condenser shell.

#### **10.4.3.4     Tests and Inspections**

Testing and inspection of the system was performed prior to initial plant operation. Components of the system are continuously monitored during operation to ensure that they are functioning satisfactorily. Periodic tests and inspections may be performed in conjunction with maintenance outages.

#### **10.4.3.5     Instrumentation Application**

Both the shell and tube sides of the seal steam generator are controlled by level-control valves, the condensate (shell) side by maintaining water surrounding the tubes, and the steam (tube) side by maintaining the water level in the seal steam generator drain tank. The flow of heating steam is regulated by the seal steam pressure control.

Liquid level in the seal steam condenser is maintained by a loop seal connected to the main condenser.

The turbine building ventilation exhaust is monitored for radiation levels and an alarm annunciates in the control room if high levels are present. The seal steam condenser exhausters discharge to the turbine building ventilation system and, therefore, should the seal steam generator develop a tube leak, the radioactive steam leaking into the turbine gland sealing system would be detected.

#### **10.4.4     Turbine Bypass System**

##### **10.4.4.1     Power Generation Design Bases**

- a. The turbine bypass system is designed to control reactor pressure during reactor heat-up to rated pressure while the turbine is being brought up to speed and synchronized during: 1) power operation when the reactor steam generation exceeds the transient turbine steam requirements; and 2) cool down of the reactor.
- b. The turbine bypass system capacity is designed for 30.4 percent of the guaranteed reactor steam flow. The bypass system will accommodate a 30.4-percent load rejection. The bypass system works in conjunction with the turbine controls (pressure control). (See subsection 7.7.1.5, Pressure Control and Turbine-Generator System.)
- c. The turbine bypass valves are capable of remote manual operation in their normal sequence, during plant startup and shutdown, and for exercising to verify that the valves are operable.

#### **10.4.4.2     System Description**

The turbine bypass system is shown in Figure 10.3-3. The turbine bypass system consists of three hydraulically operated combined stop and control valves which are mounted separately on each bypass to the condenser. They are operated automatically and in parallel. The first bypass valve leads the other two by 10 percent. The remaining valves operate in parallel. The bypass piping is connected to the main steam lines upstream of the turbine main stop valves. Each bypass valve outlet is piped directly to the main condenser, and a pressure breakdown assembly using a water spray is located at each condenser connection.

The turbine bypass valves are opened by a signal received from the pressure regulator of the digital Turbine Control and Protection System (TCPS) whenever the actual steam pressure exceeds the preset steam pressure by a small margin. This occurs when the amount of steam generated by the reactor cannot be entirely used by the turbine. The bypass stop valves automatically close whenever the vacuum in the main condenser falls below a preset value. The bypass stop and control valves will also close on the loss of hydraulic pressure, or on the loss of control power.

The turbine is protected against the loss of vacuum by an electrical low-vacuum trip. Each condenser is monitored by three separate pressure transmitters, and the turbine is tripped utilizing a 2-out-of-3 trip logic for each condenser. The electrical low-vacuum trips provide an alarm at approximately 6.0" Hg absolute, and trip the turbine at approximately 9.0" Hg absolute. Reactor scram is initiated by the closure of the main stop valves. The bypass control valves are also opened with the turbine trip to control reactor pressure. If condenser pressures continue to rise, the bypass stop valves and control valves are closed when pressure switches detect low vacuum and the main steam isolation valves are closed.

To protect the LP turbines from overpressure as the result of bypass system operation, each bypass control valve control system is provided with its own electrical low-vacuum switch. The low-vacuum switch will close the bypass control valve and the bypass stop valve when its associated condenser pressure exceeds 18.0"Hg absolute.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The LP turbine casings are additionally protected against overpressurization by four atmospheric relief diaphragms on each LP turbine. These atmospheric relief diaphragms rupture at approximately 18.5 psia.

The bypass stop and control valve is shown on Figure 10.4-14; numbers in parentheses denote components shown on Figure 10.4-14.

The bypass stop and control valve dumps steam from the main steam line into the condenser. The control valve is normally closed during turbine operation and opens to dump steam upon receiving a signal from the TCPS pressure controller whenever the steam generated in the reactor exceeds that required by the turbine.

The stop valve is normally open during operation but may be closed to permit testing the control valve without disturbing the reactor pressure control or dumping steam unnecessarily during the testing process. The stop valve may also be closed to prevent steam flow to the condenser if required.

The stop and control valves are contained in one casing with the stems arranged on a horizontal plane, and at right angles to each other. This provides a favorable routing for the bypass steam piping and good accessibility to the valves for maintenance.

The stop valve is provided with a pilot valve (7) to reduce the force required to open the stop valve against full steam pressure. The main valve cone (8) is back seated against the valve body cover (6) in the full open position to limit valve stem leakage under operating conditions. The valve stem is also steam sealed, with a leak-off connection for active steam, a feed connection for inactive sealing steam, and a leak-off connection for inactive sealing steam. The steam sealing system is backed up with soft renewable packing (3) to seal the stem externally.

The stop valve is opened hydraulically and closed by spring force. For detail of the stop valve actuator, refer to Figure 10.4-15.

The control valve stem and cone are manufactured in one piece. The guiding and sealing of the control valve stem are essentially the same as described for the stop valve except there is no back seat, since this valve is normally closed during operation.



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The control valve is opened by control fluid pressure and closed by spring force. For details of the control valve actuator, refer to Figure 10.4-16. The position of the control valve is determined by the redundant bypass position control modules in TPCS and redundant linear variable reluctance transformers (LVRT) for valve position feedback.

The bypass stop valve actuator is shown on Figure 10.4-15. The actuator opens the bypass stop valve hydraulically and closes it mechanically by spring force upon receipt of a signal from the bypass valve control function of TCPS.

The bypass stop valve is controlled by the piston and actuator rod according to the position of the valve. The piston is loaded on the one side by the spring and on the other by the control fluid. The bypass stop valve is controlled by the piston (1) and actuator rod (3) according to the state of the solenoid valve. The piston is loaded on the one side by the coil spring (2) and on the other by the control fluid. When the controller commands the solenoid valve, control fluid can flow under the piston and the bypass stop valve is opened. Without the opening command or on loss of power or hydraulic pressure, the bypass stop valve will close.

If the solenoid valve is closed, the pressure under the piston is removed and the spring drives the stop valve closed.

The bypass control valve actuator is shown on Figure 10.4-16. The steam flowing from the reactor which is not required under certain operating conditions is dumped to the condenser by the bypass control valves. The flow of steam to the condenser is thus regulated by varying the lift of the bypass control valve by means of its actuator.

During normal operation, the bypass control valve is held closed by the coil spring. The bypass control valves are opened rapidly by hydraulic pressure. The opening of the bypass control valve is determined by the electrical demand, according to the electrical signal occurring at the servo valve.

The bypass control valve is opened by hydraulic pressure on the piston (1). The coil spring (2) is connected to the piston by the cylinder rod extension (3) and spring plunger (4). The rod end (5) connects the actuator to the steam valve. The spring cushion (6) limits the opening force of the actuator placed on the steam valve at full travel.

GRAND GULF NUCLEAR GENERATING STATION  
Updated Final Safety Analysis Report (UFSAR)

---

Deleted

GRAND GULF NUCLEAR GENERATING STATION  
Updated Final Safety Analysis Report (UFSAR)

---

Deleted

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Actuations

The Pressure Control System automatically controls throttle pressure by modulation of the turbine control valves and bypass valves. Each bypass valve is controlled utilizing a redundant position controllers and its servo valve, with redundant LVRTs for position feedback. Manual operation of the bypass valves, via a bypass jack function, can be performed from the main control board TCPS HMIs. The bypass jack can be used during plant heat up and cool down and rapid depressurization of the reactor in emergency situations. during plant operations, each bypass valve can be tested independently from the main control board operation workstations.

The turbine bypass system has been designed in accordance with codes and standards as outlined in Table 3.2-1.

**10.4.4.3     System Evaluation**

The effects of turbine bypass system malfunctions on the reactor operation are bounded by events already presented in

Appendix 15A as follows:

1. A bypass system line failure is bounded by the pipe break outside containment accident. Refer to event 38 in subsection 15A.6.5.3.
2. A failure of the bypass system to open is bounded by the turbine trip and load rejection without bypass events. Refer to events 30 and 31 in subsection 15A.6.4.3.
3. An inadvertent opening of the bypass system, at worst, might cause a high steam line flow or low steam line pressure with a resultant MSIV closure trip. Refer to event 14 in subsection 15A.6.3.3.

The turbine bypass system is not essential for turbine operation. Should the bypass system malfunction and inadvertently admit bypass steam to the condenser while the turbine is under load, the

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

steam flow to the turbine would be reduced by action of the pressure controller. If, under these conditions, the condenser heat rejection rate is inadequate and the exhaust pressure becomes excessive, the turbine will be tripped by redundant condenser pressure instrumentation. In addition, should the turbine exhaust pressure continue to increase, additional and separate instrumentation are provided to close the bypass stop and control valves and MSIVs.

The effects of a malfunction of the turbine bypass system valves and the effects of such failures on other systems and components are evaluated in Chapter 15, Accident Analysis. The steam bypass system is classified as a primary power generation system; that is, it is not a safety system.

**10.4.4.4     Tests and Inspections**

[HISTORICAL INFORMATION] [The opening and closing of the turbine bypass system valves was checked during initial startup and shutdown for performance and timing. The bypass steam line was hydrostatically tested to confirm leak tightness. Visual inspection of pipe weld joints confirmed the exterior condition of the weld.]

**10.4.4.5     Instrumentation Application**

The turbine bypass valves will close if the control system loses its electric power or hydraulic system pressure. The bypass valves are designed as combined stop and control valves. During testing under operation, the stop valves will be closed before the control valves undergo the tests, and vice versa. This prevents a bypass flow to the condenser which might result in a fluctuation in the turbine control system. The demand signal to the turbine bypass system is formed in the Pressure Control System corresponding to the difference between total turbine steam flow demand and turbine control valve steam flow demand, less a small bias to limit the bypass valves from responding to signal noises.

Upon turbine trip or generator load rejection, the start of the bypass valve flow will not be delayed more than 0.1 second after the start of the stop valve or the control valve closure. A minimum of eighty percent of the rated bypass capacity will be established within 0.3 seconds after the start of the stop valve or the control valve closure. For more detail refer to subsection 7.7.1.5, Pressure Control and Turbine-Generator System.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.4.5      Circulating Water System**

**10.4.5.1      Power Generation Design Bases**

- a.    The circulating water for cycle heat rejection from the main condenser is provided by a closed circulating water system using one natural-draft cooling tower and one multi-cell mechanical draft auxiliary cooling tower.
- b.    The cooling towers are designed to remove the design heat load from the circulating water for all weather conditions at or below the design wet bulb temperature.

**10.4.5.2      System Description**

The circulating water system consists of the main condenser, cooling towers, and circulating water pumps. It is designed to supply the main condenser with cooling water at temperatures ranging from 37 to 97 F when the mechanical draft auxiliary cooling tower is not in service. With the natural draft and auxiliary cooling towers both in service, the maximum cooling water temperature to the main condenser is expected to be less than 90 F. The circulating water system is shown in Figures 10.4-5 through 10.4-7. The characteristics of the system are given in Table 10.4-1.

The system is arranged with two 50-percent (approximately 290,000 gpm each) motor-driven, vertical circulating water pumps which take suction at the circulating water pumphouse forebay fed from two discharge lines from the cooling tower basin and discharge circulating water to the LP condenser shell. The circulating water pumps (N1N71C001A/B) require external sources of clean cool water for cooling the Kingsbury thrust bearing and for lube water to the two cutless rubber lower bearings. Thrust bearing cooling is by the Plant Chilled Water System with a backup from the discharge of the circulating water pumps. Lube water is from the Plant Service Water System with a backup from the discharge of the circulating water pumps. After passing through the LP, IP, and HP shells, the heated water is discharged from the two high-pressure condenser shell outlet water boxes. The two circulating water pipes to and from the circulating water pumps are 120 inch ID.

The natural-draft cooling tower is designed for a wet bulb temperature of 79 F. The design range and the design approach are 30.4 F and 18 F, respectively. The tower is approximately 404 feet in diameter at the base and 522 feet above the grade elevation.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The mechanical draft auxiliary cooling tower is designed for a wet bulb temperature of 80 F (which includes a 1 F allowance for potential recirculation effects). The design range and the design approach are 29 F and 8.9 F, respectively. The multi-cell tower is approximately 676 feet long, 114 feet wide and 53 feet above the grade elevation.

After passing over the cooling tower fill, the circulating water falls into the concrete basins at the bottom of the towers. From the basins, the water flows by gravity to the circulating water pumphouse located next to the turbine building.

During winter operation, the following startup procedure is recommended:

- a. Open bypass valves in startup lines.
- b. Once basin is warm and circulating water reaches 80 F, close the bypass valves in startup lines.
- c. Increase heat load. Once full heat load is established, the bypass valves can be cycled to maintain circulating water temperature and assure satisfactory natural draft cooling tower operation.
- d. During winter startup when the auxiliary cooling tower is in service, the auxiliary cooling tower fans may be shutdown or the auxiliary cooling tower may be isolated to maintain circulating water temperature and assure satisfactory system operation.

For startup when the natural-draft cooling tower is in service and the wet bulb temperature is less than 35 F, (or it is anticipated that it will drop below 35 F) the condenser inlet and outlet water temperatures should be monitored. If the condenser inlet water temperature is less than 60 F or if the condenser outlet water temperature is less than 90 F, the bypass valves should be cycled to maintain circulating water temperature. Similarly, if the auxiliary cooling tower is in service for startup, the auxiliary cooling tower fans may be individually shutdown followed by auxiliary cooling isolation to maintain circulating water temperatures. If the condenser inlet water temperature remains less than 60 F or if the condenser outlet water temperature remains less than 90 F following isolation of the auxiliary cooling tower, the bypass valves should be cycled to maintain circulating water temperature.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Opening the bypass valves diverts 100 percent flow to the natural draft cooling tower basin stopping the transfer of heat in the cooling tower.

When the natural draft cooling tower is in service under normal cold weather operation with freezing ambient wet bulb temperatures, the bypass valves are cycled, under manual control mode, to maintain the circulating water temperature to the condenser between 60 F and 75 F. Similarly, if the auxiliary cooling tower is in service under normal cold weather operation with freezing ambient wet bulb temperatures, the auxiliary cooling tower fans may be individually shutdown, under manual or automatic control mode, or the auxiliary cooling tower may be isolated, also under manual control mode, to maintain circulating water temperature between 60 F and 75 F.

A makeup water system is provided to replace the circulating water losses due to evaporation, blowdown, and drift. Makeup water for the circulating water system is taken from the plant service water system. Approximately 21,500 gpm of makeup is required.

A blowdown system is provided on the circulating water system. This is required since the evaporative process in the cooling towers tends to increase the dissolved solid content in the circulating water. Therefore, blowdown (monthly average approximately 11,200 gpm) is accomplished downstream of the circulating water pumps and controlled to maintain a preselected, dissolved solids concentration ratio. Blowdown is discharged to the discharge basin.

Two methods of circulating water system chemistry control are available to prevent biological fouling (e.g., accumulation of algae growth in the cooling towers and the main condenser). These methods are the addition of a non-oxidizing biocide or a hypochlorite solution. The choice of methods is dictated by inlet water conditions and economics.

Non-oxidizing biocide solution is added to the natural draft cooling tower basin and/or the auxiliary cooling tower hot water return lines based on microbiological analysis of the circulating water. The non-oxidizing biocide is added to achieve a concentration at or below the allowable NPDES (environmental) discharge limits to prevent the interruption of circulating water blowdown flow.



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The circulating water blowdown flow is controlled to maintain a constant ratio between circulating water conductivity and makeup water conductivity. Periodic laboratory analyses of soluble calcium are made to verify the ratio used to control the desired number of cycles of concentration.

Hypochlorite solution may be used as another method of circulating water chemistry control. Discharge of free available chlorine to the river will be minimized by controlling the addition of hypochlorite solution so that the free available chlorine concentration in the cooling tower blowdown will not exceed NPDES Permit limits.

If used, Sodium Hypochlorite is to be shipped in from off-site. Injection frequency is determined by Plant Chemistry. The point of injection is to be the 120" hot water return lines to the natural draft cooling tower and when in service to the 96" hot water return lines to the auxiliary cooling tower. In this way, Sodium Hypochlorite is applied directly to the area of concern (cooling tower fill) first. Plant Chemistry evaluates and determines the optimum chlorine residual to be maintained. The point of control for chlorine residual is to be the bottom of the cooling tower fill. Circulating water system blowdown will be secured during Sodium Hypochlorite injection to prevent chlorine residuals in excess of NPDES limits from reaching the 001 outfall. Chlorine residuals are to be monitored after injection and Dechlorination used as necessary to meet NPDES limits.

A surfactant-based biodispersant may be used in conjunction with Sodium Hypochlorite at the discretion of Plant Chemistry. Any biodispersant considered for this application must have no net ionic charge so as not to interfere with any ionically charged scale dispersant used in CWS. If used, the biodispersant is to be added just prior to HYPO injection.

The circulating water blowdown flow is controlled to maintain a constant ratio between circulating water conductivity and makeup water conductivity. Periodic laboratory analysis of soluble calcium will be made to verify the ratio used to control the desired number of cycles of concentration.

Sulfuric acid is used to control pH to minimize long-term corrosion and formation of calcium deposits in the system. Acid treatment will be continuous and the injection point is at the natural draft cooling tower basin. The pH control system receives

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

a feed-forward signal from the circulating water makeup flow to adjust the acid flow rate for anticipated changes in pH. The pH measured at the HP condenser discharge is compared to the set point and if there is a difference, the control systems will adjust the acid flow rate to eliminate the error. A motor-operated valve is installed downstream of each acid metering pump in order to isolate acid injection from the circulating water system on low circulating water flow or on low cooling tower basin level. A relief valve in the discharge piping of each acid metering pump provides overpressure protection. When relieved, these valves will discharge acid back to the pump suction.

Sulfuric acid will be batch added at the natural draft cooling tower during continuous system maintenance or repair.

A dispersant and/or a surfactant are added to the circulating water system, as required, to prevent scaling and deposition of iron oxides and suspended solids in the condenser tubes. This addition supplements and augments the dispersant and surfactant which is being added through makeup from the Plant Service Water System. A mechanical Condenser Tube Cleaning System (CTCS) circulates cleaning balls through the condenser tubes. The CTCS provides for final cleaning of the condenser tubes to prevent scaling and deposition.

The above methods for the control of water chemistry and prevention of long-term corrosion and biological fouling have been reviewed for compatibility with system component and piping materials and found acceptable.

#### **10.4.5.3     System Evaluation**

The circulating water system is designed with cross-connected discharge piping from the circulating water pumps. The pumps are equipped with separate butterfly valves which permit either circulating water pump to be isolated. A 72 inch valved cross connection is provided on the discharge of the circulating water pumps downstream of the butterfly valves. Therefore, in case of a pump failure or a condenser tube leak, the circulating water system is capable of operating with one pump and one or two trains of condenser water boxes. Additionally, at the point where the hot water return lines branch off to the auxiliary cooling tower, there are two butterfly valves in the two 120" hot water return lines to the natural draft cooling tower and two butterfly valves in the two 96" hot water return lines to the auxiliary cooling tower. The butterfly valves in the hot water return lines to the auxiliary cooling tower allow the auxiliary cooling tower to be

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

isolated during cold weather operation or for maintenance. The butterfly valves in the hot water return lines to the natural draft cooling tower are maintained open during normal system operation, but can be manually closed to allow isolation of the natural draft cooling tower for maintenance when the circulating water system is shutdown. There is also a normally open 96" cross-connect valve at the 96" distribution header adjacent to the auxiliary cooling tower which was originally added to allow for future expansion of the auxiliary cooling tower.

The natural draft cooling tower is located at a minimum of one tower height away from the containment, auxiliary, and turbine building complex and any Category I structure. Since the cooling tower is smaller at the top, the tower would tend to collapse inwardly although collapse of the tower is highly improbable. Therefore, the potential for debris damaging any plant structure is very minimal. The cooling tower is made of noncombustible material.

The mechanical draft auxiliary cooling tower is only about 53 feet high and is about the same distance from Category I structures as the natural draft cooling tower; therefore, no damage to any plant structure would occur should the auxiliary cooling tower collapse. The auxiliary cooling tower contains multiple fans with their associated motors, couplings and gear boxes. The fans rotate at relatively slow speed and the fan blades are made of relatively low density material. A failure of a fan could result in the generation of missiles, however, due to the attributes discussed above and due to the location of the auxiliary cooling tower the damage would be confined to the auxiliary cooling tower itself; therefore, there would be no damage to important to safety equipment. The material used in the construction of the auxiliary cooling tower is of the type with a low flame spread rating.

The circulating water system is designed to prevent any injection of radioactive material into the circulating water and its subsequent release to the atmosphere through evaporation in the cooling towers. The circulating water passing through the condenser will always be at a higher pressure than the shell or condensing side; therefore, any leakage (such as from the condenser tube) will be from the circulating water into the shell side of the condenser.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The circulating water system piping inside the turbine building, contains expansion joints which are enclosed inside metal leakage barriers equipped with drains. In the event of excessive leakage from any of the expansion joints, a high water level alarm inside the leakage barrier will be sounded inside the control room to alert the operator that an expansion joint is failing.

The circulating water system serves no safety function. Systems analysis has shown that failure of the circulating water system will not compromise any safety-related systems or prevent safe shutdown. The circulating water system was modified to meet EPU conditions. To increase cooling capacity to meet EPU, eight new tower cells were added to the mechanical draft auxiliary cooling tower (Ref. 1). The circulating water pumps were modified to increase the circulating water system flow rate to reduce condenser pressure and condensate temperature while increasing plant output during EPU conditions (Ref. 2). The EPU analysis determined that the circulating water system will not compromise any safety-related systems or prevent safe shutdown during EPU conditions.

The circulating water system has been evaluated for the potential flooding of safety-related equipment due to the failure of a system component. The results are as follows:

- a. A total of approximately 13,500,000 gallons of water is contained in the Unit 1 circulating water system. The normal flow from the two circulating water pumps will be 580,000 gallons per minute at an operating head of 98 feet; maximum flow could increase to approximately 694,000 gpm at pump run out.
- b. The two 120-inch ID circulating water pipes enter the turbine building below the turbine building base slab. The pipes extend vertically from the base slab at El. 87-0. The pipes are connected to the condenser inlet waterboxes by expansion joints. The piping arrangement on the discharge side of the condenser is similar to that on the inlet side with the exception that a motor-operated butterfly valve is provided on each discharge line downstream of the expansion joint. Furthermore, the two discharge lines are routed horizontally through the turbine building wall at El. 117-6.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The normal operating discharge pressure from the two circulating water pumps is approximately 42.6 psig and the maximum shutoff pressure is approximately 66.1 psig. The circulating water piping, valves, expansion joints, and condenser water boxes are designed at 90 psig. This pressure is well above the operating pressure of the circulating water system.

There are two potential sources of failure in the circulating water system: a) failure of the butterfly valves, and b) failure of the expansion joints. A failure of the circulating water system inside the turbine building would result in flooding inside the condenser room because the flow cannot be handled by the four liquid radwaste sumps located at the condenser room. Each sump is equipped with level alarms which will provide indication in the control room that a gross failure inside the condenser room has taken place.

- c. The butterfly valves, two at the condenser outlet, two at the circulating water pump discharge, and one for the cross connection between the two circulating water pipes, are equipped with motor operators and require approximately 60 seconds to move from the full-open to the full-closed position. Their normal operating position is full open, except the butterfly valve for the pump cross connection, which is normally closed. Their position is not normally changed during operation.

The butterfly valves associated with the auxiliary cooling tower, two in the 96" hot water return lines to the auxiliary cooling tower, and one for the 96" cross connection at the auxiliary cooling tower, are equipped with motor operators and require approximately 3 to 5 minutes to move from the open to the full-closed position. The two butterfly valves in the 120" hot water return lines to the natural draft cooling tower are normally full open and therefore their positions are not changed during operation. The two butterfly valves in the 96" hot water return lines to the auxiliary cooling tower, may either be throttled or full open when the auxiliary cooling tower is in service or closed when the auxiliary cooling tower is out of service. The butterfly valves in the 96" hot water return lines to the auxiliary cooling tower and the 96"

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

cross connection are occasionally repositioned during operation whenever the auxiliary cooling tower is taken out of service or placed in service.

Although sudden closure of one of these valves, due to malfunction, can be postulated with higher-than-normal pressure resulting in a portion of the system, this is considered to be very unlikely because a gross failure of the valve disc shaft or the motor drive gear train would have to occur to permit closure of the valve.

The circulating water pumps are interlocked with their respective pump discharge butterfly valves which are operated by remote manual switches in the control room. Upon receiving a high-level alarm from the liquid radwaste sumps, the operator can initiate the closure of the valve and stopping of the pump manually. It can be conservatively estimated that approximately 5 minutes (assumed a 4-minute operator reaction time) will be required from the moment the failure occurs to completely stop the circulating water system flow.

- d. Should a gross failure occur in the circulating water system inside the turbine building which could not be handled by the liquid radwaste sumps (a total capacity of 7,850 gpm), water would accumulate in the condenser room. In the case of one expansion joint or a butterfly valve failure, the resulting water level will be approximately at El. 93-8-1/8 with the following plant areas affected: Unit 1 turbine building, the existing but canceled Unit 2 turbine building, radwaste buildings, control building, and the Unit 1 radwaste pipe tunnel. To attain the estimated flood level, approximately  $2.3 \times 10^6$  gallons of the total  $13.5 \times 10^6$  gallons was assumed to be dumped into the condenser room and the security wall between the Unit 1 turbine building and the canceled Unit 2 turbine building was assumed not to be installed or fails.
- e. Figure 1.2-2 shows a plan view of the turbine building at El. 93-0 and 100-9. There is no safety-related equipment located in the vicinity of the condenser room and at elevations below 116 feet, except for one secondary containment isolation valve, Q1-P44-F116. The failure of this valve will not adversely affect attaining and maintaining a cold safe shutdown. It was determined that

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

the affects of flooding, if any, would only cause the valve to fail in a safe position. Therefore, in the unlikely event of a failure of the circulating water system resulting in flooding inside the turbinebuilding, it will not affect any components or systems that are essential to the safety of the plant.

- f. The control building is interconnected with the turbine building at El. 93'-0". Therefore, it has been assumed that water will flow into the control building. In addition, the Unit 1 radwaste pipe tunnel will be flooded. The radwaste building and the canceled Unit 2 turbine building are also flooded up to El. 93'-8-1/8" (assuming the circulating water system fails and the security wall separating the Unit 1 turbine building and the canceled Unit 2 turbine building is assumed not to be installed or fails).
- g. If it were assumed that the circulating water system failed to secure, a total water inventory of  $13.5 \times 10^6$  gallons could be discharged into the condenser room.

The Unit 1 turbine building and the existing but canceled Unit 2 turbine building are separated by a security wall and interconnected at El. 93'-0". Since the doorways and openings in the security wall are not leak tight, the existing but canceled Unit 2 turbine building, the Unit 1 turbine building, radwaste building, radwaste pipe tunnels, and the control building will be the only flooded areas. The resulting flood water elevation is 104'.

All safety-related equipment in the control building that is essential in attaining and maintaining a cold safe shutdown is located above El. 111'-0".

- h. The auxiliary building is watertight up to El. 114' to prevent entry of water into the building due to a postulated circulating water system failure. Therefore, even in the extremely unlikely event of failure to shut off the circulating water delivery system in case of a butterfly valve failure or an expansion joint rupture, the resulting water level will not functionally degrade any equipment essential to attaining and maintaining a cold safe shutdown.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.4.5.4     Tests and Inspections**

All active components of the system (except the main condensers) are accessible for inspection during station operation.

Performance, hydrostatic, and leakage tests are conducted on the circulating water system butterfly valves in accordance with AWWA C-504. These will be manufacturing tests only and no routine or continuous testing will be undertaken.

**10.4.5.5     Instrumentation Application**

The circulating water pumps are individually equipped with isolation valves which permit any pump to be isolated. The isolation valves also serve to prevent vapor binding of the pumps when starting up after isolation. These isolation valves are operated by remote manual switches in the control room.

The two trains of condenser shell water boxes and the cross-connection between the water boxes are equipped with isolation valves which enable either half of the water boxes to be isolated. These isolation valves are operated by remote manual switches in the control room.

At the point where the hot water return lines branch off to the auxiliary cooling tower, there are two butterfly valves in the two 120" hot water return lines to the natural draft cooling tower and two butterfly valves in the two 96" hot water return lines to the auxiliary cooling tower. The butterfly valves in the hot water return lines to the auxiliary cooling tower allow the auxiliary cooling tower to be isolated during cold weather operation or for maintenance. Although open during normal system operation, the butterfly valves in the hot water return lines to the natural draft cooling tower allow isolation of the natural draft cooling tower for maintenance when the circulating water system is shutdown. There is also a normally open 96" cross-connect valve at the 96" distribution header adjacent to the auxiliary cooling tower which was originally added to allow for future expansion of the auxiliary cooling tower. These isolation valves are operated by remote manual switches in the auxiliary cooling tower power and control building. The butterfly valves in the 120" hot water return lines to the natural draft cooling tower are manually operated (electrical components abandoned in place) and are administratively controlled in the open position during circulating water system operation to prevent exceeding flow limitations through the auxiliary cooling tower piping.



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Temperature and pressure are measured on each condenser. The water level is automatically maintained in the natural draft cooling tower basin. Necessary level alarms and flow measurements are provided. The cooling tower blowdown system will be operated proportional to the circulating flow.

The auxiliary cooling tower is provided with instrumentation to measure combined flow to both cooling towers, flow to the auxiliary cooling tower, hot water temperature to the auxiliary cooling tower, and combined cold water temperature return from the natural draft cooling tower basin to the condensers. The auxiliary cooling tower fan motors are provided with instrumentation to monitor winding and bearing temperatures, vibration, and watts. The auxiliary cooling tower fan gear boxes are provided with instrumentation to monitor oil level and vibration. The status of the fan motors, water temperature, and flow rate are monitored by a digital control system. The operation of the auxiliary cooling tower, i.e., fan and valve operation, can be controlled manually or automatically by a digital control system.

#### **10.4.6     Condensate Cleanup System**

##### **10.4.6.1    Power Generation Design Bases**

- a.   The objective of the condensate cleanup system is to maintain the required purity of feedwater flowing to the reactor with a maximum capacity of 27,600 gpm, at a maximum temperature of 150 F, and design pressure of 350 psig.
- b.   The condensate cleanup system is designed based upon the following influent concentrations (startup and normal operation - no condenser leaks):

<u>Impurity</u>		<u>Concentration</u>
Startup		Normal operation
(ppb)		(No condenser leaks)
		(ppb)
Iron (Fe)		
Soluble	40	5
Insoluble	1000*	25
Copper (as Cu)		

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

(soluble plus insoluble)	50	7
Other metals (as the metal soluble plus insoluble)	40	3
<u>Impurity</u>		<u>Concentration</u>
Conductivity $\mu\text{mho/cm}$ at 25 C	0.5	0.2
pH at 25 C	6 to 8	6.5 to 7.5
Chloride (as Cl) Normal	10	10

\*This might be as much as 4000 ppb for several hours at initial plant startup.

- c. During normal operation, based upon the above in fluent concentrations, the system shall remove dissolved and suspended solids from the feedwater to maintain a high effluent water quality of:

Specific conductivity at 25 C ( $\mu\text{mho/cm}$ )	$\leq 0.1$
Metallic impurities (ppb)	$\leq 15$ of which copper shall not exceed 2 ppb
Silica as $\text{SiO}_2$ (ppb)	$\leq 5$
Chlorides as Cl (ppb)	$< 10$

- d. A minimum average ion exchange capacity of 25 percent of theoretical shall be maintained at all times during normal operation to maintain ample margin for a major condenser tube leak.
- e. The system will provide final polishing of the makeup water entering the feedwater loop.
- f. The system will maintain the high purity water rejected to the condensate storage and transfer system.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

- g. The limits for the conductivity of the purified condensate have been established in accordance with the guidance provided in Table 2 of Regulatory Guide 1.56, Revision 1 (July 1978). Corrective actions to be taken if the limits are exceeded are presented in approved station off-normal event procedures.

**10.4.6.2     System Description**

The condensate cleanup demineralizer system is shown in Figures 10.4-9a through 10.4-9g. The system is sized to limit the condensate impurity concentration during plant operation and in periods of peak contamination. The condensate cleanup system consists of three precoat filters (precoat filter "B" abandoned in place) and eight parallel-operating deep bed demineralizers. At startup, the condensate full flow filtration (CFFF) system removes suspended solids (iron) to < 0.5 ppb by the use of pleated filter elements. This is described in section 10.4.7.2.2. The system is sized to filter 100% startup and maximum condenser effluent flows. As an alternate, two filters of the condensate precoat filter set can filter up to 33 percent, i.e., 11,000 gpm, of the normal feedwater flow. During normal operation, the precoat filter function in conjunction with the suppression pool cleanup system and as a part of the feedwater system. For details, refer to subsection 9.3.6.

Normally, demineralizers are in operation processing 100 percent of the normal condensate flow. The system includes the associated piping, precoat filters, ultrasonic resin cleaner, the Advanced Resin Cleaning subsystem and all necessary valves, instrumentation and controls required to provide proper operation and protection against malfunction. Instrumentation includes an automatic flow-balancing control which maintains equal flow (maximum 4600 gpm) through each on-stream unit. The system is controlled from local panels. The valves and pumps are remotely operated. An automatic bypass maintains the condensate system flow in the event a high-pressure differential occurs across the condensate cleanup system. The principal code applied to the piping and components of this system is ANSI B31.1.

The initial total capacity of the new anion and cation demineralizer resins used in the condensate demineralizers shall be determined in accordance with approved plant procedures. These procedures describe the methods to obtain and analyze the sample, and are based on requirements presented in Regulatory Guide 1.56

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

(Rev. 1) (July 1978). Condensate System resins are not regenerated at GGNS, thus periodic verification of remaining resin capacity is not required.

**10.4.6.3     System Evaluation**

The condensate system provides no safety function. The system analysis has shown that a failure of the system will not compromise any safety-related systems or prevent safe shutdown.

The condensate cleanup system removes some radioactive material created by corrosion, fission products, and carryover from the reactor. While radioactive effects from these sources do not affect the capacity of the resin, the concentration of such radioactive material requires shielding (see subsections 12.1.2 and 12.3.2). Waste sludge and vent gases from the condensate cleanup system will be sent automatically to the radwaste system for cleanup and/or disposal. The addition of new resin will be done manually. Chapter 11.0 describes the activity level and removal of radioactive material from the system.

All condensate cleanup piping is located within the nonsafety-related turbine building. Therefore, the effects of postulated piping failures are not analyzed.

**10.4.6.4     Tests and Inspections**

The condensate cleanup system will be proved operable by its use during normal plant operation. Each vessel of the system can be separately isolated for testing to ensure operability and integrity of the system.

Condensate demineralizer resins are purchased to technical specifications which are commensurate to their intended application. Certification of the resins' quality is ensured by the resin vendor sampling and analyzing each batch of resin prior to shipment on site. Certified test results are furnished upon shipment for each batch of condensate demineralizer resin.

In accordance with Regulatory Guide 1.56, resin depletion is calculated by plant personnel by use of a database or a computer program that tracks total resin depletion (Inputs include condensate demineralizer flow, condensate demineralizer inlet and outlet conductivity, and resin capacity). This allows plant personnel to evaluate condensate demineralizer performance and recommend resin replacement, if needed.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

If needed, the accuracy of calculated resin capacity may be checked by measurements made on condensate cleanup demineralizer resin samples taken when the demineralizer units are removed from service for cleaning or replacement.

**10.4.6.5     Instrumentation Application**

Instrumentation includes an automatic flow balancing control for each demineralizer which will maintain equal flow through each unit by regulating a valve downstream of the unit. Samples will be taken downstream of each demineralizer and are routed through the turbine building sample conditioning and analyzing panel. A conductivity analyzer with high conductivity alarms will indicate resin exhaustion. System influent and effluent also will be monitored and the influent conductivity element shall provide indication of condenser leakage. The control room alarm set points of the conductivity meters at the inlet and outlet of the condensate cleanup demineralizers are a maximum of 0.5  $\mu\text{mho/cm}$  and 0.1  $\mu\text{mho/cm}$ , respectively. High conductivity of system effluent is alarmed as a printout on the plant process computer. An automatic bypass maintains the condensate system flow in the event the number of demineralizers in operation is inadequate to handle the required flow. A bypass valve will open upon detection of high differential pressure across the system and this condition is annunciated in the control room.

Three conductivity recorders are provided for the system. One is a multipoint recorder receiving inputs from the effluent conductivity element and each separate element downstream of each demineralizer. Two other recorders are located in the control room to record the conductivity of the system influent and effluent.

Conductivity meters for the condensate cleanup system will be electronically calibrated in accordance with approved plant Maintenance Calibration Instructions (MCI). Periodically, a correlation will be performed on the combined deep-bed influent and effluent to compare the installed process conductivity monitors with an independent in-line flow cell under controlled conditions. The correlation will be performed in accordance with approved plant procedures. Conductivity monitors are checked for accuracy on a monthly basis.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The precoat filter is provided with a pushbutton for automatic operation to start the backwashing and precoating cycle. Appropriate instruments are provided to operate the valves remotely from the control panel. A flow balancing system is provided to maintain equal flow through each precoat filter. A flow element, flow transmitter, square root extractor, and flow indicator are provided for monitoring outlet flow from each precoat filter.

Condensate demineralizer resin will be periodically cleaned or replaced, as necessary, to maintain system performance and Condensate System water purity requirements.

A 25 percent theoretical exchange capacity will be maintained.

The operator, by remote manual control, can move the resin bed from the cation regeneration/separation vessel to the URC area for ultrasonic cleaning, or by local controls, the operator can process the resin bed through the Advanced Resin Cleaning subsystem.

Once the resin bed is cleaned, it is then moved by remote manual control or local manual controls, respectively, into the resin mix and storage tank for standby service.

When used, the URC operation is remote manual only. A "group retransmit" annunciator contact is generated for each of the following:

- a. Precoat filter system trouble
- b. Condensate demineralizer system trouble
- c. Ultrasonic resin cleaner system trouble
- d. CFFF system trouble

Each of these contacts operates an annunciator point in the control room identifying the group and alerts the computer of an alarm condition.

Other instrumentation includes the suitable differential pressure monitors, pressure indicators, and local alarms for each unit.

The Advance Resin Cleaning Subsystem (ARCS) may be used to clean condensate demineralizer resins in lieu of the URC. The ARCS is operated from a local control panel. The operation of the Resin Mix & Storage Tank and the Resin Separation & Cation Regeneration

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Tank vent valves and drains is switched to the local control panel from the Radwaste Control Room. The resins are transferred from the Resin Separation & Cation Regeneration Tank and processed through the ARCS screen assembly. The clean resins are returned to the Resin Mix & Storage Tank. The ARCS waste water may be routed through a filter assembly and then to the Condensate Clean Waste Tank. Local pressure and flow indication is provided on the ARCS skids, and a local common trouble alarm is provided on the ARCS control panel.

**10.4.7      Condensate and Feedwater System**

**10.4.7.1    Power Generation Design Bases**

The objective of the condensate and feedwater system is to provide a dependable supply of feedwater to the reactor, to provide feedwater heating, and to maintain high water quality in the feedwater. The system is designed to provide the required flow at the required pressure to the reactor, allowing sufficient margin to provide continued flow under anticipated transient conditions.

a.      Performance Requirements

The system is designed:

1.      To provide feedwater at a minimum pressure of 1114 psia from the reactor feed pumps. It is sized with sufficient capacity to provide 115.5 percent of the feedwater flow at unit rating.
2.      To provide the required temperature of feedwater to the reactor with six stages of closed feedwater heating. The final feedwater design temperature is nominally 419.5°F at unit rating.
3.      To provide 80 percent of rated feedwater flow in the event of the loss of one reactor feed pump.
4.      To provide 100 percent of rated feedwater flow in the event of the loss of one condensate pump or one condensate booster pump for a short duration.
5.      To provide 100 percent of rated feedwater flow in the event of the loss of one heater drain pump, with 50 percent of heater drain tank flow bypassing to the main condenser.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

b. Feedwater Quality

Pumped-forward heater drains are deaerated sufficiently in the heater drain tank to maintain a level of 200 ppb or less oxygen content in the final feedwater supplied to the reactor during normal full-load operation.

To minimize the corrosion product input to the reactor, a startup recirculation line is provided from the reactor feedwater supply lines, downstream of the high pressure feedwater heaters, to the main condenser.

**10.4.7.2     System Description**

The condensate and feedwater system consists of the piping, valves, pumps, heat exchangers, controls, instrumentation, and the associated equipment and subsystems which supply the reactor with heated feedwater in a closed steam cycle utilizing regenerative feedwater heating. The system described in this subsection extends from the main condenser to the second valve outside of containment. The remainder of the system, extending to the reactor, is described in subsection 5.4.9, Main Steam Line and Feedwater Piping.

The main portion of the feedwater flow is condensate pumped from the main condenser. The remaining portion, which comes from the moisture separator drains, steam reheater drains, and drains from the fifth and sixth stage feedwater heaters, is pumped forward from the fifth stage of heating into the feedwater stream. Turbine extraction steam is utilized for a total of six stages of closed feedwater heating, with the drains from the No. 4 and 3 stages of feedwater heaters being cascaded to the No. 2 stage feedwater heaters. Stages No. 1 and 2 of the feedwater heaters drain independently to the main condenser.

The condensate pumps take the deaerated condensate from the intermediate-pressure condenser shell hotwell and deliver it through condensate full flow filtration system and then to the condensate demineralizers. Condensate then flows to the condensate booster pumps which discharge successively through the first, second, third, and fourth stage low-pressure feedwater heaters to the reactor feed pumps (see Figures 10.4-10, 10.4-11 and 10.4-13).



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The remainder of the feedwater flow is provided by the drains which are pumped forward and injected into the feedwater stream at a point between the fourth-stage low-pressure feedwater heaters and the suction side of the reactor feed pumps. These drains originate as follows (see Figures 10.4-10 to 10.4-12): The shell drains from the sixth stage high-pressure feedwater heaters (mainly consisting of the drains from the second stage steam reheaters, and the sixth stage extraction steam condensate), the shell drains from the fifth stage high-pressure feedwater heaters (mainly consisting of the cold reheat extraction steam condensate, and the condensed flashes from the heater drain tank) are directed to the heater drain tank. The drains from the moisture separators and from the first stage steam reheaters are also directed to the heater drain tank. The drains are deaerated sufficiently in the heater drain tank to maintain a level of 200 ppb or less oxygen content in the final feedwater supplied to the reactor during normal full-load operation. The heater drain pumps take suction from the heater drain tank and inject the deaerated drains into the feedwater stream at the suction side of the reactor feed pumps.

The reactor feed pumps then discharge the total feedwater flow through the fifth and sixth stage high-pressure feedwater heaters to the reactor (see Figure 10.4-13).

A startup recirculation line is provided from the reactor feedwater supply lines, at a point downstream of the high-pressure feedwater heaters, to the main condenser. This line is used to minimize the corrosion product input to the reactor during startup. This is accomplished by allowing the system feedwater to recirculate through the condensate cleanup system for cleanup prior to circulating it to the reactor during startup.

The conductivity of the condensate is continuously monitored to provide indications of dissolved solids. The feedwater is continuously monitored for suspended solids in order to ensure feedwater quality commensurate to that of the reactor coolant.

The feedwater heater drain system is designed to allow bypassing of the pumped forward drains in order to route all drains to the main condenser during startup and shutdown to improve feedwater quality.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

A condensate drain tank is provided to collect reactor feed pump seal leakoffs and discharges from the condensate and feedwater thermal expansion relief valves and various drains in the system. These are finally drained to the main condenser.

**10.4.7.2.1      Condensate Pumps**

Three one-third capacity condensate pumps operate in parallel. Each is a motor-driven, vertical, canned suction, multistage centrifugal unit installed at an elevation that allows operation at low condensate level in the main condenser hotwell. The condensate pumps provide the necessary suction head at the condensate booster pumps.

Isolation valves are provided which allow each condensate pump to be individually removed from service while maintaining system operability with the remaining condensate pumps.

Controlled condensate recirculation is provided downstream of the demineralizers. This ensures that the minimum safe flow through the condensate pumps is maintained during operation and it allows cleanup of the system prior to operation.

**10.4.7.2.2      Condensate Full Flow filter**

The Condensate Full Flow Filter (CFFF) consists of four parallel vessels containing pleated filters. The filters are designed to remove suspended solids (iron) to < 0.5 ppb. The CFFF is designed to operate with one vessel out of service for backwashing without a bypass (three vessels can filter 100% condenser effluent). The CFFF includes a Backwash Air Accumulator and air to air booster provided for the motivating force for backwashing individual vessels.

There is also a CFFF backwash discharge line. This line discharges the buildup of particulate on the filter elements to the condensate clean waste tank (CCWT) which acts as a surge tank. From the CCWT the CFFF backwash is pumped to the radioactive waste treatment system for processing. The CFFF vessels are located in parallel to the condensate prefilters.

A programmable logic controller (PLC) is used to automatically sequence the backwash operation. Backwashing is started manually then controlled by the PLC. Isolation valves are provided for each vessel, the backwash air storage tank and the backwash lines.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The CFFF vessels are in operation during startup and all modes of operation when the condensate system is operating. It filters 100% of the condenser effluent.

#### **10.4.7.2.3      Feedwater Heaters**

The first, second, third, and fourth stage low-pressure feedwater heaters are identically arranged in three parallel strings and are located in the necks of the three shells of the main condenser. The two remaining stages of feedwater heating are identically arranged in two parallel strings with each string having a fifth and sixth stage high-pressure feedwater heater.

Drain cooling is provided at all stages of feedwater heating except the fifth, where the drains are pumped forward, and the first. Drain cooling sections are integral with the feedwater heaters.

Each feedwater heater is a horizontal, closed type, installed at an elevation that allows proper shell drainage at all loads. Each feedwater heater utilizes U-tube construction. Tubes are made of stainless steel.

Isolation valves are provided which allow each feedwater heater string to be removed from service. System operability is maintained with the remaining feedwater heaters.

The startup and operating vents from the steam side of the feedwater heaters are piped directly to the main condenser. Discharges from shell relief valves on the steam side of the feedwater heaters are piped directly to the main condenser.

#### **10.4.7.2.4      Heater Drain Tank**

A single heater drain tank is utilized to receive drains directly from the shells of the fifth and sixth stage feedwater heaters, the moisture separator drain tanks, the moisture separator shell drain tanks, and the first stage steam reheater drain tanks. The heater drain tank provides deaeration to limit the oxygen content in the pumped-forward drain flow and provides reservoir capacity for drain pumping. The heater drain tank is installed at an elevation beneath the fifth stage feedwater heaters (pressure source) that allows these heaters to drain freely by gravity flow.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

The heater drain tank is provided with an alternate drain line to the main condenser for automatic dumping upon high level. The alternate drain line is also used during startup and shutdown when it is desirable to bypass the drain pumping for feedwater quality purposes.

**10.4.7.2.5 Heater Drain Pumps**

Two one-half capacity heater drain pumps operate in parallel, taking suction from the heater drain tank and discharging to the feedwater stream on the suction side of the reactor feed pumps. Each is a motor-driven, vertical, multistage centrifugal type located below the heater drain tank and designed for the available suction conditions.

The piping arrangement allows each heater drain pump to be individually removed from service while maintaining system operability with the remaining drain pump.

Controlled drain recirculation is provided from the discharge side of each heater drain pump to the heater drain tank. This ensures that the minimum safe flow through each heater drain pump is maintained during operation.

**10.4.7.2.6 Condensate Booster Pumps**

Three one-third capacity condensate booster pumps operate in parallel taking suction downstream of the condensate demineralizers and discharging through the four stages of low-pressure feedwater heaters. Each is a motor-driven, horizontal, single-stage centrifugal type. The condensate booster pumps provide the necessary suction head at the reactor feed pumps.

Isolation valves are provided which allow each condensate booster pump to be individually removed from service while maintaining system operability with the remaining condensate booster pumps.

Controlled condensate recirculation is provided downstream of the condensate booster pumps to the main condenser. This ensures that the minimum safe flow through the condensate booster pumps is maintained during operation.

#### **10.4.7.2.7     Reactor Feed Pumps**

Two one-half capacity reactor feed pumps operate in parallel, acting in series with the condensate pumps and condensate booster pumps. The reactor feed pumps take suction from the fourth stage low-pressure feedwater heaters and discharge through the fifth and sixth stage high-pressure feedwater heaters to provide the pressure head required by the reactor. Each pump is a turbine-driven, horizontal, single-stage centrifugal unit.

Isolation valves are provided which allow each reactor feed pump to be individually removed from service while maintaining system operability with the remaining reactor feed pump.

Controlled feedwater recirculation is provided from the discharge side of each reactor feed pump to the main condenser. This ensures that the minimum safe flow through each reactor feed pump is maintained during operation.

#### **10.4.7.2.8     Reactor Feed Pump Turbine Drives**

Each of the two one-half capacity reactor feed pumps is driven by an individual steam turbine. The turbine drives are the dual-admission type, and each is equipped with two sets of main stop and control valves. One set of valves regulates low-pressure steam flow extracted from the moisture separator reheater shell (hot reheat steam), and the other set regulates high-pressure steam flow from the main steam supply. During normal operation, the turbine drives run on the low-pressure hot reheat steam. Main steam is used during plant startup, low load, or transient conditions when hot reheat steam is either not available or is of insufficient pressure. The turbine drives exhaust to the main condenser.

Isolation valves are provided which allow each turbine drive to be individually removed from service while maintaining system operability with the remaining turbine-driven reactor feed pump.

Each turbine drive is rated at 18,107 hp at 5673 rpm with inlet conditions of low-pressure steam at 70 psia, high-pressure steam at 916.1 psia, and back pressure of 3.5 psia.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**10.4.7.2.9 Zinc Injection Passivation Subsystem**

The Zinc Injection Passivation System is a subsystem of the Condensate and Feedwater System. The Zinc Injection System is designed to continuously inject a dilute solution of ionic zinc in water into the reactor feedwater. The injected zinc ions reduce the corrosion of stainless steel surfaces in the primary system, which will lower the radiation levels due to cobalt-60 deposition.

The system is non-safety related and non-seismic and consists of isolation valves, dissolution vessel with a supply of depleted zinc oxide, flow control valves and local flow, temperature and differential pressure instrumentation. All instrumentation is mounted locally.

A stream of water taken from the feedwater pump discharge is routed through a column containing depleted zinc oxide (DZO) pellets. The dissolution of sintered DZO pellets into the diverted feedwater stream provides the ionic zinc. The dissolved DZO in the stream leaving the dissolution column is returned to the feedwater pump suction and is blended with the main feedwater flow.

The reactor water zinc concentration is periodically measured using normal plant chemistry sampling procedures. The amount of zinc leaving the dissolution column and entering the feedwater stream (the injection rate) can be adjusted to maintain the zinc concentration in the reactor water at the desired level. Zinc concentration is maintained by controlling flow through the zinc dissolution vessel via a manually operated flow control valve.

The dissolution vessel is an ASME Section VIII pressure vessel and is designed with overpressure protection for the vessel.

An air operated valve (AOV) is installed upstream of the skid to provide automatic isolation of the zinc injection system and to maintain the feedwater piping pressure boundary with feedwater depressurization during a DBA LOP/LOCA.

**10.4.7.2.10 Feedwater Debris Strainers**

One feedwater debris strainer (FWDS) is installed in each main Feedwater loop (i.e., a total of two FWDSs in piping lines 24"-DBD-25) to capture foreign material / debris prior to entering the reactor pressure vessel via the Feedwater System. The FWDSs

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

are installed in locations to ensure all feedwater being pumped to the reactor pressure vessel travels through one of the two FWDSs.

Each FWDS is equipped with pressure taps, and instrument sensing lines connect the taps to differential pressure (DP) transmitters. The DP transmitters provide indication only to allow on-line monitoring of debris accumulation and do not interface with the feedwater control system.

**10.4.7.3     System Evaluation**

The condensate and feedwater system serves no safety function. Systems analysis has shown that failure of this system will not compromise any safety-related systems or prevent safe shutdown.

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

During operation, radioactive steam and condensate are present in the feedwater heating portion of the system, which includes the extraction steam piping, feedwater heater shells, heater drain piping, and heater vent piping. Shielding and controlled access are provided as necessary (see Section 12.3). The condensate and feedwater system is designed to minimize leakage with welded construction utilized where practicable. Relief discharges and operating vents are handled through closed systems.

The condensate and feedwater system is not required to effect or support the safe shutdown of the reactor or perform in the operation of reactor safety features.

If it is necessary to remove a component such as a feedwater heater, pump, or control valve from service, continued operation of the system is possible by use of the multistring arrangement and the provisions for isolating and bypassing equipment and sections of the system.

An abnormal operational transient analysis of a loss of a feedwater heater is included in subsection 15.1.1.

All condensate and feedwater piping considered in this section is located within the nonsafety related turbine building. Therefore, the effects of postulated piping failures are not analyzed.

#### **10.4.7.4     Tests and Inspections**

[HISTORICAL INFORMATION] [Each feedwater heater, heater drain tank, pump, and valve has received a shop hydrostatic test which has been performed in accordance with applicable codes. All tube joints of feedwater heaters have been shop leak tested. Prior to initial operation, the completed condensate and feedwater system is to receive a field hydrostatic test and inspection in accordance with the applicable code.] Periodic tests and inspections of the system are to be performed in conjunction with scheduled maintenance outages.

#### **10.4.7.5     Instrumentation Application**

Feedwater flow-control instrumentation measures the feedwater flow rate from the condensate and feedwater system. This measurement is used by the feedwater control system which regulates the feedwater flow to the reactor to meet system demands. The feedwater control system is described in subsections 7.7.1.4 and 7.7.2.4.



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

Instrumentation and controls are provided to regulate the pump recirculation flow rate for the condensate, condensate booster, and reactor feed pumps.

Measurements of pump suction and discharge pressures are provided for all pumps in the system.

Measurements of differential pressure across the feedwater debris strainers (FWDSs) are provided to allow on-line monitoring of debris accumulation.

Sampling means are provided to monitor the quality of the final feedwater, as described in subsection 9.3.2.

In the feedwater heating portion of the system, temperature measurements are provided for each stage of heating. These measurements include the temperature into and out of each feedwater heater for both the water and steam sides of the system. Steam pressure measurements are provided at each feedwater heater.

The CFFF system is controlled by a Programmable Logic Controller (PLC). The backwashing cycle of any vessel is initiated manually and sequenced automatically by the PLC. There is a general trouble alarm in the Radwaste Control Room.

Instrumentation and controls are provided to regulate heater drain flow rate to maintain the proper condensate level in each feedwater heater shell (except for feedwater heaters No. 1 and 5) and the heater drain tank. High-level alarm and automatic dump action on high level are also provided. Heater No. 5 drains to the heater drain tank by gravity and heater No. 1 utilizes a loop seal for drainage control.

**10.4.8 Deleted**

**10.4.9 References**

1. Safety Analysis Report for Grand Gulf Nuclear Station Constant Pressure Power Uprate (commonly known as PUSAR), NEDC-33477P, August 2010.
2. Shaw Calculation 134948-M-0001-01, GGNS EPU Heat Balance R1 (Entergy Calculation MC-N1111-09001).

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE 10.4-1:**

**CIRCULATING WATER SYSTEM COMPONENTS**

**Circulating Water Pumps**

Number	2
Type	Vertical, motor-driven
Capacity each, gpm	290,000
Head, ft	98

**Cooling Towers**

Number	1
Design wet bulb temperature, F	79
Design range, F	29
Design approach, F	18
Relative humidity, %	60
Dimensions, ft	404 x 522

**Mechanical Draft**

Number	1
Design wet bulb temperature, F	80
Design range, F	29
Design approach, F	9
Relative humidity, %	60
Dimensions, ft	676 L x 114 W x 53 H
Number of cells	28
Type	Induced draft
Fan motor size, hp	200
Circulating flow, gpm	600,000
*Makeup flow, gpm	21,500
*Blowdown, gpm	11,200

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**TABLE 10.4-1:**

**CIRCULATING WATER SYSTEM COMPONENTS (Continued)**

**Condenser Water Box Drainage and Recirculation Pumps**

Number	2
Type	Centrifugal, horizontal, motor-driven
Capacity each, gpm	24,000
Head, ft	60


**Lube Water Pumps**

Number	3
Type	Horizontal
Capacity each, gpm	34
Head, ft	200

\*Average yearly operating condition based on 80% capacity factor.

# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

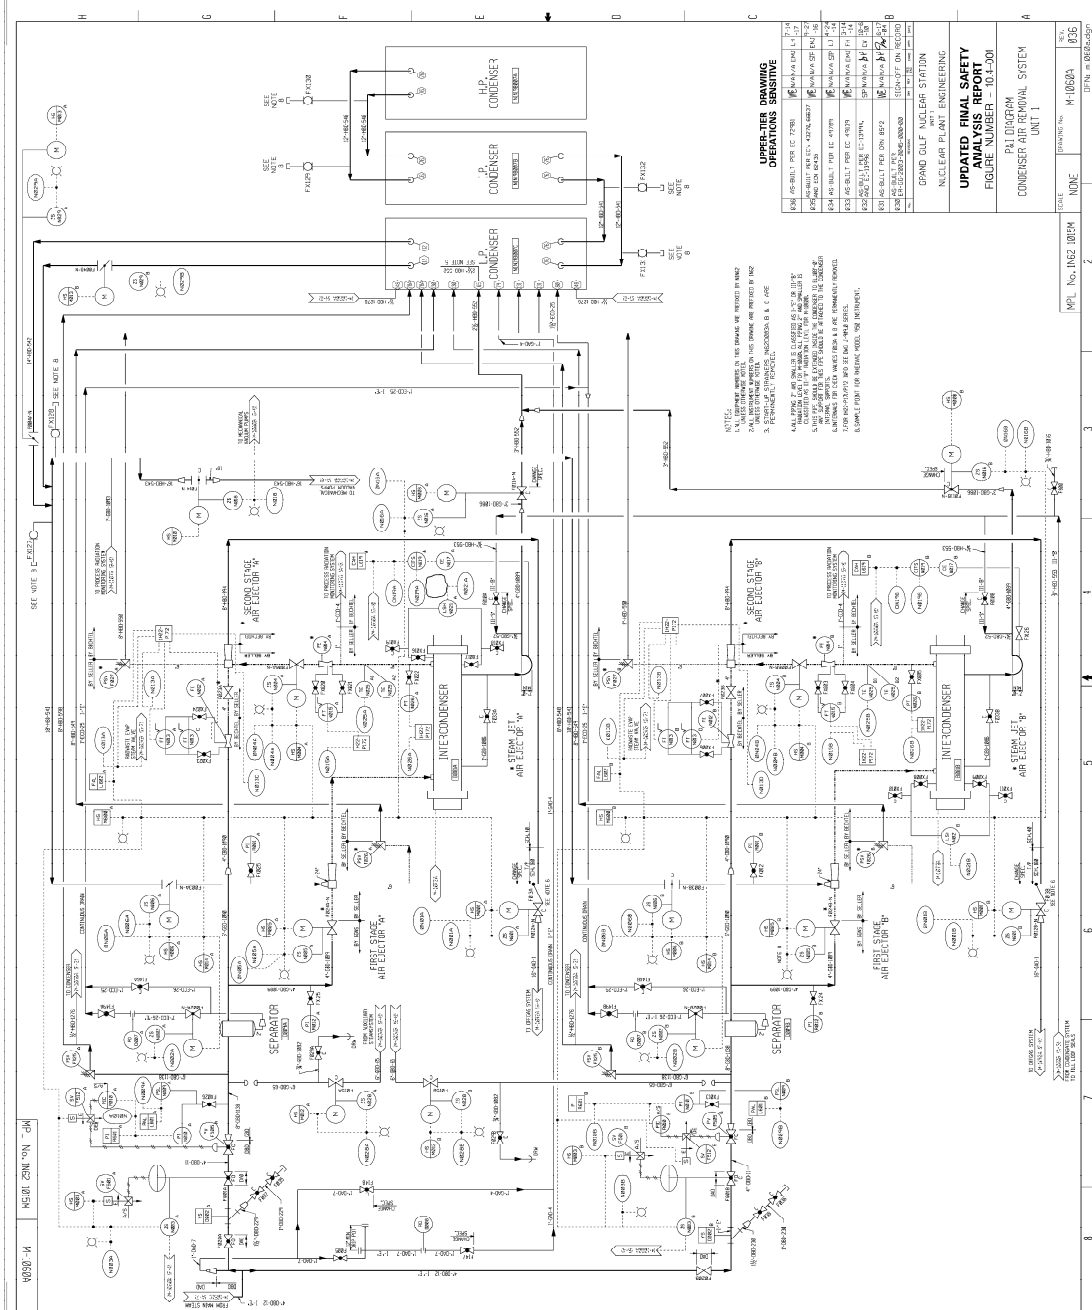


[illegible]



[illegible]

# GRAND GULF NUCLEAR GENERATING STATION


## Updated Final Safety Analysis Report (UFSAR)

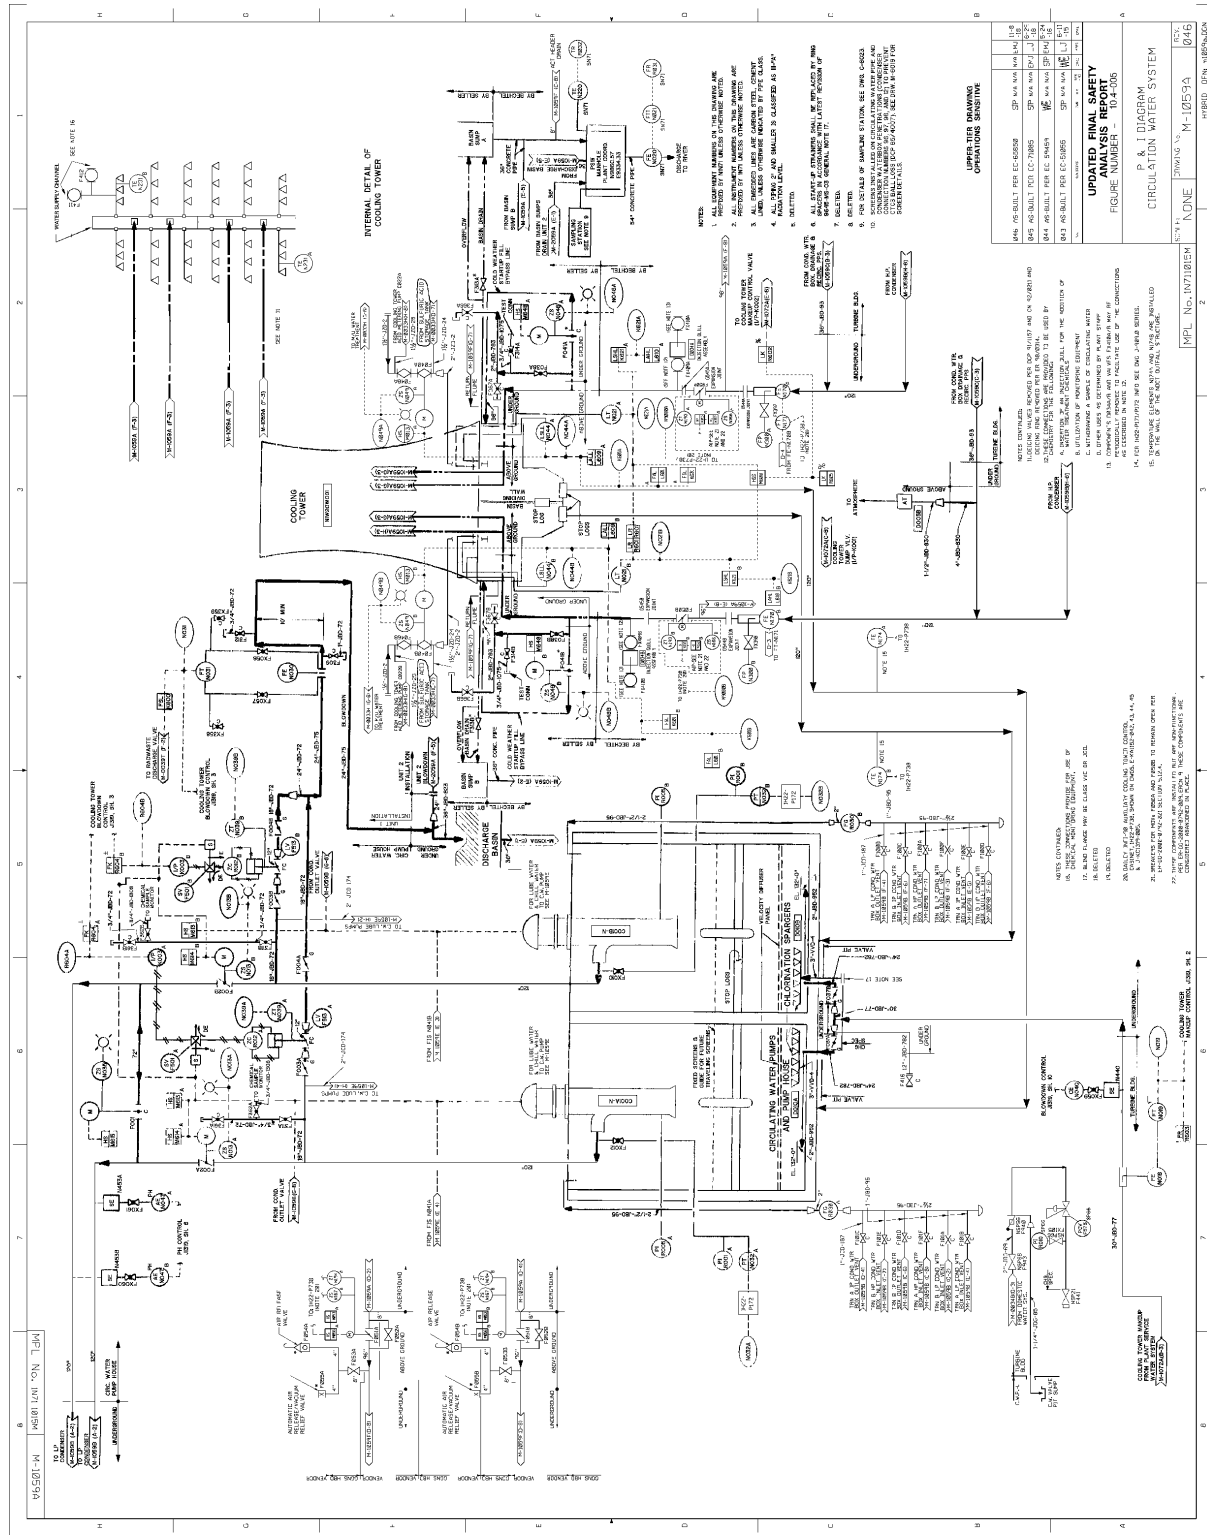



# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

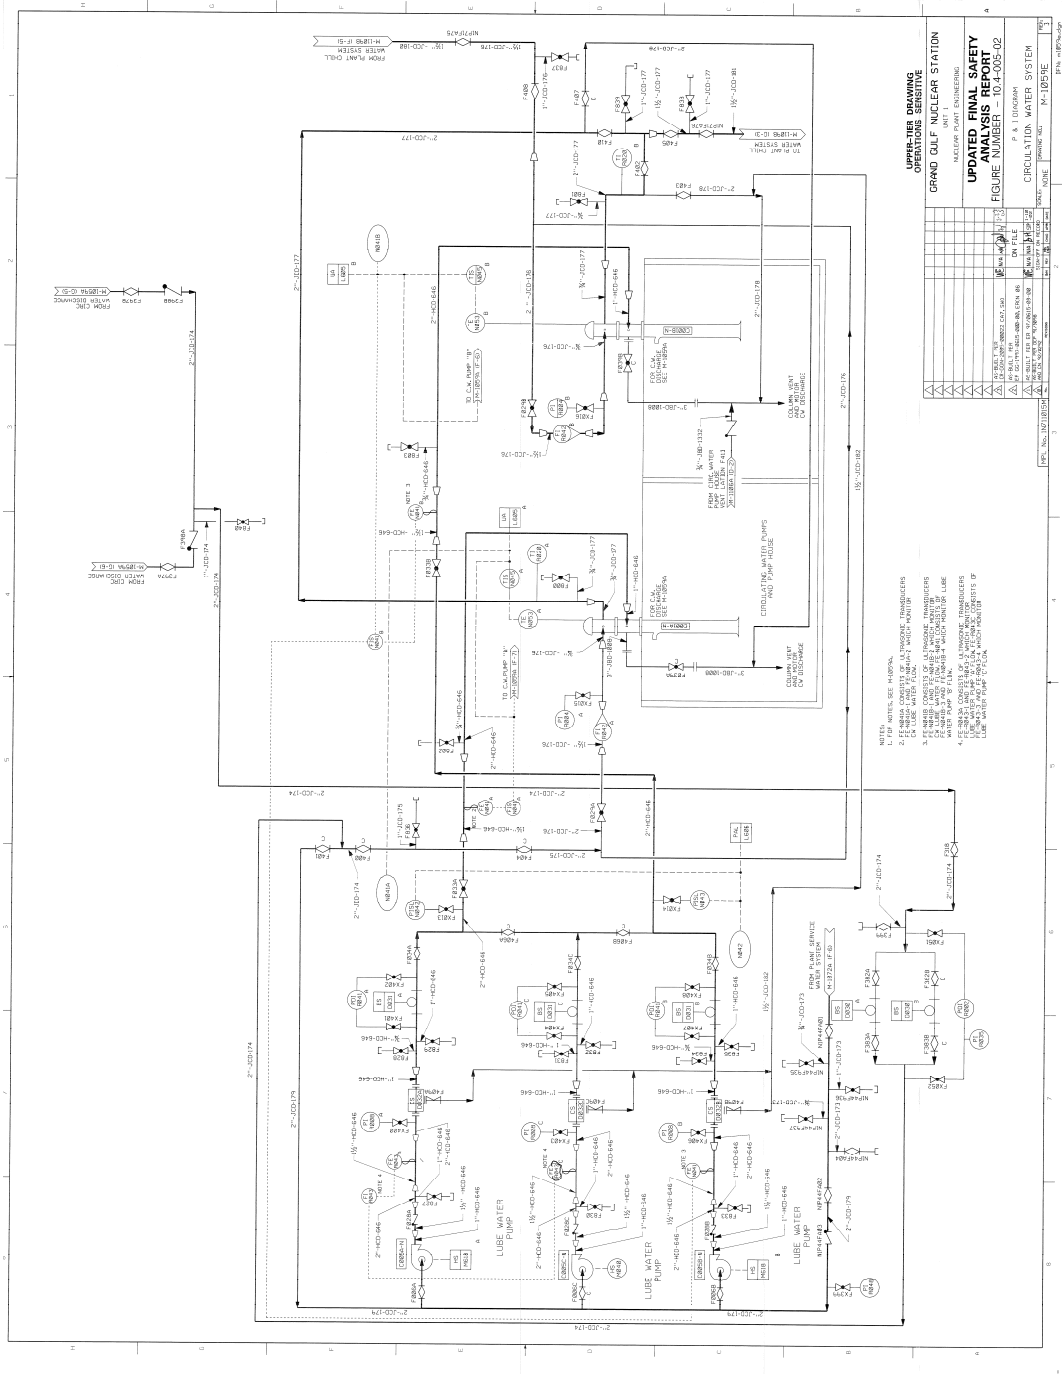








[illegible]

Figure 10.4-8 Deleted

Figure 10.4-9 Deleted

# GRAND GULF NUCLEAR GENERATING STATION


## Updated Final Safety Analysis Report (UFSAR)

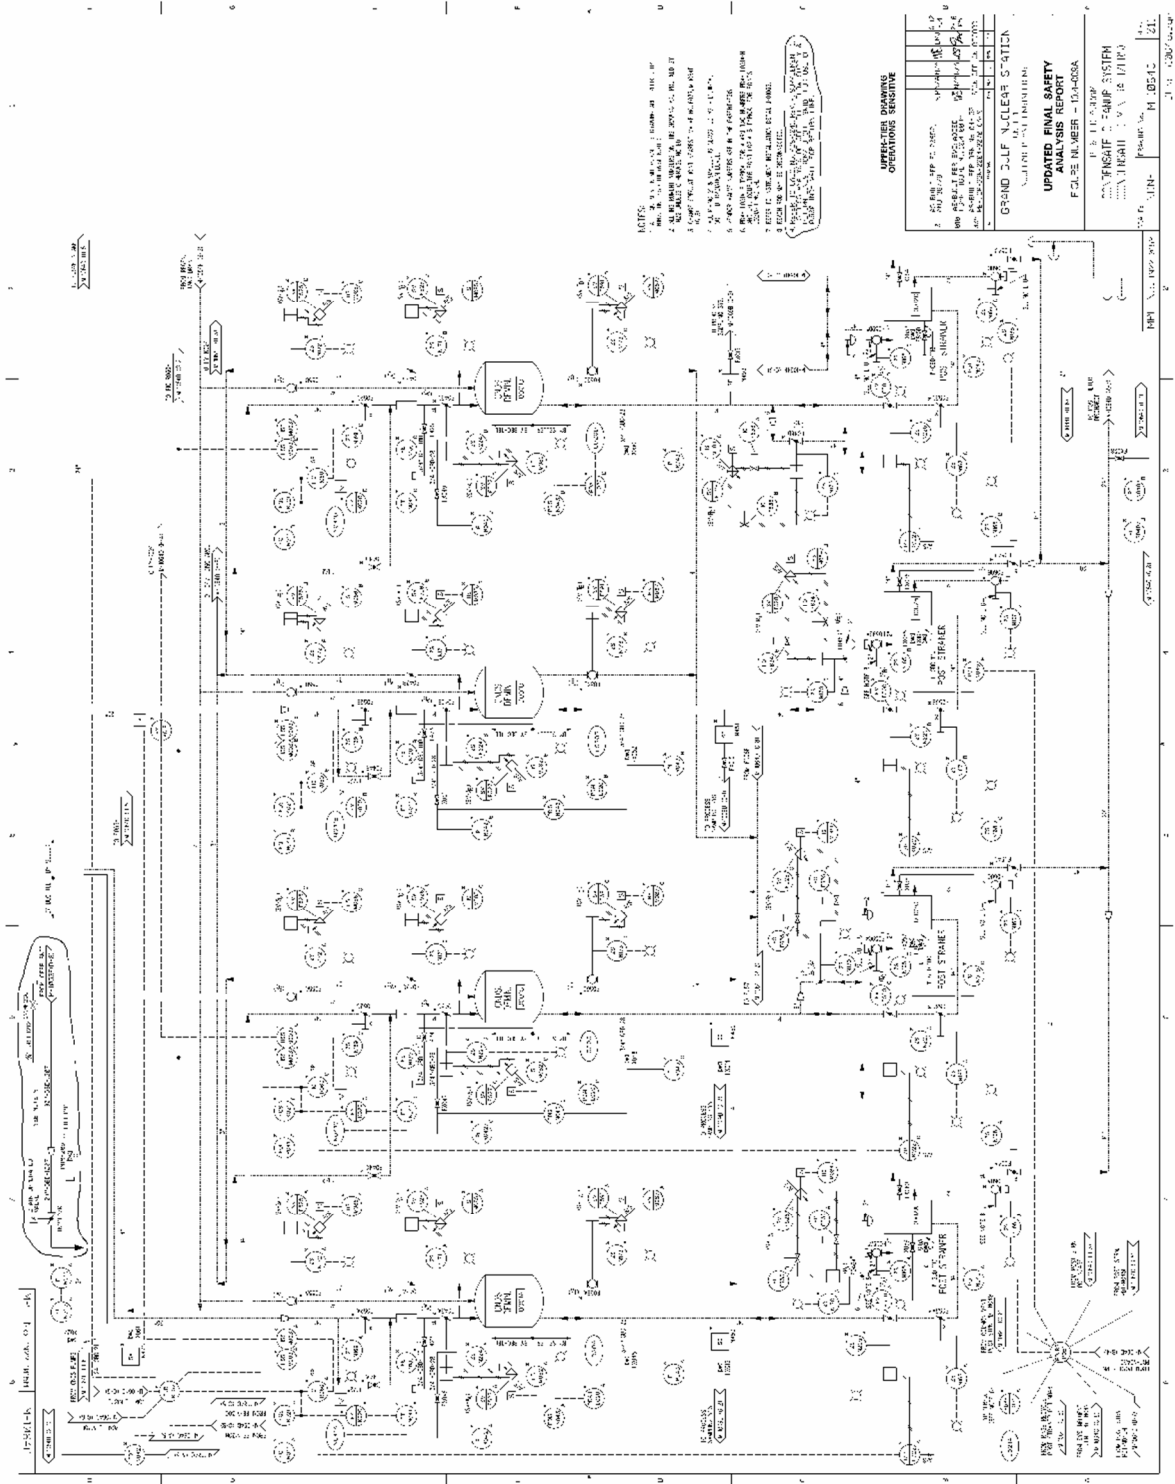



# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

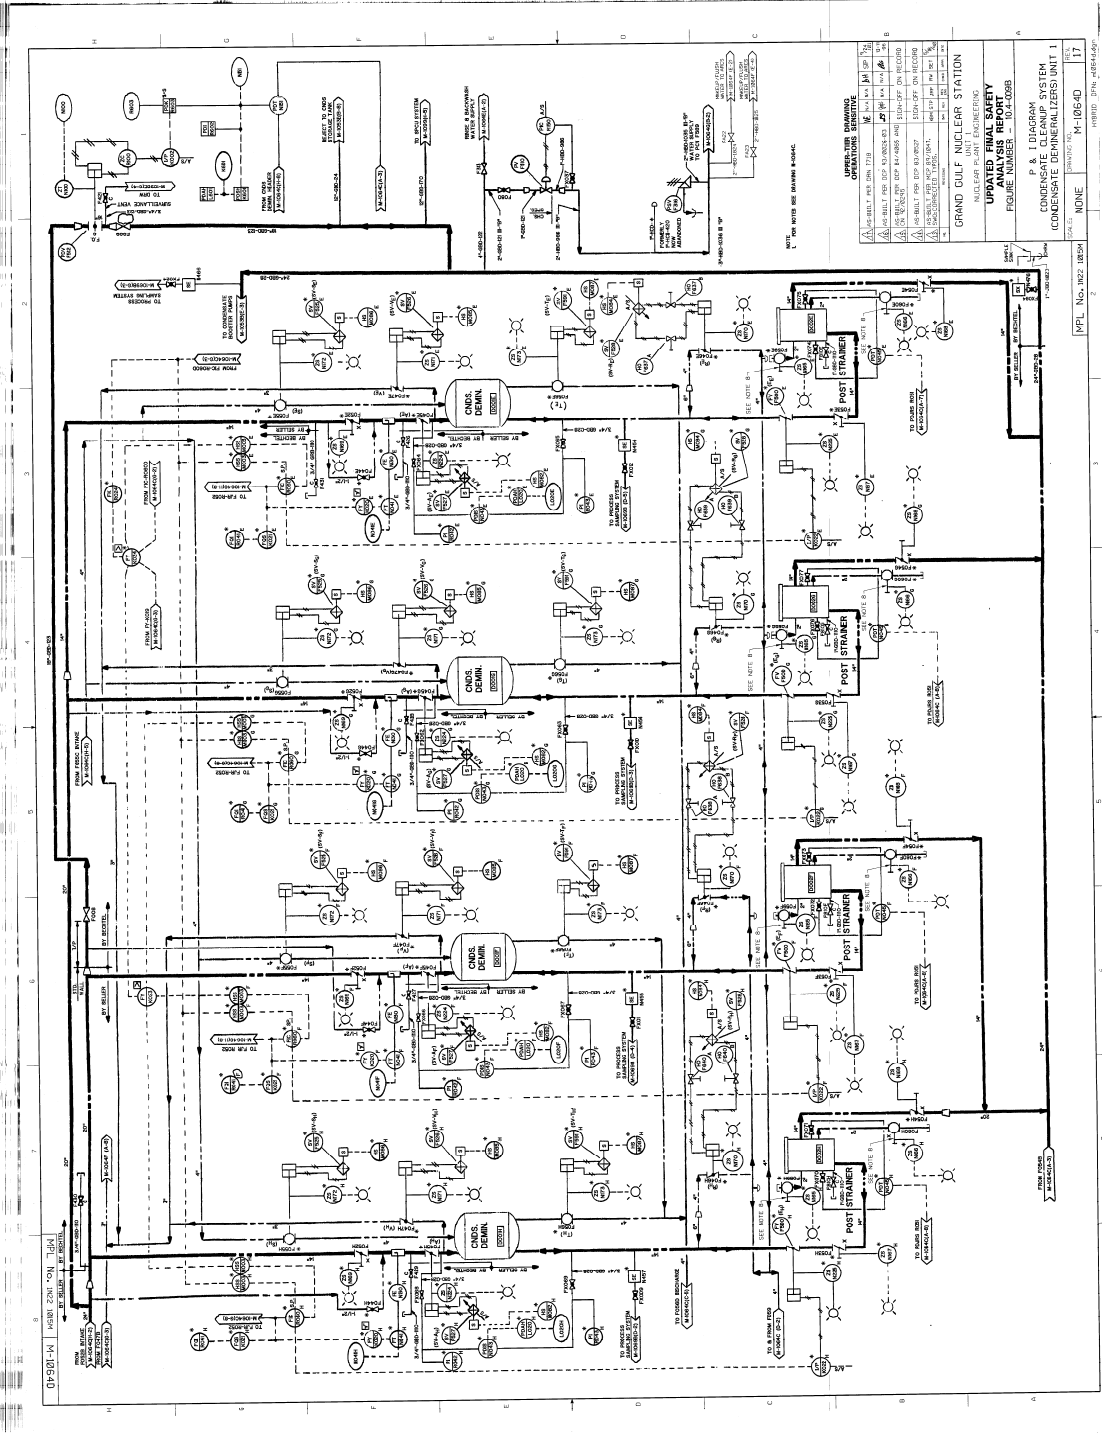

UPPER-TIER DRAWING  
OPERATIONS SCHEMATIC

GRAND GULF NUCLEAR STATION  
UNIT 1

UPDATED FINAL SAFETY  
ANALYSIS REPORT

FIGURE NUMBER - 10.4-208C

CONDENSATE PUMP SYSTEM

REGENERATION SYSTEM

FIGURE 10.4-208C

REV. 1

REV. 2

REV. 3

REV. 4

REV. 5

REV. 6

REV. 7

REV. 8

REV. 9

REV. 10

REV. 11

REV. 12

REV. 13

REV. 14

REV. 15

REV. 16

REV. 17

REV. 18

REV. 19

REV. 20

REV. 21

REV. 22

REV. 23

REV. 24

REV. 25

REV. 26

REV. 27

REV. 28

REV. 29

REV. 30

REV. 31

REV. 32

REV. 33

REV. 34

REV. 35

REV. 36

REV. 37

REV. 38

REV. 39

REV. 40

REV. 41

REV. 42

REV. 43

REV. 44

REV. 45

REV. 46

REV. 47

REV. 48

REV. 49

REV. 50

REV. 51

REV. 52

REV. 53

REV. 54

REV. 55

REV. 56

REV. 57

REV. 58

REV. 59

REV. 60

REV. 61

REV. 62

REV. 63

REV. 64

REV. 65

REV. 66

REV. 67

REV. 68

REV. 69

REV. 70

REV. 71

REV. 72

REV. 73

REV. 74

REV. 75

REV. 76

REV. 77

REV. 78

REV. 79

REV. 80

REV. 81

REV. 82

REV. 83

REV. 84

REV. 85

REV. 86

REV. 87

REV. 88

REV. 89

REV. 90

REV. 91

REV. 92

REV. 93

REV. 94

REV. 95

REV. 96

REV. 97

REV. 98

REV. 99

REV. 100

REV. 101

REV. 102

REV. 103

REV. 104

REV. 105

REV. 106

REV. 107

REV. 108

REV. 109

REV. 110

REV. 111

REV. 112

REV. 113

REV. 114

REV. 115

REV. 116

REV. 117

REV. 118

REV. 119

REV. 120

REV. 121

REV. 122

REV. 123

REV. 124

REV. 125

REV. 126

REV. 127

REV. 128

REV. 129

REV. 130

REV. 131

REV. 132

REV. 133

REV. 134

REV. 135

REV. 136

REV. 137

REV. 138

REV. 139

REV. 140

REV. 141

REV. 142

REV. 143

REV. 144

REV. 145

REV. 146

REV. 147

REV. 148

REV. 149

REV. 150

REV. 151

REV. 152

REV. 153

REV. 154

REV. 155

REV. 156

REV. 157

REV. 158

REV. 159

REV. 160

REV. 161

REV. 162

REV. 163

REV. 164

REV. 165

REV. 166

REV. 167

REV. 168

REV. 169

REV. 170

REV. 171

REV. 172

REV. 173

REV. 174

REV. 175

REV. 176

REV. 177

REV. 178

REV. 179

REV. 180

REV. 181

REV. 182

REV. 183

REV. 184

REV. 185

REV. 186

REV. 187

REV. 188

REV. 189

REV. 190

REV. 191

REV. 192

REV. 193

REV. 194

REV. 195

REV. 196

REV. 197

REV. 198

REV. 199

REV. 200

REV. 201

REV. 202

REV. 203

REV. 204

REV. 205

REV. 206

REV. 207

REV. 208

REV. 209

REV. 210

REV. 211

REV. 212

REV. 213

REV. 214

REV. 215

REV. 216

REV. 217

REV. 218

REV. 219

REV. 220

REV. 221

REV. 222

REV. 223

REV. 224

REV. 225

REV. 226

REV. 227

REV. 228

REV. 229

REV. 230

REV. 231

REV. 232

REV. 233

REV. 234

REV. 235

REV. 236

REV. 237

REV. 238

REV. 239

REV. 240

REV. 241

REV. 242

REV. 243

REV. 244

REV. 245

REV. 246

REV. 247

REV. 248

REV. 249

REV. 250

REV. 251

REV. 252

REV. 253

REV. 254

REV. 255

REV. 256

REV. 257

REV. 258

REV. 259

REV. 260

REV. 261

REV. 262

REV. 263

REV. 264

REV. 265

REV. 266

REV. 267

REV. 268

REV. 269

REV. 270

REV. 271

REV. 272

REV. 273

REV. 274

REV. 275

REV. 276

REV. 277

REV. 278

REV. 279

REV. 280

REV. 281

REV. 282

REV. 283

REV. 284

REV. 285

REV. 286

REV. 287

REV. 288

REV. 289

REV. 290

REV. 291

REV. 292

REV. 293

REV. 294

REV. 295

REV. 296

REV. 297

REV. 298

REV. 299

REV. 300

REV. 301

REV. 302

REV. 303

REV. 304

REV. 305

REV. 306

REV. 307

REV. 308

REV. 309

REV. 310

REV. 311

REV. 312

REV. 313

REV. 314

REV. 315

REV. 316

REV. 317

REV. 318

REV. 319

REV. 320

REV. 321

REV. 322

REV. 323

REV. 324

REV. 325

REV. 326

REV. 327

REV. 328

REV. 329

REV.

[illegible]

[illegible]

UPPER-TIER DRAWING OPERATIONS SENSITIVE

G3400 GULF NUCLEAR 5-A120N

REVISED 10-1-78

PREPARED BY: J. L. BROWN

CHECKED BY: J. L. BROWN


APPROVED BY: J. L. BROWN

DATE: 10-1-78

SHEET: 1 OF 1


# GRAND GULF NUCLEAR GENERATING STATION


## Updated Final Safety Analysis Report (UFSAR)

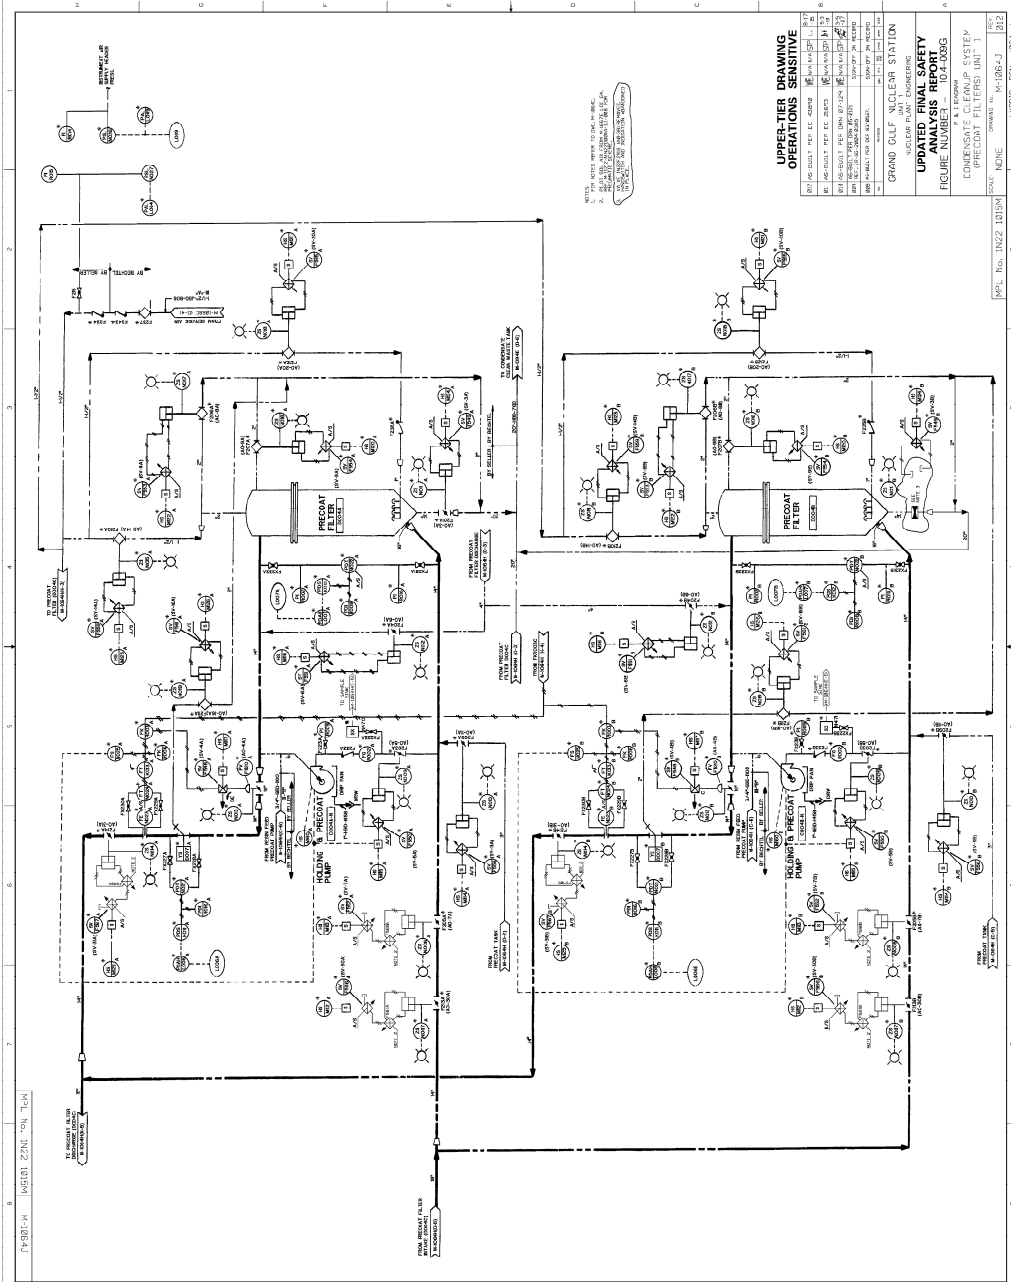

# GRAND GULF NUCLEAR GENERATING STATION


## Updated Final Safety Analysis Report (UFSAR)

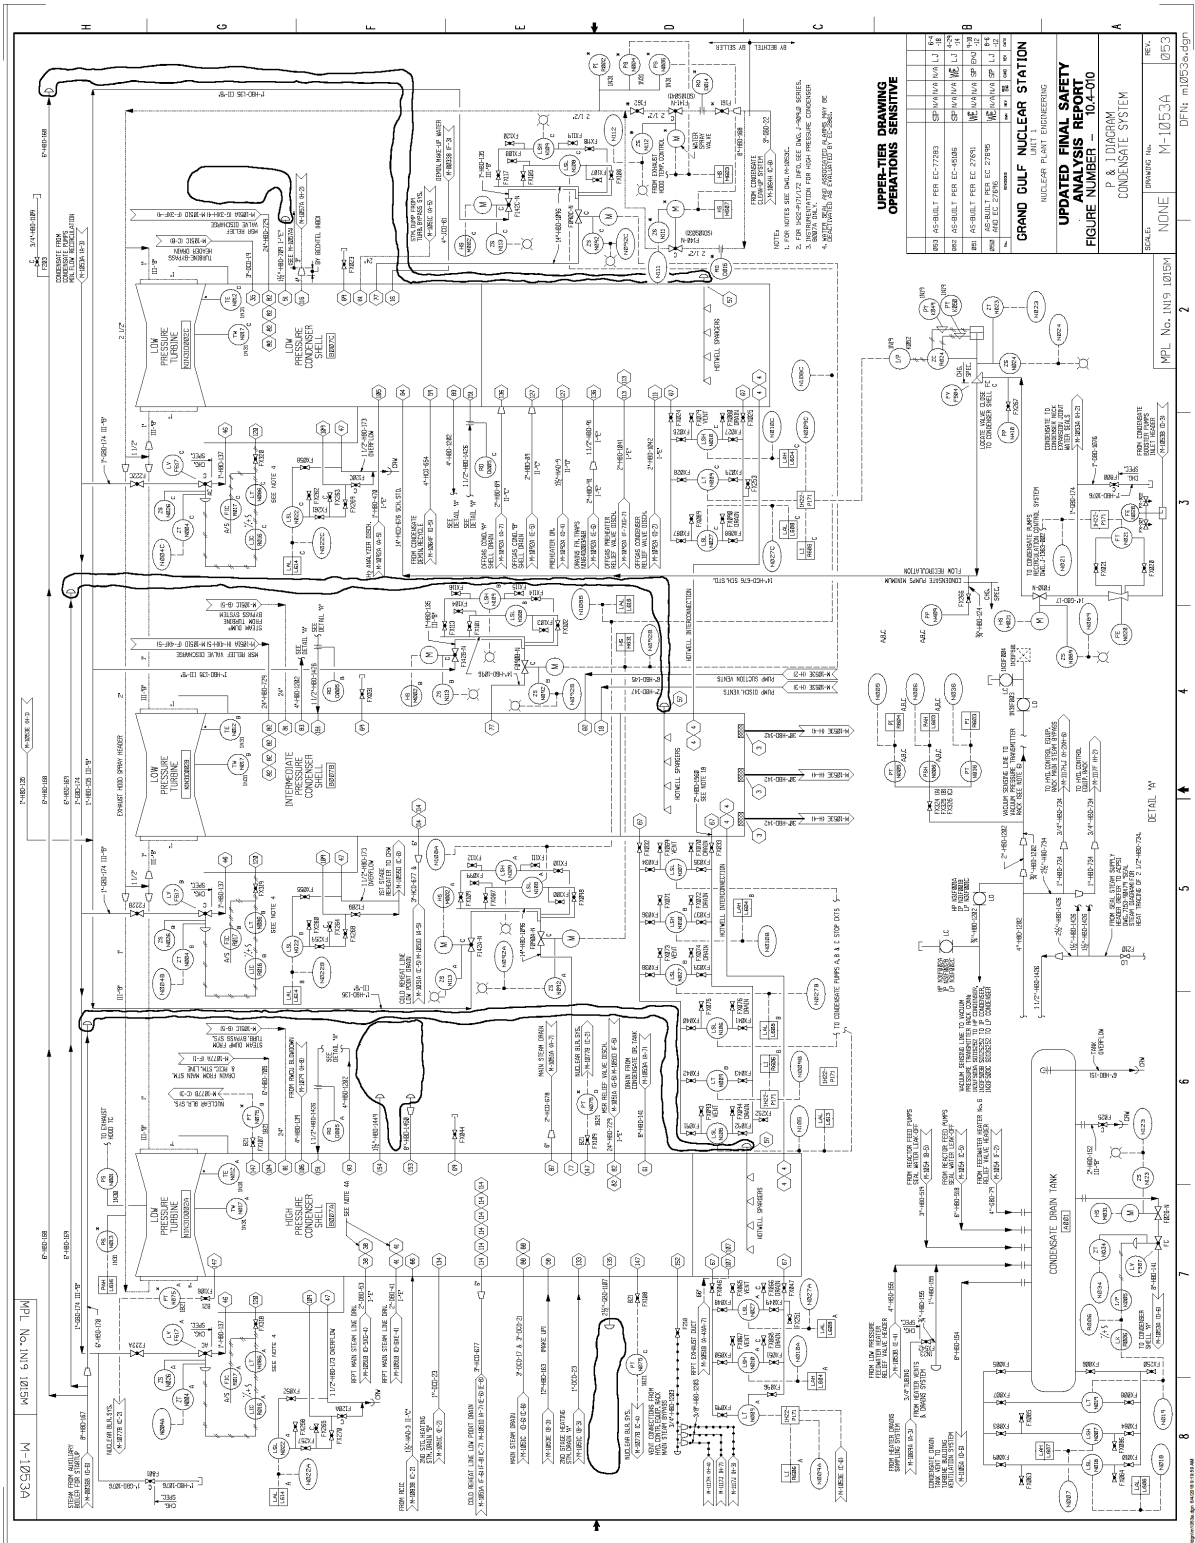










10.4-73 LBDCR 2020-051



# GRAND GULF NUCLEAR GENERATING STATION

## Updated Final Safety Analysis Report (UFSAR)

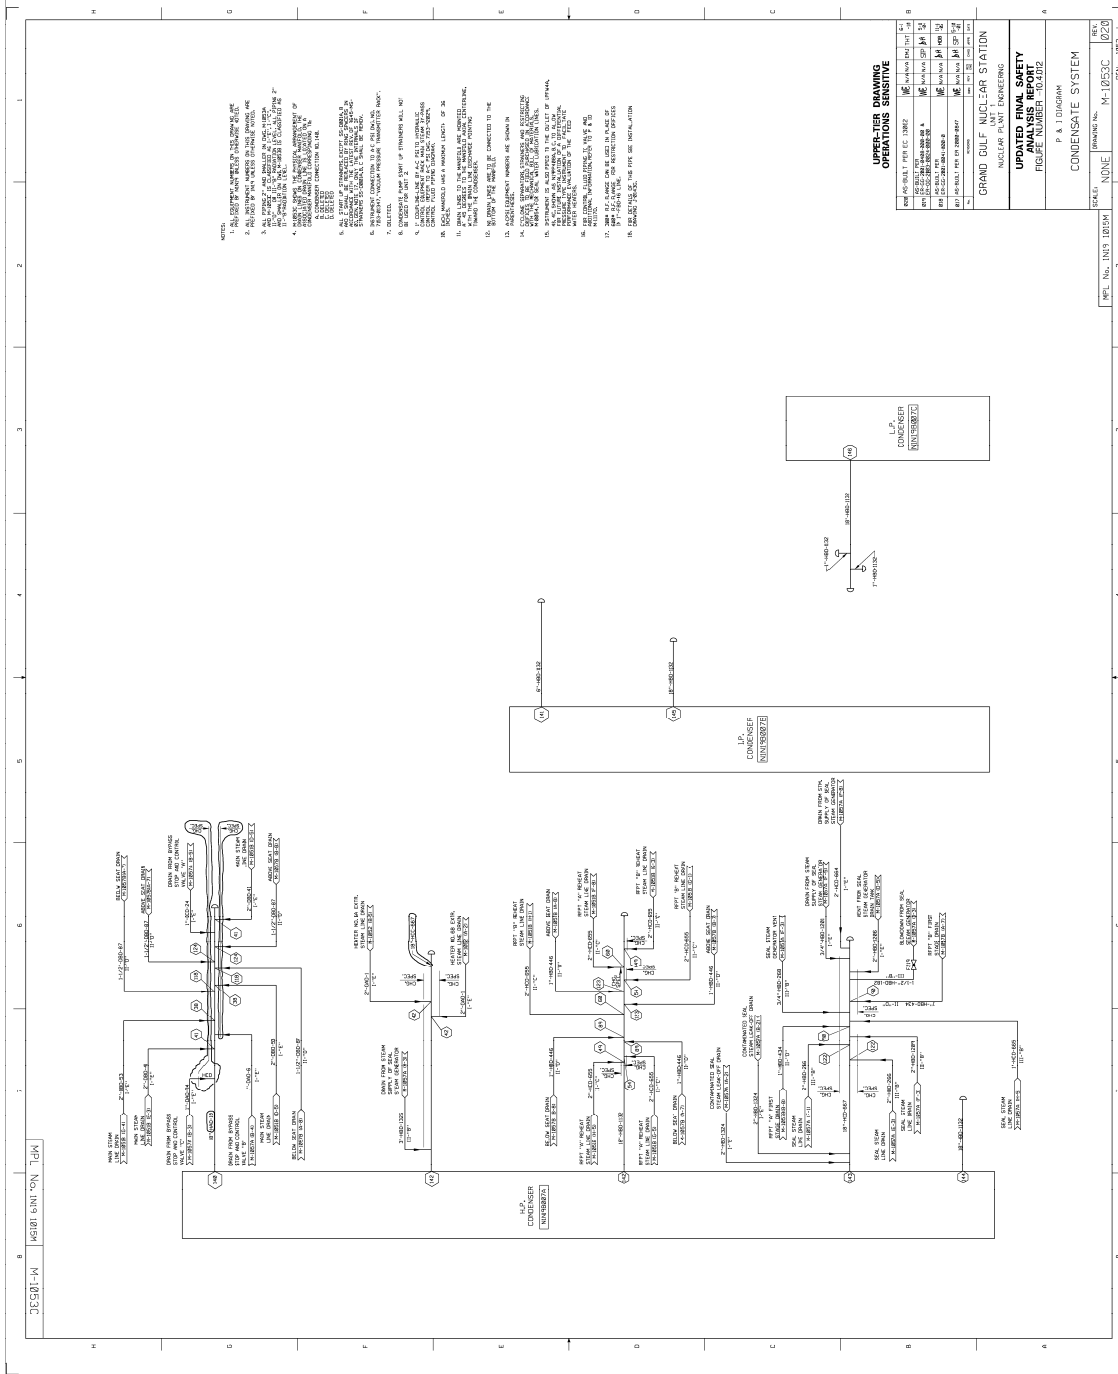


[illegible]



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

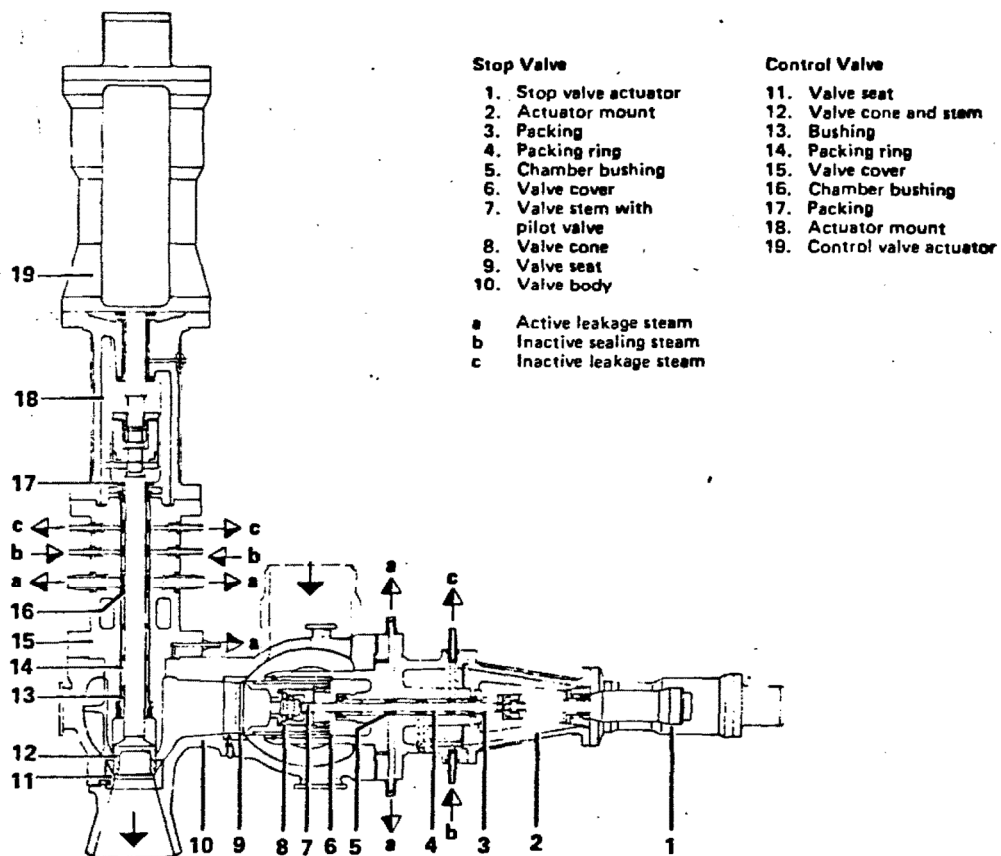


**MISSISSIPPI POWER & LIGHT COMPANY  
 GRAND GULF NUCLEAR STATION  
 UNITS 1 & 2  
 UPDATED FINAL SAFETY ANALYSIS REPORT**

**BYPASS STOP AND CONTROL VALVE**

FIGURE 10.4-14

GRAND GULF NUCLEAR GENERATING STATION  
Updated Final Safety Analysis Report (UFSAR)

---

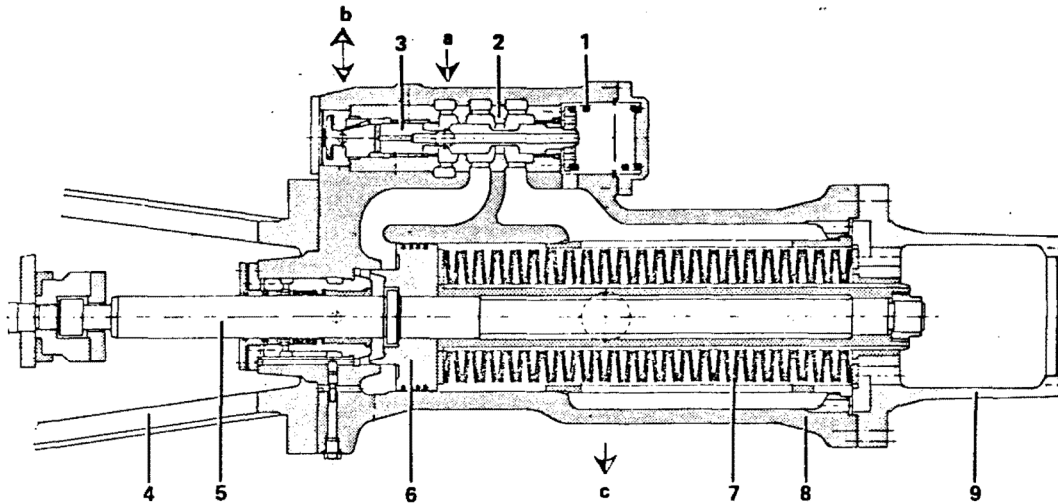


1. Spring
2. Valve bushing
3. Pilot valve
4. Actuator mount
5. Actuator rod
6. Piston
7. Disc spring
8. Casing
9. Hood

- a Control fluid (455 psig,  
unfiltered)  
b Bypass starting fluid  
c Fluid drain

MISSISSIPPI POWER & LIGHT COMPANY GRAND GULF NUCLEAR STATION UNITS 1 & 2 UPDATED FINAL SAFETY ANALYSIS REPORT
BYPASS STOP VALVE ACTUATOR
FIGURE 10.4-15



**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

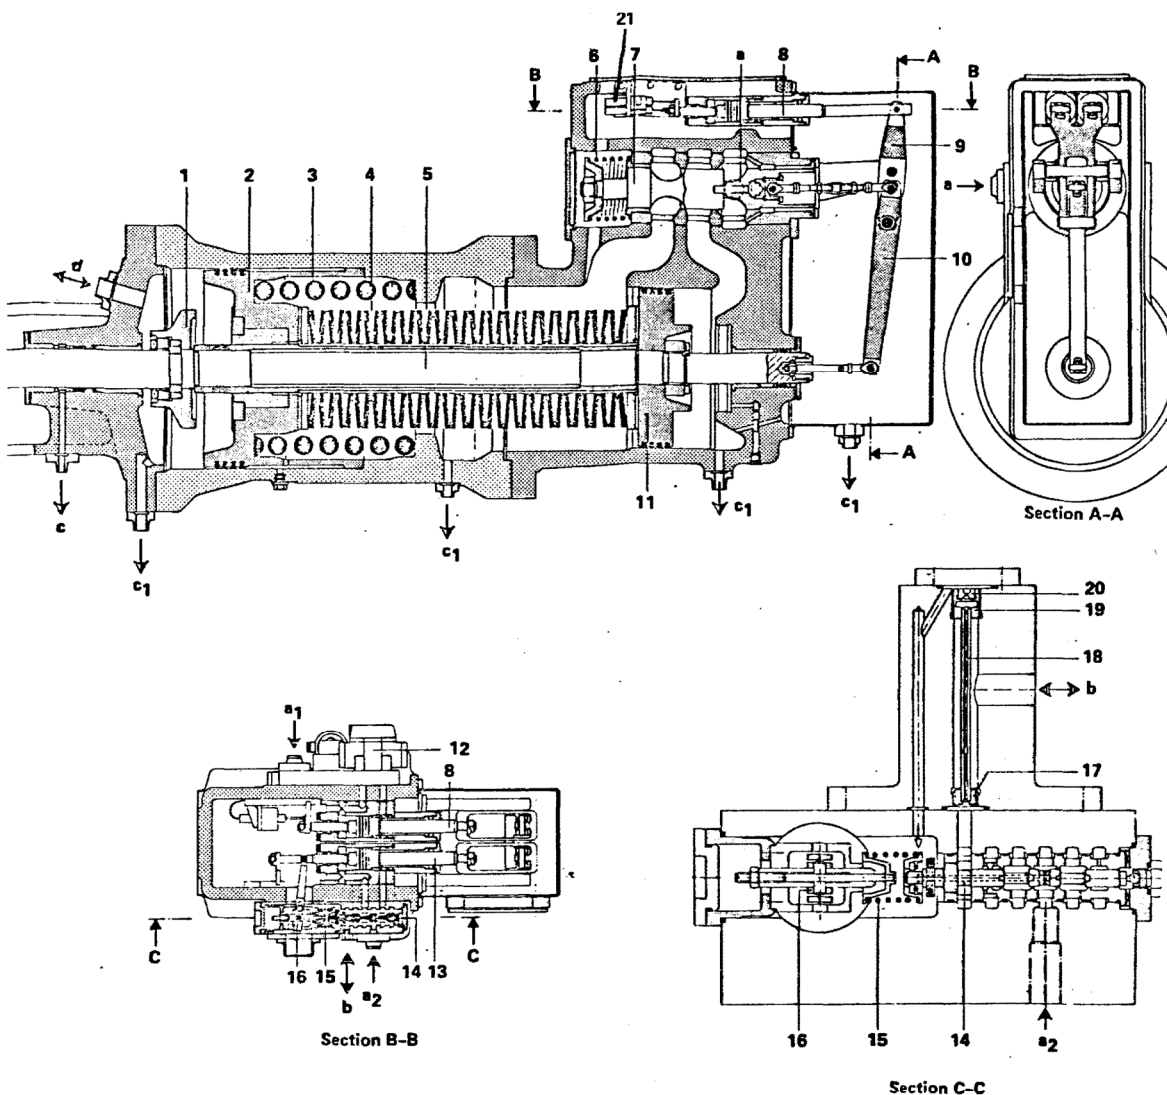

- |                           |                                       |
|---------------------------|---------------------------------------|
| 1. Limiting disc          | 17. Screw plug                        |
| 2. Piston                 | 18. Capillary tube                    |
| 3. Helical spring         | 19. Threaded insert                   |
| 4. Disc spring            | 20. Screw plug                        |
| 5. Actuator piston rod    | 21. Diff. Transformer                 |
| 6. Compression spring     | a Control fluid 455 psig (unfiltered) |
| 7. Main pilot valve       | a1 Control fluid 455 psig (filtered)  |
| 8. Pilot piston           | a2 Control fluid 455 psig (filtered)  |
| 9. Lever                  | b Bypass signal fluid                 |
| 10. Lever                 | c Return fluid                        |
| 11. Piston                | d Bypass start-up fluid               |
| 12. Servovalve            | c1 Fluid drain                        |
| 13. Pilot piston          |                                       |
| 14. Auxiliary pilot valve |                                       |
| 15. Spring                |                                       |
| 16. Feedback lever        |                                       |

**MISSISSIPPI POWER & LIGHT COMPANY**  
**GRAND GULF NUCLEAR STATION**  
**UNITS 1 & 2**  
**UPDATED FINAL SAFETY ANALYSIS REPORT**

**BYPASS CONTROL VALVE ACTUATOR**

FIGURE 10.4-16

**GRAND GULF NUCLEAR GENERATING STATION**  
**Updated Final Safety Analysis Report (UFSAR)**

---

**APPENDIX 10A**

The information originally contained in this appendix was provided by Allis-Chalmers Power Systems, Inc. and addressed turbine disc integrity and turbine missile analyses. That information was revised primarily as a result of upgrading the three low pressure turbines during RFO8, RFO9, and RFO10 by Siemens Power Corporation as discussed in Reference 7 of Section 10.2.3.8. In response, the NRC granted deletion of License Condition 2.C. (26) as documented in Reference 12 of Section 10.2.3.8. The analyses are maintained as separate controlled documents due to the contents being classified as proprietary information. The missile analyses are available for review and inspection at the site. See reference section 10.2.3.8 for specific missile analyses.